

SIEMENS

SIPROTEC 4 Overcurrent Time Protection 7SJ80

V4.78

Manual

Preface

Open Source Software

Table of Contents

Introduction	1
Functions	2
Mounting and Commissioning	3
Technical Data	4
Ordering Information and Accessories	A
Terminal Assignments	B
Connection Examples	C
Current Transformer Requirements	D
Default Settings and Protocol-dependent Functions	E
Functions, Settings, Information	F
Literature	
Glossary	
Index	

**NOTE**

For your own safety, observe the warnings and safety instructions contained in this document, if available.

Disclaimer of Liability

Subject to changes and errors. The information given in this document only contains general descriptions and/or performance features which may not always specifically reflect those described, or which may undergo modification in the course of further development of the products. The requested performance features are binding only when they are expressly agreed upon in the concluded contract.

Document version: E50417-G1140-C343-A9.03

Edition: 11.2019

Version of the product described: V4.78

Copyright

Copyright © Siemens 2019. All rights reserved.

The disclosure, duplication, distribution and editing of this document, or utilization and communication of the content are not permitted, unless authorized in writing. All rights, including rights created by patent grant or registration of a utility model or a design, are reserved.

Trademarks

SIPROTECT™, DIGSI™, SIGRA™, SIGUARD™, SAFIR™, SICAM™, and MindSphere™ are trademarks of Siemens. Any unauthorized use is prohibited. All other designations in this document may represent trademarks whose use by third parties for their own purposes may violate the proprietary rights of the owner.

Preface

Purpose of the Manual

This manual describes the functions, operation, installation, and commissioning of devices 7SJ80. In particular, one will find:

- Information regarding the configuration of the scope of the device and a description of the device functions and settings → Chapter 2;
- Instructions for Installation and Commissioning → Chapter 3;
- Compilation of the Technical Data → Chapter 4;
- As well as a compilation of the most significant data for advanced users → Appendix.

General information with regard to design, configuration, and operation of SIPROTEC 4 devices are set out in the SIPROTEC 4 System Description [/1/ SIPROTEC 4 System Description](#).

Target Audience

Protection-system engineers, commissioning engineers, persons entrusted with the setting, testing and maintenance of selective protection, automation and control equipment, and operating personnel in electrical installations and power plants.

Scope

This manual applies to: SIPROTEC 4 Overcurrent Time Protection 7SJ80; Firmware-Version V4.78.

Indication of Conformity

	This product complies with the directive of the Council of the European Communities on the approximation of the laws of the Member States relating to electromagnetic compatibility (EMC Council Directive 2004/108/EC) and concerning electrical equipment for use within specified voltage limits (Low-voltage Directive 2006/95 EC). This conformity is proved by tests conducted by Siemens AG in accordance with the Council Directive in agreement with the generic standards EN 61000-6-2 and EN 61000-6-4 for EMC directive, and with the standard EN 60255-27 for the low-voltage directive. The device has been designed and produced for industrial use. The product conforms with the international standards of the series IEC 60255 and the German standard VDE 0435.

Additional Standards IEEE Std C37.90 (see Chapter 4 "Technical Data")

This product is UL-certified according to the Technical Data. file E194016



IND. CONT. EQ.
69CA

[ul-schutz-7sx80-100310, 1, --,--]

Additional Support

For questions about the system, contact your Siemens sales partner.

Support

Our Customer Support Center provides a 24-hour service.

Phone: +49 (180) 524-7000

Fax: +49 (180) 524-2471

E-Mail: support.energy@siemens.com

Training Courses

Inquiries regarding individual training courses should be addressed to our Training Center:

Siemens AG

Siemens Power Academy TD

Humboldtstraße 59

90459 Nürnberg

Germany

Phone: +49 (911) 433-7415

Fax: +49 (911) 433-7929

E-Mail: poweracademy@siemens.com

Internet: www.siemens.com/poweracademy

Notes on Safety

This document is not a complete index of all safety measures required for operation of the equipment (module or device). However, it comprises important information that must be followed for personal safety, as well as to avoid material damage. Information is highlighted and illustrated as follows according to the degree of danger:



DANGER

DANGER means that death or severe injury **will** result if the measures specified are not taken.

✧ Comply with all instructions, in order to avoid death or severe injuries.



WARNING

WARNING means that death or severe injury **may** result if the measures specified are not taken.

✧ Comply with all instructions, in order to avoid death or severe injuries.



CAUTION

CAUTION means that medium-severe or slight injuries **can** occur if the specified measures are not taken.

✧ Comply with all instructions, in order to avoid moderate or minor injuries.

NOTICE

NOTICE means that property damage **can** result if the measures specified are not taken.

- ✧ Comply with all instructions, in order to avoid property damage.



NOTE

Important information about the product, product handling or a certain section of the documentation which must be given attention.

Qualified Electrical Engineering Personnel

Only qualified electrical engineering personnel may commission and operate the equipment (module, device) described in this document. Qualified electrical engineering personnel in the sense of this manual are people who can demonstrate technical qualifications as electrical technicians. These persons may commission, isolate, ground and label devices, systems and circuits according to the standards of safety engineering.

Proper Use

The equipment (device, module) may be used only for such applications as set out in the catalogs and the technical description, and only in combination with third-party equipment recommended and approved by Siemens.

Problem-free and safe operation of the product depends on the following:

- Proper transport
- Proper storage, setup and installation
- Proper operation and maintenance

When electrical equipment is operated, hazardous voltages are inevitably present in certain parts. If proper action is not taken, death, severe injury or property damage can result:

- The equipment must be grounded at the grounding terminal before any connections are made.
- All circuit components connected to the power supply may be subject to dangerous voltage.
- Hazardous voltages may be present in equipment even after the supply voltage has been disconnected (capacitors can still be charged).
- Operation of equipment with exposed current-transformer circuits is prohibited. Before disconnecting the equipment, ensure that the current-transformer circuits are short-circuited.
- The limiting values stated in the document must not be exceeded. This must also be considered during testing and commissioning.

Typographic and Symbol Conventions

The following text formats are used when literal information from the device or to the device appear in the text flow:

Parameter Names

Designators of configuration or function parameters which may appear word-for-word in the display of the device or on the screen of a personal computer (with operation software DIGSI), are marked in bold letters in monospace type style. The same applies to titles of menus.

1234A

Parameter addresses have the same character style as parameter names. Parameter addresses contain the suffix **A** in the overview tables if the parameter can only be set in DIGSI via the option **Display additional settings**.

Parameter Options


Possible settings of text parameters, which may appear word-for-word in the display of the device or on the screen of a personal computer (with operation software DIGSI), are additionally written in italics. The same applies to the options of the menus.

Indications


Designators for information, which may be output by the relay or required from other devices or from the switch gear, are marked in a monospace type style in quotation marks.


Deviations may be permitted in drawings and tables when the type of designator can be obviously derived from the illustration.

The following symbols are used in drawings:

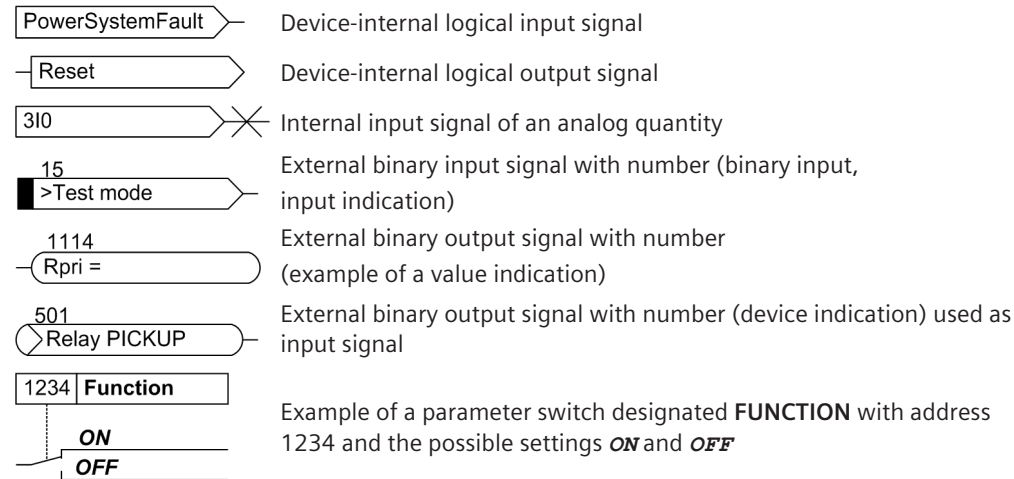

Besides these, graphical symbols are used in accordance with IEC 60617-12 and IEC 60617-13 or similar. Some of the most frequently used are listed below:

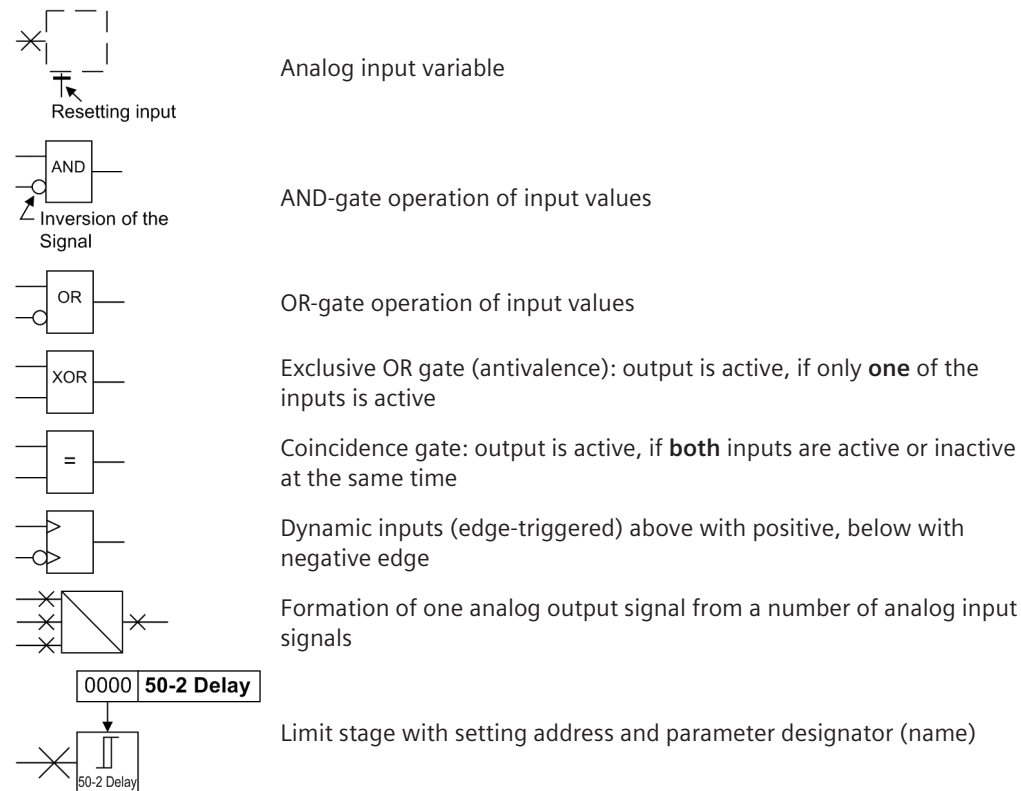

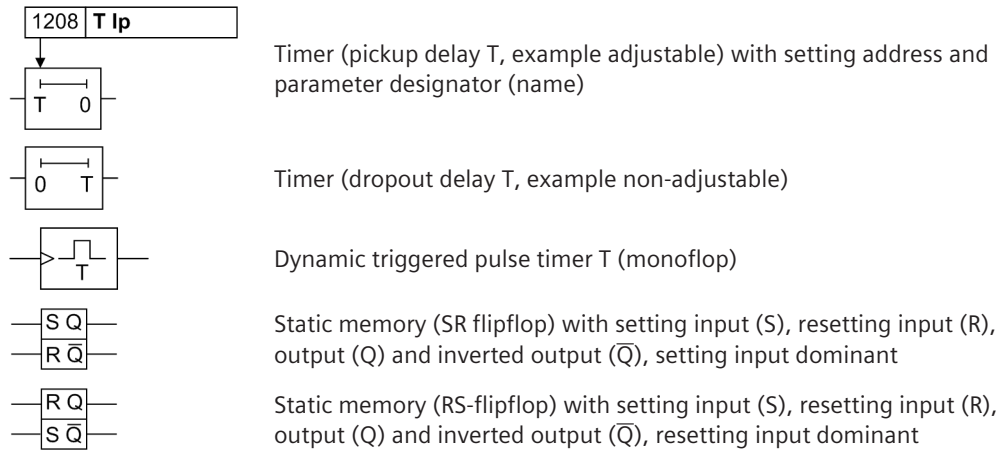

Open Source Software

The product contains, among other things, Open Source Software developed by third parties. The Open Source Software used in the product and the license agreements concerning this software can be found in the Readme_OSS. These Open Source Software files are protected by copyright. Your compliance with those license conditions will entitle you to use the Open Source Software as foreseen in the relevant license. In the event of conflicts between Siemens license conditions and the Open Source Software license conditions, the Open Source Software conditions shall prevail with respect to the Open Source Software portions of the software. The Open Source Software is licensed royalty-free. Insofar as the applicable Open Source Software License Conditions provide for it you can order the source code of the Open Source Software from your Siemens sales contact - against payment of the shipping and handling charges - for a period of at least 3 years since purchase of the Product. We are liable for the Product including the Open Source Software contained in it pursuant to the license conditions applicable to the Product. Any liability for the Open Source Software beyond the program flow intended for the Product is explicitly excluded. Furthermore any liability for defects resulting from modifications to the Open Source Software by you or third parties is excluded. We do not provide any technical support for the Product if it has been modified.

Table of Contents

	Preface.....	3
	Open Source Software.....	9
1	Introduction.....	19
1.1	Overall Operation.....	20
1.2	Application Scope.....	22
1.3	Characteristics.....	24
2	Functions.....	29
2.1	General.....	30
2.1.1	Functional Scope.....	30
2.1.1.1	Functional Description.....	30
2.1.1.2	Setting Notes.....	30
2.1.1.3	Settings.....	32
2.1.2	Device, General Settings.....	34
2.1.2.1	Functional Description.....	34
2.1.2.2	Setting Notes.....	34
2.1.2.3	Settings.....	35
2.1.2.4	Information List.....	36
2.1.3	Power System Data 1.....	38
2.1.3.1	Functional Description.....	38
2.1.3.2	Setting Notes.....	38
2.1.3.3	Settings.....	44
2.1.3.4	Information List.....	46
2.1.4	Oscillographic Fault Records.....	47
2.1.4.1	Functional Description.....	47
2.1.4.2	Setting Notes.....	48
2.1.4.3	Settings.....	48
2.1.4.4	Information List.....	49
2.1.5	Settings Groups.....	49
2.1.5.1	Functional Description.....	49
2.1.5.2	Setting Notes.....	49
2.1.5.3	Settings.....	49
2.1.5.4	Information List.....	50
2.1.6	Power System Data 2.....	50
2.1.6.1	Functional Description.....	50
2.1.6.2	Setting Notes.....	50
2.1.6.3	Settings.....	53
2.1.6.4	Information List.....	54
2.1.7	EN100-Module.....	55
2.1.7.1	Functional Description.....	55
2.1.7.2	Setting Notes.....	55
2.1.7.3	Information List.....	55

2.2	Overcurrent Protection 50, 51, 50N, 51N.....	56
2.2.1	General	56
2.2.2	Definite Time, High-set Elements 50-3, 50-2, 50N-3, 50N-2.....	57
2.2.3	Definite Time Overcurrent Elements 50-1, 50N-1.....	59
2.2.4	Inverse Time Overcurrent Elements 51, 51N	62
2.2.5	Inverse Time Overcurrent Protection 51V (Voltage-controlled / Voltage restraint).....	65
2.2.6	Dynamic Cold Load Pickup Function.....	67
2.2.7	Inrush Restraint	68
2.2.8	Pickup Logic and Tripping Logic.....	69
2.2.9	Two-phase Overcurrent Protection (Only Non-Directional)	70
2.2.10	Fast Busbar Protection Using Reverse Interlocking	71
2.2.11	Setting Notes.....	72
2.2.12	Settings.....	77
2.2.13	Information List.....	79
2.3	Directional Overcurrent Protection 67, 67N.....	82
2.3.1	General.....	82
2.3.2	Definite Time Directional High-set Elements 67-2, 67N-2, 67-3, 67N-3.....	84
2.3.3	Definite Time, Directional Time Overcurrent Elements 67-1, 67N-1.....	85
2.3.4	Inverse Time, Directional Overcurrent Elements 67-TOC, 67N-TOC.....	88
2.3.5	Interaction with Fuse Failure Monitor (FFM).....	89
2.3.6	Dynamic Cold Load Pickup Function.....	90
2.3.7	Inrush Restraint.....	90
2.3.8	Determination of Direction.....	90
2.3.9	Reverse Interlocking for Double End Fed Lines.....	94
2.3.10	Setting Notes.....	95
2.3.11	Settings.....	101
2.3.12	Information List.....	104
2.4	Dynamic Cold Load Pickup.....	106
2.4.1	Functional Description.....	106
2.4.2	Setting Notes.....	108
2.4.3	Settings.....	109
2.4.4	Information List.....	111
2.5	Single-Phase Overcurrent Protection.....	112
2.5.1	Functional Description.....	112
2.5.2	High-impedance Ground Fault Unit Protection.....	113
2.5.3	Tank Leakage Protection.....	115
2.5.4	Setting Notes.....	116
2.5.5	Settings.....	120
2.5.6	Information List.....	121
2.6	Voltage Protection 27, 59.....	122
2.6.1	Measurement Principle.....	122
2.6.2	Overvoltage Protection 59.....	123
2.6.3	Undervoltage Protection 27.....	124
2.6.4	Setting Notes.....	127
2.6.5	Settings.....	130
2.6.6	Information List.....	131

2.7	Negative Sequence Protection 46.....	132
2.7.1	Definite Time characteristic	132
2.7.2	Inverse Time characteristic.....	132
2.7.3	Setting Notes.....	135
2.7.4	Settings.....	136
2.7.5	Information List.....	137
2.8	Frequency Protection 81 O/U.....	138
2.8.1	Functional Description.....	138
2.8.2	Setting Notes.....	139
2.8.3	Settings.....	140
2.8.4	Information List.....	141
2.9	Undervoltage-controlled reactive power protection (27/Q).....	142
2.9.1	Functional Description.....	142
2.9.2	Setting Notes.....	144
2.9.3	Settings.....	145
2.9.4	Information List.....	146
2.10	Thermal Overload Protection 49.....	147
2.10.1	Functional Description.....	147
2.10.2	Setting Notes.....	148
2.10.3	Settings.....	150
2.10.4	Information List.....	151
2.11	Supervision Functions.....	152
2.11.1	Measurement Supervision.....	152
2.11.1.1	General.....	152
2.11.1.2	Hardware Monitoring	152
2.11.1.3	Software Monitoring	154
2.11.1.4	Monitoring of the Transformer Circuits.....	155
2.11.1.5	Measurement Voltage Failure Detection.....	156
2.11.1.6	Broken Wire Monitoring of Voltage Transformer Circuits.....	160
2.11.1.7	Setting Notes.....	161
2.11.1.8	Settings.....	162
2.11.1.9	Information List.....	163
2.11.2	Trip Circuit Supervision 74TC.....	164
2.11.2.1	Functional Description.....	164
2.11.2.2	Setting Notes.....	167
2.11.2.3	Settings.....	168
2.11.2.4	Information List.....	168
2.11.3	Malfunction Responses of the Monitoring Functions.....	168
2.11.3.1	Description.....	168
2.12	Ground Fault Protection 64, 67N(s), 50N(s), 51N(s).....	170
2.12.1	Ground Fault Detection for $\cos\phi$ / $\sin\phi$ Measurement (Standard Method).....	170
2.12.2	Ground Fault Detection for V_0/I_0 - ϕ Measurement.....	176
2.12.3	Extended Ground Fault Protection EPTR/TNP.....	180
2.12.3.1	General Information.....	180
2.12.3.2	Ground-Fault Protection EPTR - B.....	181
2.12.3.3	Transformer Neutral-Point Protection TNP.....	182
2.12.4	Ground Fault Location.....	182
2.12.5	Setting Notes.....	183
2.12.6	Settings.....	191
2.12.7	Settings EPTR, TNP.....	193

2.12.8	Information List.....	193
2.12.9	Information List EPTR, TNP.....	194
2.13	Intermittent Ground Fault Protection.....	196
2.13.1	Functional Description.....	196
2.13.2	Setting Notes.....	199
2.13.3	Settings.....	200
2.13.4	Information List.....	201
2.14	Dir. Intermittent earth fault protection.....	202
2.14.1	Functional Description.....	202
2.14.2	Setting Notes.....	205
2.14.3	Settings.....	206
2.14.4	Information List.....	206
2.15	Automatic Reclosing System 79.....	207
2.15.1	Program Execution.....	207
2.15.2	Blocking.....	211
2.15.3	Status Recognition and Monitoring of the Circuit Breaker.....	213
2.15.4	Controlling Protection Elements.....	214
2.15.5	Zone Sequencing / Fuse Saving Scheme.....	216
2.15.6	Setting Notes.....	217
2.15.7	Settings.....	222
2.15.8	Information List.....	228
2.16	Fault Locator.....	230
2.16.1	Functional Description.....	230
2.16.2	Setting Notes.....	231
2.16.3	Settings.....	232
2.16.4	Information List.....	232
2.17	Breaker Failure Protection 50BF.....	233
2.17.1	Functional Description.....	233
2.17.2	Setting Notes.....	236
2.17.3	Settings.....	238
2.17.4	Information List.....	239
2.18	Flexible Protection Functions.....	240
2.18.1	Functional Description.....	240
2.18.2	Setting Notes.....	244
2.18.3	Settings.....	249
2.18.4	Information List.....	251
2.19	Reverse-Power Protection Application with Flexible Protection Function.....	252
2.19.1	Functional Description.....	252
2.19.2	Implementation of the Reverse Power Protection.....	255
2.19.3	Configuring the Reverse Power Protection in DIGSI.....	257
2.20	Synchrocheck.....	260
2.20.1	General.....	260
2.20.2	Functional Sequence.....	262
2.20.3	De-energized Switching.....	263
2.20.4	Direct Command / Blocking.....	264
2.20.5	Interaction with Control, Automatic Reclosing and External Control.....	264

2.20.6	Setting Notes.....	266
2.20.7	Settings.....	270
2.20.8	Information List.....	271
2.21	Phase Rotation.....	273
2.21.1	Functional Description.....	273
2.21.2	Setting Notes.....	273
2.22	Function Logic.....	274
2.22.1	Pickup Logic of the Entire Device.....	274
2.22.2	Tripping Logic of the Entire Device.....	274
2.22.3	Setting Notes.....	275
2.23	Auxiliary Functions.....	276
2.23.1	Message Processing.....	276
2.23.1.1	LED Displays and Binary Outputs (Output Relays).....	276
2.23.1.2	Information on the Integrated Display (LCD) or Personal Computer.....	276
2.23.1.3	Information to a Control Center.....	278
2.23.2	Statistics.....	278
2.23.2.1	Functional Description.....	278
2.23.2.2	Circuit Breaker Maintenance.....	279
2.23.2.3	Setting Notes.....	285
2.23.2.4	Information List.....	287
2.23.3	Measurement.....	287
2.23.3.1	Display of Measured Values.....	288
2.23.3.2	Transfer of Measured Values.....	289
2.23.3.3	Information List.....	290
2.23.4	Average Measurements.....	291
2.23.4.1	Functional Description.....	291
2.23.4.2	Setting Notes.....	291
2.23.4.3	Settings.....	292
2.23.4.4	Information List.....	292
2.23.5	Min/Max Measurement Setup.....	292
2.23.5.1	Functional Description.....	292
2.23.5.2	Setting Notes.....	292
2.23.5.3	Settings.....	293
2.23.5.4	Information List.....	293
2.23.6	Set Points for Measured Values.....	294
2.23.6.1	Setting Notes.....	295
2.23.7	Set Points for Statistic.....	295
2.23.7.1	Functional Description.....	295
2.23.7.2	Setting Notes.....	295
2.23.7.3	Information List.....	295
2.23.8	Energy Metering.....	295
2.23.8.1	Functional Description.....	296
2.23.8.2	Setting Notes.....	296
2.23.8.3	Settings.....	296
2.23.8.4	Information List.....	296
2.23.9	Commissioning Aids.....	296
2.23.9.1	Functional Description.....	297
2.24	Breaker Control.....	298
2.24.1	Control Device.....	298
2.24.1.1	Functional Description.....	298
2.24.1.2	Information List.....	299

2.24.2	Types of Commands.....	299
2.24.2.1	Functional Description.....	299
2.24.3	Command Sequence.....	300
2.24.3.1	Functional Description.....	300
2.24.4	Switchgear Interlocking.....	300
2.24.4.1	Functional Description.....	301
2.24.5	Command Logging.....	307
2.24.5.1	Functional Description.....	307
2.25	Notes on Device Operation.....	308
2.25.1	Different operation.....	308
3	Mounting and Commissioning.....	311
3.1	Mounting and Connections.....	312
3.1.1	Configuration Information.....	312
3.1.2	Hardware Modifications.....	315
3.1.2.1	Environmental Protection Hints.....	315
3.1.2.2	Disassembly.....	316
3.1.2.3	Connections of the Current Terminals.....	319
3.1.2.4	Connections of the Voltage Terminals.....	321
3.1.2.5	Interface Modules.....	321
3.1.2.6	Reassembly.....	323
3.1.3	Installation.....	324
3.1.3.1	General.....	324
3.1.3.2	Panel Flush Mounting.....	325
3.1.3.3	Cubicle Mounting.....	326
3.1.3.4	Panel Surface Mounting.....	327
3.2	Checking Connections.....	329
3.2.1	Checking the Data Connections of the Interfaces.....	329
3.2.2	Checking the System Connections.....	331
3.3	Commissioning.....	333
3.3.1	Test Mode and Transmission Block.....	334
3.3.2	Testing the System Interface (at Port B)	334
3.3.3	Configuring Communication Modules.....	335
3.3.4	Checking the Status of Binary Inputs and Outputs.....	339
3.3.5	Tests for Breaker Failure Protection.....	341
3.3.6	Testing User-Defined Functions.....	343
3.3.7	Current, Voltage, and Phase Rotation Testing.....	343
3.3.8	Test for High Impedance Protection.....	344
3.3.9	Testing the Reverse Interlocking Scheme.....	344
3.3.10	Direction Check with Load Current.....	345
3.3.11	Polarity Check for Voltage Input V_3	346
3.3.12	Ground Fault Check.....	348
3.3.13	Polarity Check for Current Input I_E	349
3.3.14	Trip/Close Tests for the Configured Operating Devices.....	351
3.3.15	Creating Oscillographic Recordings for Tests.....	351
3.4	Final Preparation of the Device.....	353
4	Technical Data.....	355
4.1	General Device Data.....	356
4.1.1	Analog Inputs.....	356

4.1.2	Auxiliary voltage.....	356
4.1.3	Binary Inputs and Outputs.....	357
4.1.4	Communication Interfaces.....	358
4.1.5	Electrical Tests.....	360
4.1.6	Mechanical Tests.....	362
4.1.7	Climatic Stress Tests.....	363
4.1.8	Service Conditions.....	363
4.1.9	Constructive Design.....	363
4.1.10	UL certification conditions.....	364
4.2	Definite-time Overcurrent Protection.....	365
4.3	Inverse-time Overcurrent Protection.....	367
4.4	Directional Overcurrent Protection.....	378
4.5	Inrush Restraint.....	380
4.6	Dynamic Cold Load Pickup.....	381
4.7	1-phase Overcurrent Protection.....	382
4.8	Voltage Protection.....	383
4.9	Negative Sequence Protection (definite-time characteristic).....	385
4.10	Negative Sequence Protection (inverse-time characteristics).....	386
4.11	Frequency Protection 81 O/U.....	392
4.12	Undervoltage-controlled reactive power protection (27/Q).....	393
4.13	Thermal Overload Protection.....	395
4.14	Ground Fault Detection (Sensitive/Insensitive).....	397
4.15	Intermittent Ground Fault Protection.....	403
4.16	Directional intermittent ground fault protection.....	404
4.17	Automatic Reclosing.....	405
4.18	Fault Locator.....	406
4.19	Breaker Failure Protection 50BF	407
4.20	Flexible Protection Functions	408
4.21	Synchrocheck 25	411
4.22	User-defined Functions (CFC).....	413
4.23	Auxiliary Functions.....	418
4.24	Switching Device Control.....	423
4.25	Dimensions.....	424
4.25.1	Panel Flush and Cubicle Mounting (Housing Size 1/6)	424
4.25.2	Panel Surface Mounting (Housing Size 1/6)	425
4.25.3	Bottom view.....	425
4.25.4	Varistor.....	426
A	Ordering Information and Accessories.....	427
A.1	Ordering Information 7SJ80	428
A.2	Accessories.....	433
B	Terminal Assignments.....	435
B.1	7SJ80 — Housing for panel flush mounting and cubicle installation and for panel surface mounting	436

C	Connection Examples.....	443
	C.1 Connection Examples for Current and Voltage Transformers.....	444
	C.2 Connection Examples for SICAM I/O Units.....	456
D	Current Transformer Requirements.....	457
	D.1 Accuracy limiting factors.....	458
	D.2 Class conversion.....	459
	D.3 Cable core balance current transformer.....	460
E	Default Settings and Protocol-dependent Functions.....	461
	E.1 LEDs.....	462
	E.2 Binary Input.....	464
	E.3 Binary Output.....	465
	E.4 Function Keys.....	466
	E.5 Default Display.....	467
	E.6 Protocol-dependent Functions.....	470
F	Functions, Settings, Information.....	471
	F.1 Functional Scope.....	472
	F.2 Settings.....	474
	F.3 Information List.....	505
	F.4 Group Indications.....	543
	F.5 Measured Values.....	545
	Literature.....	551
	Glossary.....	553
	Index.....	563

1 Introduction

The device family SIPROTEC 7SJ80 devices is introduced in this section. An overview of the devices is presented in their application, characteristics, and scope of functions.


1.1	Overall Operation	20
1.2	Application Scope	22
1.3	Characteristics	24

1.1 Overall Operation

The digital SIPROTEC 7SJ80 overcurrent protection is equipped with a powerful microprocessor. It allows all tasks to be processed digitally, from the acquisition of measured quantities to sending commands to circuit breakers. *Figure 1-1* shows the basic structure of the 7SJ80.

Analog Inputs

The measuring inputs (MI) convert the currents and voltages coming from the measuring transformers and adapt them to the level appropriate for the internal processing of the device. The device provides 4 current transformers and - depending on the model - additionally 3 voltage transformers. Three current inputs serve for the input of the phase currents, another current input (I_N) may be used for measuring the ground fault current I_N (current transformer neutral point) or for a separate ground current transformer (for sensitive ground fault detection I_{Ns} and directional determination of ground faults) - depending on the model.

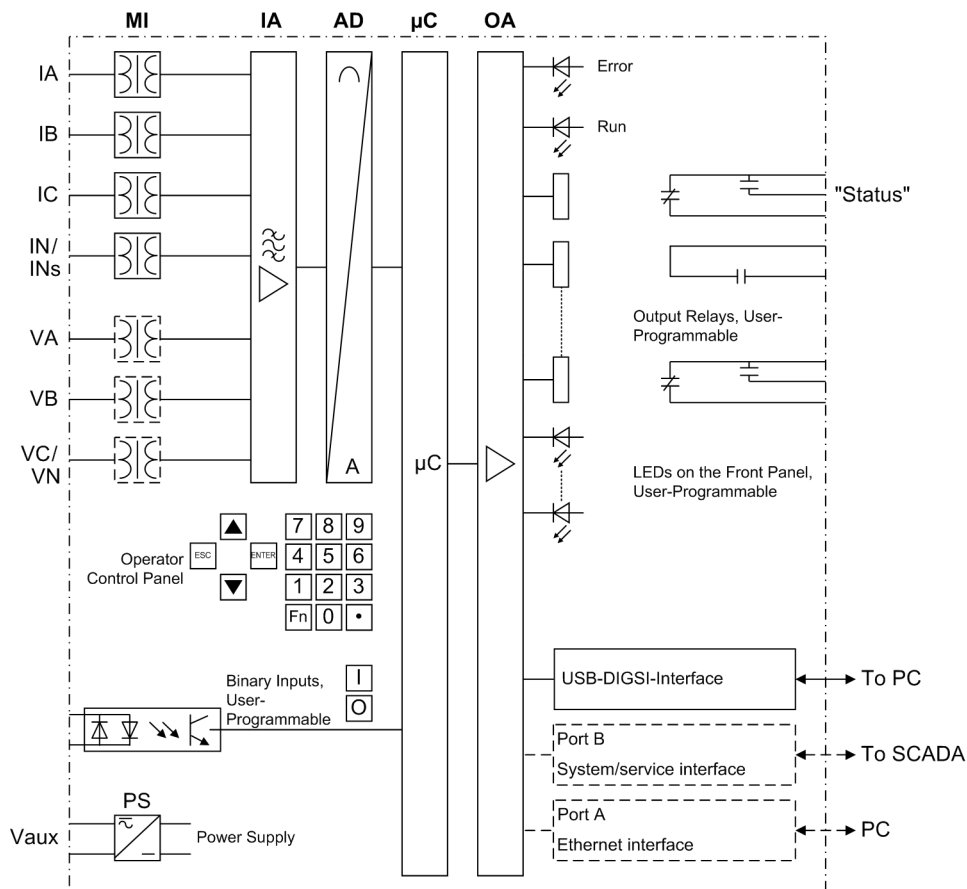

[hw-struktur-7sj80-060606, 1, en_US]

Figure 1-1 Hardware structure of the digital multi-functional protective relay 7SJ80

The optional voltage transformers can either be used to input 3 phase-to-ground voltages or 2 phase-to-phase voltages and the displacement voltage (open delta voltage) or any other voltages. It is also possible to connect two phase-to-phase voltages in open delta connection.

The analog input quantities are passed on to the input amplifiers (IA). The input amplifier IA element provides a high-resistance termination for the input quantities. It consists of filters that are optimized for measured-value processing with regard to bandwidth and processing speed.

The analog-to-digital (AD) transformer group consists of an analog-to-digital converter and memory components for the transmission of data to the microcomputer.

Microcomputer System

Apart from processing the measured values, the microcomputer system (μ C) also executes the actual protection and control functions. They especially include:

- Filtering and preparation of the measured quantities
- Continuous monitoring of the measured quantities
- Monitoring of the pickup conditions for the individual protective functions
- Interrogation of limit values and sequences in time
- Control of signals for the logic functions
- Output of control commands for switching devices
- Recording of messages, fault data and fault values for analysis
- Management of the operating system and the associated functions such as data recording, real-time clock, communication, interfaces, etc.
- The information is distributed via output amplifiers (OA).

Binary Inputs and Outputs

The computer system obtains external information through the binary input/output boards (inputs and outputs). The computer system obtains information from the system (e.g. remote resetting) or from external equipment (e.g. blocking commands). These outputs include, in particular, trip commands to circuit breakers and signals for the remote indication of important events and conditions.

Front Panel

Information such as messages related to events, states, measured values and the functional status of the device are visualized by light-emitting diodes (LEDs) and a display screen (LCD) on the front panel.

Integrated control and numeric keys in conjunction with the LCD enable interaction with the remote device. These elements can be used to access the device for information such as configuration and setting parameters. Similarly, setting parameters can be accessed and changed if needed.

In addition, control of circuit breakers and other equipment is possible from the front panel of the device.

Interfaces

Communication with a PC can be implemented via the **USB DIGSI interface** using the DIGSI software, allowing all device functions to be easily executed.

Communication with a PC is also possible via **port A** (Ethernet interface) and **port B** (System/Service interface) using DIGSI.

In addition to the device communication via DIGSI, **port B** can also be used to transmit all device data to a central evaluator or a control center. This interface may be provided with various protocols and physical transmission schemes to suit the particular application.

Power Supply

A power supply unit (Vaux or PS) delivers power to the functional units using the different voltage levels. Voltage dips may occur if the voltage supply system (substation battery) becomes short-circuited. Usually, they are bridged by a capacitor (see also Technical Data).

A buffer battery is located under the flap at the lower end of the front cover.

1.2 Application Scope

The multi-function numerical overcurrent protection SIPROTEC 4 7SJ80 is used as protection, control and monitoring unit for busbar feeders. For line protection, the device can be used in networks with grounded, lowresistance grounded, isolated or a compensated neutral point structure. It is suited for networks that are radial and supplied from a single source, open or closed looped networks and for lines with sources at both ends.

The device includes the functions that are usually necessary for protection, monitoring of circuit breaker positions and control of circuit breakers in single and double busbars; therefore, the device can be employed universally. The device provides excellent backup protection of differential protective schemes of any kind for lines, transformers and busbars of all voltage levels.

Protective Functions

Non-directional overcurrent protection (50, 50N, 51, 51N) is the basic function of the device. There are three definite time elements and one inverse time element for the phase currents and the ground current. For the inverse time elements, several characteristics of different standards are provided. Alternatively, a user-defined characteristic can be used for the sensitive ground fault detection.

Further protection functions included are the negative sequence protection, overload protection, circuit breaker failure protection and ground fault protection.

Depending on the ordered variant, further protection functions are included, such as frequency protection, overvoltage and undervoltage protection, and ground fault protection for high-resistance ground faults (directional or non-directional).

Apart from the short circuit protection functions mentioned before, there are further protection functions possible as order variants. The overcurrent protection can, for example, be supplemented by a directional overcurrent protection.

The automatic reclosing function enables several different reclosing cycles for overhead lines. An external automatic reclosing system can also be connected. To ensure quick detection of the fault location after a short circuit, the device is equipped with a fault locator.

Before reclosing after a three-pole tripping, the device can verify the validity of the reclosure via a voltage check and/or a synchrocheck. The synchrocheck function can also be controlled externally.

Control Functions

The device provides a control function which can be accomplished for activating and deactivating the switchgear via operator buttons, port B, binary inputs and - using a PC and the DIGSI software - via the front interface.

The status of the primary equipment can be transmitted to the device via auxiliary contacts connected to binary inputs. The present status (or position) of the primary equipment can be displayed on the device, and used for interlocking or alarm condition monitoring. The number of operating equipments to be switched is limited by the binary inputs and outputs available in the device or the binary inputs and outputs allocated for the switch position indications. Depending on the primary equipment being controlled, one binary input (single point indication) or two binary inputs (double point indication) may be used for this process.

The capability of switching primary equipment can be restricted by a setting associated with switching authority (Remote or Local), and by the operating mode (interlocked/non-interlocked, with or without password request).

Processing of interlocking conditions for switching (e.g. switchgear interlocking) can be established with the aid of integrated, user-configurable logic functions.

Messages and Measured Values; Recording of Event and Fault Data

The operational indications provide information about conditions in the power system and the device. Measurement quantities and values that are calculated can be displayed locally and communicated via the serial interfaces.

Device messages can be assigned to a number of LEDs on the front cover (allocatable), can be externally processed via output contacts (allocatable), linked with user-definable logic functions and/or issued via serial interfaces.

During a fault (system fault) important events and changes in conditions are saved in fault protocols (Event Log or Trip Log). Instantaneous fault values are also saved in the device and may be analyzed subsequently.

Communication

The following interfaces are available for communication with external operating, control and memory systems.

The USB DIGSI interface on the front cover serves for local communication with a PC. By means of the SIPROTEC 4 operating software DIGSI, all operational and evaluation tasks can be executed via this **operator interface**, such as specifying and modifying configuration parameters and settings, configuring user-specific logic functions, retrieving operational messages and measured values, inquiring device conditions and measured values, issuing control commands.

Depending on the ordered variant, additional interfaces are located at the bottom of the device. They serve for establishing extensive communication with other digital operating, control and memory components:

Port A serves for DIGSI communication directly on the device or via network. Furthermore, 2 SICAM I/O units 7XV5673 can be connected to this port. **Port A** can also be used for time synchronization using the NTP protocol.

Port B serves for central communication between the device and a control center. It can be operated via data lines or fiber optic cables. For the data transfer, there are standard protocols in accordance with IEC 60870-5-103 available. The integration of the devices into the SINAUT LSA and SICAM automation systems can also be implemented with this profile.

Alternatively, additional connection options are available with PROFIBUS DP and the DNP3.0 and MODBUS protocols. If an EN100 module is available, you can use the protocols IEC61850, PROFINET or DNP3 TCP. Furthermore, connecting a SICAM I/O unit is possible via IEC61850 GOOSE.

1.3 Characteristics

General Characteristics

- Powerful 32-bit microprocessor system
- Complete digital processing and control of measured values, from the sampling of the analog input quantities to the initiation of outputs, for example, tripping or closing circuit breakers or other switchgear devices
- Total electrical separation between the internal processing stages of the device and the external transformer, control, and DC supply circuits of the system because of the design of the binary inputs, outputs, and the DC or AC converters
- Complete set of functions necessary for the proper protection of lines, feeders, motors, and busbars
- Easy device operation through an integrated operator panel or by means of a connected personal computer running DIGSI
- Continuous calculation and display of measured and metered values on the front of the device
- Storage of min./max. measured values (slave pointer function) and storage of long-term mean values
- Recording of event and fault data for the last 8 system faults (fault in a network) with real-time information as well as instantaneous values for fault recording for a maximum time range of 20 s
- Constant monitoring of the measured quantities, as well as continuous self-diagnostics covering the hardware and software
- Communication with SCADA or substation controller equipment via serial interfaces through the choice of data cable, modem, or optical fibers
- Battery-buffered clock which can be synchronized via a synchronization signal at the binary input or via a protocol
- Switching statistics: Counting the number of trip commands initiated by the device, logging the currents of the last switch-off operation initiated by the device, and accumulating the eliminated short-circuit currents of each breaker pole
- Operating hours counter: Counting the operating hours of the protected object under load
- Commissioning aids such as connection and direction check, status indication of all binary inputs and outputs, easy testing of port B, and influencing of information at port B during test operation.

Time Overcurrent Protection 50, 51, 50N, 51N

- Three definite time overcurrent protective elements and one inverse time overcurrent protective element for phase current and ground current I_N or summation current $3I_0$
- Two-phase operation of the overcurrent protection (I_A , I_C) is possible
- For inverse-time overcurrent protection, selection from various characteristics of different standards possible
- Blocking is possible, e.g. for reverse interlocking with any element
- Instantaneous tripping by any element is possible when switching onto a fault
- In-rush restraint with second harmonic current quantities.

Ground Fault Protection 50N, 51N

- Three definite time overcurrent protective elements and one inverse time overcurrent protective element applicable for grounded or high-resistance grounded systems
- For inverse-time overcurrent protection, selection from various characteristics of different standards

- In-rush restraint with second harmonic current quantities
- Instantaneous tripping by any overcurrent element upon switch onto fault is possible.

Directional Time Overcurrent Protection 67, 67N

- Three definite time overcurrent protection elements and one inverse time overcurrent protection element for the phase operate in parallel to the non-directional overcurrent elements. Their pickup values and time delays can be set independently of these.
- Direction determination with cross-polarized voltages and voltage memory and dynamically unlimited direction sensitivity
- Fault direction is calculated phase-selectively and separately for phase faults, ground faults and summation current faults.

Dynamic Cold Load Pick-up Function 50C, 50NC, 51C, 51NC, 67C, 67NC

- Dynamic changeover of time overcurrent protection settings, e.g. when cold load conditions are recognized
- Detection of cold load condition via circuit breaker position or current threshold
- Activation via automatic reclosure (AR) is possible
- Activation also possible via binary input.

Single-Phase Overcurrent Protection

- Evaluation of the measured current via the sensitive or insensitive ground current transformer
- Suitable as differential protection that includes the neutral point current on transformer side, generator side or motor side or for a grounded reactor set
- As tank leakage protection against abnormal leakage currents between transformer tanks and ground.

Voltage Protection 27, 59

- Two element undervoltage detection via the positive-sequence system of the voltages, phase-to-phase or phase-to-ground voltages
- Choice of current supervision for 27-1 and 27-2
- Separate two-element overvoltage detection of the largest voltages applied or detection of the positive or negative sequence component of the voltages
- Settable dropout ratio for all elements of the undervoltage and overvoltage protection.

Negative Sequence Protection 46

- Evaluation of the negative sequence component of the currents
- Two definite-time elements 46-1 and 46-2 and one inverse-time element 46-TOC; curves of common standards are available for 46-TOC.

Frequency Protection 81 O/U

- Monitoring of falling below ($f <$) and/or exceeding ($f >$) with 4 frequency limits and time delays that are independently adjustable
- Insensitive to harmonics and abrupt phase angle changes
- Adjustable undervoltage threshold.

Undervoltage-controlled reactive power protection (27/Q)

- Detection of critical power system situations
- Disconnection of power supply facilities from the grid
- Reconnection under stable power system conditions

Thermal Overload Protection 49

- Thermal profile of energy losses (overload protection has full memory capability)
- True r.m.s. calculation
- Adjustable thermal warning element
- Adjustable alarm level based on current magnitude

Monitoring Functions

- Increased reliability due to monitoring of the internal measurement circuits as well as the hardware and software
- Fuse failure monitor with protection function blocking
- Monitoring of the current transformer and voltage transformer secondary circuits using sum and symmetry supervision with optional protection function blocking
- Trip circuit monitoring possible
- Phase rotation check.

Ground Fault Detection 50N(s), 51N(s), 67N(s), 59N/64

- Displacement voltage is measured or calculated from the three phase voltages
- Determination of a faulty phase on ungrounded or grounded systems
- Two-element Ground Fault Detection: 50Ns-1 and 50Ns-2
- High sensitivity (as low as 1 mA)
- Overcurrent element with definite time or inverse time delay
- For inverse-time overcurrent protection, a user-defined characteristic is available
- Direction determination with zero sequence quantities(I_0 , V_0), wattmetric ground fault direction determination
- Any element can be set as directional or non-directional — forward sensing directional, or reverse sensing directional
- Optionally applicable as additional ground fault protection.

Intermittent Ground Fault Protection

- Detects and accumulates intermittent ground faults
- Tripping after configurable total time.

Directional intermittent ground fault protection

- Detects intermittent ground faults
- Direction determination
- Tripping after settable number of intermittent re-ignitions

Automatic Reclosing 79

- Single-shot or multi-shot
- With separate dead times for the first and all succeeding shots
- Protective elements that initiate automatic reclosing are selectable. The choices can be different for phase faults and ground faults
- Separate programs for phase and ground faults
- Interaction to time overcurrent protection element and ground fault elements. They can be blocked in dependence of the reclosing cycle or released instantaneously
- Synchronous reconnection is possible .

Fault Location

- Initiation by trip command, external command or dropout of pickup
- Calculation of the fault distance and output of the fault location in ohms (primary and secondary) and in kilometers or miles
- Up to three line sections can be configured.

Breaker Failure Protection 50 BF

- By checking the current and/or evaluating the circuit breaker auxiliary contacts
- Started by any integrated protection function that trips
- Initiation possible via a binary input from an external protective device.

Flexible Protective Functions

- Up to 20 customizable protection functions with three-phase or single-phase operation
- Any calculated or directly measured quantity can be evaluated on principle
- Standard protection logic with definite time characteristic
- Internal and configurable pickup and dropout delay
- Modifiable message texts.

Synchrocheck

- Verification of the synchronous conditions before reclosing after three-pole tripping
- Fast measurement of the voltage difference ΔV , the phase angle difference $\Delta\phi$ and the frequency difference Δf
- Alternatively, check of the de-energized state before reclosing
- Setable minimum and maximum voltage
- Verification of the synchronous conditions or de-energized state also possible before the manual closing of the circuit breaker, with separate limit values
- Measurement also possible via transformer without external intermediate matching transformer
- Measuring voltages optionally phase-to-phase or phase-to-ground.

Phase Rotation

- Selectable ABC or ACB by setting (static) or binary input (dynamic).

Circuit-Breaker Maintenance

- Statistical methods to help adjust maintenance intervals for CB contacts according to their actual wear
- several independent subfunctions have been implemented (ΣI -procedure, ΣI^x -procedure, 2P-procedure and I^2t -procedure)
- Acquisition and conditioning of measured values for all subfunctions operates phase-selective using one procedure-specific threshold per subfunction.

User Defined Functions

- Freely programmable linking of internal and external signals in order to implement user-defined logic functions
- All standard logic functions (AND, OR, NOT, EXCLUSIVE-OR, etc.)
- Time delays and limit value interrogations
- Processing of measured values, including zero suppression, adding a knee curve for a transducer input, and live-zero monitoring.

Breaker Control

- Switching devices can be opened and closed manually using control keys, programmable function keys, via port B (e.g. of SICAM or LSA), or via the user interface (using a personal computer and the DIGSI operating software)
- Feedback of switching states via the switch auxiliary contacts
- Plausibility monitoring of the circuit breaker position and check of interlocking conditions.

2 Functions

This chapter describes the numerous functions available on the SIPROTEC 4 device 7SJ80. It shows the setting possibilities for each function in maximum configuration. Information with regard to the determination of setting values as well as formulas, if required, are also provided.

Based on the following information, it can also be determined which of the provided functions should be used.

2.1	General	30
2.2	Overcurrent Protection 50, 51, 50N, 51N	56
2.3	Directional Overcurrent Protection 67, 67N	82
2.4	Dynamic Cold Load Pickup	106
2.5	Single-Phase Overcurrent Protection	112
2.6	Voltage Protection 27, 59	122
2.7	Negative Sequence Protection 46	132
2.8	Frequency Protection 81 O/U	138
2.9	Undervoltage-controlled reactive power protection (27/Q)	142
2.10	Thermal Overload Protection 49	147
2.11	Supervision Functions	152
2.12	Ground Fault Protection 64, 67N(s), 50N(s), 51N(s)	170
2.13	Intermittent Ground Fault Protection	196
2.14	Dir. Intermittent earth fault protection	202
2.15	Automatic Reclosing System 79	207
2.16	Fault Locator	230
2.17	Breaker Failure Protection 50BF	233
2.18	Flexible Protection Functions	240
2.19	Reverse-Power Protection Application with Flexible Protection Function	252
2.20	Synchrocheck	260
2.21	Phase Rotation	273
2.22	Function Logic	274
2.23	Auxiliary Functions	276
2.24	Breaker Control	298
2.25	Notes on Device Operation	308

2.1 General

The settings associated with the various device functions can be modified using the operating or service interface in DIGSI in conjunction with a personal computer. Some parameters can also be changed using the controls on the front panel of the device. The procedure is described in detail in the SIPROTEC System Description [/1/ SIPROTEC 4 System Description](#).

2.1.1 Functional Scope

The 7SJ80 relay contains protection functions as well as auxiliary functions. The hardware and firmware is designed for this scope of functions. Additionally, the control functions can be matched to the system requirements. Individual functions can be enabled or disabled during the configuration procedure. The interaction of functions may also be modified.

2.1.1.1 Functional Description

Setting the Functional Scope

Example for the configuration of the functional scope:

A protected system consists of overhead lines and underground cables. Since automatic reclosing is only needed for the overhead lines, the automatic reclosing function is not configured or “disabled” for the relays protecting the underground cables.

The available protection and additional functions can be configured as **Enabled** or **Disabled**. For individual functions, a choice between several alternatives may be possible, as described below.

Functions configured as **Disabled** are not processed by the 7SJ80. There are no messages and corresponding settings (functions, limit values) queried during configuration.



NOTE

Available functions and default settings are depending on the order variant of the relay (see [A Ordering Information and Accessories](#)).

2.1.1.2 Setting Notes

Setting the Functional Scope

Your protection device is configured using the DIGSI software. Connect your personal computer either to the USB port on the device front or to port A or port B on the bottom side of the device depending on the device version (ordering code). The operation via DIGSI is explained in the SIPROTEC 4 System Description.

The **Device Configuration** dialog box allows you to adjust your device to the specific system conditions.

Password no. 7 is required (for parameter set) for changing configuration parameters in the device. Without the password the settings can only be read but not edited and transmitted to the device.

Special Features

Most settings are self-explanatory. The special cases are described in the following.

If you want to use the setting group change function, set address 103 **Grp Chge OPTION** to **Enabled**. In this case, you can select up to four different groups of function parameters between which you can switch quickly and conveniently during operation. Only **one** setting group can be used when selecting the option **Disabled**.

For the elements associated with non-directional overcurrent protection 50(N), 51(N) (phase and ground), various tripping characteristics can be selected at addresses 112 **Charac. Phase** and 113 **Charac. Ground**. If only the definite time characteristic is desired, select **Definite Time**. Alternatively, you can select between inverse-time curves according to IEC standard (**TOC IEC**) or ANSI standard (**TOC ANSI**). The dropout behavior of the IEC and ANSI curves is specified at address 1210 or 1310 when configuring the time overcurrent protection.

Set to **Disabled** to disable the entire time overcurrent protection.

The directional overcurrent protection 67(N) is set at address 115 **67/67-TOC** and 116 **67N/67N-TOC**. Here, the same options are available as for non-directional overcurrent protection (except the 50-3 element).

For (sensitive) ground fault detection address 130 **S.Gnd.F.Dir.Ch** lets you specify the directional characteristic of the sensitive ground fault detection. You can select between **cos ϕ / sin ϕ** and **V0/I0 ϕ mea.** as the measurement procedure. The **cos ϕ / sin ϕ** procedure (via residual wattmetric current detection) is set by default.

If the measuring method **cos ϕ / sin ϕ** is set, select between a definite time characteristic (**Definite Time**) and an inverse time characteristic **User Defined PU** at address 131 **Sens. Gnd Fault. V0/I0 ϕ mea.** provides the definite time characteristic **Definite Time**, inverse time characteristics **TOC IEC** or **TOC ANSI**. When selecting the setting **Disabled**, the entire function is disabled.

For the intermittent ground fault protection, you can specify the measured quantity (**with Ignd, with 3I0** or **with Ignd, sens.**) to be used by this protection function at address 133 **INTERM.EF**.

At address 134 **Dir. Interm. EF** you can set the directional intermittent ground fault protection to **Enabled** or **Disabled**.

For unbalanced load protection, address 140 **46** allows you to specify which tripping characteristics to use. You can select between **Definite Time**, **TOC ANSI** or **TOC IEC**. If this function is not required, select **Disabled**.

The overload protection is activated in address 142 **49** by selecting the setting without ambient temperature No ambient temp or it is set to **Disabled**.

At address 155 **27/Q-Protection** you can set the QU protection to **Enabled** or **Disabled**.

The synchronization function is activated in address 161 **25 Function 1** by the setting **SYNCHROCHECK** or it is set to **Disabled**.

In address 170 you can set the breaker failure protection to **Enabled** or **Disabled**. The setting option **enabled w/ 3I0** subjects the ground current and the negative sequence current to a plausibility check.

For the CB maintenance functions, several options are available under address 172 **52 B.WEAR MONIT**. Irrespective of this, the basic functionality of the summation current formation (ΣI procedure) is always active. It requires no further configurations and adds up the tripping currents of the trips initiated by the protection functions.

When selecting the **ΣI^x -Procedure**, the sum of all tripping current powers is formed and output as reference value. The **2P Procedure** continuously calculates the remaining lifespan of the circuit breaker.

With the **I²t Procedure** the square fault current integrals are formed via arc time and output as a reference value.

Further information concerning the individual procedures of the CB maintenance are given in Section [2.23.2 Statistics](#). You can also disable this function by setting it to **Disabled**.

In address 181, you can enter how many line sections (maximum of three) are taken into account by the fault locator.

Under address 182 **74 Trip Ct Supv** it can be selected whether the trip-circuit supervision works with two (**2 Binary Inputs**) or only one binary input (**1 Binary Input**), or whether the function is configured **Disabled**.

In address 617 **ServiProt (CM)** you can specify for which purpose port B is used. **T103** means that the device is connected to a control and protection facility via serial port, **DIGSI** means that you are using the port to connect DIGSI or you are not using port B (**Disabled**).

The flexible protection functions can be configured via parameter **FLEXIBLE FUNC..** You can create up to 20 flexible functions by setting a checkmark in front of the desired function (an example is given in the Section [2.19 Reverse-Power Protection Application with Flexible Protection Function](#)). If the checkmark of a function is removed, all settings and configurations made previously will be lost. After re-selecting the function, all settings and configurations are in default setting. Setting of the flexible function is done in DIGSI under "Parameters", "Additional Functions" and "Settings". The configuration is done, as usual, under "Parameters" and "Masking I/O (Configuration Matrix)".

2.1.1.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
103	Grp Chge OPTION	Disabled Enabled	Disabled	Setting Group Change Option
104	OSC. FAULT REC.	Disabled Enabled	Enabled	Oscillographic Fault Records
112	Charac. Phase	Disabled Definite Time TOC IEC TOC ANSI	Definite Time	50/51
113	Charac. Ground	Disabled Definite Time TOC IEC TOC ANSI	Definite Time	50N/51N
115	67/67-TOC	Disabled Definite Time TOC IEC TOC ANSI	Definite Time	67, 67-TOC
116	67N/67N-TOC	Disabled Definite Time TOC IEC TOC ANSI	Definite Time	67N, 67N-TOC
117	Coldload Pickup	Disabled Enabled	Disabled	Cold Load Pickup
122	InrushRestraint	Disabled Enabled	Disabled	2nd Harmonic Inrush Restraint
127	50 1Ph	Disabled Enabled	Disabled	50 1Ph
130	S.Gnd.F.Dir.Ch	$\cos \varphi / \sin \varphi$ V0/I0 φ mea.	$\cos \varphi / \sin \varphi$	(sens.) Ground fault dir. characteristic
131	Sens. Gnd Fault	Disabled Definite Time User Defined PU	Disabled	(sensitive) Ground fault
133	INTERM.EF	Disabled with Ignd with 3I0 with Ignd,sens.	Disabled	Intermittent earth fault protection
134	Dir. Interm. EF	Disabled Enabled	Disabled	Dir. Intermittent earth fault protection
135	E Flt(ext)	Disabled EPTR Trans. Neutral	Disabled	Earth Fault(extend)
140	46	Disabled TOC ANSI TOC IEC Definite Time	Disabled	46 Negative Sequence Protection
142	49	Disabled No ambient temp	No ambient temp	49 Thermal Overload Protection

Addr.	Parameter	Setting Options	Default Setting	Comments
150	27/59	Disabled Enabled	Disabled	27, 59 Under/Overvoltage Protection
154	81 O/U	Disabled Enabled	Disabled	81 Over/Underfrequency Protection
155	27/Q-Protection	Disabled Enabled	Disabled	27 / Q dir. con. Protection
161	25 Function 1	Disabled SYNCHROCHECK	Disabled	25 Function group 1
170	50BF	Disabled Enabled enabled w/ 3I0>	Disabled	50BF Breaker Failure Protection
171	79 Auto Recl.	Disabled Enabled	Disabled	79 Auto-Reclose Function
172	52 B.WEAR MONIT	Disabled Ix-Method 2P-Method I2t-Method	Disabled	52 Breaker Wear Monitoring
180	Fault Locator	Disabled Enabled	Disabled	Fault Locator
181	L-sections FL	1 Section 2 Sections 3 Sections	1 Section	Line sections for fault locator
182	74 Trip Ct Supv	Disabled 2 Binary Inputs 1 Binary Input	Disabled	74TC Trip Circuit Supervision
617	ServiProt (CM)	Disabled T103 DIGSI	T103	Port B usage
-	FLEXIBLE FCT. 1...20	Flexible Function 01 Flexible Function 02 Flexible Function 03 Flexible Function 04 Flexible Function 05 Flexible Function 06 Flexible Function 07 Flexible Function 08 Flexible Function 09 Flexible Function 10 Flexible Function 11 Flexible Function 12 Flexible Function 13 Flexible Function 14 Flexible Function 15 Flexible Function 16 Flexible Function 17 Flexible Function 18 Flexible Function 19 Flexible Function 20	Please select	Flexible Functions 1...20

2.1.2 Device, General Settings


The device requires some general information. This may be, for example, the type of annunciation to be issued in the event of an occurrence of a power system fault.

2.1.2.1 Functional Description

Command-Dependent Messages "No Trip – No Flag"

The storage of indications assigned to local LEDs and the availability of spontaneous indications can be made dependent on whether the device has issued a trip command. This information is then not issued if during a system disturbance one or more protection functions have picked up but the 7SJ80 did not trip because the fault was cleared by another device (e.g. on another line). These messages are then limited to faults in the line to be protected.

The following figure illustrates the generation of the reset command for stored indications. The instant the device drops out, the presetting of parameter 610 **FltDisp.LED/LCD** decides whether the new fault remains stored or is reset.

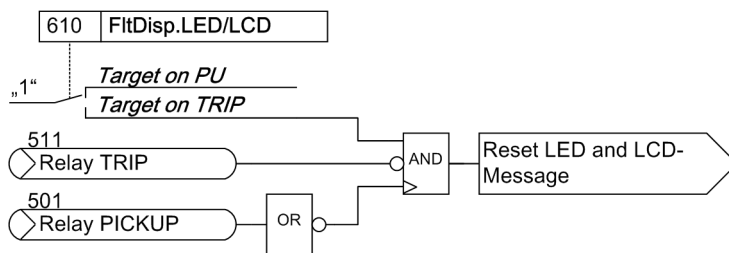

[dw_ruecksetzbefehl-fuer-n-speicher-led-lcd-meld, 1, en_US]

Figure 2-1 Creation of the reset command for the latched LED and LCD messages

Spontaneous Messages on the Display

You can determine whether or not the most important data of a fault event is displayed automatically after the fault has occurred (see also Subsection "Fault Messages" in Section "Auxiliary Functions").

2.1.2.2 Setting Notes

Fault Messages

A new pickup of a protection function generally turns off any previously set light displays so that only the latest fault is displayed at any one time. It can be selected whether the stored LED displays and the spontaneous messages on the display appear after the new pickup or only after a new trip signal is issued. In order to select the desired mode of display, select the Device submenu in the SETTINGS menu. Under address 610 **FltDisp.LED/LCD** the two options *Target on PU* and *Target on TRIP* ("No trip – no flag") can be selected.

Use parameter 611 **Spont. FltDisp.** to specify whether or not a spontaneous fault message should appear automatically on the display (**YES**) or not (**NO**).

Selection of Default Display

The start page of the default display appearing after startup of the device can be selected in the device data via parameter 640 **Start image DD**. The pages available for each device version are listed in the Appendix [E Default Settings and Protocol-dependent Functions](#).

Time Synchronization via Port A

If you want the time synchronization of the device to be performed via port A, set the parameters required for this purpose at the following addresses:

Address 660 IP adr[0] (Prim) to 663 IP adr[3] (Prim)	IP-Addresses 0 to 3, NTP primary
Address 664 IP adr[0] (Sec) to 667 IP adr[3] (Sec)	IP-Addresses 0 to 3, NTP secondary
Address 668 Client activ	client for primary and secondary addresses switched on or off.
Address 669 Daylight Set	daylight saving time switched on or off.
Address 670 Offset TZ/min	offset for the time zone in minutes
Address 671 Offset DayT/min	offset for daylight saving time in minutes
Address 672 W2S month to 675 W2S hour	month, week (of the month), day of the week, hour of switching to daylight saving time
Address 676 S2W month to 679 S2W hour	month, week (of the month), day of the week, hour of switching to winter time

Access authorization for port A

At address 651 **ParEN100 (LC) blk** you can parameterize a **read** access option via the EN100 module at port A. If the parameter is set to **ON**, you can read out the device parameters using DIGSI or fetch fault records.

IEC 61850 GOOSE Function

At address 700 **GOOSE-Stop** you can set the GOOSE function of the IEC 61850 protocol to active or not. If **GOOSE-Stop** is set to **YES**, you can release the GOOSE function again via a binary input during operation.

2.1.2.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
610	FltDisp.LED/LCD	Target on PU Target on TRIP	Target on PU	Fault Display on LED / LCD
611	Spont. FltDisp.	YES NO	NO	Spontaneous display of flt.annunciations
640	Start image DD	image 1 image 2 image 3 image 4 image 5 image 6 image 7 image 8	image 1	Start image Default Display
651	ParEN100(LC)blk	OFF ON	OFF	DIGSI-config. over EN100 (LC) blocked
660	IP adr[0](Prim)	0 .. 255	0	IP address [0] (NTP-Primary)
661	IP adr[1](Prim)	0 .. 255	0	IP address [1] (NTP-Primary)
662	IP adr[2](Prim)	0 .. 255	0	IP address [2] (NTP-Primary)
663	IP adr[3](Prim)	0 .. 255	0	IP address [3] (NTP-Primary)
664	IP adr[0] (Sec)	0 .. 255	0	IP address [0] (NTP-Sekundary)
665	IP adr[1] (Sec)	0 .. 255	0	IP address [1] (NTP-Sekundary)
666	IP adr[2] (Sec)	0 .. 255	0	IP address [2] (NTP-Sekundary)
667	IP adr[3] (Sec)	0 .. 255	0	IP address [3] (NTP-Sekundary)
668	Client activ	OFF ON	OFF	Client activ

Addr.	Parameter	Setting Options	Default Setting	Comments
669	Daylight Set	OFF ON	OFF	Daylight Set
670	Offset TZ/min	-1440 .. 1440 min	60 min	Offset for time zone in minutes
671	Offset DayT/min	-1440 .. 1440 min	60 min	Offset for daylight in minutes
672	W2S month	1 .. 12	3	month of time set winter to summer
673	W2S week	1 .. 5	5	week of time set winter to summer
674	W2S day	Monday Tuesday Wednesday Thursday Friday Saturday Sunday	Sunday	day of time set winter to summer
675	W2S hour	1 .. 24	2	hour of time set winter to summer
676	S2W month	1 .. 12	10	month of time set summer to winter
677	S2W week	1 .. 5	5	week of time set summer to winter
678	S2W day	Monday Tuesday Wednesday Thursday Friday Saturday Sunday	Sunday	day of time set summer to winter
679	S2W hour	1 .. 24	3	hour of time set summer to winter
700	GOOSE-Stop	YES NO	NO	GOOSE-Stop

2.1.2.4 Information List

No.	Information	Type of Information	Comments
–	>Light on	SP	>Back Light on
–	Reset LED	IntSP	Reset LED
–	DataStop	IntSP	Stop data transmission
–	Test mode	IntSP	Test mode
–	Feeder gnd	IntSP	Feeder GROUNDED
–	Brk OPENED	IntSP	Breaker OPENED
–	HWTestMod	IntSP	Hardware Test Mode
–	SynchClock	IntSP_Ev	Clock Synchronization
–	Distur.CFC	OUT	Disturbance CFC
1	Not configured	SP	No Function configured
2	Non Existent	SP	Function Not Available
3	>Time Synch	SP_Ev	>Synchronize Internal Real Time Clock
5	>Reset LED	SP	>Reset LED

No.	Information	Type of Information	Comments
15	>Test mode	SP	>Test mode
16	>DataStop	SP	>Stop data transmission
51	Device OK	OUT	Device is Operational and Protecting
52	ProtActive	IntSP	At Least 1 Protection Funct. is Active
55	Reset Device	OUT	Reset Device
56	Initial Start	OUT	Initial Start of Device
67	Resume	OUT	Resume
68	Clock SyncError	OUT	Clock Synchronization Error
69	DayLightSavTime	OUT	Daylight Saving Time
70	Settings Calc.	OUT	Setting calculation is running
71	Settings Check	OUT	Settings Check
72	Level-2 change	OUT	Level-2 change
73	Local change	OUT	Local setting change
110	Event Lost	OUT_Ev	Event lost
113	Flag Lost	OUT	Flag Lost
125	Chatter ON	OUT	Chatter ON
140	Error Sum Alarm	OUT	Error with a summary alarm
160	Alarm Sum Event	OUT	Alarm Summary Event
177	Fail Battery	OUT	Failure: Battery empty
178	I/O-Board error	OUT	I/O-Board Error
181	Error A/D-conv.	OUT	Error: A/D converter
191	Error Offset	OUT	Error: Offset
193	Alarm NO calibr	OUT	Alarm: NO calibration data available
194	Error neutralCT	OUT	Error: Neutral CT different from MLFB
232	CT ph mismatch	OUT	LPCT phase Current Transf. mismatching
233	CT gnd mismatch	OUT	LPCT ground Current Transf. mismatching
301	Pow.Sys.Flt.	OUT	Power System fault
302	Fault Event	OUT	Fault Event
303	sens Gnd flt	OUT	sensitive Ground fault
320	Warn Mem. Data	OUT	Warn: Limit of Memory Data exceeded
321	Warn Mem. Para.	OUT	Warn: Limit of Memory Parameter exceeded
322	Warn Mem. Oper.	OUT	Warn: Limit of Memory Operation exceeded
323	Warn Mem. New	OUT	Warn: Limit of Memory New exceeded
335	>GOOSE-Stop	SP	>GOOSE-Stop
502	Relay Drop Out	SP	Relay Drop Out
510	Relay CLOSE	SP	General CLOSE of relay
545	PU Time	VI	Time from Pickup to drop out
546	TRIP Time	VI	Time from Pickup to TRIP
10080	Error Ext I/O	OUT	Error Extension I/O
10081	Error Ethernet	OUT	Error Ethernet
10082	Error Terminal	OUT	Error Current Terminal
10083	Error Basic I/O	OUT	Error Basic I/O

2.1.3 Power System Data 1

2.1.3.1 Functional Description

The device requires certain basic data regarding the protected equipment so that the device can adapt to its desired application. These may be, for instance, nominal power system and transformer data, measured quantity polarities and their physical connections, breaker properties (where applicable) etc. There are also certain parameters that are common to all functions, i.e. not associated with a specific protection, control or monitoring function. The following section discusses these parameters.

2.1.3.2 Setting Notes

General

Some **P.System Data 1** can be entered directly at the device. See Section [2.25 Notes on Device Operation](#) for more information regarding this topic.

In DIGSI double-click **Settings** to open the corresponding dialog box. In doing so, a dialog box with tabs will open under **P.System Data 1** where individual parameters can be configured. The following descriptions are therefore structured according to these tabs.

Rated Frequency (Power System)

The nominal frequency of the system is set under the Address 214 **Rated Frequency**. The factory pre-setting in accordance with the model need only be changed if the device will be employed for a purpose other than that which was planned when ordering.


In the US device versions (ordering data position 10= C), parameter 214 is preset to 60 Hz. 214.

Phase Rotation (Power System)

Address 209 **PHASE SEQ.** is used to change the default phase sequence (**A B C** for clockwise rotation) if your power system permanently has an anti-clockwise phase sequence (**A C B**). A temporary reversal of rotation is also possible using binary inputs (see Section [2.21.2 Setting Notes](#)).

Polarity of Current Transformers (Power System)

At address 201 **CT Starpoint**, the polarity of the wye-connected current transformers is specified (the following figure applies accordingly to two current transformers). This setting determines the measuring direction of the device (forward = line direction). Changing this parameter also results in a polarity reversal of the ground current inputs I_N or I_{NS} .

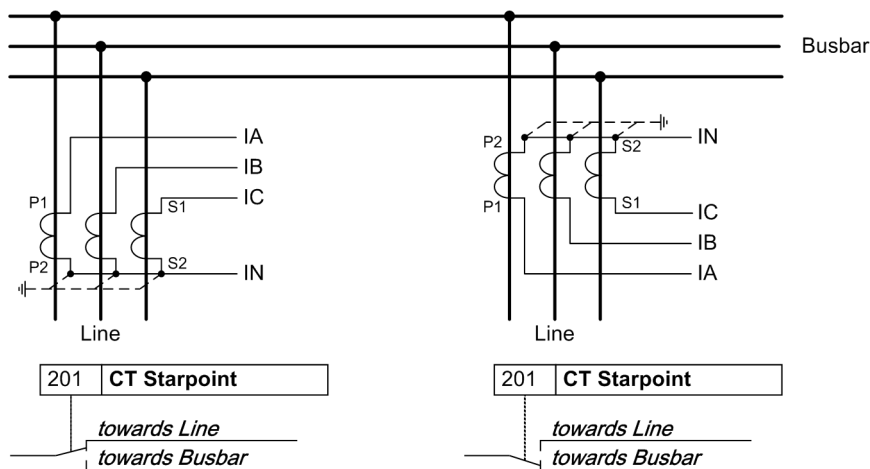

[polung-stromwandler-020313-kn, 1, en, en_US]


Figure 2-2 Polarity of current transformers

Current Connection I4 (Power System)

Here, it is communicated to the device whether the ground current of the current transformer neutral point is connected to the fourth current input (I_4). This corresponds to the Holmgren connection, (see connection example in [C Connection Examples](#)). In this case, parameter 280 **Holmgr. for Σi** is set to **YES**. In all other cases, even if the ground current of the own line is measured via a separate ground current transformer, enter the setting **NO**. This setting exclusively affects the function "Current Sum Monitoring" (see Section [2.11.1 Measurement Supervision](#)).

Current Connection (Power System)

Via parameter 251 **CT Connect.** a special connection of the current transformers can be determined. The standard connection is **A, B, C, (Gnd)**. It may only be changed if the device is set to measure one or more ground currents via two current inputs. The standard connection has to be used in all other cases. The following picture illustrates such a special connection.

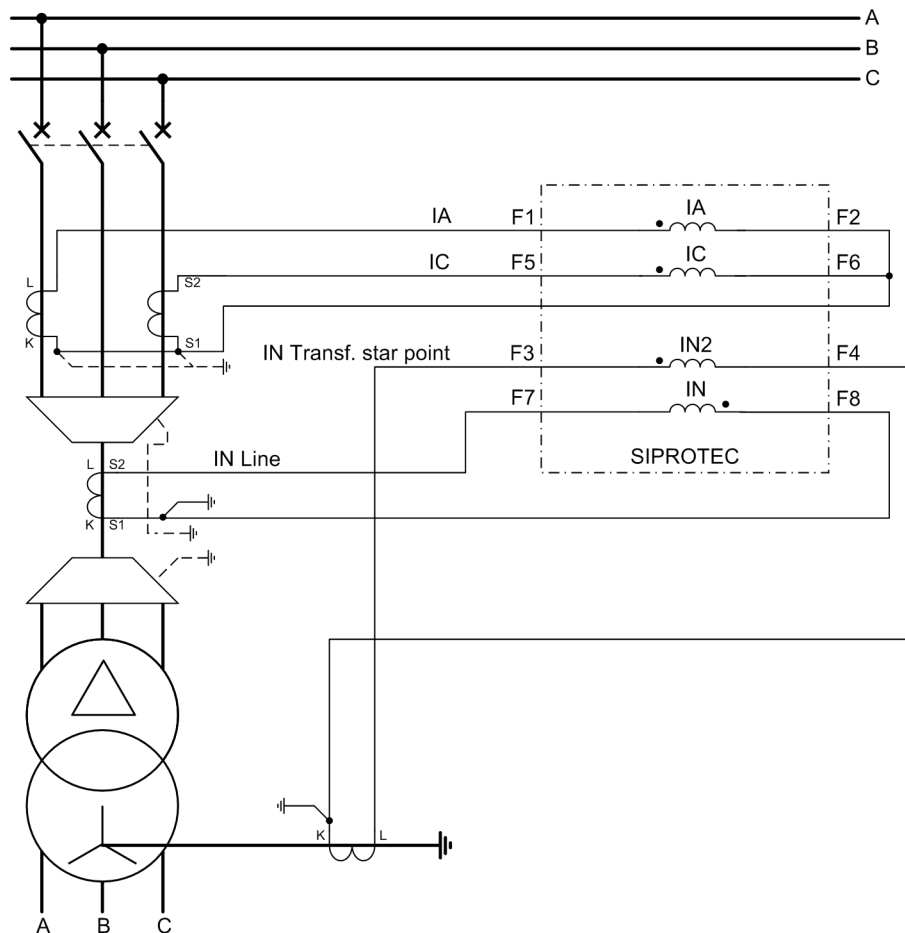

[7sj80-mess-2erdstroeme-20070301, 1, en_US]

Figure 2-3 Measurement of two ground currents, example

The phase currents I_A and I_C must be connected to the first current input (terminals F1, F2) and to the third (terminals F5, F6). The ground current I_N or I_{Ns} is connected to the fourth input (terminals F7, F8) as usual, in this case the ground current of the line. A second ground current, in this case the transformer starpoint current, is connected to the second current input I_{N2} (terminals F3, F4).

The settings **A, G2, C, G; G→B** or **A, G2, C, G; G2→B** are used here. They both define the connection of a ground current I_{N2} to the second current input (terminals F3, F4). The settings only differ in the calculation of I_B . In the case of **A, G2, C, G; G2→B**, the phase current I_B is determined from the phase currents I_A and I_C and

from the measured ground current I_N or I_{Ns} at the fourth current input. In the case of **A, G2, C, G; G2→B**, the phase current I_B is determined from the phase currents I_A and I_C and from the measured ground current I_{N2} at the second current input. This setting is only possible for devices with sensitive ground current transformer. Therefore, the current I_{N2} at the second current input is referred to I_N in the flexible protection functions and in the operational measured values. The sensitive ground current at the fourth current input is referred to I_{Ns} . The setting must be selected according to the system requirements.

The following table gives an overview of how the protection functions are assigned to the ground current inputs for the special connection.

Function	Current input 2 (I_{N2})	Current input 4 (I_N / I_{Ns})
Time overcurrent protection ground 50N/51N (Section 2.2 Overcurrent Protection 50, 51, 50N, 51N)	x	
Directional time overcurrent protection ground 67N (Section 2.3 Directional Overcurrent Protection 67, 67N).	x	
Ground fault detection 64, 67N(s), 50N(s), 51N(s) (Section 2.12 Ground Fault Protection 64, 67N(s), 50N(s), 51N(s))		x
Single-phase Time Overcurrent Protection (Section 2.5 Single-Phase Overcurrent Protection)		x
Operational Measured Values Display	I_N	I_{Ns}
Track in disturbance record	I_N	I_{Ns}

Important! The function "Directional Time Overcurrent Protection Ground 67N" may only be enabled if the ground current of the protected line is measured via I_{N2} . This is not the case in the example shown in [Figure 2-3](#). Here, the ground current of the protected line is measured via I_N . The function must be deactivated. A connection in which the function can be enabled is illustrated in the Appendix [C Connection Examples Figure C-11](#)

The settings for address 251 are only possible with DIGSI at **Display Additional Settings-**

The Appendix provides some connection examples at [C Connection Examples](#).



NOTE

The settings in address 2251 **CT Connect.** for evaluating the phase currents are only effective if address 250 **50/51 2-ph prot** was set to **OFF**.

Voltage Connection (Power System)

Address 213 specifies how the voltage transformers are connected.

VT Connect. 3ph = Van, Vbn, Vcn means that the three phase voltages are wye connected, i.e. the three phase-to-ground voltages are measured.ground.

VT Connect. 3ph = Vab, Vbc, VGnd means that two phase-to-phase voltages (open delta voltage) and the displacement voltage V_{GND} are connected.

VT Connect. 3ph = Vab, Vbc means that two phase-to-phase voltages (open delta voltage) are connected. The third voltage transformer of the device is not used.

VT Connect. 3ph = Vab, Vbc, Vx means that two phase-to-phase voltages (open delta voltage) are connected. Furthermore, any third voltage V_x is connected that is used exclusively for the flexible protection functions. The transformer nominal voltages for V_x are set at address 232 and 233.

VT Connect. 3ph = Vab, Vbc, VSyn means that two phase-to-phase voltages (open delta voltage) and the reference voltage for V_{SYN} are connected. This setting is enabled if the synchronization function of the device is used.

VT Connect. 3ph = Vph-g, VSyn is used if the synchronization function of the device is used and only phase-to-ground voltages are available for the protected object to be synchronized. One of these voltages is

connected to the first voltage transformer; the reference voltage V_{SYN} is connected to the third voltage transformer.

The selection of the voltage transformer connection affects the operation of all device functions that require voltage input.

The settings **Vab**, **Vbc** or **Vab**, **Vbc**, **Vx** or **Vab**, **Vbc**, **VSyn** or **Vph-g**, **VSyn** do not allow determining the zero sequence voltage. The associated protection functions are inactive in this case.

The table gives an overview of the functions that can be activated for the corresponding connection type (depends also on the ordering number). The functions which are not shown are available for all connection types.

Table 2-1 Connection Types of the Voltage Transformers

Connection type	Functions							
	Directional definite time/ inverse time overcurrent protection phase	Directional definite-time/ inverse time overcurrent protection ground	Sensitive ground fault protection 50Ns, 51Ns, 67Ns	Synchroni- zation	Fault locator	QU protec- tion	Direc- tional intermit- tent ground fault	Fuse failure monitor
Van , Vbn , Vcn	yes	yes	yes	no	yes	yes	yes	yes
Vab , Vbc , VGnd	yes	yes	yes	no	yes	yes	yes	yes
Vab , Vbc	yes	yes ¹⁾	yes ²⁾	no	no	yes	no	no
Vab , Vbc , Vx	yes	yes ¹⁾	yes ²⁾	no	no	yes	no	no
Vab , Vbc , VSyn	yes	no	yes ²⁾	yes	no	yes	no	no
Vph-g , VSyn	no	no	yes ²⁾	yes	no	no	no	no
¹⁾ Determination of the direction is only possible by evaluating the negative sequence system (otherwise select zero sequence system or negative sequence system).								
²⁾ With this type of voltage transformer connection the current elements operate only non-directional, the voltage elements do not work.								

With voltage connections **Vab**, **Vbc**, **Vab**, **Vbc**, **Vx** and **Vab**, **Vbc**, **VSyn** the power values are only available if you have symmetrical voltage conditions within the network. In this case, address 207 **Vol**.

Symmetry (Power System Data 1) is set to **YES**. The power values are not available with setting **NO**.

Measured values, which due to the chosen voltage connection cannot be calculated, will be displayed as dots.

The Appendix provides some connection examples for all connection types at [C Connection Examples](#).

Distance Unit (Power System)

Address 215 **Distance Unit** allows you to specify the distance unit (**km** or **Miles**) for the fault locator. In the absence of a fault locator or if this function has been removed, this parameter is of no importance.

Changing the distance unit does not imply an automatic conversion of the setting values that are dependent on the distance unit. These have to be re-entered at the respective addresses.

ATEX100 (Power System)

Parameter 235 **ATEX100** enables meeting the requirements for protecting explosion-protected motors for thermal replicas. Set this parameter to **YES** to save all thermal replicas of the 7SJ80 devices in the event of a power supply failure. After the supply voltage is restored, the thermal replicas will resume operation using the stored values. Set the parameter to **NO**, to reset the calculated overtemperature values of all thermal replicas to zero if the power supply fails.

Nominal Values of Current Transformers (CTs)

At addresses 204 **CT PRIMARY** and 205 **CT SECONDARY**, information is entered regarding the primary and secondary ampere ratings of the current transformers. It is important to ensure that the rated secondary current of the current transformer matches the rated current of the device, otherwise the device will calculate incorrect primary data. At addresses 217 **I_{gnd}-CT PRIM** and 218 **I_{gnd}-CT SEC**, information is entered regarding the primary and secondary ampere rating of the current transformer. In case of a normal connection (neutral point current connected to I_N transformer), 217 **I_{gnd}-CT PRIM** and 204 **CT PRIMARY** must be set to the same value.

If the device features a sensitive ground current input, parameter 218 **I_{gnd}-CT SEC** is set to 1 A by default. In this case, the setting cannot be changed.

For US device models (order item 10= C) parameters 205 and 218 are set by default to 5 A..

If address 251 has been set so that ground currents are measured by two inputs (setting options **A, G2, C, G; G->B** or **A, G2, C, G; G2->B**), you have to set the primary rated current of the second ground transformer connected to I_{N2} at address 238. secondary ampere rating must conform with the phase current transformer.

To calculate the phase current I_B correctly, the primary rated current of the ground current transformer, which is used to calculate I_B (address 217 or address 238), must be smaller than the primary rated current of the phase current transformer (address 204).

Nominal Values of Voltage Transformers (VTs)

At addresses 202 **V_{nom} PRIMARY** and 203 **V_{nom} SECONDARY**, information is entered regarding the primary nominal voltage and secondary nominal voltage (phase-to-phase) of the connected voltage transformers.

Transformation Ratio of Voltage Transformers (VTs)

Address 206 **V_{ph} / V_{delta}** informs the device of the adjustment factor between the phase voltage and the displacement voltage. This information is relevant for the processing of ground faults (in grounded systems and ungrounded systems), for the operational measured value V_N and measured-variable monitoring.

If the voltage transformer set provides open delta windings and if these windings are connected to the device, this must be specified accordingly in address 213 (see above margin heading "Voltage Connection"). Since the voltage transformer ratio is normally as follows:

$$\frac{V_{\text{nomPrimary}}}{\sqrt{3}} / \frac{V_{\text{nomSecondary}}}{\sqrt{3}} / \frac{V_{\text{nomSecondary}}}{3}$$

[fo_uebersetzung-spannungswandler, 1, en_US]

the factor V_{ph}/V_N (secondary voltage, address 206 **V_{ph} / V_{delta}**) must be set to $3/\sqrt{3} = \sqrt{3} = 1.73$ which must be used if the VN voltage is connected. For other transformation ratios, i.e. the formation of the displacement voltage via an interconnected transformer set, the factor must be corrected accordingly. Please take into consideration that also the calculated secondary V_o-voltage is divided by the value set in address 206. Thus, even if the V_o-voltage is not connected, address 206 has an impact on the secondary operational measured value V_N.

If **V_{ab}**, **V_{bc}**, **V_{gnd}** is selected as voltage connection type, parameter **V_{ph} / V_{delta}** is used to calculate the phase-to-ground voltages and is therefore important for the protection function. With voltage connection type **V_{an}**, **V_{bn}**, **V_{cn}**, this parameter is used only to calculate the operational measured value of the secondary voltage V_N.

Trip and Close Command Duration (Breaker)

In address 210 the minimum trip command duration **T_{min} TRIP CMD** is set. This setting applies to all protection functions that can initiate tripping.

In address 211 the maximum close command duration **T_{max} CLOSE CMD** is set. It applies to the integrated reclosing function. It must be set long enough to ensure that the circuit breaker has securely closed. An excessive duration causes no problem since the closing command is interrupted in the event another trip is initiated by a protection function.

Current Flow Monitoring (Breaker)

In address 212 **BkrClosed I MIN** the pickup threshold of the integrated current flow monitoring function can be set. This parameter is used by several protection functions (e.g. voltage protection with current criterion, overload protection and circuit breaker maintenance). If the set current value is exceeded, the circuit breaker is considered closed.

The threshold value setting applies to all three phases, and must take into consideration all used protection functions.

The pickup threshold for the breaker failure protection is set separately (see [2.17.2 Setting Notes](#)).

Circuit-breaker Maintenance (Breaker)

Parameters 260 to 267 are assigned to CB maintenance. The parameters and the different procedures are explained in the setting notes of this function (see Section [2.23.2 Statistics](#)).

Pickup Thresholds of the Binary Inputs (Thresholds BI)

At address 220 **Threshold BI 1** to 226 **Threshold BI 7** you can set the pickup thresholds of the binary inputs of the device. The settings **Thresh. BI 176V**, **Thresh. BI 88V** or **Thresh. BI 19V** are possible.

Two-phase Time Overcurrent Protection (Protection Operating Quantities)

The two-phase overcurrent protection functionality is used in grounded or compensated systems where interaction of three-phase devices with existing two-phase protection equipment is required. Via parameter 250 **50/51 2-ph prot** the time overcurrent protection can be configured to two or three-phase operation. If the parameter is set to **ON**, the value 0 A instead of the measured value for I_b is used permanently for the threshold comparison so that no pickup is possible in phase B. All other functions, however, operate in three phases.

Ground Fault Protection (Protection Operating Quantities)

Parameter 613 **50N/51N/67N w.** defines whether ground fault protection, breaker failure protection or Fuse Failure Monitor is either to operate using measured values (**I_{gnd} (measured)**) or the quantities calculated from the three phase currents (**3I₀ (calcul.)**). In the first case, the measured quantity at the fourth current input is evaluated. In the latter case, the summation current is calculated from the three phase current inputs. If the device features a sensitive ground current input (measuring range starts at 1 mA), the ground fault protection always uses the calculated variable 3I₀. In this case, parameter 613 **50N/51N/67N w.** is not available.

Voltage Protection (Protection Operating Quantities)

In a three-phase connection, the fundamental harmonic of the largest of the three phase-to-phase voltages (**V_{phph}**) or phase-ground voltages (**V_{ph-n}**) or the positive sequence voltage (**V₁**) or the negative sequence voltage (**V₂**) is supplied to the overvoltage protection elements. In three-phase connection, undervoltage protection relies either on the positive sequence voltage (**V₁**) or the smallest of the phase-to-phase voltages (**V_{phph}**) or the phase-to-ground voltages (**V_{ph-n}**). This is configured by setting the parameter value in address 614 **OP. QUANTITY 59** and 615 **OP. QUANTITY 27**.

With single-phase voltage transformers, a direct comparison of the measured quantities with the threshold values is carried out and the parameterization of the characteristic quantity switchover is ignored.



NOTE

If parameter 213 **VT Connect. 3ph** is set to **V_{ph-g}**, **V_{Syn}**, the voltage measured by voltage transformer 1 is always used for voltage protection. Then parameters 614 and 615 are not available.



NOTE

If parameter 213 **VT Connect. 3ph** is set to **V_{ab}**, **V_{bc}**, **V_{Syn}** or **V_{ab}**, **V_{bc}** or **V_{ab}**, **V_{bc}**, **V_x**, the setting option **V_{ph-n}** for parameter 614 and 615 is not available.

2.1.3.3 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
201	CT Starpoint		towards Line towards Busbar	towards Line	CT Starpoint
202	Vnom PRIMARY		0.10 .. 800.00 kV	20.00 kV	Rated Primary Voltage
203	Vnom SECONDARY		34 .. 225 V	100 V	Rated Secondary Voltage (L-L)
204	CT PRIMARY		10 .. 50000 A	400 A	CT Rated Primary Current
205	CT SECONDARY		1A 5A	1A	CT Rated Secondary Current
206A	Vph / Vdelta		1.00 .. 3.00	1.73	Matching ratio Phase-VT To Open-Delta-VT
207	Vol. Symmetry		NO YES	NO	Assumption voltage symmetry
209	PHASE SEQ.		A B C A C B	A B C	Phase Sequence
210A	TMin TRIP CMD		0.01 .. 32.00 sec	0.15 sec	Minimum TRIP Command Duration
211A	TMax CLOSE CMD		0.01 .. 32.00 sec	1.00 sec	Maximum Close Command Duration
212	BkrClosed I MIN	1A	0.04 .. 1.00 A	0.04 A	Closed Breaker Min. Current Threshold
		5A	0.20 .. 5.00 A	0.20 A	
213	VT Connect. 3ph		Van, Vbn, Vcn Vab, Vbc, VGnd Vab, Vbc, VSyn Vab, Vbc Vph-g, VSyn Vab, Vbc, Vx	Van, Vbn, Vcn	VT Connection, three-phase
214	Rated Frequency		50 Hz 60 Hz	50 Hz	Rated Frequency
215	Distance Unit		km Miles	km	Distance measurement unit
217	Ignd-CT PRIM		1 .. 50000 A	60 A	Ignd-CT rated primary current
218	Ignd-CT SEC		1A 5A	1A	Ignd-CT rated secondary current
220	Threshold BI 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 1
221	Threshold BI 2		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 2
222	Threshold BI 3		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 3

Addr.	Parameter	C	Setting Options	Default Setting	Comments
223	Threshold BI 4		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 4
224	Threshold BI 5		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 5
225	Threshold BI 6		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 6
226	Threshold BI 7		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 7
227	Threshold BI 8		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 8
228	Threshold BI 9		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 9
229	Threshold BI 10		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 10
230	Threshold BI 11		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 11
232	VXnom PRIMARY		0.10 .. 800.00 kV	20.00 kV	Rated Primary Voltage X
233	VXnom SECONDARY		100 .. 225 V	100 V	Rated Secondary Voltage X
235A	ATEX100		NO YES	YES	Storage of th. Replicas w/o Power Supply
238	Ignd2-CT PRIM.		1 .. 50000 A	400 A	Ignd2-CT rated primary c. (conn. to I2)
239	Ignd2-CT SEC.		1A 5A	1A	Ignd2-CT rated secondary current (I2)
250A	50/51 2-ph prot		OFF ON	OFF	50, 51 Time Overcurrent with 2ph. prot.
251A	CT Connect.		A, B, C, (Gnd) A,G2,C,G; G->B A,G2,C,G; G2->B	A, B, C, (Gnd)	CT Connection
252	Ph LPCT pol.		not reversed reversed	not reversed	Phase LPCT orientation / polarity
260	Ir-52		10 .. 50000 A	125 A	Rated Normal Current (52 Breaker)
261	OP.CYCLES AT Ir		100 .. 1000000	10000	Switching Cycles at Rated Normal Current
262	Isc-52		10 .. 100000 A	25000 A	Rated Short-Circuit Breaking Current
263	OP.CYCLES Isc		1 .. 1000	50	Switch. Cycles at Rated Short-Cir. Curr.
264	Ix EXPONENT		1.0 .. 3.0	2.0	Exponent for the Ix-Method

Addr.	Parameter	C	Setting Options	Default Setting	Comments
265	Cmd.via control		(Setting options depend on configuration)	none	52 B.Wear: Open Cmd. via Control Device
266	T 52 BREAKTIME		1 .. 600 ms	80 ms	Breaktime (52 Breaker)
267	T 52 OPENING		1 .. 500 ms	65 ms	Opening Time (52 Breaker)
280	Holmgr. for Σi		NO YES	NO	Holmgreen-conn. (for fast sum-i-monit.)
310	Iph-PRIM ref.		10 .. 50000 A	400 A	Primary refer. phase current for prot.
311	Iph-LPCT PRIM		1 .. 5000 A	400 A	Rated primary phase current LPCT
312	Ignd-PRIM ref.		1 .. 50000 A	60 A	Primary refer. ground current for prot.
313	Ignd-LPCT PRIM		0.01 .. 5000.00 A	2.00 A	Rated primary ground current LPCT
314	Vph-LPCT SEC		10.0 .. 1000.0 mV	225.0 mV	Rated secondary phase voltage LPCT
315	Vgnd-LPCT SEC		10.0 .. 1000.0 mV	225.0 mV	Rated secondary ground voltage LPCT
320A	Corr.factor IL1		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IL1
321A	Corr.factor IL2		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IL2
322A	Corr.factor IL3		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IL3
323A	Corr.factor IE		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IE
324A	Corr.factor IEE		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IEE
330	V-LPVT SEC		3.00 .. 17.00 V	3.25 V	rated secondary voltage LPVT
332A	V-LPVT PHA		-10.00 .. 10.00 °	0.00 °	phase angle LPVT
613A	Gnd O/Cprot. w.		Ignd (measured) 3I0 (calcul.)	Ignd (measured)	Ground Overcurrent protection with
614A	OP. QUANTITY 59		Vphph Vph-n V1 V2	Vphph	Opera. Quantity for 59 Overvolt. Prot.
615A	OP. QUANTITY 27		V1 Vphph Vph-n	V1	Opera. Quantity for 27 Undervolt. Prot.
616	STATIC GEN.		YES NO	NO	Static or non self-exc. Asyn. Generator

2.1.3.4 Information List

No.	Information	Type of Information	Comments
5145	>Reverse Rot.	SP	>Reverse Phase Rotation
5147	Rotation ABC	OUT	Phase rotation ABC
5148	Rotation ACB	OUT	Phase rotation ACB

2.1.4 Oscillographic Fault Records

The Multifunctional Protection with Control 7SJ80 is equipped with a fault record memory. The instantaneous values of the measured values

$i_A, i_B, i_C, i_N, i_{N5}$ and $v_A, v_B, v_C, v_{A2}, v_{B3}, v_{C1}, v_N, v_X, v_{ph-n}, v_{SYN}$

(voltages depending on connection) are sampled at intervals of 1.0 ms (at 50 Hz) and stored in a revolving buffer (20 samples per cycle). In the event of a fault, the data are recorded for a set period of time, but not for more than 5 seconds. A maximum of 8 faults can be recorded in this buffer. The fault record memory is automatically updated with every new fault, so no acknowledgment for previously recorded faults is required. In addition to protection pickup, the recording of the fault data can also be started via a binary input or via the serial interface.

2.1.4.1 Functional Description

The data of a fault event can be read out via the device interface and evaluated with the help of the SIGRA 4 graphic analysis software. SIGRA 4 graphically represents the data recorded during the fault event and also calculates additional information from the measured values. Currents and voltages can be presented either as primary or as secondary values. Signals are additionally recorded as binary tracks (marks), e.g. "pickup", "trip". If port B of the device has been configured correspondingly, the fault record data can be imported by a central controller via this interface and evaluated. Currents and voltages are prepared for a graphic representation. Signals are additionally recorded as binary tracks (marks), e.g. "pickup", "trip".

The retrieval of the fault data by the central controller takes place automatically either after each protection pickup or after a tripping.

If device parameter 651 **ParEN100 (LC) blk** is set to **ON**, you can also read out fault records via port A (see Section 2.1.2.2 [Setting Notes](#)).

Depending on the selected type of connection of the voltage transformers (address 213 **VT Connect. 3ph**), the following measured values are recorded in the fault record:

	Voltage connection					
	V_{an}, V_{bn}, V_{cn}	V_{ab}, V_{bc}, V_{Gnd}	V_{ab}, V_{bc}	V_{ab}, V_{bc}, V_x	V_{ab}, V_{bc}, V_{Syn}	V_{ph-g}, V_{Syn}
V_{AB}	yes	yes	yes	yes	yes	
V_{BC}	yes	yes	yes	yes	yes	
V_{CA}	yes	yes	yes	yes	yes	
V_A	yes	yes				
V_B	yes	yes				
V_C	yes	yes				
V						yes
V_{en}	yes	yes				
V_{SYN}					yes	yes
V_x				yes		



NOTE

The signals used for the binary tracks can be allocated in DIGSI.



NOTE

If one of the current transformer connection types **A, G2, C, G; G→B** or **A, G2, C, G; G2→B** has been selected via parameter 251 **CT Connect.**, the ground current I_{N2} measured with the second current transformer is indicated under track I_N . The ground current detected by the fourth current transformer is indicated under track I_{Ns} .

2.1.4.2 Setting Notes

Configuration

Fault recording (waveform capture) will only take place if address 104 **OSC. FAULT REC.** is set to **Enabled**. Other settings pertaining to fault recording (waveform capture) are found in the **Osc. Fault Rec.** submenu of the **SETTINGS** menu. Waveform capture makes a distinction between the trigger instant for an oscillographic record and the criterion to save the record (address 401 **WAVEFORMTRIGGER**). Normally, the trigger is the pickup of a protection element, i.e. the time 0 is defined as the instant the first protection function picks up. The criterion for saving may be both the device pickup (**Save w. Pickup**) or the device trip (**Save w. TRIP**). A trip command issued by the device can also be used as trigger instant (**Start w. TRIP**), in this case it is also the saving criterion.

A fault event starts with the pickup by any protection function and ends when the last pickup of a protection function has dropped out. Usually this is also the extent of a fault recording (address 402 **WAVEFORM DATA = Fault event**). If automatic reclosing is performed, the entire system fault — with several reclosing attempts if necessary — can be recorded until the fault has been cleared for good (address 402 **WAVEFORM DATA = Pow.Sys.Flt.**). This facilitates the representation of the entire system fault history, but also consumes storage capacity during the automatic reclosing dead time(s).

The actual storage time begins at the pre-fault time **PRE. TRIG. TIME** (address 404) ahead of the reference instant, and ends at the post-fault time **POST REC. TIME** (address 405) after the storage criterion has reset. The maximum storage duration of each fault record (**MAX. LENGTH**) is entered at address 403. Recording per fault must not exceed 5 seconds. In maximum 8 records can be saved altogether with a maximum total time of 18 s.

An oscillographic record can be triggered by a status change of a binary input, or from a PC via the operator interface. Storage is then triggered dynamically. The length of the fault recording is set in address 406 **BinIn CAPT. TIME** (but not longer than **MAX. LENGTH**, address 403). Pre-fault and post-fault times will add to this. If the binary input time is set to ∞ , the length of the record equals the time that the binary input is activated (static), but not longer than the **MAX. LENGTH** (address 403).

2.1.4.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
401	WAVEFORMTRIGGER	Save w. Pickup Save w. TRIP Start w. TRIP	Save w. Pickup	Waveform Capture
402	WAVEFORM DATA	Fault event Pow.Sys.Flt.	Fault event	Scope of Waveform Data
403	MAX. LENGTH	0.30 .. 5.00 sec	2.00 sec	Max. length of a Waveform Capture Record
404	PRE. TRIG. TIME	0.05 .. 0.50 sec	0.25 sec	Captured Waveform Prior to Trigger
405	POST REC. TIME	0.05 .. 0.50 sec	0.10 sec	Captured Waveform after Event
406	BinIn CAPT.TIME	0.10 .. 5.00 sec; ∞	0.50 sec	Capture Time via Binary Input

2.1.4.4 Information List

No.	Information	Type of Information	Comments
–	FltRecSta	IntSP	Fault Recording Start
4	>Trig.Wave.Cap.	SP	>Trigger Waveform Capture
203	Wave. deleted	OUT_Ev	Waveform data deleted
30053	Fault rec. run.	OUT	Fault recording is running

2.1.5 Settings Groups

Up to four different setting groups can be created for establishing the device's function settings.

Applications

- Setting groups enable the user to save the corresponding settings for each application so that they can be quickly called up when required. All setting groups are stored in the device. Only one setting group may be active at a time.

2.1.5.1 Functional Description

Changing Setting Groups

During operation the user can switch back and forth setting groups locally, via the operator panel, binary inputs (if so configured), the service interface using a personal computer, or via the system interface. For reasons of safety it is not possible to change between setting groups during a power system fault.

A setting group includes the setting values for all functions that have been selected as **Enabled** during configuration (see Section [2.1.1.2 Setting Notes](#)). In 7SJ80 relays, four independent setting groups (A to D) are available. While setting values may vary, the selected functions of each setting group remain the same.

2.1.5.2 Setting Notes

General

If setting group change option is not required, Group A is the default selection. Then, the rest of this section is not applicable.

If the changeover option is desired, group changeover must be set to **Grp Chge OPTION = Enabled** (address 103) when the function extent is configured. For the setting of the function parameters, each of the required setting groups A to D (a maximum of 4) must be configured in sequence. The SIPROTEC 4 System Description gives further information on how to copy setting groups or reset them to their status at delivery and also how to change from one setting group to another.

Section [3.1 Mounting and Connections](#) of this manual tells you how to change between several setting groups externally via binary inputs.

2.1.5.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
302	CHANGE	Group A Group B Group C Group D Binary Input Protocol	Group A	Change to Another Setting Group

2.1.5.4 Information List

No.	Information	Type of Information	Comments
–	P-GrpA act	IntSP	Setting Group A is active
–	P-GrpB act	IntSP	Setting Group B is active
–	P-GrpC act	IntSP	Setting Group C is active
–	P-GrpD act	IntSP	Setting Group D is active
7	>Set Group Bit0	SP	>Setting Group Select Bit 0
8	>Set Group Bit1	SP	>Setting Group Select Bit 1

2.1.6 Power System Data 2

2.1.6.1 Functional Description

The general protection data (**P.System Data 2**) include settings associated with all functions rather than a specific protection or monitoring function. In contrast to the **P.System Data 1** as discussed before, they can be changed with the setting group.

Applications

When the primary reference voltage and the primary reference current of the protected object are set, the device is able to calculate and output the operational measured value percentage.

For purposes of fault location, a maximum of three different line sections can be considered.

2.1.6.2 Setting Notes

Definition of Nominal Rated Values

At addresses 1101 **FullScaleVolt.** and 1102 **FullScaleCurr.**, the primary reference voltage (phaseto-phase) and reference current (phase) of the protected equipment is entered. If these reference sizes match the primary nominal values of the VTs and CTs, they correspond to the settings in address 202 and 204 (Section [2.1.3.2 Setting Notes](#)). They are generally used to show values referenced to full scale.

Ground Impedance Ratios (only for Fault Location)

The adjustment of the ground impedance ratio is only important for the utilization of the line fault location function. This is done by entering the resistance ratio **RE/RL** and the reactance ratio **XE/XL**.

The values under addresses 1103 and 1104 apply if only one line section is available and to all faults that occur outside the defined line sections.

If several line sections are set, the following shall apply:

- for line section 1, addresses 6001 and 6002
- for line section 1, addresses 6011 and 6012
- for line section 1, addresses 6021 and 6022.

Resistance ratio **RE/RL** and reactance ratio **XE/XL** are calculated formally and do not correspond to the real and imaginary components of $\underline{Z}_E/\underline{Z}_L$. No complex calculation is required! The ratios can be obtained from the line data using the following formulas:

$$\frac{R_G}{R_L} = \frac{1}{3} \cdot \left(\frac{R_0}{R_1} - 1 \right) \qquad \frac{X_G}{X_L} = \frac{1}{3} \cdot \left(\frac{X_0}{X_1} - 1 \right)$$

[fo_fehlerort, 1, en_US]

Where

R_0	– Zero sequence resistance of the line
X_0	– Zero sequence reactance of the line
R_1	– Positive sequence resistance of the line
X_1	– Positive sequence reactance of the line

This data can be used for the entire line or line section, or as distance-related values, since the quotients are independent of the distance.

Calculation example:

20 kV free line 120 mm² with the following data:

$R_0/s = 0.88 \text{ } \Omega/\text{km}$ (1.42 Ω/mile)	Zero sequence resistance
$X_0/s = 1.26 \text{ } \Omega/\text{km}$ (2.03 Ω/mile)	Zero sequence reactance
$R_1/s = 0.24 \text{ } \Omega/\text{km}$ (0.39 Ω/mile)	Positive sequence resistance
$X_1/s = 0.34 \text{ } \Omega/\text{km}$ (0.55 Ω/mile)	Positive sequence reactance

For ground impedance ratios, the following results:

$$\frac{R_{\text{Gnd}}}{R_{\text{Ph}}} = \frac{1}{3} \cdot \left(\frac{R_0}{R_1} - 1 \right) = \frac{1}{3} \cdot \left(\frac{0.88 \text{ } \Omega/\text{km}}{0.24 \text{ } \Omega/\text{km}} - 1 \right) = 0.89$$

$$\frac{X_{\text{Gnd}}}{X_{\text{Ph}}} = \frac{1}{3} \cdot \left(\frac{X_0}{X_1} - 1 \right) = \frac{1}{3} \cdot \left(\frac{1.26 \text{ } \Omega/\text{km}}{0.34 \text{ } \Omega/\text{km}} - 1 \right) = 0.90$$

[fo_formfehl, 1, en_US]

Reactance per Unit Length (only for Fault Location)

The setting of the reactance per unit length is only important for the utilization of the line fault location function. The reactance setting enables the protective relay to indicate the fault location in terms of distance.

The reactance value X' is entered as a reference value x' , i.e. in Ω/mile if set to distance unit **Miles** (address 215, see Section 2.1.3.2 [Setting Notes](#) under "Distance Unit") or in Ω/km if set to distance unit **km**. If, after having entered the reactance per unit length, the distance unit is changed under address 215, the reactance per unit length must be reconfigured in accordance with the new distance unit.

The values under address 1106 (**km**) or 1105 (**Miles**) apply if only one line section is available and to all faults that occur outside the defined line sections.

If several line sections are set, the following shall apply:

- for line section 1, addresses 6004(**km**) or 6003 (**Miles**)
- for line section 2, addresses 6014 (**km**) or 6013 (**Miles**),
- for line section 3, addresses 6024 (**km**) or 6023 (**Miles**).

When setting the parameters in DIGSI, the values can also be entered as primary values. In that case the following conversion to secondary values is not required.

For the conversion of primary values to secondary values the following applies in general:

$$Z_{\text{secondary}} = \frac{\text{Current-Transformer-Ratio}}{\text{Voltage-Transformer-Ration}} \cdot Z_{\text{primary}}$$

[fo_zsekundaer, 1, en_US]

Likewise, the following applies to the reactance per unit length of a line:

$$X'_{\text{sec}} = \frac{N_{\text{CTR}}}{N_{\text{VTR}}} \cdot X'_{\text{prim}}$$

[fo_xsekundaer, 1, en_US]

with

N_{CTR}	— Transformation ratio of the current transformer
N_{VTR}	— Transformation ratio of the voltage transformer

Calculation example:

In the following, the same line as illustrated in the example for ground impedance ratios (above) and additional data on the voltage transformers will be used:

Current Transformers	500 A/5 A
Voltage Transformers	20 kV/0.1 kV

The secondary reactance per unit length is calculated as follows:

$$X'_{\text{sec}} = \frac{N_{CTR}}{N_{CTR}} \cdot X'_{\text{prim}} = \frac{500 \text{ A}/5 \text{ A}}{20 \text{ kV}/0.1 \text{ kV}} \cdot 0.34 \text{ } \Omega/\text{km} = 0.170 \text{ } \Omega/\text{km}$$

[xsekund-beispiel-260602-kn, 1, en_US]

Line Angle (only for Fault Location)

The setting of the line angle is only important for the utilization of the line fault location function. The line angle can be derived from the line constants. The following applies:

$$\tan \varphi = \frac{X_L}{R_L} \quad \text{or} \quad \varphi = \arctan\left(\frac{X_L}{R_L}\right)$$

[fo_allg-ltgdaten-1-oz, 1, en_US]

with R_L being the ohmic resistance and X_L being the reactance of the line.

The value under address 1109 applies if only one line section is available and to all faults that occur outside the defined line sections.

If several line sections are set, the following shall apply:

- for line section 1, address 6005
- for line section 2, address 6015
- for line section 3, address 6025

This data can be used for the entire line or line section, or as distance-related values, since the quotients are independent of the distance. It is also irrelevant whether the quotients were derived from primary or secondary values.

Calculation Example::

110 kV free line 150 mm² with the following data:

$$R'_1 = 0.19 \text{ } \Omega/\text{km} \text{ (0.31 } \Omega/\text{mile)}$$

$$X'_1 = 0.42 \text{ } \Omega/\text{km} \text{ (0.69 } \Omega/\text{mile)}$$

The line angle is calculated as follows:

$$\tan \varphi = \frac{X_L}{R_L} = \frac{X'_1}{R'_1} = \frac{0.42 \text{ } \Omega/\text{mile}}{0.19 \text{ } \Omega/\text{mile}} = 2.21 \quad \varphi = 65.7^\circ$$

[formel-allg-ltgdaten-2-oz-310702, 1, en_US]

The respective address must be set to **Line angle = 66°**.

Line Length (only for Fault Location)

The setting of the line length is only important for the utilization of the line fault location function. The line length is required so that the fault location can be given as a reference value (in %). Furthermore, when using several line sections, the respective length of the individual sections is defined.

The values under address 1110 (**km**) or 1111 (**Miles**) apply if only one line section is available and to all faults that occur outside the defined line sections.

If several line sections are set, the following shall apply:

- for line section 1, addresses 6006 (**km**) or 6007 (**Miles**)
- for line section 2, addresses 6016 (**km**) or 6017 (**Miles**)
- for line section 3, addresses 6026 (**km**) or 6027 (**Miles**)

The length set for the entire line must correspond to the sum of lengths configured for the line sections. A deviation of 10% max. is admissible.

Operating Range of the Overload Protection

The current threshold entered in address 1107 **I MOTOR START** limits the operating range of the overload protection to larger current values. The thermal replica is kept constant for as long as this threshold is exceeded.

Inverting Power Measured Values/Metered Values

The directional values (power, power factor, work and related min., max., mean and setpoint values), calculated in the operational measured values, are usually defined a positive in the direction of the protected object. This requires that the connection polarity for the entire device was configured accordingly in the **P.System Data 1** (compare also "Polarity of the Current Transformers", address 201). But it is also possible to make different settings for the "forward" direction for the protection functions and the positive direction for the power etc., e.g. to have the active power supply (from the line to the busbar) displayed positively. To do so, set address 1108 **P,Q sign** to **reversed**. If the setting is **not reversed** (default), the positive direction for the power etc. corresponds to the "forward" direction for the protection functions. Section [4 Technical Data](#) provides a detailed list of the values in question.

2.1.6.3 Settings

The table indicates region-specific presettings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
1101	FullScaleVolt.		0.10 .. 800.00 kV	20.00 kV	Measurment:FullScale-Voltage(Equipm.rating)
1102	FullScaleCurr.		10 .. 50000 A	400 A	Measurment:FullScaleCurrent(Equipm.rating)
1103	RE/RL		-0.33 .. 7.00	1.00	Zero seq. compensating factor RE/RL
1104	XE/XL		-0.33 .. 7.00	1.00	Zero seq. compensating factor XE/XL
1105	x'	1A	0.0050 .. 15.0000 Ω/mi	0.2420 Ω/mi	feeder reactance per mile: x'
		5A	0.0010 .. 3.0000 Ω/mi	0.0484 Ω/mi	
1106	x'	1A	0.0050 .. 9.5000 Ω/km	0.1500 Ω/km	feeder reactance per km: x'
		5A	0.0010 .. 1.9000 Ω/km	0.0300 Ω/km	
1107	I MOTOR START	1A	0.40 .. 10.00 A	2.50 A	Motor Start Current (Block 49, Start 48)
		5A	2.00 .. 50.00 A	12.50 A	
1108	P,Q sign		not reversed reversed	not reversed	P,Q operational measured values sign
1109	Line angle		10 .. 89 °	85 °	Line angle
1110	Line length		0.1 .. 1000.0 km	100.0 km	Line length in kilometer
1111	Line length		0.1 .. 650.0 Miles	62.1 Miles	Line length in miles
6001	S1: RE/RL		-0.33 .. 7.00	1.00	S1: Zero seq. compensating factor RE/RL
6002	S1: XE/XL		-0.33 .. 7.00	1.00	S1: Zero seq. compensating factor XE/XL

Addr.	Parameter	C	Setting Options	Default Setting	Comments
6003	S1: x'	1A	0.0050 .. 15.0000 Ω/mi	0.2420 Ω/mi	S1: feeder reactance per mile: x'
		5A	0.0010 .. 3.0000 Ω/mi	0.0484 Ω/mi	
6004	S1: x'	1A	0.0050 .. 9.5000 Ω/km	0.1500 Ω/km	S1: feeder reactance per km: x'
		5A	0.0010 .. 1.9000 Ω/km	0.0300 Ω/km	
6005	S1: Line angle		10 .. 89 °	85 °	S1: Line angle
6006	S1: Line length		0.1 .. 650.0 Miles	62.1 Miles	S1: Line length in miles
6007	S1: Line length		0.1 .. 1000.0 km	100.0 km	S1: Line length in kilometer
6011	S2: RE/RL		-0.33 .. 7.00	1.00	S2: Zero seq. compensating factor RE/RL
6012	S2: XE/XL		-0.33 .. 7.00	1.00	S2: Zero seq. compensating factor XE/XL
6013	S2: x'	1A	0.0050 .. 15.0000 Ω/mi	0.2420 Ω/mi	S2: feeder reactance per mile: x'
		5A	0.0010 .. 3.0000 Ω/mi	0.0484 Ω/mi	
6014	S2: x'	1A	0.0050 .. 9.5000 Ω/km	0.1500 Ω/km	S2: feeder reactance per km: x'
		5A	0.0010 .. 1.9000 Ω/km	0.0300 Ω/km	
6015	S2: Line angle		10 .. 89 °	85 °	S2: Line angle
6016	S2: Line length		0.1 .. 650.0 Miles	62.1 Miles	S2: Line length in miles
6017	S2: Line length		0.1 .. 1000.0 km	100.0 km	S2: Line length in kilometer
6021	S3: RE/RL		-0.33 .. 7.00	1.00	S3: Zero seq. compensating factor RE/RL
6022	S3: XE/XL		-0.33 .. 7.00	1.00	S3: Zero seq. compensating factor XE/XL
6023	S3: x'	1A	0.0050 .. 15.0000 Ω/mi	0.2420 Ω/mi	S3: feeder reactance per mile: x'
		5A	0.0010 .. 3.0000 Ω/mi	0.0484 Ω/mi	
6024	S3: x'	1A	0.0050 .. 9.5000 Ω/km	0.1500 Ω/km	S3: feeder reactance per km: x'
		5A	0.0010 .. 1.9000 Ω/km	0.0300 Ω/km	
6025	S3: Line angle		10 .. 89 °	85 °	S3: Line angle
6026	S3: Line length		0.1 .. 650.0 Miles	62.1 Miles	S3: Line length in miles
6027	S3: Line length		0.1 .. 1000.0 km	100.0 km	S3: Line length in kilometer

2.1.6.4 Information List

No.	Information	Type of Information	Comments
126	ProtON/OFF	IntSP	Protection ON/OFF (via system port)
356	>Manual Close	SP	>Manual close signal
466.4010	Cmd Trip	IntSP	Trip via control command
501	Relay PICKUP	OUT	Relay PICKUP
511	Relay TRIP	OUT	Relay GENERAL TRIP command
533	Ia =	VI	Primary fault current Ia
534	Ib =	VI	Primary fault current Ib
535	Ic =	VI	Primary fault current Ic
561	Man.Clos.Detect	OUT	Manual close signal detected
2720	>Enable ANSI#-2	SP	>Enable 50/67-(N)-2 (override 79 blk)
4601	>52-a	SP	>52-a contact (OPEN, if bkr is open)
4602	>52-b	SP	>52-b contact (OPEN, if bkr is closed)
16019	>52 Wear start	SP	>52 Breaker Wear Start Criteria
16020	52 WearSet.fail	OUT	52 Wear blocked by Time Setting Failure

No.	Information	Type of Information	Comments
16027	52WL.blk I PErr	OUT	52 Breaker Wear Logic blk Ir-CB>=Isc-CB
16028	52WL.blk n PErr	OUT	52 Breaker W.Log.blk SwCyc.Isc>=SwCyc.Ir
18420	>Trip via BI	SP	>Trip via Binary Input
18421	Trip via GOOSE	ExSP	Trip via GOOSE
18423	Direct Trip	OUT	Direct Trip
18424	PI Trip NC	OUT	PI Trip NC(ON,if Device ok & No Trip)
18425	>DDI Open	SP	>DDI Open status

2.1.7 EN100-Module

2.1.7.1 Functional Description

The Ethernet EN100-Modul enables integration of the 7SJ80 in 100-Mbit communication networks in control and automation systems with the protocols according to IEC 61850 standard. This standard permits uniform communication of the devices without gateways and protocol converters. Even when installed in heterogeneous environments, SIPROTEC 4 relays therefore provide for open and interoperable operation. Parallel to the process control integration of the device, this interface can also be used for communication with DIGSI and for inter-relay communication via GOOSE.

2.1.7.2 Setting Notes

Interface Selection

No special settings are required for operating the Ethernet system interface module (IEC 1850, **Ethernet EN100-Modul**). If the ordered version of the device is equipped with such a module, it is automatically allocated to the interface available for it, namely **Port B**.

IEC 61850 GOOSE Function

The GOOSE function can be disabled via a device parameter. For more information, please refer to Section [2.1.2.2 Setting Notes](#).

2.1.7.3 Information List

No.	Information	Type of Information	Comments
009.0100	Failure Modul	IntSP	Failure EN100 Modul
009.0101	Fail Ch1	IntSP	Failure EN100 Link Channel 1 (Ch1)
009.0102	Fail Ch2	IntSP	Failure EN100 Link Channel 2 (Ch2)

2.2 Overcurrent Protection 50, 51, 50N, 51N

The overcurrent protection is provided with a total of four elements each for the phase currents and the ground current. All elements are independent from each other and can be combined as desired.

If it is desired in isolated or resonant-grounded systems that three-phase devices should work together with two-phase protection equipment, the overcurrent protection can be configured in such a way that it allows twophase operation besides the three-phase mode (see Section [2.1.3.2 Setting Notes](#)).

The high-set elements 50-2, 50-3, 50N-2, 50N-3 as well as the overcurrent elements 50-1 and 50N-1 always operate with a definite tripping time (51), the elements 51 and 51N always with an inverse tripping time (50).

Applications

- The non-directional overcurrent protection is applicable for networks that are radial and supplied from a single source or open looped networks, for backup protection of differential protective schemes of all types of lines, transformers, generators and busbars.

2.2.1 General

The overcurrent protection for the ground current can either operate with measured values I_N or with the quantities 3I0 calculated from the three phase currents. Which values are used depends on the setting of parameter 613 **Gnd O/Cprot. w.** and the selected type of connection of the current transformers. Information on this can be found in Chapter [2.1.3.2 Setting Notes](#), connection examples in Appendix [C Connection Examples](#). Devices featuring a sensitive ground current input, however, generally use the calculated quantity 3I0.

All overcurrent elements enabled in the device may be blocked via the automatic reclosing function (depending on the cycle) or via an external signal to the binary inputs of the device. Removal of blocking during pickup will restart time delays. The Manual Close signal is an exception in this case. If a circuit breaker is manually closed onto a fault, it can be re-opened immediately. For overcurrent elements or high-set elements the delay may be bypassed via a Manual Close pulse, thus resulting in high speed tripping. This pulse is extended up to at least 300 ms.

The automatic reclosure function 79 may also initiate immediate tripping for the overcurrent and high-set elements depending on the cycle.

Pickup of the definite-time elements can be stabilized by setting the dropout times. This protection is used in systems where intermittent faults occur. Combined with electromechanical relays, it allows different dropout responses to be adjusted and a time grading of digital and electromechanical relays to be implemented.

Pickup and delay settings may be quickly adapted to system requirements via dynamic setting changeover (see Section [2.4 Dynamic Cold Load Pickup](#)).

Tripping by the 50-1 and 51 elements (in phases), 50N-1 and 51N elements (in ground path) may be blocked for inrush conditions by utilizing the inrush restraint feature.

The following table gives an overview of the interconnections to other functions of the devices 7SJ80.

Table 2-2 Interconnection to other functions

Overcurrent Protection Elements	Connection to Automatic Reclosing	Manual CLOSE	Dynamic Cold Load Pickup	Inrush Restraint
50-1	•	•	•	•
50-2	•	•	•	
50-3	•	•	•	
51	•	•	•	•
50N-1	•	•	•	•
50N-2	•	•	•	

Overcurrent Protection Elements	Connection to Automatic Reclosing	Manual CLOSE	Dynamic Cold Load Pickup	Inrush Restraint
50N-3	•	•	•	
51N	•	•	•	•

2.2.2 Definite Time, High-set Elements 50-3, 50-2, 50N-3, 50N-2


For each element, an individual pickup value **50-3 PICKUP**, **50-2 PICKUP** or **50N-3 PICKUP**, **50N-2 PICKUP** is set. For **50-3 PICKUP** and **50N-3 PICKUP**, it is possible to measure the *Instantaneous* in addition to *Fundamental* and *True RMS*. If set to *Instantaneous*, the element picks up at $2 \cdot \sqrt{2} \cdot$ setting value (rms). Each phase and ground current is compared separately per element with the common pickup values **50-3 PICKUP**, **50-2 PICKUP** or **50N-3 PICKUP**, **50N-2 PICKUP**. If the respective pickup value is exceeded, this is signaled. After the user-defined time delays **50-3 DELAY**, **50-2 DELAY** or **50N-3 DELAY**, **50N-2 DELAY** have elapsed, trip commands are issued which are available for each element. The dropout value is roughly equal to 95% of the pickup value for currents $> 0.3 I_{Nom}$. If the measurement of the instantaneous values has been parameterized for the 50-3 or 50N-3 element, the dropout ratio is set to 90 %.

Pickup can be stabilized by setting dropout times **1215 50 T DROP-OUT** or **1315 50N T DROP-OUT**. This time is started and maintains the pickup condition if the current falls below the threshold. Therefore, the function does not drop out at high speed. The trip delay time **50-3 DELAY**, **50-2 DELAY** or **50N-3 DELAY**, **50N-2 DELAY** continues running in the meantime. After the dropout delay time has elapsed, the pickup is reported OFF and the trip delay time is reset unless the threshold **50-3 PICKUP**, **50-2 PICKUP** or **50N-3 PICKUP**, **50N-2 PICKUP** has been exceeded again. If the threshold is exceeded again during the dropout delay time, the time is canceled. The trip delay time **50-3 DELAY**, **50-2 DELAY** or **50N-3 DELAY**, **50N-2 DELAY** continues running in the meantime. If the threshold value is exceeded after this time has elapsed, the trip command is issued immediately. If the threshold value is not exceeded at this time, there is no reaction. If the threshold value is exceeded again after expiry of the trip command delay time while the dropout delay time is still running, tripping is initiated immediately.

These elements can be blocked by the automatic reclosing function (79 AR).

The pickup values of each 50-2, 50-3 Element for phase currents and 50N-2, 50N-3 Element for the ground current and the element-specific time delays can be set individually.

The following figures give an example of logic diagrams for the high-set elements **50-2 PICKUP** or **50N-2 PICKUP**. They also apply analogously to the high-set elements **50-3 PICKUP** and **50N-3 PICKUP**.

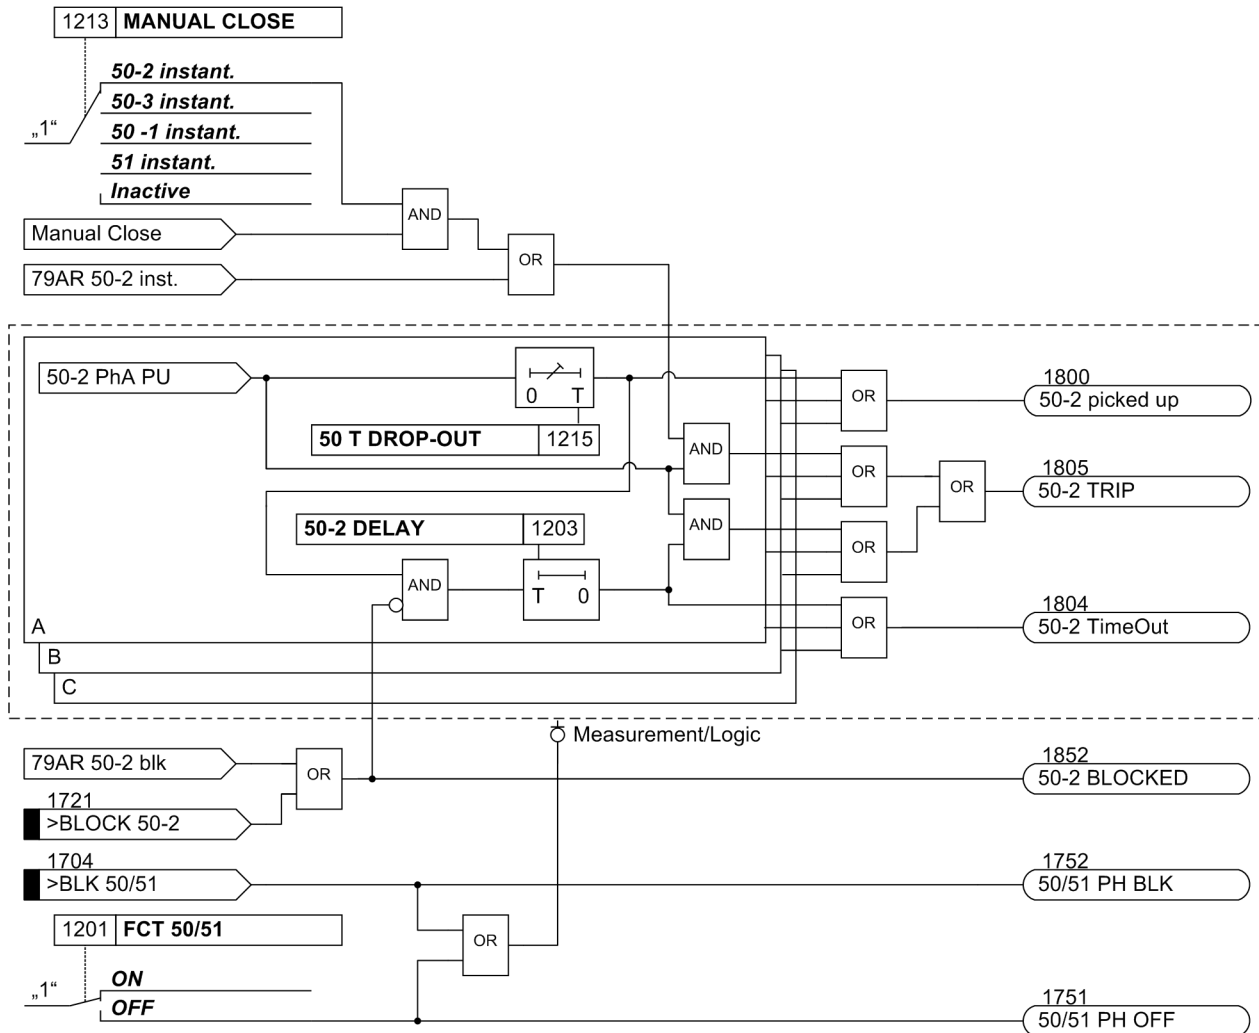


[7sj6x-hochstromst-i-fuer-ph-20061212, 1, en_US]

Figure 2-4 Logic diagram for 50-2 high-set element for phases

If parameter **MANUAL CLOSE** is set to **50-2 instant.** or **50-3 instant.** and manual close detection is used, a pickup causes instantaneous tripping, even if the element is blocked via binary input.

The same applies to 79 AR 50-2 inst. or 79 AR 50-3 inst.

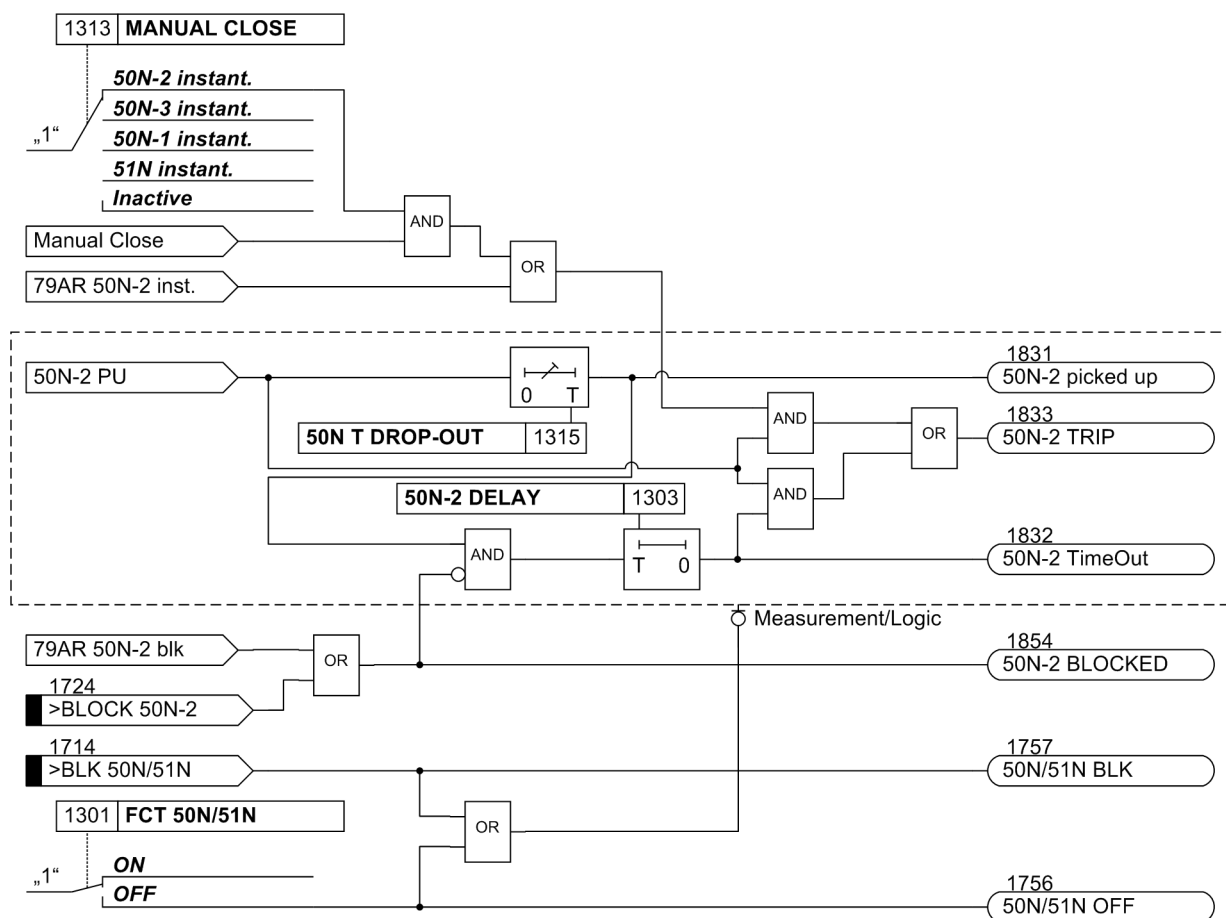

[7sj6x-hochstromst-ie-20061212, 1, en_US]

Figure 2-5 Logic diagram for 50N-2 high-set element

If parameter **MANUAL CLOSE** is set to **50N-2 instant.** or **50N-3 instant.** and manual close detection is used, a pickup causes instantaneous tripping, even if the element is blocked via binary input. The same applies to AR 50N-2 inst.

The same applies to 79 AR 50N-2 inst. or 79 AR 50N-3 inst.

2.2.3 Definite Time Overcurrent Elements 50-1, 50N-1

For each element an individual pickup value **50-1 PICKUP** or **50N-1 PICKUP** is set. Apart from **Fundamental**, the **True RMS** can also be measured. Each phase and ground current is compared separately with the setting value 50-1 or 50N-1 for each element. If the respective value is exceeded, this is signaled. If the inrush restraint feature (see below) is applied, either the normal pickup signals or the corresponding inrush signals are output as long as inrush current is detected. After user-configured time delays **50-1 DELAY** or **50N-1 DELAY** have elapsed, a trip signal is issued if no inrush current is detected or inrush restraint is disabled. If the inrush restraint feature is enabled and an inrush condition exists, no tripping takes place but a message is recorded and displayed indicating when the overcurrent element time delay elapses. Trip signals and signals on the expiration of time delay are available separately for each element. The dropout value is approximately 95% of the pickup value for currents > 0.3 I_{Nom}.

Pickup can be stabilized by setting dropout times 1215 **50 T DROP-OUT** or 1315 **50N T DROP-OUT**. This time is started and maintains the pickup condition if the current falls below the threshold. Therefore, the function does not drop out at high speed. The trip-command delay time **50-1 DELAY** or **50N-1 DELAY** continues running in the meantime. After the dropout delay time has elapsed, the pickup is reported OFF and the trip delay time is reset unless the threshold 50-1 or 50N-1 has been exceeded again. If the threshold is exceeded again during the dropout delay time, the time is canceled. However, the trip-command delay time **50-1**


DELAY or **50N-1 DELAY** continues running. If the threshold value is exceeded after its expiry, the trip command is issued immediately. If the threshold value is not exceeded at this time, there is no reaction. If the threshold value is exceeded again after expiry of the trip-command delay time, while the dropout delay time is still running, tripping occurs immediately.

Pickup stabilization of the overcurrent elements 50-1 or 50N-1 by means of settable dropout time is deactivated if an inrush pickup is present since an inrush does not represent an intermittent fault.

These elements can be blocked by the automatic reclosing function (79 AR).

The pickup values of each 50-1 element for phase currents and 50N-1 element for the ground current and the element-specific time delays can be set individually.

The following figures show the logic diagrams for the current elements 50-1 and 50N-1.

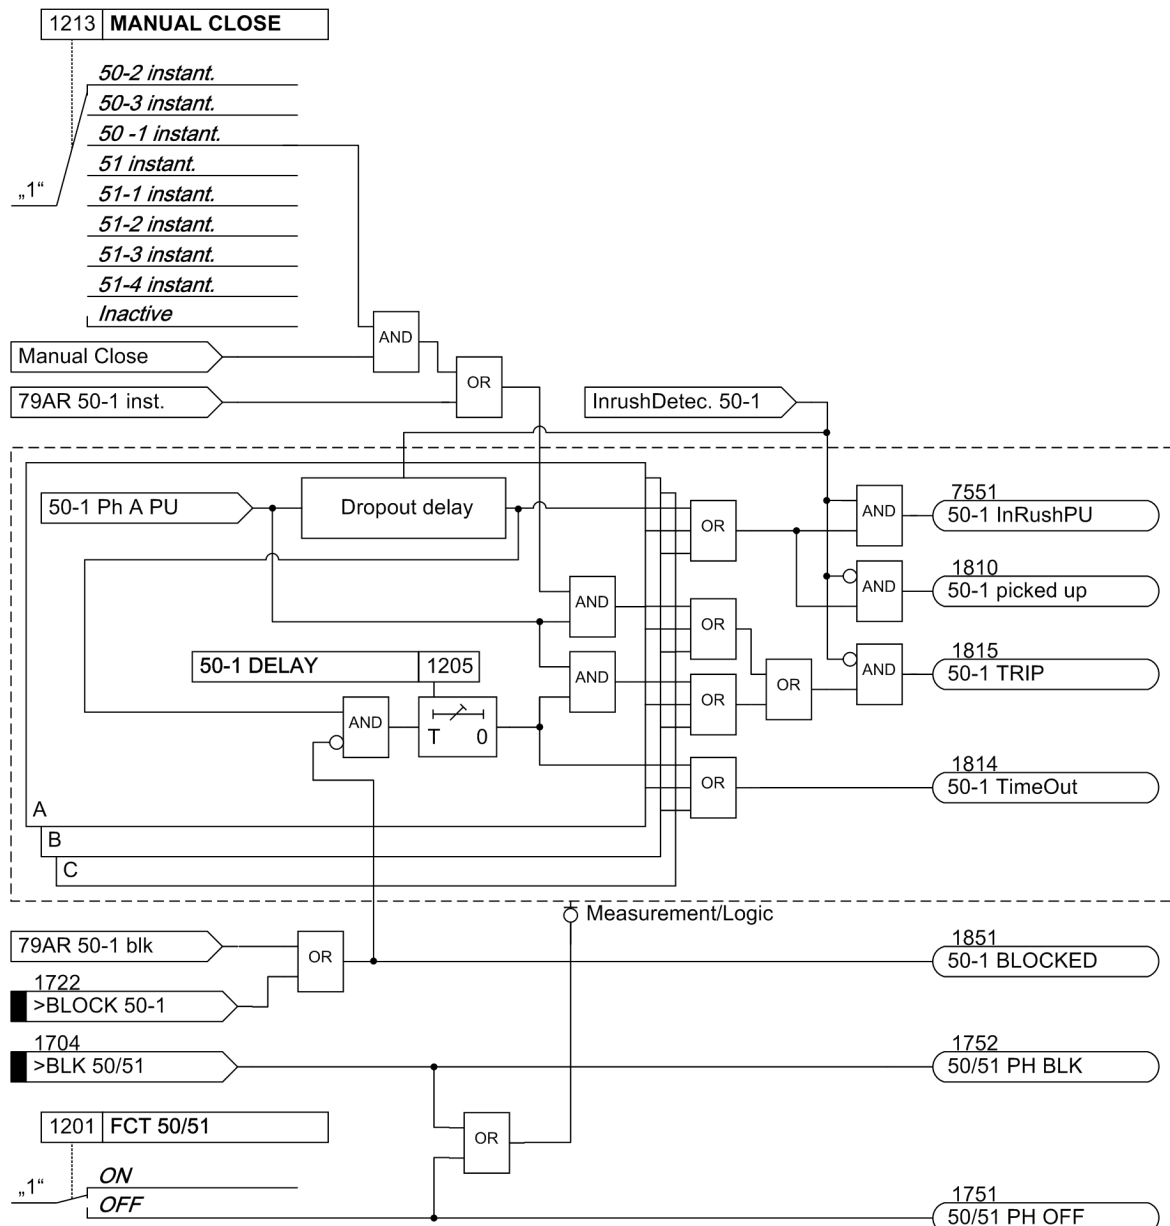


[7s]6x-ueberstromst-i-fuer-ph-20061212, 1, en_US]

Figure 2-6 Logic diagram for the 50-1 overcurrent element for phases

If parameter **MANUAL CLOSE** is set to **50 -1 instant.** and manual close detection is used, a pickup causes instantaneous tripping, even if blocking of the element via binary input is present.


The same applies to 79 AR 50-1 inst.

The dropout delay only operates if no inrush was detected. An incoming inrush will reset a running dropout delay time.

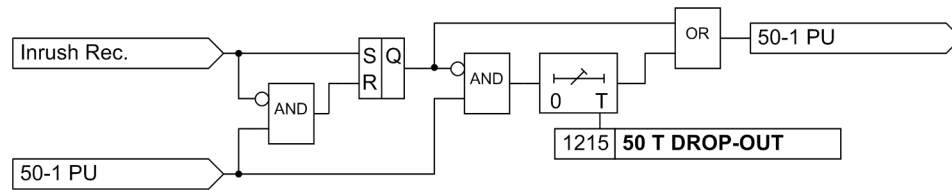

[7sj6x_rueckfallverzögerung_i_gr_ph_260803_he, 1, en_US]

Figure 2-7 Logic diagram of the dropout delay for 50-1

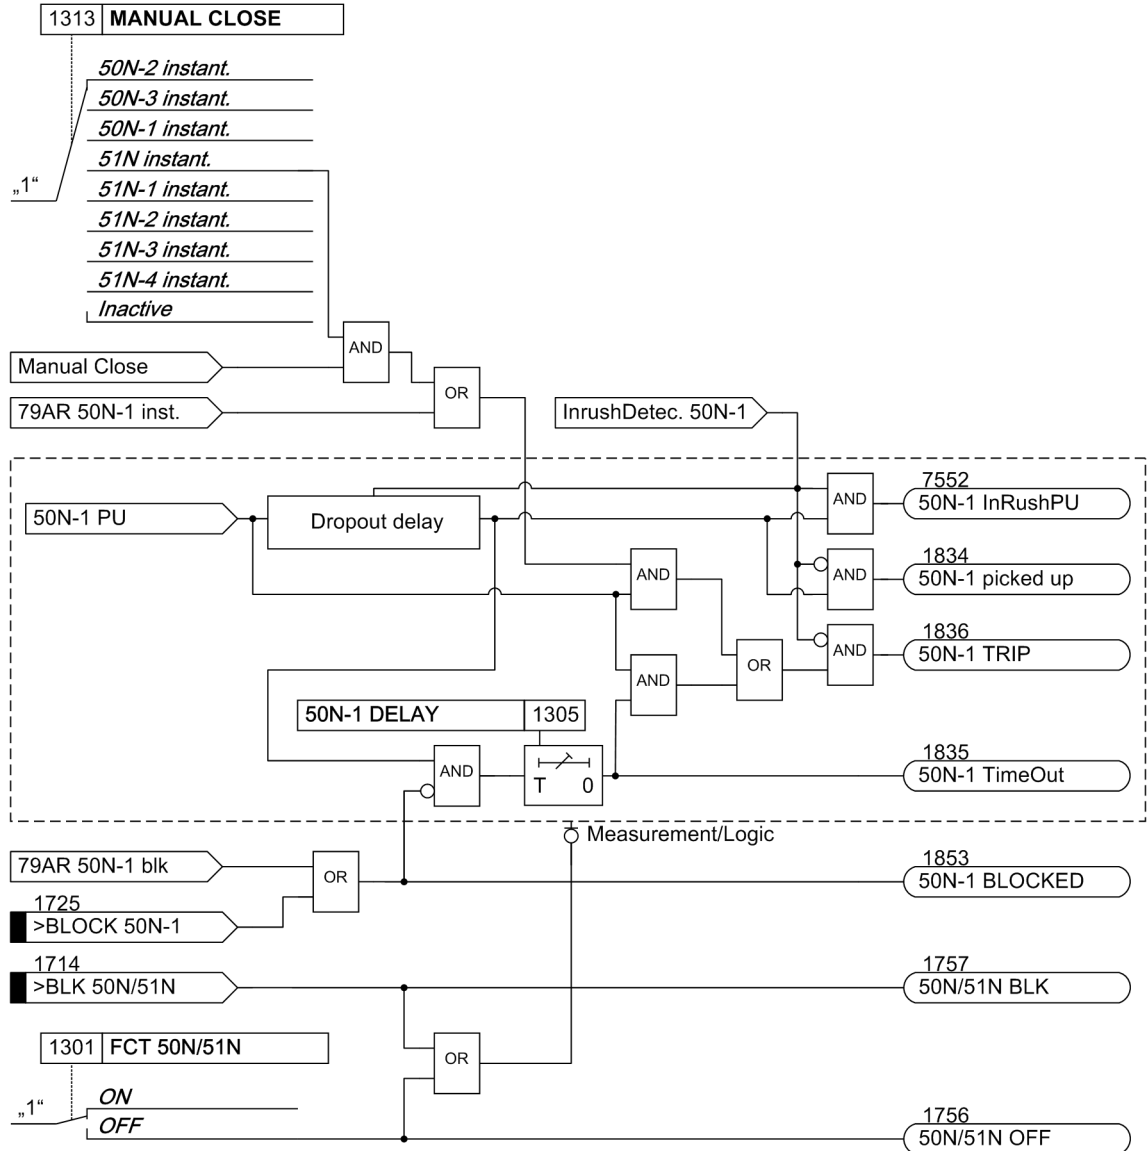

[7sj6x-ueberstromst-je-20061212, 1, en_US]

Figure 2-8 Logic diagram for the 50N-1 overcurrent current element

If parameter **MANUAL CLOSE** is set to **50N-1 instant.** and manual close detection applies, the trip is initiated as soon as the pickup conditions arrive, even if the element is blocked via a binary input.

The same applies to 79 AR 50N-1 inst.

The pickup values of each 50-1, 50-2 element for the phase currents and 50N-1, 50N-2 element for the ground current and the valid delay times for each element can be set individually.

The dropout delay only functions if no inrush was detected. An incoming inrush will reset a running dropout time delay.

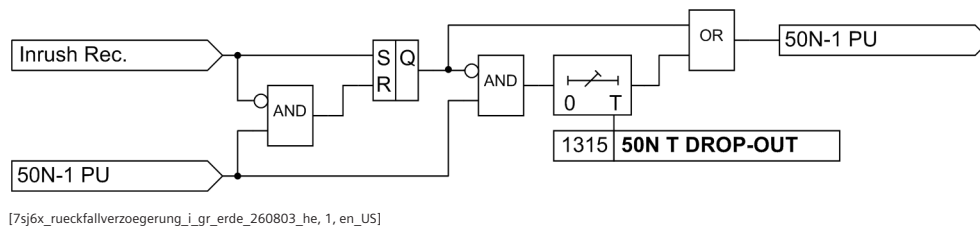


Figure 2-9 Logic of the dropout delay for 50N-1

2.2.4 Inverse Time Overcurrent Elements 51, 51N

Inverse time overcurrent elements are dependent on the ordering version. They always operate with an inverse time Curve in accordance with IEC or ANSI standards. The characteristics and associated formulas are given in the Technical Data.

When configuring one of the inverse-time characteristics, the definite-time elements 50-3, 50-2, and 50-1 are also active (see Section "Definite-time High-set Current Elements 50-3, 50-2, 50N-3, 50N-2 " and "Definite-time Overcurrent Elements 50-1, 50N-1 ").

A voltage restraint can optionally be set (see Section "Inverse Time Overcurrent Protection (Voltage-controlled / Voltage-restraint").

Pickup Behavior


For each element, an individual pickup value **51 PICKUP** or **51N PICKUP** is set. Apart from **Fundamental**, the **True RMS** can also be measured. Each phase and ground current is separately compared with the setting value 51 or 51N per element. If a current exceeds 1.1 times the setting value, the corresponding element picks up and is signaled individually. If the inrush restraint function is used, either the normal pickup signals or the corresponding inrush signals are issued as long as inrush current is detected. If the 51 element picks up, the tripping time is calculated from the actual fault current flowing, using an integrating method of measurement. The calculated tripping time depends on the selected tripping curve. Once this time has elapsed, a trip signal is issued provided that no inrush current is detected or inrush restraint is disabled. If the inrush restraint function is enabled and an inrush condition exists, no tripping takes place but a message is issued indicating when the overcurrent element time delay elapses.

These elements can be blocked by the automatic reclosing feature (79 AR).

For ground current element 51N, the characteristic may be selected independently of the characteristic used for phase currents.

Pickup values of elements 51 (phase currents) and 51N (ground current) and the relevant time multipliers may be set individually.

The following two figures show the logic diagrams for the inverse time overcurrent protection.

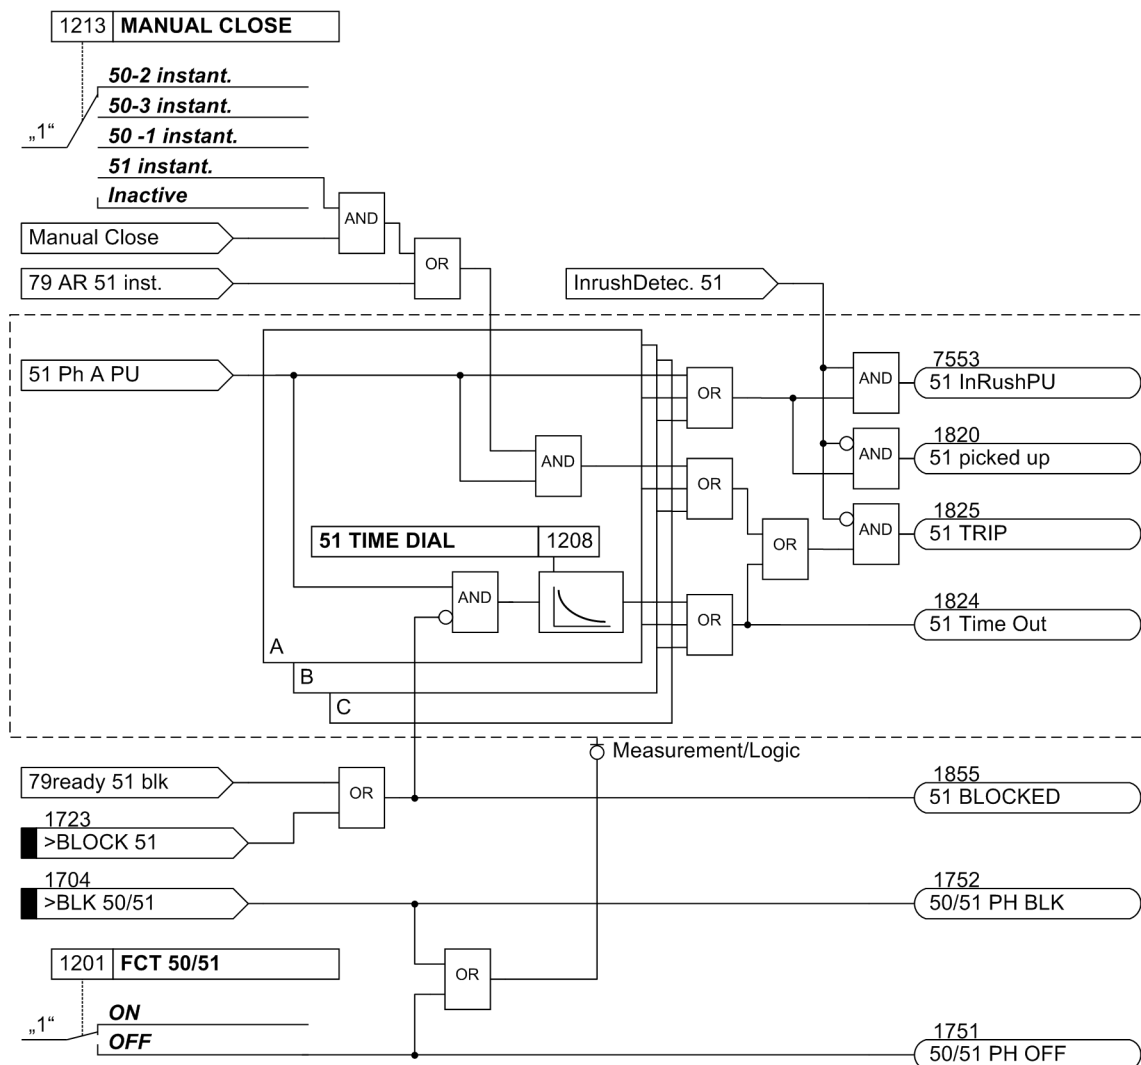


[7sj6x-abhueberstromzeit-phase-20061212, 1, en_US]

Figure 2-10 Logic diagram of the inverse-time overcurrent protection element for phases

If an ANSI characteristic is configured, parameter 1209 **51 TIME DIAL** is used instead of parameter 1208 **51 TIME DIAL**.

If parameter **MANUAL CLOSE** is set to *51 instant.* and manual close detection applies, the trip is initiated as soon as the pickup conditions arrive, even if the element is blocked via a binary input.

The same applies to 79 AR 51N inst.

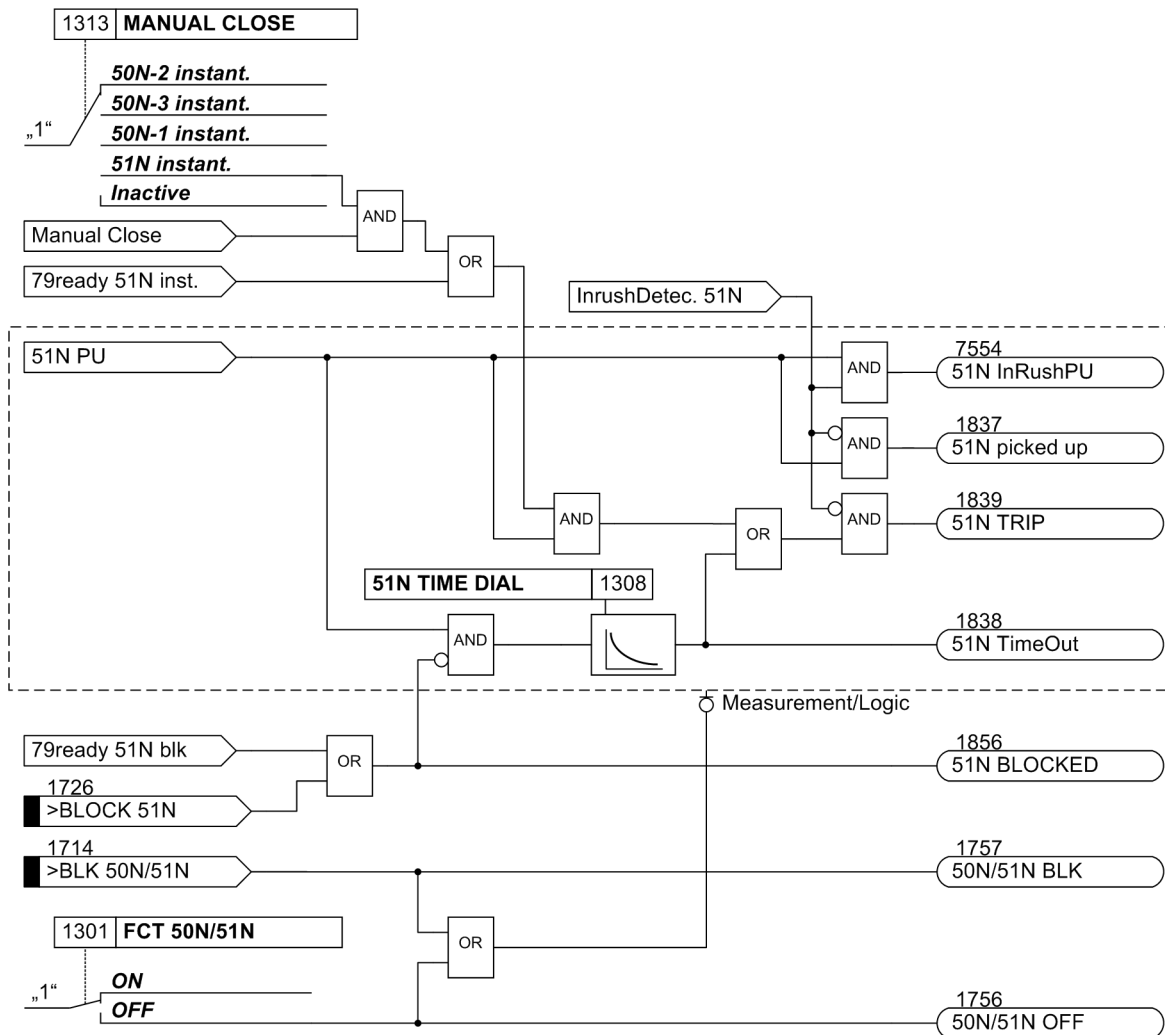

[7sj6x-abhueberstromzeit-erde-20061212, 1, en_US]

Figure 2-11 Logic diagram of the inverse-time overcurrent protection element for ground

If an ANSI characteristic is configured, parameter 1309 **51N TIME DIAL** is used instead of parameter 1308 **51N TIME DIAL**.

If parameter **MANUAL CLOSE** is set to **51N instant.** and manual close detection applies, the trip is initiated as soon as the pickup conditions arrive, even if the element is blocked via binary input.

The same applies to 79 AR 51N inst.

Dropout Behavior

For the ANSI or IEC characteristics, you can select whether an element drops out instantaneously after a threshold has been undershot or whether dropout is performed by means of disk emulation. "Instantaneous" means that the picked-up element drops out when 95 % of the pickup value is undershot. For a new pickup, the time delay starts at zero.

The disk emulation evokes a dropout process (timer counter is decrementing) which begins after de-energization. This process corresponds to the reset of a Ferraris disk (explaining its denomination "disk emulation"). In case several faults occur in succession, the "history" is taken into consideration due to the inertia of the Ferraris disk and the time response is adapted. Reset begins as soon as 90 % of the setting value is undershot, in accordance to the dropout curve of the selected characteristic. In the range between the dropout value (95 % of the pickup value) and 90 % of the setting value, the incrementing and the decrementing processes are in idle state.


Disk emulation offers advantages when the overcurrent relay elements must be coordinated with conventional electromechanical overcurrent relays located towards the source.

2.2.5 Inverse Time Overcurrent Protection 51V (Voltage-controlled / Voltage-restraint)

Undervoltage Consideration

The inverse time overcurrent protection is provided with an undervoltage detection that can be disabled (address 1223 **VOLT . INFLUENCE**). This function can influence overcurrent detection by means of two different methods:

- **Voltage-controlled:** If a set voltage threshold is undershot, the overcurrent element is released.
- **Voltage-restraint:** The pickup threshold of the overcurrent element depends on the voltage magnitude. A lower voltage decreases the current pickup value (see Figure 2-13). In the range between $V/V_{Nom} = 1.00$ to 0.25 a linear, directly proportional dependence is realized, and therefore the following applies:

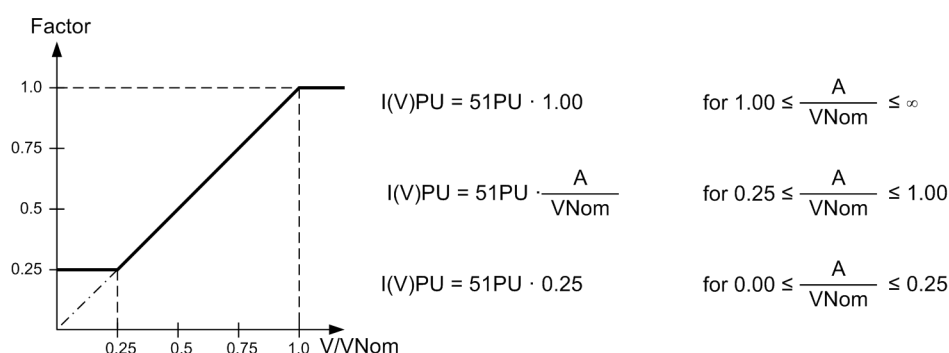

with V_{Nom} = Nominal voltage

51PU = Pick-up value of inverse time characteristic

$I(V)PU$ = Voltage influence of the pickup value

[spannungsabhaengigkeit-des-anregewertes, 1, en_US]

Figure 2-12 Voltage influence of the pickup value

The 51 PICKUP value is decreased proportional to the voltage decrease. Consequently, for constant current I the $I/51$ PICKUP ratio is increased and the tripping time is reduced. Compared with the standard curves represented in Section "Technical Data" the tripping curve shifts to the left side as the voltage decreases.


Switching to the lower pickup value or decreasing the pickup threshold is carried out phase-selectively. The assignment of voltages to current-carrying phases is shown in the following table.

Table 2-3 Controlling voltages in relation to the fault currents

Current	Voltage
I_A	$V_A - V_B$
I_B	$V_B - V_C$
I_C	$V_C - V_A$


In order to avoid an unwanted operation in case of a voltage transformer fault, a function blocking is implemented via a binary input controlled by the voltage transformer protection breaker as well as via the device-internal measuring voltage failure detection ("Fuse Failure Monitor").

The following two figures show the logic diagrams for the inverse time overcurrent protection with undervoltage consideration.

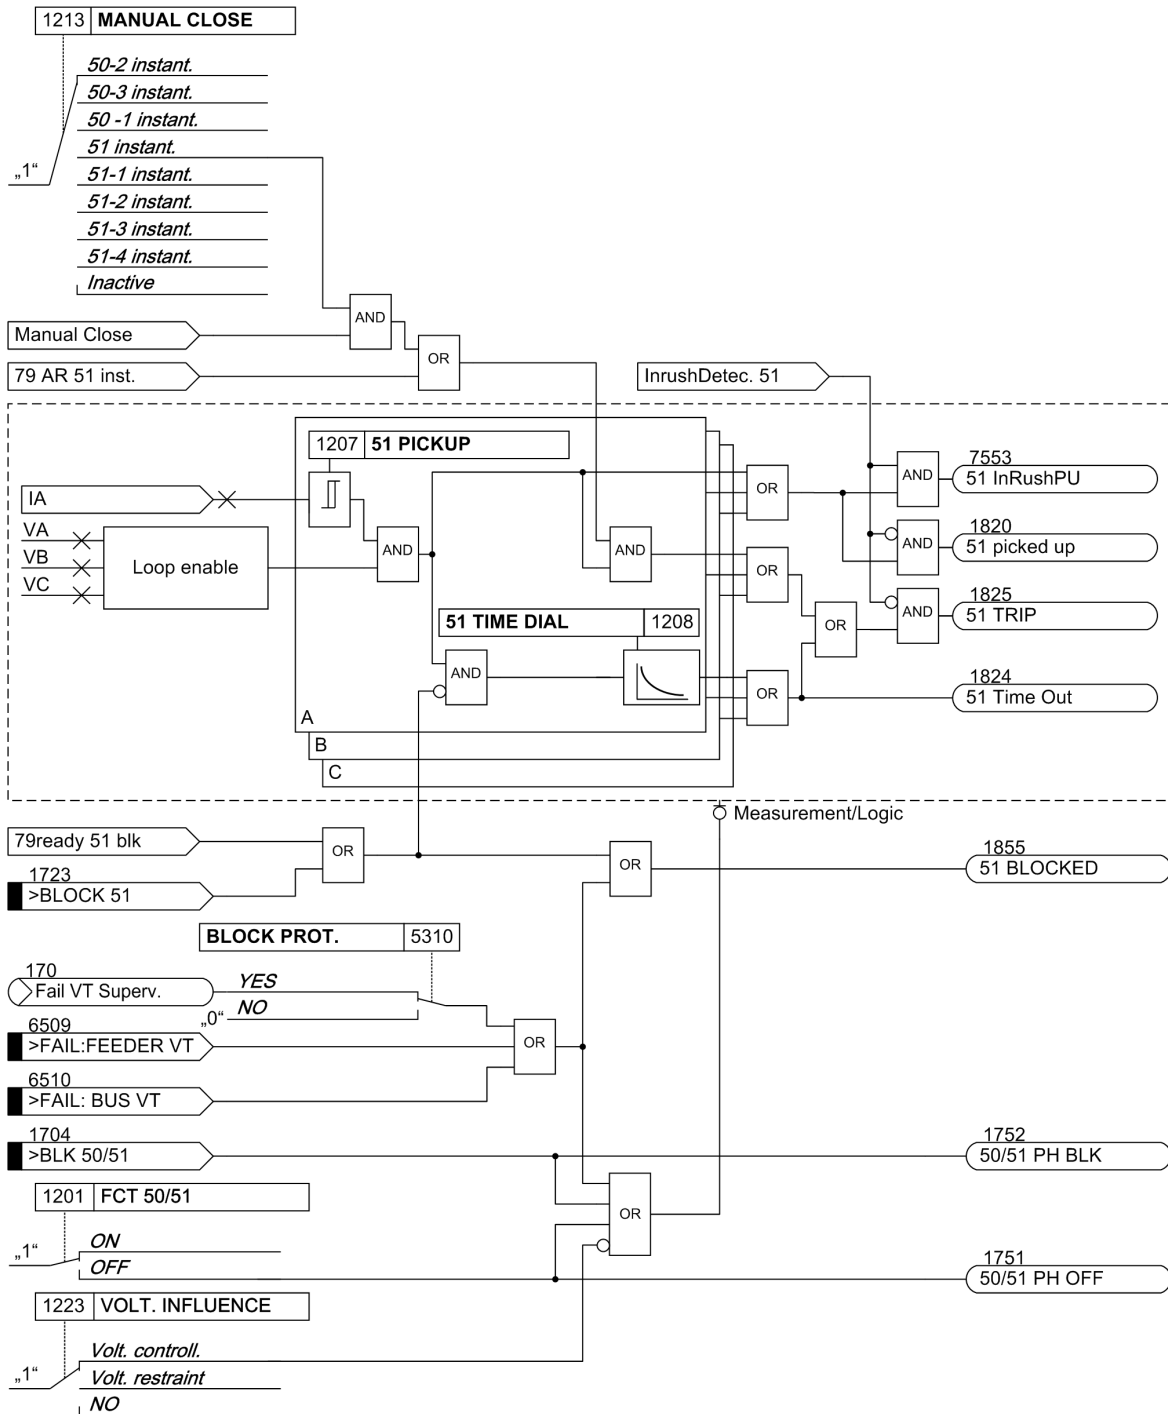

[7sjx_logic_51-phase-schleife-aktiv, 1, en_US]

Figure 2-13 Logic diagram of the voltage-controlled inverse time overcurrent protection

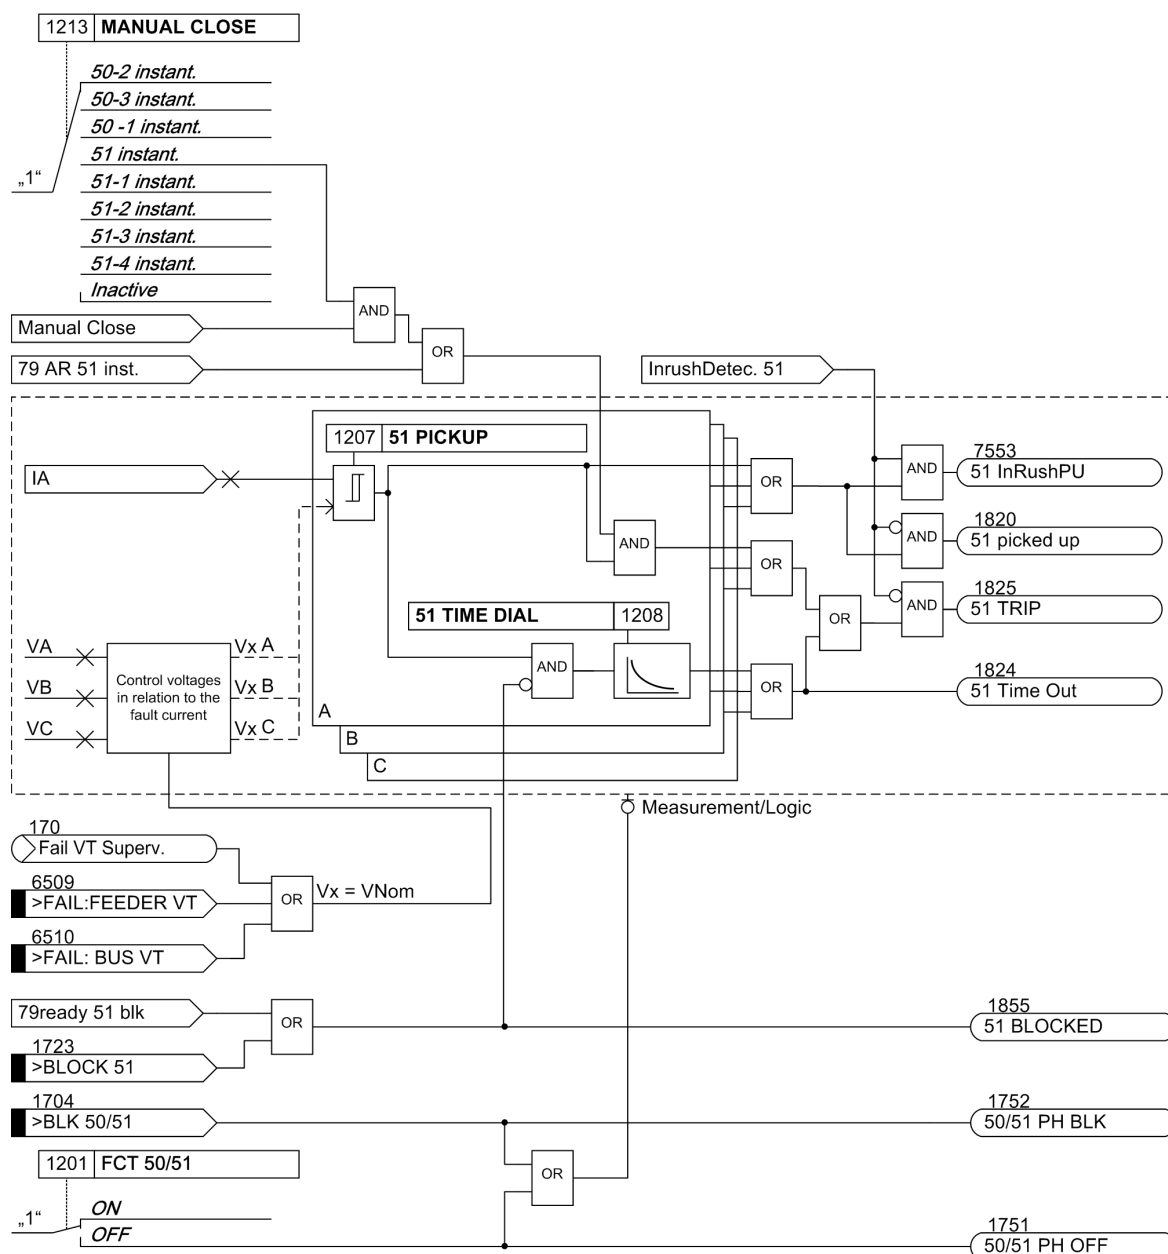

[7sjx_logic_51-phase, 1, en_US]

Figure 2-14 Logic diagram of the voltage-restraint inverse-time overcurrent protection

2.2.6 Dynamic Cold Load Pickup Function

It may be necessary to dynamically increase the pickup thresholds of the overcurrent protection if certain system components exhibit an increased power consumption when they are switched on after a long period of zero voltage (e.g. air-conditioning systems, heating installations, motors). Thus, a general increase of pickup thresholds can be avoided taking into consideration such starting conditions.

This dynamic pickup value changeover function is common to all overcurrent elements and is described in Section 2.4 [Dynamic Cold Load Pickup](#). The alternative pickup values can be set individually for each element of the time overcurrent protection.

2.2.7 Inrush Restraint

When the multi-functional protective relay with local control 7SJ80 is installed, for instance, to protect a power transformer, large magnetizing inrush currents will flow when the transformer is energized. These inrush currents may be several times the nominal transformer current, and, depending on the transformer size and design, may last from several tens of milliseconds to several seconds.

Although pickup of the relay elements is based only on the fundamental harmonic component of the measured currents, false device pickup due to inrush is still a potential problem since, depending on the transformer size and design, the inrush current also comprises a large component of the fundamental.

The 7SJ80 features an integrated inrush restraint function. It prevents the “normal” pickup of 50-1 or 51 relay elements (not 50-2 and 50-3) in the phases and the ground path of all directional and non-directional overcurrent relay elements. The same is true for the alternative pickup thresholds of the dynamic cold load pickup function. After detection of inrush currents above a pickup value, special inrush signals are generated. These signals also initiate fault annunciations and start the associated trip delay time. If inrush conditions are still present after the tripping time delay has elapsed, a corresponding message („ . . . *Timeout.*“) is output, but the overcurrent tripping is blocked (see also logic diagrams of time overcurrent elements, [Figure 2-6](#) to [Figure 2-11](#)).

Inrush current contains a relatively large second harmonic component (twice the nominal frequency) which is nearly absent during a fault current. The inrush restraint is based on the evaluation of the 2nd harmonic present in the inrush current. For frequency analysis, digital filters are used to conduct a Fourier analysis of all three phase currents and the ground current.

Inrush current is recognized if the following conditions are fulfilled at the same time:

- The harmonic content is larger than the setting value 2202 **2nd HARMONIC** (minimum $0.125 * I_{\text{Nom,sec}}$);
- the currents do not exceed an upper limit value 2205 **I Max**;
- an exceeding of a threshold value via an inrush restraint of the blocked element takes place.

In this case an inrush in the affected phase is recognized (annunciations 1840 to 1842 and 7558 *InRush Gnd Det*, see [Figure 2-15](#)) and its blocking being carried out.

Since quantitative analysis of the harmonic components cannot be completed until a full line period has been measured, pickup will generally be blocked by then. Therefore, assuming the inrush restraint feature is enabled, a pickup message will be delayed by a full line period if no closing process is present. On the other hand, trip delay times of the time overcurrent protection feature are started immediately even with the inrush restraint being enabled. Time delays continue running with inrush currents present. If inrush blocking drops out after the time delay has elapsed, tripping will occur immediately. Therefore, utilization of the inrush restraint feature will not result in any additional tripping delays. If a relay element drops out during inrush blocking, the associated time delay will reset.

Cross Blocking


Since inrush restraint operates individually for each phase, protection is ideal where a power transformer is energized into a single-phase fault and inrush currents are detected on a different healthy phase. However, the protection feature can be configured to allow that not only this phase element but also the remaining elements (including ground) are blocked (the so-called **CROSS BLOCK** function, address 2203) if the permissible harmonic component of the current is exceeded for only one phase.

Please take into consideration that inrush currents flowing in the ground path will not cross-block tripping by the phase elements.

Cross blocking is reset if there is no more inrush in any phase. Furthermore, the cross blocking function may also be limited to a particular time interval (address 2204 **CROSS BLK TIMER**). After expiry of this time interval, the cross blocking function will be disabled, even if inrush current is still present.

The inrush restraint has an upper limit: Above this (via adjustable parameter 2205 **I Max**) current blocking is suppressed since a high-current fault is assumed in this case.

The following figure shows the inrush restraint influence on the time overcurrent elements including cross-blocking.

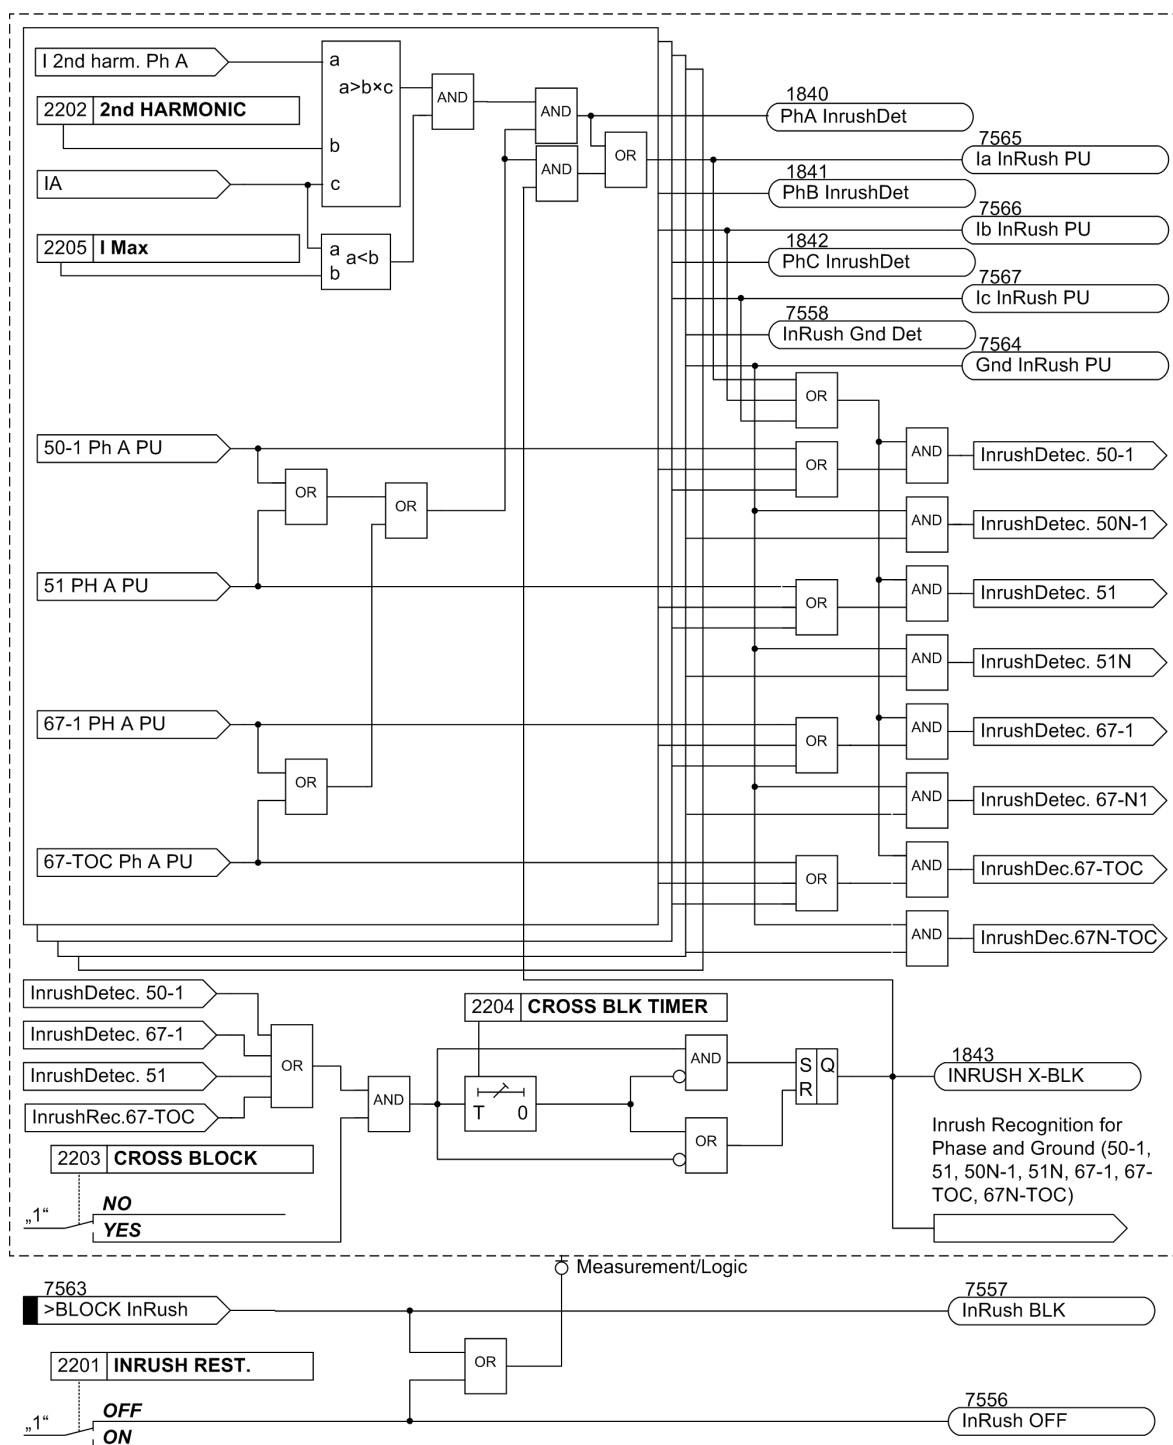

[7sj6x_einschaltstabilisierung-150502-1, en_US]

Figure 2-15 Logic diagram for inrush restraint

2.2.8 Pickup Logic and Tripping Logic

The pickup annunciations of the individual phases (or ground) and the individual element are combined with each other in such a way that the phase information and the element that has picked up are issued.

Table 2-4 Pickup Indications of Overcurrent Protection

Internal indication	Figure	Output indication	FNo.
50-3 A PU 50-2 A PU 50-1 A PU 51 A PU	Figure 2-4 Figure 2-6 Figure 2-10	50/51 Ph A PU	1762
50-3 B PU 50-2 B PU 50-1 B PU 51 B PU	Figure 2-4 Figure 2-6 Figure 2-10	50/51 Ph B PU	1763
50-3 C PU 50-2 C PU 50-1 C PU 51 C PU	Figure 2-4 Figure 2-6 Figure 2-10	50/51 Ph C PU	1764
50N-3 PU 50N-2 PU 50N-1 PU 51N PU	Figure 2-5 Figure 2-8 Figure 2-11	50N/51N Picked up	1765
50-3 A PU 50-3 B PU 50-3 C PU		50-3 picked up	1767
50N-3 PU		50N-3 picked up	1768
50-2 A PU 50-2 B PU 50-2 C PU	Figure 2-4 Figure 2-4 Figure 2-4	50-2 picked up	1800
50N-2 PU	Figure 2-5	50N-2 picked up	1831
50-1 A PU 50-1 B PU 50-1 C PU	Figure 2-6 Figure 2-6 Figure 2-6	50-1 picked up	1810
50N-1 PU	Figure 2-5	50N-1 picked up	1834
51 A PU 51 B PU 51 C PU	Figure 2-10 Figure 2-10 Figure 2-10	51 picked up	1820
51N PU	Figure 2-11	51N picked up	1837
(All pickups)		50(N)/51(N) PU	1761

In the trip signals, the element which initiated the tripping is also indicated.

2.2.9 Two-phase Overcurrent Protection (Only Non-Directional)

The 2-phase overcurrent protection functionality is used in isolated or grounded systems where interaction with existing 2-phase protection equipment is required. As an isolated or grounded system remains operational with a 1-phase ground fault, this protection serves to detect double ground faults with high ground fault currents. The respective feeder must be switched off only in this case. A 2-phase measurement is sufficient for this purpose. In order to ensure selectivity of the protection in this section of the system, only phases A and C are monitored.

If 250 50/51 2-ph prot (settable in **P.System Data 1**) is set to **ON**, I_b is not used for threshold comparison. If the fault is a simple ground fault in B, the element will not pick up. A double ground fault is assumed only after pickup on A or C, causing the element to pick up and trip after the delay time has elapsed.

**NOTE**


With inrush detection activated and inrush only on B, no cross blocking will take place in the other phases. On the other hand, if inrush with cross blocking is activated on A or C, B will also be blocked.

2.2.10 Fast Busbar Protection Using Reverse Interlocking

Application Example

Each of the current elements can be blocked via binary inputs. A setting parameter determines whether the binary input operates in the normally open (i.e. actuated when energized) or the normally closed (i.e. actuated when de-energized) mode. This allows fast busbar protection to be applied in star systems or open ring systems by applying "reverse interlocking". This principle is often used, for example, in distribution systems, auxiliary systems of power plants and similar systems, where a station supply transformer supplied from the transmission grid serves internal loads of the generation station via a medium voltage bus with multiple feeders (Figure 2-16).

The reverse interlocking principle is based on the following: Time overcurrent protection of the busbar feeder trips with a short time delay T 50-2 independent of the grading times of the feeders, unless the pickup of the next load-side overcurrent protection element blocks the busbar protection (Figure 2-16). Always the protection element nearest to the fault will trip with the short time delay since this element cannot be blocked by a protection element located behind the fault. Time elements T 50-1 or T51 are still effective as backup element. Pickup signals output by the load-side protective relay are used as input message `>BLOCK 50-2` via a binary input at the feeder-side protective relay.

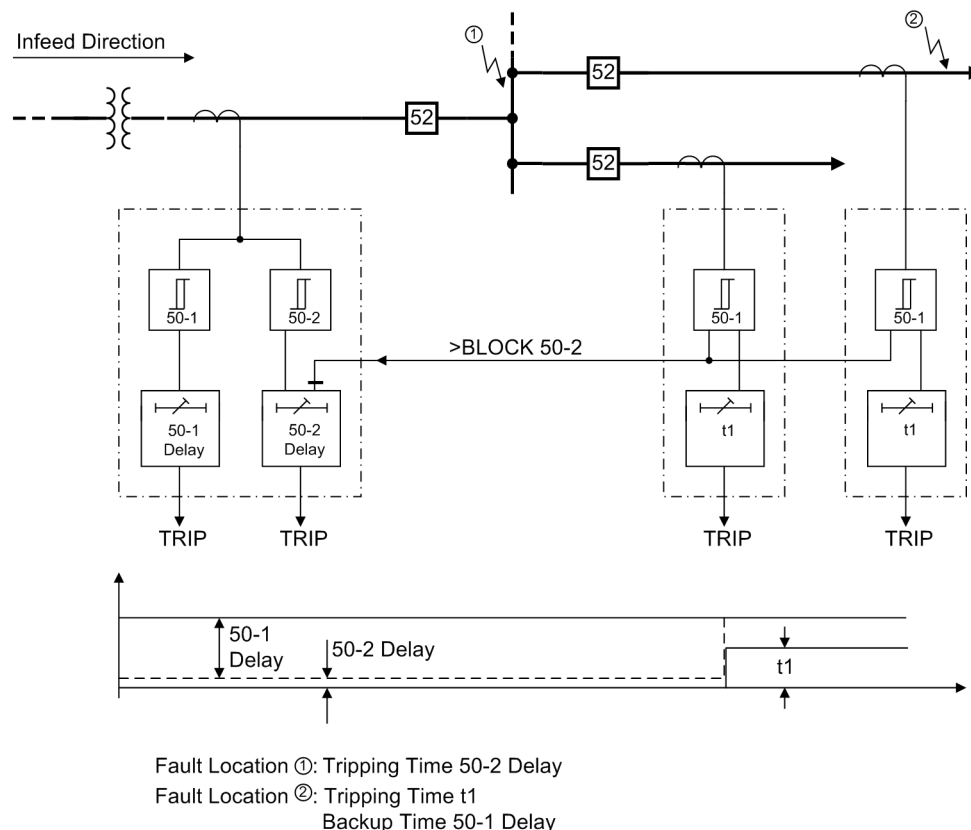

[rueckwerr-150502-kn, 1, en_US]

Figure 2-16 Reverse interlocking protection scheme

2.2.11 Setting Notes

General

When selecting the time overcurrent protection in DIGSI, a dialog box appears with several tabs for setting the individual parameters. Depending on the functional scope specified during configuration of the protection functions under addresses 112 **Charac. Phase** and 113 **Charac. Ground**, the number of tabs can vary. If address **FCT 50/51** was set to **Definite Time**, or **Charac. Ground** was set to **Definite Time**, then only the settings for the definite time elements are available. The selection of **TOC IEC** or **TOC ANSI** makes available additional inverse time characteristics. The superimposed high-set elements 50-2, 50-3 or 50N-2, 50N-3 are available in all these cases.

Parameter 250 **50/51 2-ph prot** can also be set to activate two-phase overcurrent protection.

Under address 1201 **FCT 50/51**, overcurrent protection for phases and under address 1301 **FCT 50N/51N**, the ground overcurrent protection can be switched **ON** or **OFF**.

Pickup values, time delays, and characteristics for ground protection are set separately from the pickup values, time delays and characteristic curves associated with phase protection. Because of this, relay coordination for ground faults is independent of relay coordination for phase faults, and more sensitive settings can often be applied to directional ground protection.

Depending on the setting of parameter 251 **CT Connect.**, the device can also be used in specific system configuration with regard to current connections. Further information can be found under Section [2.1.3.2 Setting Notes](#), "Current Connections".

Measurement Methods

The comparison values to be used for the respective element can be set in the setting sheets for the elements.

- Measurement of the **fundamental harmonic** (standard method):
This measurement method processes the sampled values of the current and filters in numerical order the fundamental harmonic so that the higher harmonics or transient peak currents remain largely unconsidered.
- Measurement of the **true RMS value**
The current amplitude is derived from the sampled values in accordance with the definition equation of the true RMS value. This measurement method should be selected when higher harmonics are to be considered by the function (e.g. in capacitor banks).
- Measurement with **instantaneous values**
This procedure compares the instantaneous values to the set threshold. The element picks up at $2 \cdot \sqrt{2} \cdot$ setting value (rms). It does not perform a mean-value calculation and is thus sensitive with regard to disturbances. This measurement method should only be selected if an especially short pickup time of the element is required. In this measurement procedure, the operating time of the element is reduced compared to the measurement of effective values or fundamental harmonics (see "Technical Data").

The type of the comparison values can be set under the following addresses:

50-3 element	Address 1219 50-3 measurem.
50-2 element	Address 1220 50-2 measurem.
50-1 element	Address 1221 50-1 measurem.
51 element	Address 1222 51 measurem.
50N-3 element	Address 1319 50N-3 measurem.
50N-2 element	Address 1320 50N-2 measurem.
50N-1 element	Address 1321 50N-1 measurem.
51N element	Address 1322 51N measurem.

High-set Current Elements 50-2, 50-3 (phases)

The pickup current of the high-set element **50-2 PICKUP** or **50-3 PICKUP** can be set at address 1202 or 1217. The corresponding delay time **50-2 DELAY** or **50-3 DELAY** can be configured under address 1203 or 1218.

1218. It is usually used for purposes of current grading intended for large impedances that are prevalent in transformers or generators. It is specified in such manner that it picks up faults up to this impedance.

Example of the high-set current element 50-2 PICKUP: Transformer used for busbar supply with the following data:

Rated apparent power	$S_{\text{NomT}} = 16 \text{ MVA}$
Transformer impedance	$ZT = 10 \%$
Primary nominal voltage	$V_{\text{Nom1}} = 110 \text{ kV}$
Secondary nominal voltage	$V_{\text{Nom2}} = 20 \text{ kV}$
Vector groups	Dy 5
Neutral point	Grounded
Fault power on 110 kV-side	1 GVA

Based on the data above, the following fault currents are calculated:

Three-Phase High Voltage Side Fault Current	at 110 kV = 5250 A
Three-Phase Low Voltage Side Fault Current	at 20 kV = 3928 A
On the High Voltage Side Flowing	at 110 kV = 714 A

The nominal current of the transformer is:

$I_{\text{NomT}, 110} = 84 \text{ A}$ (High Voltage Side)	$I_{\text{NomT}, 20} = 462 \text{ A}$ (Low Voltage Side)
Current Transformer (High Voltage Side)	100 A/1 A
Current Transformer (Low Voltage Side)	500 A/1 A

Due to the following definition

$$\text{High-set Element 50-2 PICKUP} \quad \frac{50-2}{I_{\text{Nom}}} > \frac{1}{V_{\text{kTransf}}} \cdot \frac{I_{\text{NomTransf}}}{I_{\text{NomCT}}}$$

[hochstrom-260602-kn, 1, en_US]

the following setting applies to the protection device: The 50-2 high-set current element must be set higher than the maximum fault current which is detected during a low side fault on the high side. To reduce fault probability as much as possible even when fault power varies, the following setting is selected in primary values: 50-2 $I_{\text{Nom}} = 10$, i.e. 50-2 = 1000 A. The same applies analogously when using the high-set element 50-3.

Increased inrush currents, if their fundamental component exceeds the setting value, are rendered harmless by delay times (address 1203 **50-2 DELAY** or 1218 **50-3 DELAY**).

The principle of the "reverse interlocking" utilizes the multi-element function of the time overcurrent protection: Element **50-2 PICKUP** is applied as a fast busbar protection with a shorter safety delay time **50-2 DELAY** (e.g. 100 ms). For faults at the outgoing feeders, element 50-2 is blocked. The elements 50-1 or 51 serve as backup protection. The pickup values of both elements (50-1 PICKUP or 51 PICKUP and 50-2 PICKUP) are set equal. The delay time **50-1 DELAY** or **51 TIME DIAL** is set in such manner that it overgrades the delay for the outgoing feeders.

The selected time is an additional delay time and does not include the operating time (measuring time, dropout time). The delay can also be set to ∞ . In this case, the element will not trip after pickup. However, pickup, will be signaled. If the 50-2 element or the 50-3 element is not required at all, the pickup threshold 50-2 or 50-3 is set to ∞ . This setting prevents tripping and the generation of a pickup message.

High-set Current Elements 50N-2, 50N-3 (ground)

The pickup current of the high-set element **50N-2 PICKUP** or **50N-3 PICKUP** can be set at address 1302 or 1317. The corresponding delay time **50N-2 DELAY** or **50N-3 DELAY** can be configured under address 1303 or 1318. The same considerations apply to these settings as they did for phase currents discussed earlier.

The selected time is an additional delay time and does not include the operating time (measuring time, dropout time). The delay can also be set to ∞ . In this case, the element will not trip after pickup. However,

pickup, will be signaled. If the 50N-2 element or 50N-3 element is not required at all, the pickup threshold 50N-2 or 50N-3 should be set to ∞ . This setting prevents tripping and the generation of a pickup message.

50-1 Element (phases)

For setting the 50-1 element, it is the maximum anticipated load current that must be considered above all. Pickup due to overload should never occur since in this mode the device operates as fault protection with correspondingly short tripping times and not as overload protection. For this reason, a setting equal to 20% of the expected peak load is recommended for line protection, and a setting equal to 40% is recommended for transformers and motors.

The settable time delay (address 1205 **50-1 DELAY**) results from the grading coordination chart defined for the system.

The selected time is an additional delay time and does not include the operating time (measuring time, dropout time). The delay can also be set to ∞ . In this case, the element will not trip after pickup. However, pickup, will be signaled. If the 50-1 element is not required at all, then the pickup threshold 50-1 should be set to ∞ . This setting prevents tripping and the generation of a pickup message.

50N-1 Element (ground)

The 50N-1 element is normally set based on minimum ground fault current.

If the relay is used to protect transformers or motors with large inrush currents, the inrush restraint feature of 7SJ80 may be used for the 50N-1 relay element. It can be enabled or disabled for both the phase current and the ground current in address 2201 **INRUSH REST**. The characteristic values of the inrush restraint are listed in Subsection "Inrush Restraint".

The settable delay time (address 1305 **50N-1 DELAY**) results from the time coordination chart defined for the system. For ground currents in a grounded system a separate coordination timer with short time delays can be applied.

The selected time is an additional delay time and does not include the operating time (measuring time, dropout time). The delay can also be set to ∞ . In this case, the element will not trip after pickup. However, pickup, will be signaled. If the 50N-1 element is not required at all, the pickup threshold 50N-1 PICKUP should be set to ∞ . This setting prevents tripping and the generation of a pickup message.

Pickup Stabilization (Definite Time)

The configurable dropout times 1215 **50 T DROP-OUT** or 1315 **50N T DROP-OUT** can be set to implement a uniform dropout behavior when using electromechanical relays. This is necessary for a time grading. The dropout time of the electromechanical relay must be known to this end. Subtract the dropout time of the device (see Technical Data) from this value and enter the result in the parameters.

51 Element (phases) with IEC or ANSI characteristics

Having set address 112 **Charac. Phase** = **TOC IEC** or **TOC ANSI** when configuring the protection functions (Section 2.1.1.2 *Setting Notes*), the parameters for the inverse time characteristics will also be available.

If address 112 **Charac. Phase** was set to **TOC IEC**, you can select the desired IEC characteristic (**Normal Inverse**, **Very Inverse**, **Extremely Inv.** or **Long Inverse**) at address 1211 **51 IEC CURVE**. If address 112 **Charac. Phase** was set to **TOC ANSI**, you can select the desired ANSI characteristic (**Very Inverse**, **Inverse**, **Short Inverse**, **Long Inverse**, **Moderately Inv.**, **Extremely Inv.** or **Definite Inv.**) at address 1212 **51 ANSI CURVE**.

If the inverse time trip characteristic is selected, it must be noted that a safety factor of about 1.1 has already been included between the pickup value and the setting value. This means that a pickup will only occur if a current of about 1.1 times the setting value is present. If **Disk Emulation** was selected at address 1210 **51 Drop-out**, reset will occur in accordance with the reset curve as described before.

The current value is set in address 1207 **51 PICKUP**. The setting is mainly determined by the maximum anticipated operating current. Pickup due to overload should never occur since in this mode, the device operates as fault protection with correspondingly short tripping times and not as overload protection.

The corresponding time multiplier for an IEC characteristic is set at address 1208 **51 TIME DIAL** and in address 1209 **51 TIME DIAL** for an ANSI characteristic. It must be coordinated with the time coordination chart of the system.

The time multiplier can also be set to ∞ . In this case, the element will not trip after pickup. However, pickup will be signaled. If the 51 element is not required at all, address 112 **Charac. Phase** should be set to **Definite Time** during protection function configuration (see Section 2.1.1.2 *Setting Notes*).

If highly sensitive settings close to the load current are required in weak power systems or transformers, the element can be stabilized via the undervoltage as an additional criterion for the power system fault. The operating modes can be set in address 1223 **VOLT. INFLUENCE**. In a voltage-controlled operation, the voltage threshold is defined via parameter 1224 **51V V<** below which the current element is released

51N Element (ground) with IEC or ANSI Characteristics

Having set address 113 **Charac. Ground = TOC IEC** when configuring the protection functions (Section 2.1.1 *Functional Scope*), the parameters for the inverse time characteristics will also be available. Specify in address 113 **Charac. Ground = TOC IEC** the desired IEC characteristic (**Normal Inverse**, **Very Inverse**, **Extremely Inv.** or **Long Inverse**). If address 113 **Charac. Ground = TOC ANSI**, you can select the desired ANSI characteristic (**Very Inverse**, **Inverse**, **Short Inverse**, **Long Inverse**, **Moderately Inv.**, **Extremely Inv.** or **Definite Inv.**) in address 1312 **51N ANSI CURVE**.

If the inverse time trip characteristic is selected, it must be noted that a safety factor of about 1.1 has already been included between the pickup value and the setting value. This means that a pickup will only occur if a current of about 1.1 times the setting value is present. If **Disk Emulation** was selected at address 1310 **51 Drop-out**, reset will occur in accordance with the reset curve as described before.

The current value is set in address 1307 **51N PICKUP**. The setting is mainly determined by the minimum anticipated ground fault current.

The corresponding time multiplier for an IEC characteristic is set at address 1308 **51N TIME DIAL** and at address 1309 **51N TIME DIAL** for an ANSI characteristic. This has to be coordinated with the grading coordination chart of the network. For ground currents with grounded network, you can often set up a separate grading coordination chart with shorter delay times.

The time multiplier can also be set to ∞ . In this case, the element will not trip after pickup. However, pickup will be signaled. If the 51N-TOC element is not required at all, address 113 **Charac. Ground** should be set to **Definite Time** during configuration of the protection functions (see Section 2.1.1 *Functional Scope*).

Inrush Restraint

When applying the protection device to transformers where high inrush currents are to be expected, the 7SJ80 can make use of an inrush restraint function for the overcurrent elements 50-1, 51, 50N-1 and 51N.

Inrush restraint is only effective and accessible if address 122 **InrushRestraint** was set to **Enabled**. If this function is not required, then **Disabled** is set. In address 2201 **INRUSH REST.**, the function is switched **ON** or **OFF** jointly for the overcurrent elements **50-1 PICKUP**, **51 PICKUP**, **50N-1 PICKUP** and **51N PICKUP**.

The inrush restraint is based on the evaluation of the 2nd harmonic present in the inrush current. Upon delivery from the factory, a ratio I_{2f}/I_f of 15 % is set. Under normal circumstances, this setting will not need to be changed. The setting value is identical for all phases and ground. However, the component required for restraint may be adjusted to system conditions in address 2202 **2nd HARMONIC**. To provide more restraint in exceptional cases, where energizing conditions are particularly unfavorable, a smaller value can be set in the aforementioned address, e.g. 12 %. Irrespective of parameter 2202 **2nd HARMONIC**, rush blocking will only occur if the absolute value of the 2nd harmonic is at least $0.125 \cdot I_{Nom,sec}$.


The effective duration of the cross-blocking 2203 **CROSS BLK TIMER** can be set to a value between 0 s (harmonic restraint active for each phase individually) and a maximum of 180 s (harmonic restraint of a phase blocks also the other phases for the specified duration).

If the current exceeds the value set in address 2205 **I Max**, no further restraint will take place for the 2nd harmonic.

Manual Close Mode (phases ground)

When a circuit breaker is closed onto a faulted line, a high-speed trip by the circuit breaker is usually desired. For overcurrent or high-set element the delay may be bypassed via a Manual Close pulse, thus resulting in instantaneous tripping. The internal "Manual close" signal is built from the binary input signal >Manual Close (no. 356). The internal "Manual close" signal remains active as long as the binary input signal >Manual Close is active, but at least for 300 ms (see the following logic diagram). To enable the device to react properly on

occurrence of a fault in the phase element, address 1213 **MANUAL CLOSE** has to be set accordingly. Correspondingly, address 1313 **MANUAL CLOSE** is considered for the ground path address. Thus, the user determines for both elements, the phase and the ground element, what pickup value is active with what delay when the circuit breaker is closed manually.

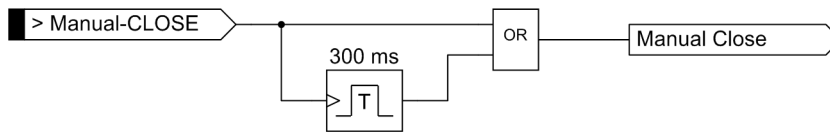

[lo_7sj6-hand-ein, 1, en_US]


Figure 2-17 Manual close feature

External Control Command

If the manual close signal is not sent from 7SJ80 device, i.e. neither via the built-in operator interface nor via a serial interface, but directly from a control acknowledgment switch, this signal must be passed to a 7SJ80 binary input, and configured accordingly (*>Manual Close*), so that the element selected for **MANUAL CLOSE** can become effective. The alternative **Inactive** means that all elements operate as per configuration even with manual close and do not get special treatment.

Internal Control Function

If the manual close signal is sent via the internal control function of the device, an internal connection of information has to be established via CFC (interlocking task level) using the CMD_Information block (see [Figure 2-18](#)).

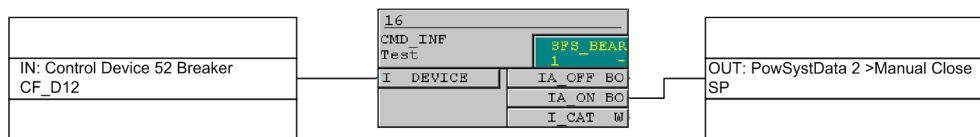

[handein-260602-kn, 1, en_US]

Figure 2-18 Example for the generation of a manual close signal using the internal control function



NOTE

For an interaction between the automatic reclosing function (79 AR) and the control function, an extended CFC logic is necessary. See margin heading "Close command: Directly or via Control" in the Setting Notes of the automatic reclosing function (Section [2.15.6 Setting Notes](#)).

Interaction with the Automatic Reclosing Function (phases)

If reclosing follows, high-speed and simultaneous protection against faults with 50-2 or 50-3 is usually desired. If the fault still exists after the first reclosing, the 50-1 or the 51 element will be initiated with graded tripping times, that is, element 50-2 or 50-3 will be blocked. You can use the parameters 1214 **50-2 active** or 1216 **50-3 active** active for this purpose to define whether or not the 50-2 or the 50-3 element is impacted by a release signal of the internal or an external automatic reclosing system. The setting **with 79 active** means that the 50-2 or the 50-3 element will only be released if automatic reclosing is not blocked. If this is not desired, the setting **Always** is selected so that the 50-2 or the 50-3 element is always active.

The integrated automatic reclosing function of 7SJ80 also provides the option to individually determine for each overcurrent element whether tripping or blocking is to be carried out instantaneously or unaffected by the AR with the set time delay (see Section [2.15 Automatic Reclosing System 79](#)).

Interaction with the Automatic Reclosing Function (ground)

When reclosing occurs, it is desirable to have high-speed protection against faults with 50N-2 or 50N-3. If the fault still exists after the first reclosing, the 50N-1 or the 51N element will be initiated with coordinated tripping times, that is, element 50N-2 or 50N-3 will be blocked. At address 1314 **50N-2 active** or 1316 **50N-3 active** active it can be specified whether the 50N-2 or the 50N-3 element should be influenced by the

release signal of an internal or external automatic reclosing system. Address **with 79 active** determines that the 50N-2 or the 50N-3 element will only operate if automatic reclosing is not blocked. If not desired, select the setting **Always** so that the 50N-2 or the 50N-3 element will always operate, as configured.

The integrated automatic reclosing function of 7SJ62/64 also provides the option to individually determine for each overcurrent element whether tripping or blocking is to be carried out instantaneously or unaffected by the AR with the set time delay (see Section [2.15 Automatic Reclosing System 79](#)).

2.2.12 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
1201	FCT 50/51		ON OFF	ON	50, 51 Phase Time Overcurrent
1202	50-2 PICKUP	1A	0.10 .. 35.00 A; ∞	4.00 A	50-2 Pickup
		5A	0.50 .. 175.00 A; ∞	20.00 A	
1203	50-2 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	50-2 Time Delay
1204	50-1 PICKUP	1A	0.10 .. 35.00 A; ∞	1.00 A	50-1 Pickup
		5A	0.50 .. 175.00 A; ∞	5.00 A	
1205	50-1 DELAY		0.00 .. 60.00 sec; ∞	0.50 sec	50-1 Time Delay
1207	51 PICKUP	1A	0.10 .. 4.00 A	1.00 A	51 Pickup
		5A	0.50 .. 20.00 A	5.00 A	
1208	51 TIME DIAL		0.05 .. 3.20 sec; ∞	0.50 sec	51 Time Dial
1209	51 TIME DIAL		0.50 .. 15.00 ; ∞	5.00	51 Time Dial
1210	51 Drop-out		Instantaneous Disk Emulation	Disk Emulation	Drop-out characteristic
1211	51 IEC CURVE		Normal Inverse Very Inverse Extremely Inv. Long Inverse	Normal Inverse	IEC Curve
1212	51 ANSI CURVE		Very Inverse Inverse Short Inverse Long Inverse Moderately Inv. Extremely Inv. Definite Inv.	Very Inverse	ANSI Curve
1213A	MANUAL CLOSE		50-3 instant. 50-2 instant. 50 -1 instant. 51 instant. Inactive	50-2 instant.	Manual Close Mode
1214A	50-2 active		Always with 79 active	Always	50-2 active
1215A	50 T DROP-OUT		0.00 .. 60.00 sec	0.00 sec	50 Drop-Out Time Delay
1216A	50-3 active		Always with 79 active	Always	50-3 active

Addr.	Parameter	C	Setting Options	Default Setting	Comments
1217	50-3 PICKUP	1A	1.00 .. 35.00 A; ∞	∞ A	50-3 Pickup
		5A	5.00 .. 175.00 A; ∞	∞ A	
1218	50-3 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	50-3 Time Delay
1219A	50-3 measurem.		Fundamental True RMS Instantaneous	Fundamental	50-3 measurement of
1220A	50-2 measurem.		Fundamental True RMS	Fundamental	50-2 measurement of
1221A	50-1 measurem.		Fundamental True RMS	Fundamental	50-1 measurement of
1222A	51 measurem.		Fundamental True RMS	Fundamental	51 measurement of
1223	VOLT. INFLUENCE		NO Volt. controll. Volt. restraint	NO	51V Voltage Influence
1224	51V V<		10.0 .. 125.0 V	75.0 V	51V V< Threshold for Release Ip
1301	FCT 50N/51N		ON OFF	ON	50N, 51N Ground Time Overcurrent
1302	50N-2 PICKUP	1A	0.05 .. 35.00 A; ∞	0.50 A	50N-2 Pickup
		5A	0.25 .. 175.00 A; ∞	2.50 A	
1303	50N-2 DELAY		0.00 .. 60.00 sec; ∞	0.10 sec	50N-2 Time Delay
1304	50N-1 PICKUP	1A	0.05 .. 35.00 A; ∞	0.20 A	50N-1 Pickup
		5A	0.25 .. 175.00 A; ∞	1.00 A	
1305	50N-1 DELAY		0.00 .. 60.00 sec; ∞	0.50 sec	50N-1 Time Delay
1307	51N PICKUP	1A	0.05 .. 4.00 A	0.20 A	51N Pickup
		5A	0.25 .. 20.00 A	1.00 A	
1308	51N TIME DIAL		0.05 .. 3.20 sec; ∞	0.20 sec	51N Time Dial
1309	51N TIME DIAL		0.50 .. 15.00 ; ∞	5.00	51N Time Dial
1310	51N Drop-out		Instantaneous Disk Emulation	Disk Emulation	Drop-Out Characteristic
1311	51N IEC CURVE		Normal Inverse Very Inverse Extremely Inv. Long Inverse	Normal Inverse	IEC Curve
1312	51N ANSI CURVE		Very Inverse Inverse Short Inverse Long Inverse Moderately Inv. Extremely Inv. Definite Inv.	Very Inverse	ANSI Curve
1313A	MANUAL CLOSE		50N-3 instant. 50N-2 instant. 50N-1 instant. 51N instant. Inactive	50N-2 instant.	Manual Close Mode

Addr.	Parameter	C	Setting Options	Default Setting	Comments
1314A	50N-2 active		Always With 79 Active	Always	50N-2 active
1315A	50N T DROP-OUT		0.00 .. 60.00 sec	0.00 sec	50N Drop-Out Time Delay
1316A	50N-3 active		Always with 79 active	Always	50N-3 active
1317	50N-3 PICKUP	1A	0.25 .. 35.00 A; ∞	∞ A	50N-3 Pickup
1318	50N-3 DELAY		0.00 .. 60.00 sec; ∞	0.05 sec	50N-3 Time Delay
1319A	50N-3 measurem.		Fundamental True RMS Instantaneous	Fundamental	50N-3 measurement of
1320A	50N-2 measurem.		Fundamental True RMS	Fundamental	50N-2 measurement of
1321A	50N-1 measurem.		Fundamental True RMS	Fundamental	50N-1 measurement of
1322A	51N measurem.		Fundamental True RMS	Fundamental	51N measurement of
2201	INRUSH REST.		OFF ON	OFF	Inrush Restraint
2202	2nd HARMONIC		10 .. 45 %	15 %	2nd. harmonic in % of fundamental
2203	CROSS BLOCK		NO YES	NO	Cross Block
2204	CROSS BLK TIMER		0.00 .. 180.00 sec	0.00 sec	Cross Block Time
2205	I Max	1A	0.30 .. 25.00 A	7.50 A	Maximum Current for Inrush Restraint
		5A	1.50 .. 125.00 A	37.50 A	

2.2.13 Information List

No.	Information	Type of Information	Comments
1704	>BLK 50/51	SP	>BLOCK 50/51
1714	>BLK 50N/51N	SP	>BLOCK 50N/51N
1718	>BLOCK 50-3	SP	>BLOCK 50-3
1719	>BLOCK 50N-3	SP	>BLOCK 50N-3
1721	>BLOCK 50-2	SP	>BLOCK 50-2
1722	>BLOCK 50-1	SP	>BLOCK 50-1
1723	>BLOCK 51	SP	>BLOCK 51
1724	>BLOCK 50N-2	SP	>BLOCK 50N-2
1725	>BLOCK 50N-1	SP	>BLOCK 50N-1
1726	>BLOCK 51N	SP	>BLOCK 51N
1751	50/51 PH OFF	OUT	50/51 O/C switched OFF
1752	50/51 PH BLK	OUT	50/51 O/C is BLOCKED
1753	50/51 PH ACT	OUT	50/51 O/C is ACTIVE
1756	50N/51N OFF	OUT	50N/51N is OFF
1757	50N/51N BLK	OUT	50N/51N is BLOCKED
1758	50N/51N ACT	OUT	50N/51N is ACTIVE

No.	Information	Type of Information	Comments
1761	50(N)/51(N) PU	OUT	50(N)/51(N) O/C PICKUP
1762	50/51 Ph A PU	OUT	50/51 Phase A picked up
1763	50/51 Ph B PU	OUT	50/51 Phase B picked up
1764	50/51 Ph C PU	OUT	50/51 Phase C picked up
1765	50N/51NPickedup	OUT	50N/51N picked up
1767	50-3 picked up	OUT	50-3 picked up
1768	50N-3 picked up	OUT	50N-3 picked up
1769	50-3 TRIP	OUT	50-3 TRIP
1770	50N-3 TRIP	OUT	50N-3 TRIP
1787	50-3 TimeOut	OUT	50-3 TimeOut
1788	50N-3 TimeOut	OUT	50N-3 TimeOut
1791	50(N)/51(N)TRIP	OUT	50(N)/51(N) TRIP
1800	50-2 picked up	OUT	50-2 picked up
1804	50-2 TimeOut	OUT	50-2 Time Out
1805	50-2 TRIP	OUT	50-2 TRIP
1810	50-1 picked up	OUT	50-1 picked up
1814	50-1 TimeOut	OUT	50-1 Time Out
1815	50-1 TRIP	OUT	50-1 TRIP
1820	51 picked up	OUT	51 picked up
1824	51 Time Out	OUT	51 Time Out
1825	51 TRIP	OUT	51 TRIP
1831	50N-2 picked up	OUT	50N-2 picked up
1832	50N-2 TimeOut	OUT	50N-2 Time Out
1833	50N-2 TRIP	OUT	50N-2 TRIP
1834	50N-1 picked up	OUT	50N-1 picked up
1835	50N-1 TimeOut	OUT	50N-1 Time Out
1836	50N-1 TRIP	OUT	50N-1 TRIP
1837	51N picked up	OUT	51N picked up
1838	51N TimeOut	OUT	51N Time Out
1839	51N TRIP	OUT	51N TRIP
1840	PhA InrushDet	OUT	Phase A inrush detection
1841	PhB InrushDet	OUT	Phase B inrush detection
1842	PhC InrushDet	OUT	Phase C inrush detection
1843	INRUSH X-BLK	OUT	Cross blk: PhX blocked PhY
1851	50-1 BLOCKED	OUT	50-1 BLOCKED
1852	50-2 BLOCKED	OUT	50-2 BLOCKED
1853	50N-1 BLOCKED	OUT	50N-1 BLOCKED
1854	50N-2 BLOCKED	OUT	50N-2 BLOCKED
1855	51 BLOCKED	OUT	51 BLOCKED
1856	51N BLOCKED	OUT	51N BLOCKED
1866	51 Disk Pickup	OUT	51 Disk emulation Pickup
1867	51N Disk Pickup	OUT	51N Disk emulation picked up
7551	50-1 InRushPU	OUT	50-1 InRush picked up
7552	50N-1 InRushPU	OUT	50N-1 InRush picked up
7553	51 InRushPU	OUT	51 InRush picked up

No.	Information	Type of Information	Comments
7554	51N InRushPU	OUT	51N InRush picked up
7556	InRush OFF	OUT	InRush OFF
7557	InRush BLK	OUT	InRush BLOCKED
7558	InRush Gnd Det	OUT	InRush Ground detected
7559	67-1 InRushPU	OUT	67-1 InRush picked up
7560	67N-1 InRushPU	OUT	67N-1 InRush picked up
7561	67-TOC InRushPU	OUT	67-TOC InRush picked up
7562	67N-TOC InRushPU	OUT	67N-TOC InRush picked up
7563	>BLOCK InRush	SP	>BLOCK InRush
7564	Gnd InRush PU	OUT	Ground InRush picked up
7565	Ia InRush PU	OUT	Phase A InRush picked up
7566	Ib InRush PU	OUT	Phase B InRush picked up
7567	Ic InRush PU	OUT	Phase C InRush picked up
10034	50-3 BLOCKED	OUT	50-3 BLOCKED
10035	50N-3 BLOCKED	OUT	50N-3 BLOCKED

2.3 Directional Overcurrent Protection 67, 67N

The directional time overcurrent protection comprises three elements each for phase currents and the ground current that can operate directional or non-directional. All elements are independent of each other and can be combined as desired.


High current element 67-2 and overcurrent element 67-1 always operate with a definite tripping time, the third element 67-TOC always operates with inverse tripping time.

Applications

- The directional overcurrent protection allows the application of multifunctional protection devices 7SJ80 also in systems where protection coordination depends on knowing both the magnitude of the fault current and the direction of power flow to the fault location.
- The non-directional overcurrent protection described in Section [2.2 Overcurrent Protection 50, 51, 50N, 51N](#) may operate as overlapping backup protection or may be disabled. Additionally, individual elements (e.g. 67-2 and/or 67N-2) may be interconnected with the directional overcurrent protection.
- For parallel lines or transformers supplied from a single source, only directional overcurrent protection allows selective fault detection.
- For line sections supplied from two sources or in ring-operated lines, the overcurrent protection has to be supplemented by the element-specific directional criterion.

2.3.1 General


For parallel lines or transformers supplied from a single source (see [Figure 2-19](#)), the second feeder (II) is opened on occurrence of a fault in the first feeder (I) if tripping of the breaker in the parallel feeder is not prevented by a directional measuring element (at B). Therefore, where indicated with an arrow ([Figure 2-19](#)), directional overcurrent protection is applied. Please ensure that the "forward" direction of the protection element is in the direction of the line (or object to be protected). This is not necessarily identical with the direction of the normal load flow, as shown in [Figure 2-19](#).

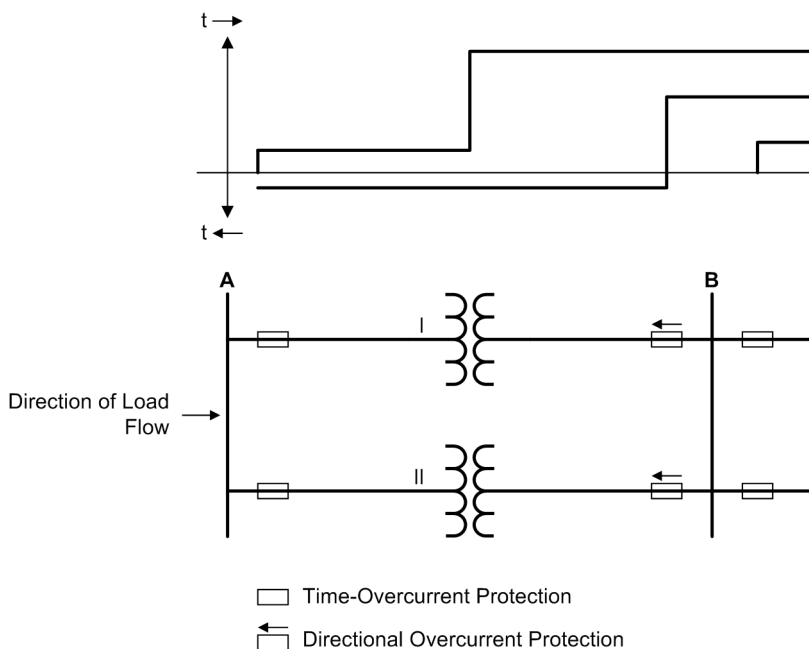

[ueberstromzeitschutz-bei-paralleltransformatoren-020626-kn, 1, en_US]

Figure 2-19 Overcurrent protection for parallel transformers

For line sections supplied from two sources or in ring-operated lines, the overcurrent protection has to be supplemented by the directional criterion. [Figure 2-20](#) shows a ring system where both energy sources are merged to one single source.

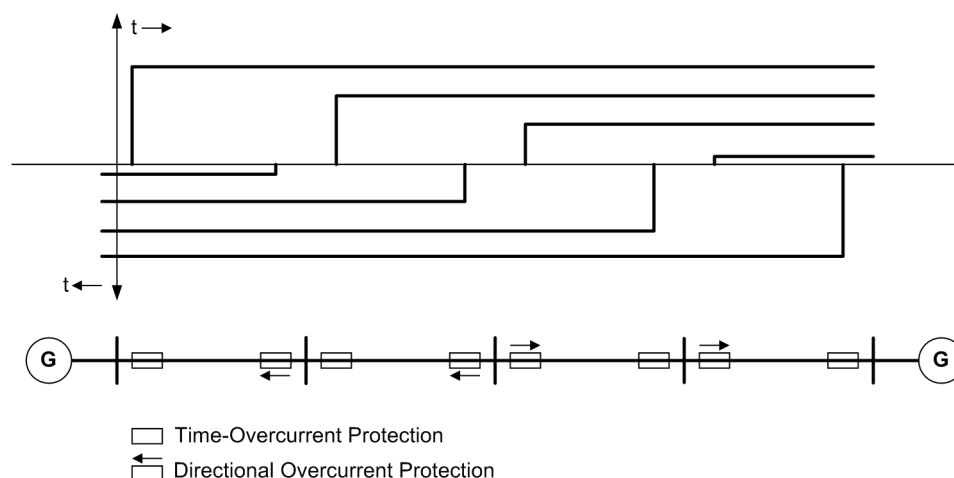

[zweiseitig-ge-speister-leitungszug-260602-kn, 1, en_US]

Figure 2-20 Transmission lines with sources at both ends

Depending on the setting of parameter 613 **50N/51N/67N w.**, the ground current element can operate either with measured values I_N or with the values $3I_0$ calculated from the three phase currents. Devices featuring a sensitive ground current input, however, use the calculated quantity $3I_0$.

The directional orientation **Forward**, **Reverse** or **Non-Directional** can be set individually for each element (**Non-Directional** from V4.7 on).

For each element the time can be blocked via binary input or automatic reclosing (cycle-dependent), thus suppressing the trip command. Removal of blocking during pickup will restart time delays. The Manual Close signal is an exception. If a circuit breaker is manually closed onto a fault, it can be re-opened immediately. For overcurrent elements or high-set elements the delay may be bypassed via a Manual Close pulse, thus resulting in high-speed tripping.

Furthermore, immediate tripping may be initiated in conjunction with the automatic reclosing function (cycle dependant).

Pickup stabilization for the 67/67N elements of the directional overcurrent protection can be accomplished by means of settable dropout times. This protection comes into use in systems where intermittent faults occur. Combined with electromechanical relays, it allows different dropout responses to be adjusted and a time grading of digital and electromechanical relays to be implemented.

Pickup and delay settings may be quickly adjusted to system requirements via dynamic setting switching (see [Section 2.4 Dynamic Cold Load Pickup](#)).

Utilizing the inrush restraint feature tripping may be blocked by the 67-1, 67-TOC, 67N-1, and 67N-TOC elements in phases and ground path when inrush current is detected.

The following table gives an overview of these interconnections to other functions of the 7SJ80 devices.

Table 2-5 Interconnection to other functions

Directional Time Overcurrent Protection Elements	Connection to Auto-matic Reclosing	Manual CLOSE	Dynamic Cold Load Pickup	Inrush Restraint
67-1	•	•	•	•
67-2	•	•	•	
67-3	•	•	•	
67-TOC	•	•	•	•
67N-1	•	•	•	•
67N-2	•	•	•	

Directional Time Overcurrent Protection Elements	Connection to Automatic Reclosing	Manual CLOSE	Dynamic Cold Load Pickup	Inrush Restraint
67N-3	•	•	•	
67N-TOC	•	•	•	•

2.3.2 Definite Time Directional High-set Elements 67-2, 67N-2, 67-3, 67N-3


For each element an individual pickup value **67-2 PICKUP**, **67-3 PICKUP** or **67N-2 PICKUP**, **67N-3 PICKUP** is set which can be measured as *Fundamental* or *True RMS*. Each phase current and the ground current is compared with the common pickup value for each element **67-2 PICKUP**, **67-3 PICKUP** or **67N-2 PICKUP**, **67N-3 PICKUP**, and it is signaled when the value is exceeded provided that the fault direction is the same as the parameterized direction. After the associated delay times **67-2 DELAY**, **67-3 DELAY** or **67N-2 DELAY**, **67N-3 DELAY** have expired, the tripping commands are initiated which are equally available separately for each element. The dropout value is approximately 95% of the pickup value for currents $> 0.3 I_{Nom}$.

Pickup can be stabilized by setting dropout times 1518 **67 T DROP-OUT** or 1618 **67N T DROP-OUT**. This time is started and maintains the pickup condition if the current falls below the threshold. Therefore, the function does not drop out instantaneously. The trip delay times **50-2 DELAY**, **67-3 DELAY** or **50N-2 DELAY**, **67N-3 DELAY** continue during that time. After the dropout delay time has elapsed, the pickup is reported OFF and the trip delay time is reset unless the threshold **50-2 PICKUP**, **67-3 PICKUP** or **50N-2 PICKUP**, **67N-3 PICKUP** has been exceeded again. If the threshold is exceeded again during the dropout delay time, the time is canceled. The trip delay time **50-2 DELAY**, **67-3 DELAY** or **50N-2 DELAY**, **67N-3 DELAY** continues. If the threshold value is exceeded after this time has elapsed, the trip command is issued immediately. If the threshold value is not exceeded at this time, there is no reaction. If the threshold value is exceeded again after expiry of the trip command delay time, while the dropout delay time is still running, tripping is initiated immediately.

Each of these elements can be directional or non-directional (non-directional from V4.7 on).

These elements can be blocked by the automatic reclosing function (79 AR).

The following figure gives an example of the logic diagram for the high-set elements 67-2 of the phase currents. The high-set element 67-3 is structured identically.

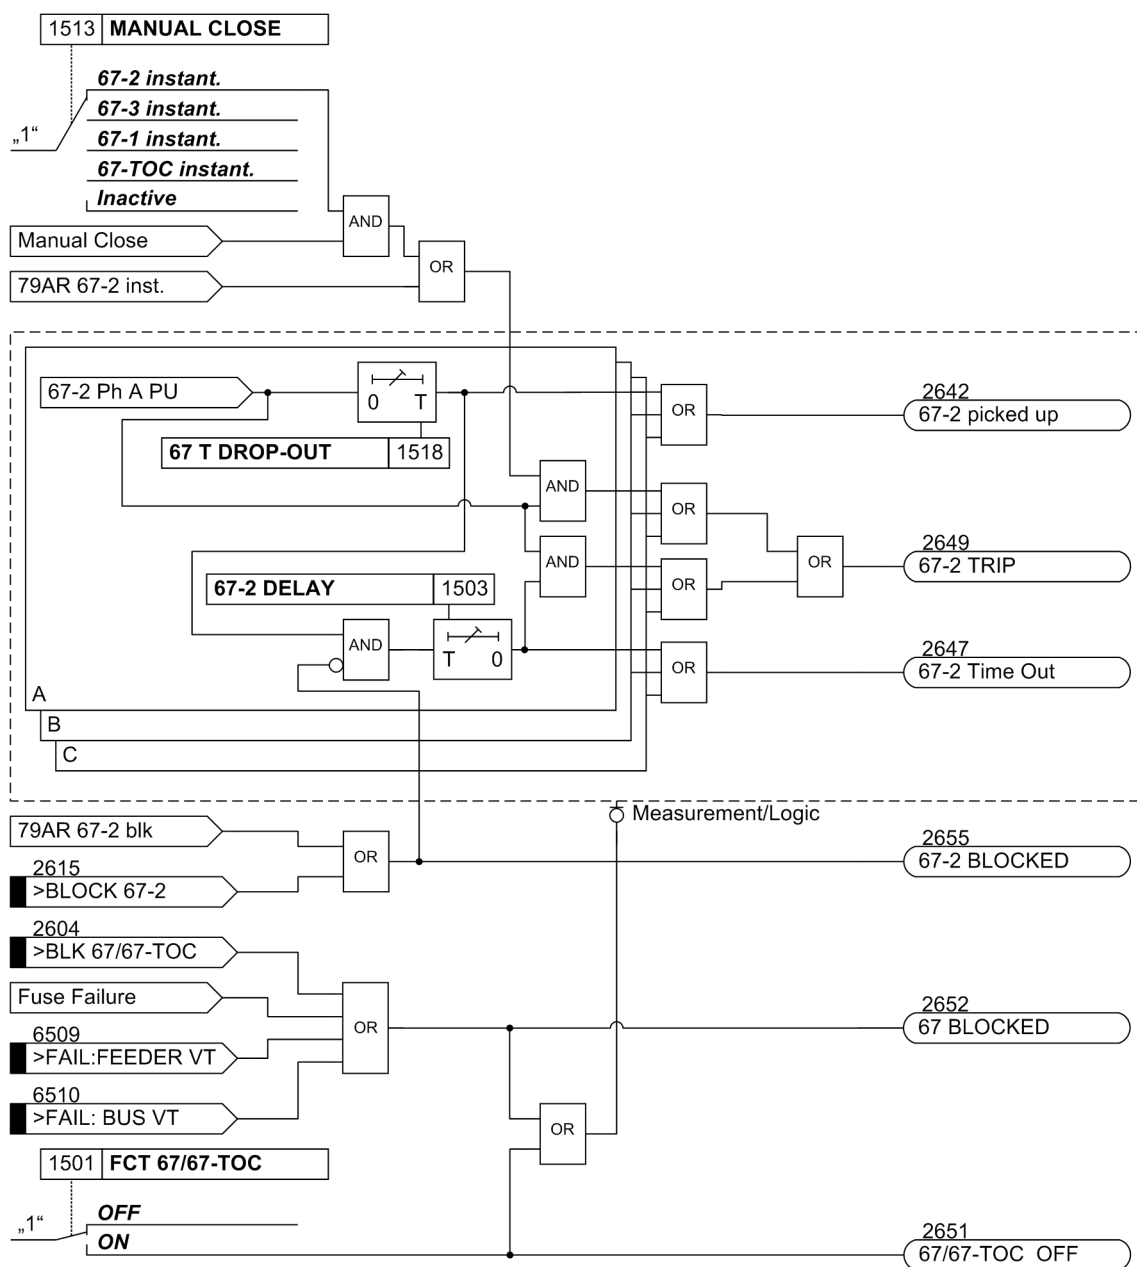

[7sj6x_gerueberstromzeit_hochstromst-030903-he, 1, en_US]

Figure 2-21 Logic diagram for directional high-set element 67-2 for phases

If parameter **MANUAL CLOSE** is set to **67-2 instant.** or **67-3 instant.** and manual close detection is present, a pickup causes instantaneous tripping even if the element is blocked via binary input. The same applies to 79 AR 67-2 or 79 AR 67-3 instantaneous.

2.3.3 Definite Time, Directional Time Overcurrent Elements 67-1, 67N-1

For each element, an individual pickup value **67-1 PICKUP** or **67N-1 PICKUP** is set which can be measured as **Fundamental** or **True RMS**. Phase and ground currents are compared separately with the common setting value **67-1 PICKUP** or **67N-1 PICKUP**. Currents above the setting values are recognized separately when fault direction is equal to the configured direction. If the inrush restraint function is used, either the normal pickup signals or the corresponding inrush signals are issued as long as inrush current is detected. When the relevant delay times **67-1 DELAY**, **67N-1 DELAY** have expired, a tripping command is issued

unless an inrush has been recognized or inrush restraint is active. If the inrush restraint feature is enabled, and an inrush condition exists, no tripping takes place, but a message is recorded and displayed indicating when the overcurrent element time delay elapses. Trip signals and other flags for each element are issued when the element times out. The dropout value is roughly equal to 95% of the pickup value for currents $> 0.3 I_{Nom}$.


Pickup can be stabilized by setting dropout times 1518 **67 T DROP-OUT** or 1618 **67N T DROP-OUT**. This time is started and maintains the pickup condition if the current falls below the threshold. Therefore, the function does not drop out at high speed. The trip-command delay time **50-1 DELAY** or **50N-1 DELAY** continues in the meantime. After the dropout delay time has elapsed, the pickup is reported OFF and the trip delay time is reset unless the threshold **50-1 PICKUP** or **50N-1 PICKUP** has been exceeded again. If the threshold is exceeded again during the dropout delay time, the time is canceled. The trip-command delay time **50-1 DELAY** or **50N-1 DELAY** continues in the meantime. Should the threshold value be exceeded after its expiry, the trip command is issued immediately. If the threshold value is not exceeded at this time, there will be no reaction. If the threshold value is exceeded again after expiry of the trip-command delay time, while the dropout delay time is still running, tripping occurs immediately.

The inrush restraint of the overcurrent elements **50-1 PICKUP** or **50N-1 PICKUP** is disabled via configurable dropout times if an inrush pickup occurs, because the occurrence of an inrush does not constitute an intermittent fault.

Each of these elements can be directional or non-directional (non-directional from V4.7 on).

These elements can be blocked by the automatic reclosure function (AR).

The following figure shows by way of an example the logic diagram for the directional overcurrent element 67-1.

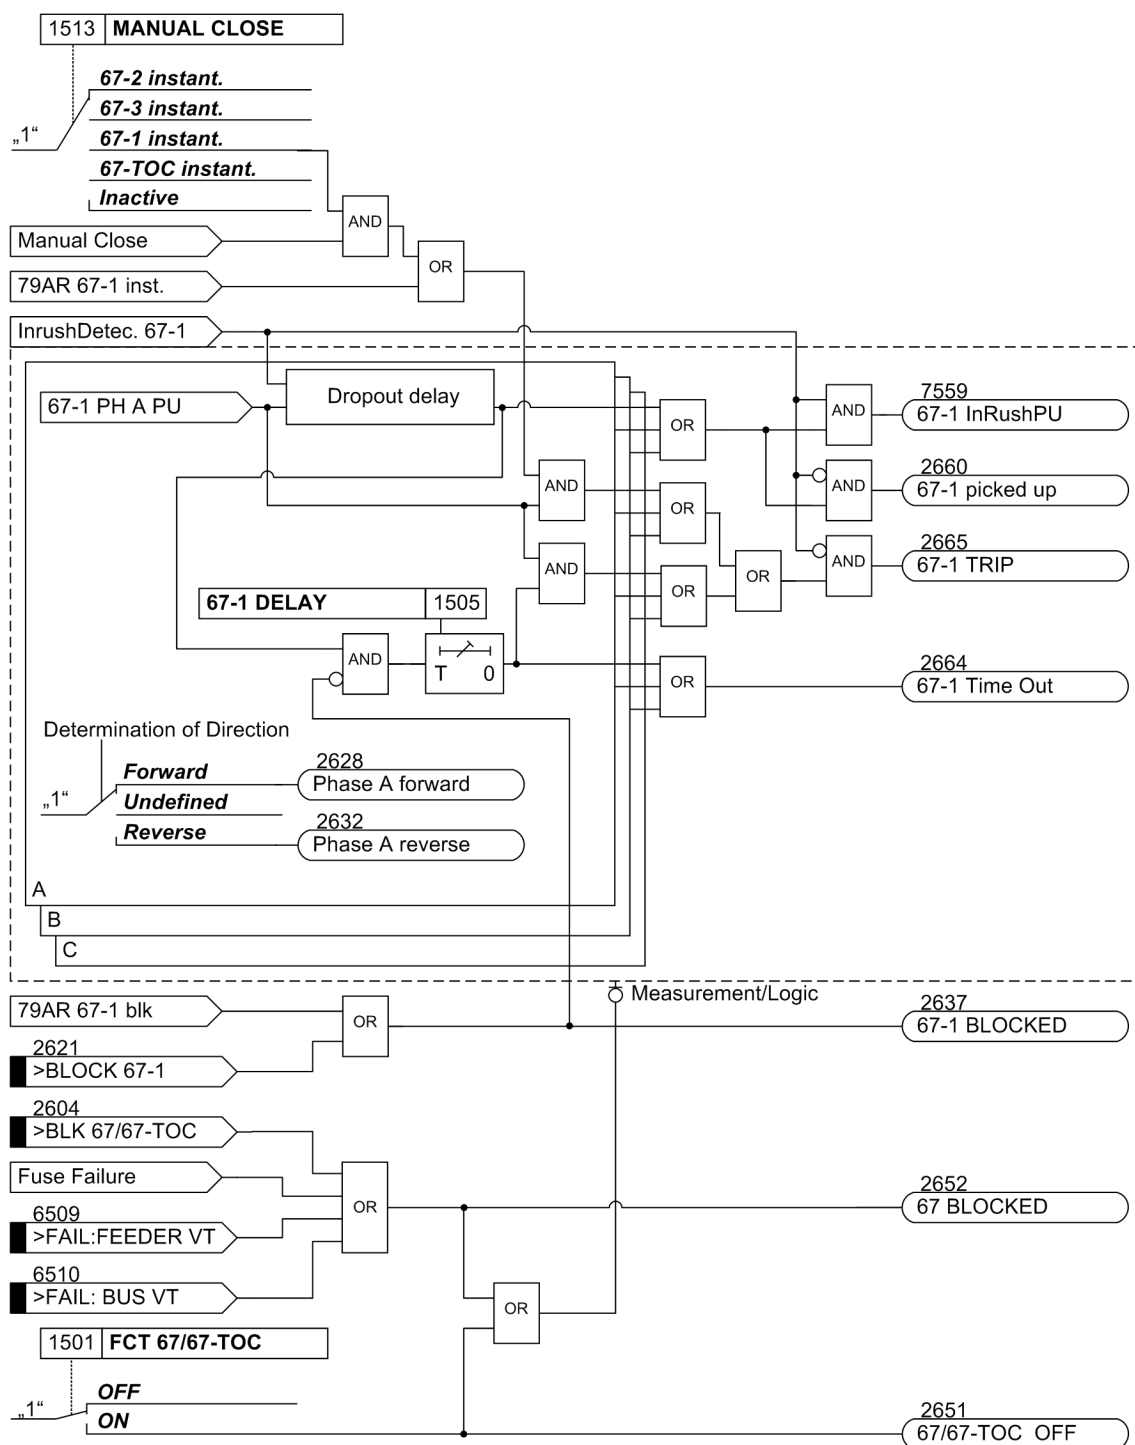


[7sj6x_gerueberstromzeit_ueberstromst-030903-he, 1, en_US]

Figure 2-22 Logic diagram for the directional relay element 67-1 for phases

If parameter **MANUAL CLOSE** is set to **67-1 instant.** and manual close detection is present, a pickup causes instantaneous tripping even if the element is blocked via binary input.

The same applies to 79 AR 67-1 instantaneous.

The dropout delay does only function if no inrush was detected. An approaching inrush resets an already running dropout time delay.

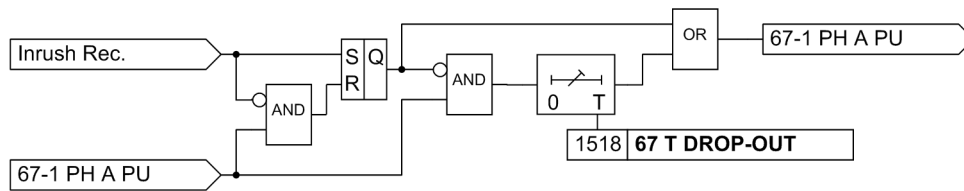

[dw_7sj6x_gerrueckfallverzögerung_i_gr_ph, 1, en_US]

Figure 2-23 Logic of the dropout delay for 67-1

2.3.4 Inverse Time, Directional Overcurrent Elements 67-TOC, 67N-TOC

Inverse time elements are dependent on the variant ordered. They operate either according to the IEC- or the ANSI-standard. The characteristics and associated formulas are identical with those of the non-directional overcurrent protection and are given in the Technical Data. When the inverse time curves are configured, the definite time elements (67-2, 67-1) are also available.

Pickup Behavior

For each element, an individual pickup value **67-TOC PICKUP** or **67N-TOC PICKUP** is set which can be measured as *Fundamental* or *True RMS*. Each phase and ground current is separately compared with the common pickup value **67-TOC PICKUP** or **67N-TOC PICKUP** of each element. When a current value exceeds the corresponding setting value by a factor of 1.1, the corresponding phase picks up and a message is generated phase-selectively assuming that the fault direction is equal to the direction configured. If the inrush restraint feature is used, either the normal pickup signals or the corresponding inrush signals are issued as long as inrush current is detected. If the 67-TOC element picks up, the tripping time is calculated from the actual fault current flowing, using an integrating method of measurement. The calculated tripping time depends on the selected tripping curve. Once this time has elapsed, a trip signal is issued provided that no inrush current is detected or inrush restraint is disabled. If the inrush restraint feature is enabled and an inrush condition exists, no tripping takes place, but a message is recorded and displayed indicating when the overcurrent element time delay elapses.

For ground current element **67N-TOC PICKUP**, the characteristic may be selected independently of the characteristic used for phase currents.

Pickup values of the 67-TOC (phases) and 67N-TOC (ground current) and the associated time multipliers may be set individually.

Each of these elements can be directional or non-directional (non-directional from V4.7 on).


Dropout Behavior

When using an ANSI or IEC curve, it can be selected whether the dropout of an element is to occur instantaneously or whether dropout is to be performed by means of the disk emulation mechanism. "Instantaneously" means that pickup drops out when the pickup value of approx. 95 % of the set pickup value is undershot. For a new pickup, the time counter starts at zero.

The disk emulation evokes a dropout process (time counter is decrementing) which begins after de-energization. This process corresponds to the reset of a Ferraris disk (explaining its denomination "disk emulation"). In case several faults occur in succession the "history" is taken into consideration due to the inertia of the Ferraris disk and the time response is adapted. Reset begins as soon as 90 % of the setting value is undershot, in accordance to the dropout curve of the selected characteristic. In the range between the dropout value (95 % of the pickup value) and 90 % of the setting value, the incrementing and the decrementing processes are in idle state.

Disk emulation offers advantages when the overcurrent relay elements must be coordinated with conventional electromechanical overcurrent relays located towards the source.

The following figure shows by way of an example the logic diagram for the 67-TOC relay element of the directional inverse time overcurrent protection of the phase currents.

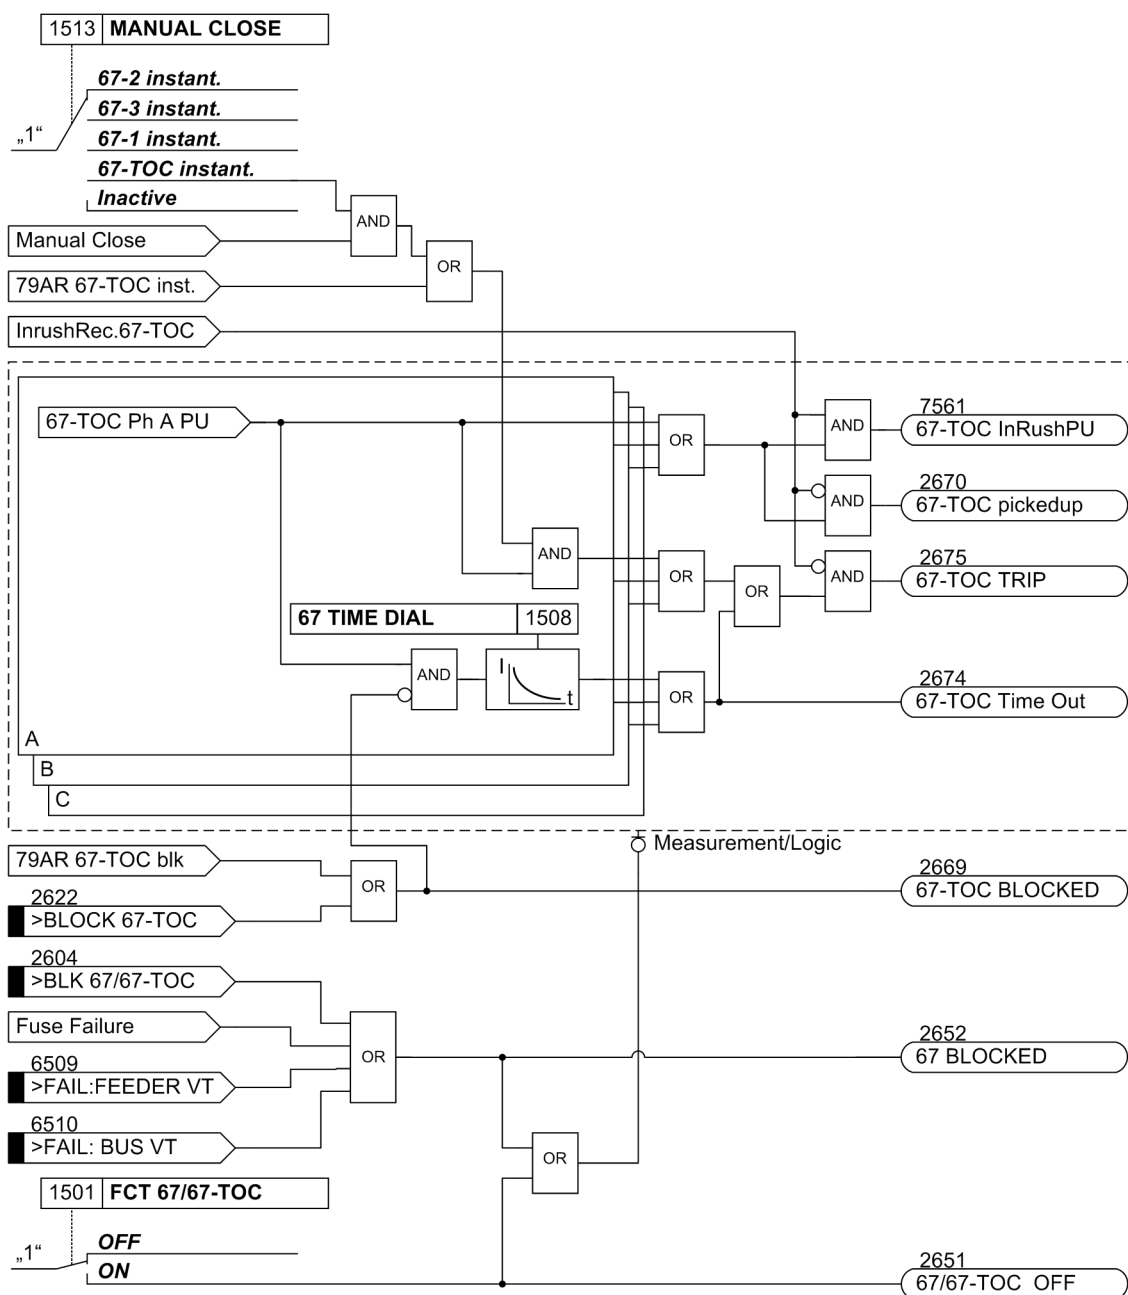

[7sj6x_geueberstromzeit_abh_ueberstrom_ip-150502-kn, 1, en_US]

Figure 2-24 Logic diagram for the directional overcurrent protection: 67-TOC relay element

2.3.5 Interaction with Fuse Failure Monitor (FFM)

False or undesired tripping can be caused by a measuring voltage that can be caused by either short-circuit or broken wire in the voltage transformer's secondary system or an operation of the voltage transformer fuse. Failure of the measuring voltage in one or two phases can be detected, and the directional time overcurrent elements (Dir Phase and Dir Ground) can be blocked, see logic diagrams.

Undervoltage protection, sensitive ground fault detection and synchronization are also blocked in this case. For additional information on the operation of the fuse failure monitor, see Section [2.11.1 Measurement Supervision](#).

2.3.6 Dynamic Cold Load Pickup Function

It may be necessary to dynamically increase the pickup values of the directional time overcurrent protection if, at starting, certain elements of the system show an increased power consumption after a long period of zero voltage (e.g. air-conditioning systems, heating installations, motors). Thus, a general raise of pickup thresholds can be avoided taking into consideration such starting conditions.

This dynamic pickup value changeover is common to all overcurrent elements and is described in Section [2.4 Dynamic Cold Load Pickup](#). The alternative pickup values can be set individually for each element of the directional and non-directional time overcurrent protection.

2.3.7 Inrush Restraint

7SJ80 features an integrated inrush restraint function. It prevents "normal" pickup of the 67-1 or 67-TOC elements (not 67-2 and 67-3) in the phases and in the ground path of the non-directional and directional overcurrent protection functions. The same is true for the alternative pickup thresholds of the dynamic cold load pickup function. If inrush currents are detected, special inrush pickup signals are generated. These signals also initiate fault recording and start the associated trip delay time. If inrush conditions are still present after the tripping time delay has elapsed, a corresponding message ("**....TimeOut** ") is output, but tripping is blocked (for further information see "Inrush Restraint" in Section [2.2 Overcurrent Protection 50, 51, 50N, 51N](#)).

2.3.8 Determination of Direction

The determination of the fault direction for the phase directional element and the ground directional element is performed independently.

Basically, the direction determination is performed by determining the phase angle between the fault current and a reference voltage.

Method of Directional Measurement

For the phase directional element the fault current of the corresponding phase and the unfaulted phase-to-phase voltage are used as reference voltage. The unfaulted voltage also allows for a correct direction determination even if the fault voltage has collapsed entirely (short-line fault). In phase-to-ground voltage connections, the phase-to-phase voltages are calculated. In a connection of two phase-to-phase voltages and V_N , the third phase-to-phase voltage is also calculated.

With three-phase short-line faults, memory voltage values are used to clearly determine the direction if the measurement voltages are not sufficient. Upon the expiration of the storage time period (2 s), the detected direction is saved, as long as no sufficient measuring voltage is available. When closing onto a fault, if no memory voltage values exist in the buffer, the relay element will trip. In all other cases the voltage magnitude will be sufficient for determining the direction.

For each directional ground element there are two possibilities of direction determination.

Direction Determination with Zero-sequence System or Ground Quantities

For the directional ground fault elements, the direction can be determined from the zero-sequence system quantities. In the current path, the I_N current is valid, when the transformer neutral current is connected to the device. Otherwise, the device calculates the ground current from the sum of the three phase currents. In the voltage path, the displacement voltage V_N is used as reference voltage if connected. Otherwise the device calculates as reference voltage the zero-sequence voltage $3 \cdot V_0$ from the sum of the three phase voltages. If the magnitude of V_0 or $3 \cdot V_0$ is not sufficient to determine the direction, the direction is undefined. Then the directional ground element will not initiate a trip signal. The directional ground element cannot be applied when only two current transformers are used.


Direction Determination with Negative Sequence System

Here, the negative sequence current and as reference voltage the negative sequence voltage are used for the direction determination. This is advantageous if the zero sequence is influenced via a parallel line or if the zero voltage becomes very small due to unfavorable zero impedances. The negative sequence system is calculated from the individual voltages and currents. As with the use of the zero sequence values, a direction determination is carried out if the values necessary for the direction determination have exceeded a minimum threshold. Otherwise the direction is undetermined.

When voltage transformers are open-delta-connected, direction determination is always based on the negative-sequence quantities.

Cross-Polarized Reference Voltages for Direction Determination

The direction of a phase-directional element is detected by means of a cross-polarized voltage. In a phase-to-ground fault, the cross-polarized voltage (reference voltage) is 90° out of phase with the fault voltages (see [Figure 2-25](#)). With phase-to-phase faults, the position of the reference voltages changes, depending on the degree of collapse of the fault voltages, up to 30°.

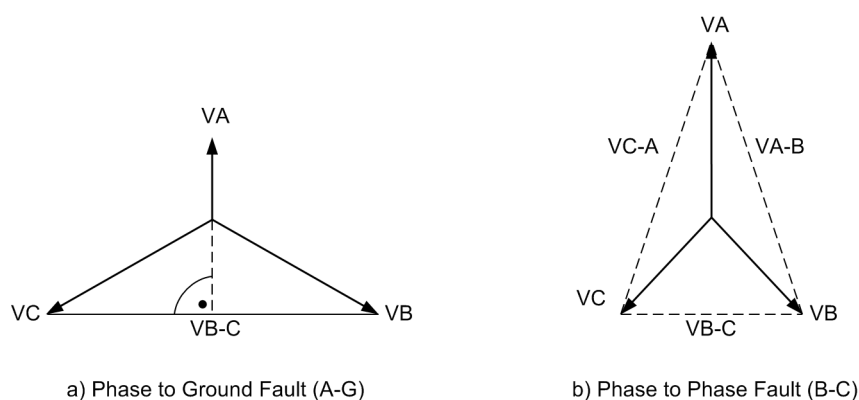

[kurzschlussfremde-spannungen-fuer-richtungsbestimmung-260602-kn, 1, en_US]

Figure 2-25 Cross-polarized voltages for direction determination

Measured Values for the Determination of Fault Direction

Each phase has its own phase measuring element. The fourth measuring element is used as ground measuring element. If the current exceeds the pickup threshold of a phase or that of the ground path, direction determination is started by the associated measuring element. In case of a multiphase fault, all phase measuring elements involved perform their own direction determination. If one of the calculated directions differs from the set direction, the function picks up.

The following table shows the allocation of measured values for the determination of fault direction for various causes of pickup.

Table 2-6 Measured Values for the Determination of Fault Direction


Pickup	Measuring element							
	A		B		C		ground	
	Current	Voltage	Current	Voltage	Current	Voltage	Current	Voltage
A	I_A	$V_B - V_C$	—	—	—	—	—	—
B	—	—	I_B	$V_C - V_A$	—	—	—	—
C	—	—	—	—	I_C	$V_A - V_B$	—	—
N	—	—	—	—	—	—	I_N	$V_N^{1)}$
A, N	—	$V_B - V_C$	—	—	—	—	I_N	$V_N^{1)}$
B, N	—	—	I_B	$V_C - V_A$	—	—	I_N	$V_N^{1)}$
C, N	—	—	—	—	I_C	$V_A - V_B$	I_N	$V_N^{1)}$

Pickup	Measuring element							
	A		B		C		ground	
	Current	Voltage	Current	Voltage	Current	Voltage	Current	Voltage
A, B	I_A	$V_B - V_C$	I_B	$V_C - V_A$	—	—	—	—
B, C	—	—	I_B	$V_C - V_A$	I_C	$V_A - V_B$	—	—
AC	I_A	$V_B - V_C$	—	—	I_C	$V_A - V_B$	—	—
A, B, N	I_A	$V_B - V_C$	I_B	$V_C - V_A$	—	—	I_N	$V_N^{1)}$
B, C, N	—	—	I_B	$V_C - V_A$	I_C	$V_A - V_B$	I_N	$V_N^{1)}$
A, C, N	I_A	$V_B - V_C$	—	—	I_C	$V_A - V_B$	I_N	$V_N^{1)}$
A, B, C	I_A	$V_B - V_C$	I_B	$V_C - V_A$	I_C	$V_A - V_B$	—	—
A, B, C, N	I_A	$V_B - V_C$	I_B	$V_C - V_A$	I_C	$V_A - V_B$	I_N	$V_N^{1)}$

¹⁾ or $3 \cdot V_0 = |V_A + V_B + V_C|$, depending on the connection type of voltages

Direction Determination of Directional Phase Elements

As already mentioned, the direction determination is performed by determining the phase angle between the fault current and the reference voltage. In order to satisfy different network conditions and applications, the reference voltage can be rotated by an adjustable angle. In this way, the vector of the rotated reference voltage can be closely adjusted to the vector of the fault current in order to provide the best possible result for the direction determination. [Figure 2-26](#) clearly shows the relationship for the directional phase element based on a single-phase ground fault in Phase A. The fault current I_{scA} follows the fault voltage by fault angle ϕ_{sc} . The reference voltage, in this case V_{BC} for the directional phase element A, is rotated by the setting value 1519 **ROTATION ANGLE**, positively counter-clockwise. In this case, a rotation by $+45^\circ$.

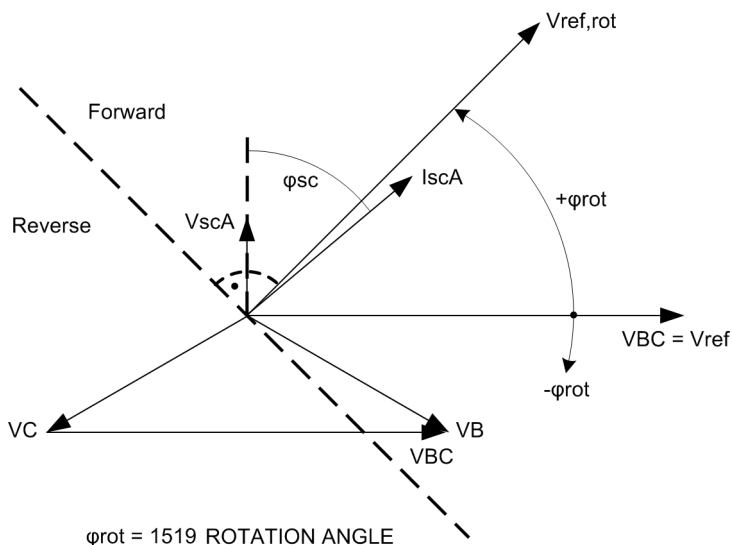


[7sj6x_drehung-referenzspannung-phase-200904-he, 1, en_US]

Figure 2-26 Rotation of the reference voltage, directional phase element

The rotated reference voltage defines the forward and reverse area, see [Figure 2-27](#). The forward area is a range of $\pm 86^\circ$ around the rotated reference voltage $V_{ref,rot}$. If the vector of the fault current is in this area, the device detects forward direction. In the mirrored area, the device detects reverse direction. In the intermediate area, the direction result is undefined.

In a network, the vector of the fault current is usually in the forward or reverse area. If the vector moves out of one these areas, e.g. the forward area, in direction of the undefined area, it leaves the forward area at $V_{ref,rot} \pm 86^\circ$ and reaches the undefined area. If the vector leaves the undefined area in direction of the forward area

(or reverse area), a hysteresis of 2° is added. This hysteresis prevents chattering of the directional result. The current vector reaches the forward area at $\pm 84^\circ$ ($= 86^\circ - 2^\circ$ hysteresis).

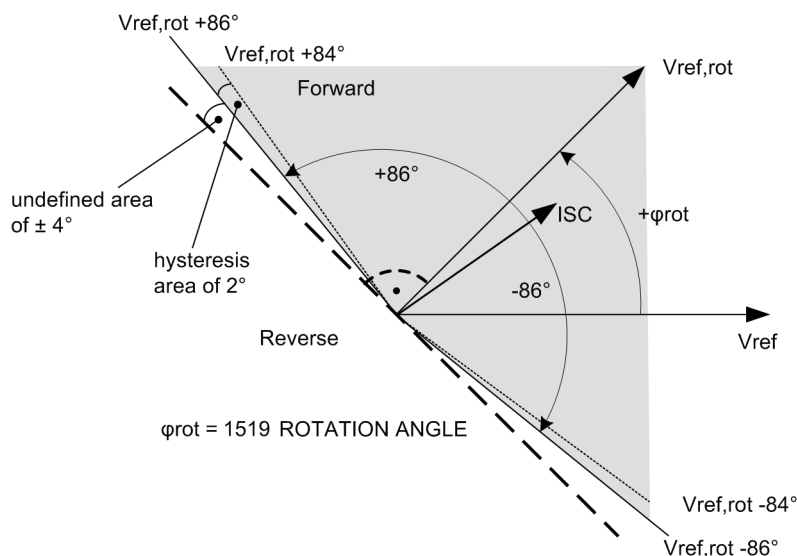


[7sj6x_vorwaertscharakteristik-gumz-phase-220904-he, 1, en_US]

Figure 2-27 Forward characteristic of the directional function, directional phase element

Direction Determination of Directional Ground Element with Ground Values

Figure 2-28 shows the treatment of the reference voltage for the directional ground element, also based on a single-phase ground fault in phase A. Contrary to the directional phase elements, which work with the unfaulted voltage as reference voltage, the fault voltage itself is the reference voltage for the directional ground element. Depending on the connection of the voltage transformer, this is the voltage $3V_0$ (as shown in Figure 2-28) or V_N . The fault current $-3I_0$ is phase offset by 180° to the fault current I_{scA} and follows the fault voltage $3V_0$ by fault angle ϕ_{sc} . The reference voltage is rotated by the setting value 1619 **ROTATION ANGLE**. In this case, a rotation by -45° .

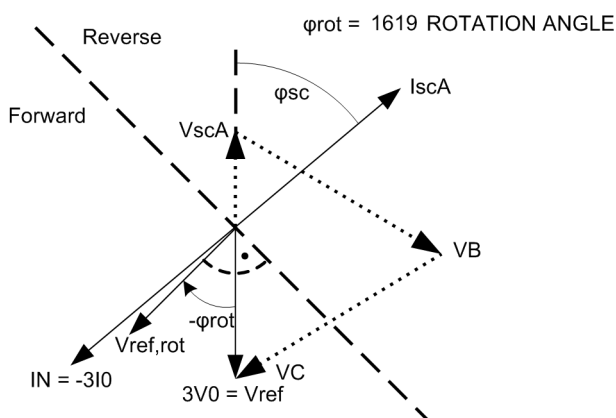

[7sj6x_drehung-referenzspannung-erde-nullsys-220904-he, 1, en_US]


Figure 2-28 Rotation of the reference voltage, directional ground element with zero sequence values

The forward area is also a range of $\pm 86^\circ$ around the rotated reference voltage $V_{ref,rot}$. If the vector of the fault current $-I_0$ (or I_N) is in this area, the device detects forward direction.

Direction Determination of Directional Ground Element with Negative Sequence Values

Figure 2-29 shows the treatment of the reference voltage for the directional ground element using the negative sequence values based on a single-phase ground fault in phase A. As reference voltage, the negative

sequence voltage is used, as current for the direction determination, the negative sequence system in which the fault current is displayed. The fault current $-3I_2$ is in phase opposition to the fault current I_{scA} and follows the voltage $3V_2$ by the fault angle ϕ_{sc} . The reference voltage is rotated through the setting value 1619 **ROTATION ANGLE**. In this case, a rotation of -45° .

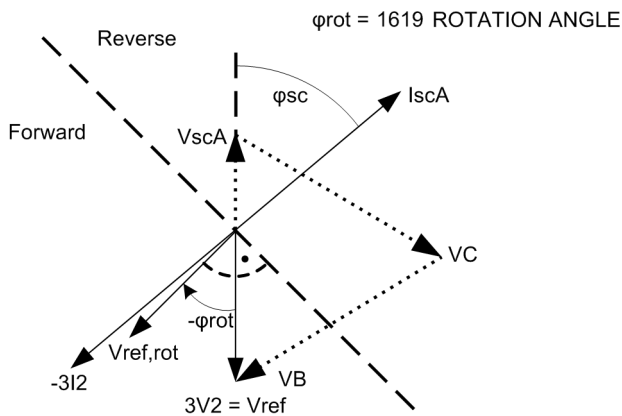

[7sj6x_drehung-referenzspannung-erde-gegensys-220904-he, 1, en_US]

Figure 2-29 Rotation of the reference voltage, directional ground element with negative sequence values

The forward area is a range of $\pm 86^\circ$ around the rotated reference voltage $V_{ref, rot}$. If the vector of the negative sequence system current $-3I_2$ is in this area, the device detects forward direction.

2.3.9 Reverse Interlocking for Double End Fed Lines


Application Example

The directionality feature of the directional overcurrent protection enables the user to perform reverse interlocking also on double end fed lines using relay element 67-1. It is designed to selectively isolate a faulty line section (e.g. sections of rings) in high speed, i.e. no long graded times will slow down the process. This scheme is feasible when the distance between protective relays is not too great and when pilot wires are available for signal transfer via an auxiliary voltage loop.

For each line, a separate data transfer path is required to facilitate signal transmission in each direction. When implemented in a closed-circuit connection, disturbances in the communication line are detected and signalled with time delay. The local system requires a local interlocking bus wire similar to the one described in Subsection "Reverse Interlocking Bus Protection" for the directional overcurrent protection (Section [2.2 Overcurrent Protection 50, 51, 50N, 51N](#)).

During a line fault, the device that detects faults in forward (line) direction using the directional relay element 67-1 will block one of the non-directional overcurrent elements (50-1, 50-TOC) of devices in the reverse direction (at the same busbar) since they should not trip ([Figure 2-30](#)). In addition, a message is generated regarding the fault direction. "Forward" messages are issued when the current threshold of the directional relay element 67-1 is exceeded and directional determination is done. Subsequently, "forward" messages are transmitted to the device located in reverse direction.


During a busbar fault, the device that detects faults in reverse (busbar) direction using the directional relay element 67-1 will block one of the non-directional overcurrent elements (50-1, 50-TOC) of devices at the opposite end of the same feeder. In addition, a "Reverse" message is generated and transmitted via the auxiliary voltage loop to the relay located at the opposite end of the line.

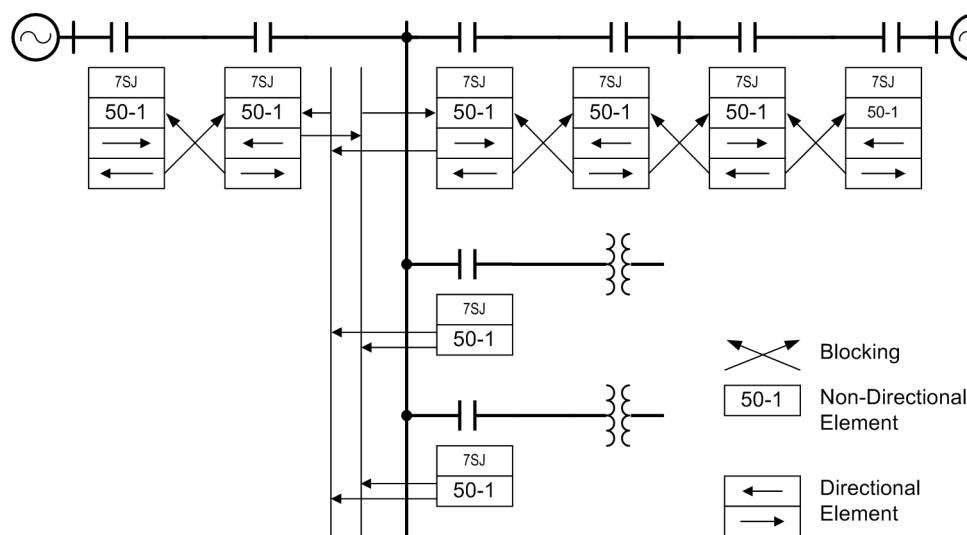

[selektivitaetdurchueckwverr-260602-kn, 1, en_US]

Figure 2-30 Reverse interlocking using directional elements

The directional overcurrent element providing normal time grading operates as selective backup protection. The following figure shows the logic diagram for the generation of fault direction signals.

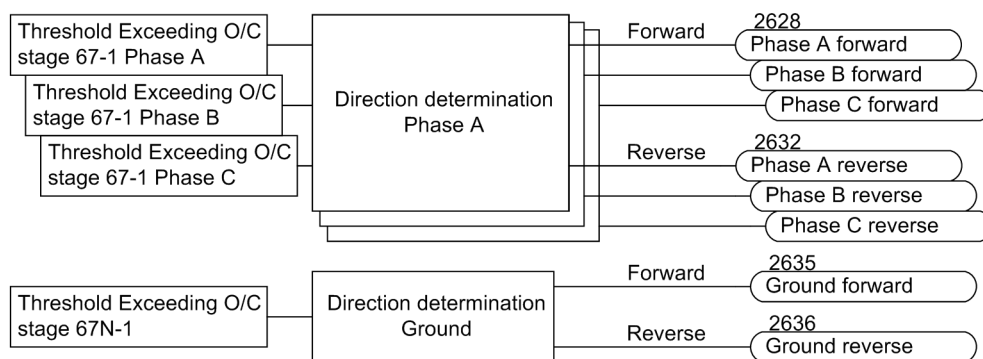

[7sj6x-meld-gener-fehlerricht-20060118, 1, en_US]

Figure 2-31 Logic diagram for the generation of fault direction signals

2.3.10 Setting Notes

General

When selecting the directional time overcurrent protection in DIGSI, a dialog box appears with several tabs for setting the associated parameters. Depending on the functional scope specified during configuration of the protective functions in addresses 115 **67/67-TOC** and 116 **67N/67N-TOC**, the number of tabs can vary.

If **67/67-TOC** or **67N/67N-TOC** is set equal to **Definite Time**, only the parameters for definite time overcurrent protection are accessible here. If you select **TOC IEC** or **TOC ANSI**, the inverse time characteristics is available, too. The superimposed directional elements 67-3, 67-2 and 67-1 or 67N-3, 67N-2 and 67N-1 apply in all these cases.

At address 1501 **FCT 67/67-TOC**, directional phase overcurrent protection may be switched **ON** or **OFF**.

Pickup values, time delays, and characteristic are set separately for phase protection and ground protection. Because of this, relay coordination for ground faults is independent of relay coordination for phase faults, and more sensitive settings can often be applied to directional ground protection. Thus, at address 1601 **FCT 67N/67N-TOC**, directional ground time overcurrent protection may be switched **ON** or **OFF** independent of the directional phase time overcurrent protection.

Depending on the parameter 613 **50N/51N/67N w.**, the device can either operate using measured values I_N or the quantities 3I0 calculated from the three phase currents. Devices featuring a sensitive ground current input generally use the calculated quantity $3I_0$.

The directional orientation of the function is influenced by parameter 201 **CT Starpoint** (see Section [2.1.3 Power System Data 1](#)).

Measurement Methods

The comparison values to be used for the respective element can be set in the setting sheets for the elements.

- Measurement of the **Fundamental Harmonic** (standard method):
This measurement method processes the sampled values of the current and filters in numerical order the fundamental harmonic so that the higher harmonics or transient peak currents are rejected.
- Measurement of the **True RMS Value**
The current amplitude is derived from the sampled value in accordance with the definition equation of the true RMS value. This measurement method should be selected when higher harmonics are to be considered by the function (e.g. in capacitor bank).

The type of the comparison values can be set under the following addresses:

67-3 element	Address 1527 67-3 MEASUREM.
67-2 element	Address 1520 67-2 MEASUREM.
67-1 element	Address 1521 67-1 MEASUREM.
67-TOC element	Address 1522 67-TOC MEASUR.
67N-3 element	Address 1627 67N-3 MEASUREM.
67N-2 element	Address 1620 67N-2 MEASUREM.
67N-1 element	Address 1621 67N-1 MEASUREM.
67N-TOC element	Address 1622 67N-TOC MEASUR.

Direction Characteristic

The direction characteristic, i.e. the position of the ranges "forward" and "reverse" is set for the phase directional elements under address 1519 **ROTATION ANGLE** and for the ground directional element under address 1619 **ROTATION ANGLE**. The short-circuit angle is generally inductive in a range of 30° to 60°. This means that usually the default settings of +45° for the phase directional elements and -45° for the ground directional element can be maintained for the adjustment of the reference voltage, as they guarantee a safe direction result.

Nevertheless, the following contains some setting examples for special applications ([Table 2-7](#)). The following must be observed: With the phase directional elements, the reference voltage (fault-free voltage) for phase-ground faults is vertical on the short-circuit voltage. For this reason, the resulting setting of the angle of rotation is (see also Section [2.3.8 Determination of Direction](#)):

Ref. volt. angle of rotation = $90 - \varphi_{sc}$	Phase directional element (phase-to-ground fault)




With the ground directional element, the reference voltage is the short-circuit voltage itself. The resulting setting of the angle of rotation is then:

Ref. volt. angle of rotation = $-\varphi_{sc}$	Directional ground element (phase-to-ground fault).

It should also be noted for phase directional elements that with phase-to-phase faults, the reference voltage is rotated between 0° (remote fault) and 30° (close-up fault) depending on the collapse of the faulty voltage. This can be taken into account with a mean value of 15°:

Ref. volt. angle of rotation = $90 - \varphi_{sc} - 15^\circ$	Phase directional element (phase-to-phase fault)

Table 2-7 Setting examples

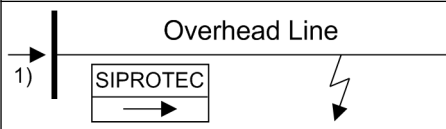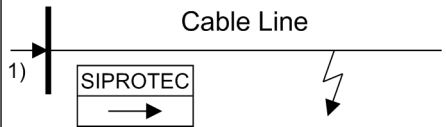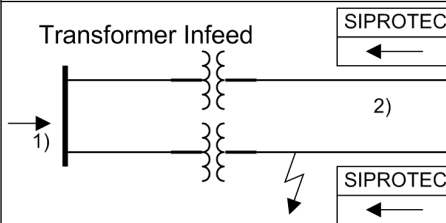Application	φ_k typical	Setting Directional Phase Element 1519 ROTATION ANGLE	Setting Directional Ground Element 1619 ROTATION ANGLE
	60°	Bereich 30°...0° → 15°	-60°
	30°	Bereich 60°...30° → 45°	-30°
	30°	Bereich 60°...30° → 45°	-30°

1) Power flow direction

2) With the assumption that these are cable lines

Directional Orientation

Directional overcurrent protection normally operates in the direction of the protected object (line, transformer, etc.). If the protection device is properly connected in accordance with one of the circuit diagrams in Appendix [C Connection Examples](#), this is the "forward" direction.

The directional orientation **Forward** or **Reverse** can be set separately for each element. Moreover, each element can also be operated **Non-Directional**.

- Address 1526 **67-3 Direction**
- Address 1523 **67-2 Direction**
- Address 1524 **67-1 Direction**
- Address 1525 **67-TOC Direct.**
- Address 1626 **67N-3 Direction**
- Address 1623 **67N-2 Direction**
- Address 1624 **67N-1 Direction**
- Address 1625 **67N-TOC Direct.**



NOTE

If the threshold value of the 67-1 or 67N-1 element is exceeded, the phase-specific directional indications "forward" or "reverse" are output (indications 2628 to 2636), independent of whether the fault direction is the same as the configured direction.

These indications are used for directional comparison protection.

Quantity Selection for Direction Determination for the Directional Ground Element

Parameter 1617 **67N POLARIZAT**. can be set to specify whether direction determination is accomplished from the zero sequence quantities or ground quantities (**with VN and IN**) or from the negative sequence quantities (**with V2 and I2**) in the ground directional element. The first option is the preferential setting; the latter is to be selected in case of danger that the zero voltage be too small due to unfavourable zero impedance or that a parallel line influences the zero system.



NOTE

If parameter 213 **VT Connect. 3ph** is set to **Vab, Vbc, Vab, Vbc, VSyn** or **Vab, Vbc, Vx**, the direction is always determined using the negative sequence values V_2/I_2 . For these voltage connection types the zero sequence voltage (V_N or $3V_0$) is not available.

Directional High-set Elements 67-2, 67-3 (phases)

The high-current element **67-2 PICKUP** or **67-3 PICKUP** is set at address 1502 or 1528. The associated delay **67-2 DELAY** or **67-3 DELAY** at 1503 or 1529. For setting, the same considerations apply as did for the non-directional time overcurrent protection in Section [2.2.11 Setting Notes](#).

The selected time is only an additional time delay and does not include the operating time (measuring time, dropout time). The delay can be set to ∞ . After pickup the element will then not trip. Pickup, however, will be signaled. If the 67-2 element or 67-3 element is not required at all, the pickup value **67-2 PICKUP** or **67-3 PICKUP** should be set to ∞ . For this setting, there is neither a pickup signal generated nor a trip.

Directional High-set Elements 67-2, 67-3 (ground)

The high-current element **67N-2 PICKUP** or **67N-3 PICKUP** is set at address 1602 or 1628. The associated delay **67N-2 DELAY** or **67N-3 DELAY** at 1603 or 1629. The same considerations apply for these settings as for the phase currents.

The selected time is an additional delay time and does not include the operating time (measuring time, dropout time). If the delay time is set to ∞ , the element does not trip after the pickup, but the pickup condition is signaled. If the directional 67N-2 element or 67N-3 element is not required, set the pickup threshold **67N-2 PICKUP** or **67N-3 PICKUP** to ∞ . This setting prevents tripping and the generation of a pickup indication.

Directional Overcurrent Element 67-1 (phases)

The pickup value of the 67-1 element (**67-1 PICKUP**) address 1504 should be set above the maximum anticipated load current. Pickup due to overload should never occur since in this mode the device operates as fault protection with correspondingly short tripping times and not as overload protection. For this reason, lines are set to approx. 20% above the maximum expected (over)load and transformers and motors to approx. 40%.

If the relay is used to protect transformers or motors with large inrush currents, the inrush restraint feature of 7SJ80 may be used for the 67-1 element (for more information see margin heading "Inrush Restraint").

The delay for directional elements (address 1505 **67-1 DELAY**) is usually set shorter than the delay for nondirectional elements (address 1205) since the non-directional elements overlap the directional elements as backup protection. It should be based on the system coordination requirements for directional tripping.

For parallel transformers supplied from a single source (see "Applications"), the delay of element **67-1 DELAY** located on the load side of the transformers may be set to 0 without provoking negative impacts on selectivity.

The selected time is only an additional time delay and does not include the operating time (measuring time, dropout time). The delay can be set to ∞ . After pickup the element will then not trip. Pickup, however, will be signaled. If the 67-1 element is not required at all, the pickup value **67-1 PICKUP** should be set to ∞ . This setting prevents from tripping and the generation of a pickup message.

Directional Overcurrent Element 67N-1 (ground)

The pickup value of the 67N-1 overcurrent element (1604 **67N-1 PICKUP**) should be set below the minimum anticipated ground fault current.

If the relay is used to protect transformers or motors with large inrush currents, the inrush restraint feature of 7SJ80 may be used for the 67N-1 relay element (**67N-1 PICKUP**) (for more information see margin heading "Inrush Restraint").

The delay is set at address 1605 **67N-1 DELAY** and should be based on system coordination requirements for directional tripping. For ground currents in a grounded system a separate coordination chart with short time delay is often used.

The selected time is only an additional time delay and does not include the operating time (measuring time, dropout time). The delay can be set to ∞ . After pickup the element will then not trip. Pickup, however, will be signaled. If the 67N-1 element is not required at all, the pickup value **67N-1 PICKUP** should be set to ∞ . This setting prevents from tripping and the generation of a pickup message.

Pickup Stabilization (67/67N Directional)

The pickups can also be stabilized via parameterizable dropout times under address 1518 **67 T DROP-OUT** or 1618 **67N T DROP-OUT**.

Directional Element 67-TOC with IEC or ANSI Curves (phases)

Having set address 115 **67/67-TOC = TOC IEC** or **TOC ANSI** when configuring the protection functions (Section 2.1.1 *Functional Scope*), the parameters for the inverse time characteristics will also be available.

If the relay is used to protect transformers or motors with large inrush currents, the inrush restraint function of 7SJ80 may be used for the 67-TOC element (**67-TOC PICKUP**) (for more information see margin heading "Inrush Restraint").

If the inverse time trip characteristic is selected, it must be noted that a safety factor of about 1.1 has already been included between the pickup value and the setting value. This means that a pickup will only occur if a current of about 1.1 times the setting value is present. If Address 1510 **67-TOC Drop-out** is set to **Disk Emulation**, reset will occur in accordance with the reset curve as described in Section 2.2 *Overcurrent Protection 50, 51, 50N, 51N*.

The current value is set in address 1507 **67-TOC PICKUP**. The setting is mainly determined by the maximum operating current. Pickup due to overload should never occur, since the device in this operating mode operates as fault protection with correspondingly short tripping times and not as overload protection.

The corresponding element time multiplication factor for an IEC characteristic is set at address 1508 **67 TIME DIAL** and in address 1509 **67 TIME DIAL** for an ANSI characteristic. It must be coordinated with the time grading of the network.

The time multiplier can also be set to ∞ . After pickup the element will then not trip. Pickup, however, will be signaled. If the 67-TOC element is not required at all, address 115 **67/67-TOC** should be set to **Definite Time** during protective function configuration (see Section 2.1.1 *Functional Scope*).

If address 115 **67/67-TOC = TOC IEC**, you can specify the desired IEC-characteristic (**Normal Inverse**, **Very Inverse**, **Extremely Inv.** or **Long Inverse**) in address 1511 **67- IEC CURVE**. If address 115 **67/67-TOC = TOC ANSI** you can specify the desired ANSI-characteristic (**Very Inverse**, **Inverse**, **Short Inverse**, **Long Inverse**, **Moderately Inv.**, **Extremely Inv.** oder **Definite Inv.**) in address 1512 **67- ANSI CURVE**.

Directional Element 67N-TOC with IEC or ANSI Curves (ground)

Having set address 116 **67N/67N-TOC = TOC IEC** when configuring the protection functions (Section 2.1.1 *Functional Scope*), the parameters for the inverse time characteristics will also be available. Specify in address 1611 **67N-TOC IEC** the desired IEC characteristic (**Normal Inverse**, **Very Inverse**, **Extremely Inv.** or **Long Inverse**). If address 116 **67N/67N-TOC** was set to **TOC ANSI**, you can select the desired ANSI characteristic (**Very Inverse**, **Inverse**, **Short Inverse**, **Long Inverse**, **Moderately Inv.**, **Extremely Inv.** or **Definite Inv.**) in address 1612 **67N-TOC ANSI**.

If the relay is used to protect transformers or motors with large inrush currents, the inrush restraint feature of 7SJ80 may be used for the 67N-TOC element (**67N-TOC PICKUP**) (for more information see margin heading "Inrush Restraint").

If the inverse time trip characteristic is selected, it must be noted that a safety factor of about 1.1 has already been included between the pickup value and the setting value **67N-TOC PICKUP**. This means that a pickup will only occur if a current of about 1.1 times the setting value is present. If **Disk Emulation** was selected at

address 1610 **67N-TOC DropOut**, reset will occur in accordance with the reset curve as for the existing nondirectional time overcurrent protection described in Section 2.2 *Overcurrent Protection 50, 51, 50N, 51N*. The current value is set at address 1607 **67N-TOC PICKUP**. The minimum appearing ground fault current is most relevant for this setting.

The corresponding element time multiplication factor for an IEC characteristic is set at address 1608 **67N-TOC T-DIAL** and in address 1609 **67N-TOC T-DIAL** for an ANSI characteristic. This has to be coordinated with the system grading coordination chart for directional tripping. For ground currents with grounded network, you can mostly set up a separate grading coordination chart with shorter delay times.


The time multiplier can also be set to ∞ . After pickup the element will then not trip. Pickup, however, will be signaled. If the 67N-TOC element is not required at all, address 116 **67N/67N-TOC** should be set to **Definite Time** during protection function configuration (see Section 2.1.1).

Inrush Restraint

When applying the protection device to transformers where high inrush currents are to be expected, the 7SJ80 can make use of an inrush restraint function for the directional overcurrent elements **67-1 PICKUP**, **67-TOC PICKUP**, **67N-1 PICKUP** and **67N-TOC PICKUP** as well as the non-directional overcurrent elements. The inrush restraint option is enabled or disabled in 2201 **INRUSH REST**. (in the settings option non-directional time overcurrent protection). The characteristic values of the inrush restraint are already listed in the section discussing the **non-directional** time overcurrent (Section 2.2.11 *Setting Notes*).

Manual Close Mode (phases, ground)

When a circuit breaker is closed onto a faulted line, a high speed trip by the circuit breaker is often desired. For overcurrent or high-set element the delay may be bypassed via a Manual Close pulse, thus resulting in instantaneous tripping. The internal "Manual close" signal is built from the binary input signal **>Manual Close** (no. 356). The internal "Manual close" signal remains active as long as the binary input signal **>Manual Close** is active, but at least for 300 ms (see the following logic diagram). To enable the device to react properly on occurrence of a fault in the phase elements after manual close, address 1513 **MANUAL CLOSE** has to be set accordingly. Accordingly, address 1613 **MANUAL CLOSE** is considered for the ground path address. Thus, the user determines for both elements, the phase and the ground element, what pickup value is active with what delay when the circuit breaker is closed manually.

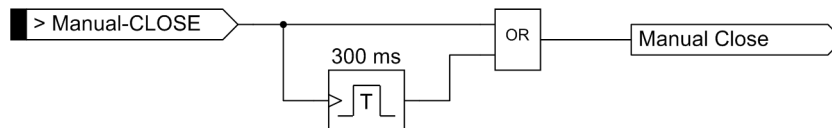

[lo_7sj6-hand-ein, 1, en_US]


Figure 2-32 Manual close feature

External Control Switch

If the manual close signal is not from the 7SJ80 device, that is, neither sent via the built-in operator interface nor via a serial port but directly from a control acknowledgment switch, this signal must be passed to a 7SJ80 binary input, and configured accordingly (**>Manual Close**), so that the element selected for **MANUAL CLOSE** can become effective. **Inactive** means that all elements (phase and ground) operate with the configured trip times even with manual close.

Internal Control Function

The manual closing information must be allocated via CFC (interlocking task-level) using the CMD_Information block, if the internal control function is used.

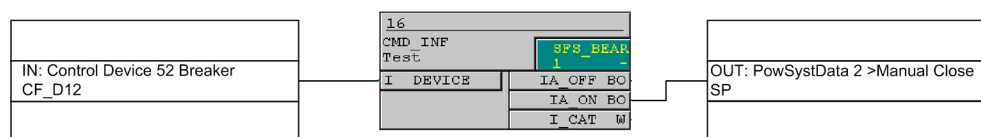

[handein-260602-kn, 1, en_US]

Figure 2-33 Example for the generation of a manual close signal using the internal control function

**NOTE**

For an interaction between the automatic reclosing function (79 AR) and the control function, an extended CFC logic is necessary. See margin heading "Close command: Directly or via Control" in the Setting Notes of the automatic reclosing function (Section [2.15.6 Setting Notes](#)).

Interaction with Automatic Reclosure Function (phases)

When reclosing follows, high-speed protection against faults with 67-2 or 67-3 is usually desired. If the fault still exists after reclosing, the 67-1 or 67-TOC element will be initiated with graded tripping times, that is, the 67-2 or 67-3 element will be blocked. You can use parameter 1514 **67-2 active** or 1532 **67-3 active** active to define whether the 67-2 or 67-3 element is influenced by a release signal of the internal or an external automatic reclosing device or not. The setting **with 79 active** means that the 67-2 or 67-3 element is only released if the automatic reclosing function is not blocked. If this is not desired, the setting **always** is selected so that the 67-2 or 67-3 element is always active as configured.

The integrated automatic reclosing function of 7SJ80 also provides the option to individually determine for each overcurrent element whether tripping or blocking is to be carried out instantaneously, unaffected by the AR with time delay (see Section [2.15 Automatic Reclosing System 79](#)).

Interaction with Automatic Reclosing Function (ground)

If reclosing follows, high-speed and simultaneous closing in the event of a fault with 67N-2 is usually desired. If the fault still exists after reclosing, the 67N-1 or 67N-TOC element is initiated with graded tripping times, that is, the 67N-2 or 67N-3 element is blocked. For this purpose, parameter 1614 **67N-2 active** or 1632 **67N-3 active** is used to determine whether the 67N-2 or 67N-3 element is influenced by the release signal of the internal or an external automatic reclosing device or not. The setting **with 79 active** means that the 67N-2 or 67N-3 element is only released if the automatic reclosing function is not blocked. If this is not desired, the setting **always** is selected so that the 67N-2 or 67N-3 element is always active as configured.

The integrated automatic reclosing function of 7SJ80 also provides the option to individually determine for each overcurrent element whether tripping or blocking is to be carried out instantaneously, unaffected by the AR with time delay (see Section [2.15 Automatic Reclosing System 79](#)).

2.3.11 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
1501	FCT 67/67-TOC		OFF ON	OFF	67, 67-TOC Phase Time Overcurrent
1502	67-2 PICKUP	1A	0.10 .. 35.00 A; ∞	2.00 A	67-2 Pickup
		5A	0.50 .. 175.00 A; ∞	10.00 A	
1503	67-2 DELAY		0.00 .. 60.00 sec; ∞	0.10 sec	67-2 Time Delay
1504	67-1 PICKUP	1A	0.10 .. 35.00 A; ∞	1.00 A	67-1 Pickup
		5A	0.50 .. 175.00 A; ∞	5.00 A	
1505	67-1 DELAY		0.00 .. 60.00 sec; ∞	0.50 sec	67-1 Time Delay
1507	67-TOC PICKUP	1A	0.10 .. 4.00 A	1.00 A	67-TOC Pickup
		5A	0.50 .. 20.00 A	5.00 A	
1508	67 TIME DIAL		0.05 .. 3.20 sec; ∞	0.50 sec	67-TOC Time Dial
1509	67 TIME DIAL		0.50 .. 15.00 ; ∞	5.00	67-TOC Time Dial
1510	67-TOC Drop-out		Instantaneous Disk Emulation	Disk Emulation	Drop-Out Characteristic

Addr.	Parameter	C	Setting Options	Default Setting	Comments
1511	67- IEC CURVE		Normal Inverse Very Inverse Extremely Inv. Long Inverse	Normal Inverse	IEC Curve
1512	67- ANSI CURVE		Very Inverse Inverse Short Inverse Long Inverse Moderately Inv. Extremely Inv. Definite Inv.	Very Inverse	ANSI Curve
1513A	MANUAL CLOSE		67-3 instant. 67-2 instant. 67-1 instant. 67-TOC instant. Inactive	67-2 instant.	Manual Close Mode
1514A	67-2 active		with 79 active always	always	67-2 active
1518A	67 T DROP-OUT		0.00 .. 60.00 sec	0.00 sec	67 Drop-Out Time Delay
1519A	ROTATION ANGLE		-180 .. 180 °	45 °	Rotation Angle of Reference Voltage
1520A	67-2 MEASUREM.		Fundamental True RMS	Fundamental	67-2 measurement of
1521A	67-1 MEASUREM.		Fundamental True RMS	Fundamental	67-1 measurement of
1522A	67-TOC MEASUR.		Fundamental True RMS	Fundamental	67-TOC measurement of
1523	67-2 Direction		Forward Reverse Non-Directional	Forward	67-2 Direction
1524	67-1 Direction		Forward Reverse Non-Directional	Forward	67-1 Direction
1525	67-TOC Direct.		Forward Reverse Non-Directional	Forward	67-TOC Direction
1526	67-3 Direction		Forward Reverse Non-Directional	Forward	67-3 Direction
1527A	67-3 MEASUREM.		Fundamental True RMS	Fundamental	67-3 measurement of
1528	67-3 PICKUP	1A	1.00 .. 35.00 A; ∞	∞ A	67-3 Pickup
		5A	5.00 .. 175.00 A; ∞	∞ A	
1529	67-3 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	67-3 Time Delay
1530	67		1.00 .. 20.00 I/lp; ∞ 0.01 .. 999.00 TD		67
1531	MofPU Res T/Tp		0.05 .. 0.95 I/lp; ∞ 0.01 .. 999.00 TD		Multiple of Pickup <-> T/Tp

Addr.	Parameter	C	Setting Options	Default Setting	Comments
1532A	67-3 active		always with 79 active	always	67-3 active
1601	FCT 67N/67N-TOC		OFF ON	OFF	67N, 67N-TOC Ground Time Overcurrent
1602	67N-2 PICKUP	1A	0.05 .. 35.00 A; ∞	0.50 A	67N-2 Pickup
		5A	0.25 .. 175.00 A; ∞	2.50 A	
1603	67N-2 DELAY		0.00 .. 60.00 sec; ∞	0.10 sec	67N-2 Time Delay
1604	67N-1 PICKUP	1A	0.05 .. 35.00 A; ∞	0.20 A	67N-1 Pickup
		5A	0.25 .. 175.00 A; ∞	1.00 A	
1605	67N-1 DELAY		0.00 .. 60.00 sec; ∞	0.50 sec	67N-1 Time Delay
1607	67N-TOC PICKUP	1A	0.05 .. 4.00 A	0.20 A	67N-TOC Pickup
		5A	0.25 .. 20.00 A	1.00 A	
1608	67N-TOC T-DIAL		0.05 .. 3.20 sec; ∞	0.20 sec	67N-TOC Time Dial
1609	67N-TOC T-DIAL		0.50 .. 15.00 ; ∞	5.00	67N-TOC Time Dial
1610	67N-TOC DropOut		Instantaneous Disk Emulation	Disk Emulation	Drop-Out Characteristic
1611	67N-TOC IEC		Normal Inverse Very Inverse Extremely Inv. Long Inverse	Normal Inverse	IEC Curve
1612	67N-TOC ANSI		Very Inverse Inverse Short Inverse Long Inverse Moderately Inv. Extremely Inv. Definite Inv.	Very Inverse	ANSI Curve
1613A	MANUAL CLOSE		67N-3 instant. 67N-2 instant. 67N-1 instant. 67N-TOC instant Inactive	67N-2 instant.	Manual Close Mode
1614A	67N-2 active		always with 79 active	always	67N-2 active
1617	67N POLARIZAT.		with VN and IN with V2 and I2	with VN and IN	Ground Polarization
1618A	67N T DROP-OUT		0.00 .. 60.00 sec	0.00 sec	67N Drop-Out Time Delay
1619A	ROTATION ANGLE		-180 .. 180 °	-45 °	Rotation Angle of Refer- ence Voltage
1620A	67N-2 MEASUREM.		Fundamental True RMS	Fundamental	67N-2 measurement of
1621A	67N-1 MEASUREM.		Fundamental True RMS	Fundamental	67N-1 measurement of
1622A	67N-TOC MEASUR.		Fundamental True RMS	Fundamental	67N-TOC measurement of
1623	67N-2 Direction		Forward Reverse Non-Directional	Forward	67N-2 Direction

Addr.	Parameter	C	Setting Options	Default Setting	Comments
1624	67N-1 Direction		Forward Reverse Non-Directional	Forward	67N-1 Direction
1625	67N-TOC Direct.		Forward Reverse Non-Directional	Forward	67N-TOC Direction
1626	67N-3 Direction		Forward Reverse Non-Directional	Forward	67N-3 Direction
1627A	67N-3 MEASUREM.		Fundamental True RMS	Fundamental	67N-3 measurement of
1628	67N-3 PICKUP		0.50 .. 35.00 A; ∞	∞ A	67N-3 Pickup
1629	67N-3 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	67N-3 Time Delay
1630	M.of PU TD		1.00 .. 20.00 I/lp; ∞ 0.01 .. 999.00 TD		Multiples of PU Time-Dial
1631	I/I _{Ep} R _f T/TE _p		0.05 .. 0.95 I/lp; ∞ 0.01 .. 999.00 TD		67N TOC
1632A	67N-3 active		always with 79 active	always	67N-3 active

2.3.12 Information List

No.	Information	Type of Information	Comments
2603	67N-3 TRIP	OUT	67N-3 TRIP
2604	>BLK 67/67-TOC	SP	>BLOCK 67/67-TOC
2605	67N-3 BLOCKED	OUT	67N-3 is BLOCKED
2606	67-3 BLOCKED	OUT	67-3 is BLOCKED
2614	>BLK 67N/67NTOC	SP	>BLOCK 67N/67N-TOC
2615	>BLOCK 67-2	SP	>BLOCK 67-2
2616	>BLOCK 67N-2	SP	>BLOCK 67N-2
2617	>BLOCK 67-3	SP	>BLOCK 67-3
2618	>BLOCK 67N-3	SP	>BLOCK 67N-3
2621	>BLOCK 67-1	SP	>BLOCK 67-1
2622	>BLOCK 67-TOC	SP	>BLOCK 67-TOC
2623	>BLOCK 67N-1	SP	>BLOCK 67N-1
2624	>BLOCK 67N-TOC	SP	>BLOCK 67N-TOC
2628	Phase A forward	OUT	Phase A forward
2629	Phase B forward	OUT	Phase B forward
2630	Phase C forward	OUT	Phase C forward
2632	Phase A reverse	OUT	Phase A reverse
2633	Phase B reverse	OUT	Phase B reverse
2634	Phase C reverse	OUT	Phase C reverse
2635	Ground forward	OUT	Ground forward
2636	Ground reverse	OUT	Ground reverse
2637	67-1 BLOCKED	OUT	67-1 is BLOCKED

No.	Information	Type of Information	Comments
2642	67-2 picked up	OUT	67-2 picked up
2646	67N-2 picked up	OUT	67N-2 picked up
2647	67-2 Time Out	OUT	67-2 Time Out
2648	67N-2 Time Out	OUT	67N-2 Time Out
2649	67-2 TRIP	OUT	67-2 TRIP
2651	67/67-TOC OFF	OUT	67/67-TOC switched OFF
2652	67 BLOCKED	OUT	67/67-TOC is BLOCKED
2653	67 ACTIVE	OUT	67/67-TOC is ACTIVE
2655	67-2 BLOCKED	OUT	67-2 is BLOCKED
2656	67N OFF	OUT	67N/67N-TOC switched OFF
2657	67N BLOCKED	OUT	67N/67N-TOC is BLOCKED
2658	67N ACTIVE	OUT	67N/67N-TOC is ACTIVE
2659	67N-1 BLOCKED	OUT	67N-1 is BLOCKED
2660	67-1 picked up	OUT	67-1 picked up
2664	67-1 Time Out	OUT	67-1 Time Out
2665	67-1 TRIP	OUT	67-1 TRIP
2668	67N-2 BLOCKED	OUT	67N-2 is BLOCKED
2669	67-TOC BLOCKED	OUT	67-TOC is BLOCKED
2670	67-TOC pickedup	OUT	67-TOC picked up
2674	67-TOC Time Out	OUT	67-TOC Time Out
2675	67-TOC TRIP	OUT	67-TOC TRIP
2676	67-TOC DiskPU	OUT	67-TOC disk emulation is ACTIVE
2677	67N-TOC BLOCKED	OUT	67N-TOC is BLOCKED
2678	67-3 TRIP	OUT	67-3 TRIP
2679	67N-2 TRIP	OUT	67N-2 TRIP
2681	67N-1 picked up	OUT	67N-1 picked up
2682	67N-1 Time Out	OUT	67N-1 Time Out
2683	67N-1 TRIP	OUT	67N-1 TRIP
2684	67N-TOCPickedup	OUT	67N-TOC picked up
2685	67N-TOC TimeOut	OUT	67N-TOC Time Out
2686	67N-TOC TRIP	OUT	67N-TOC TRIP
2687	67N-TOC Disk PU	OUT	67N-TOC disk emulation is ACTIVE
2691	67/67N pickedup	OUT	67/67N picked up
2692	67 A picked up	OUT	67/67-TOC Phase A picked up
2693	67 B picked up	OUT	67/67-TOC Phase B picked up
2694	67 C picked up	OUT	67/67-TOC Phase C picked up
2695	67N picked up	OUT	67N/67N-TOC picked up
2696	67/67N TRIP	OUT	67/67N TRIP
2697	67-3 picked up	OUT	67-3 picked up
2698	67N-3 picked up	OUT	67N-3 picked up
2699	67-3 Time Out	OUT	67-3 Time Out
2700	67N-3 Time Out	OUT	67N-3 Time Out

2.4 Dynamic Cold Load Pickup

With the cold load pickup function, pickup and delay settings of directional and non-directional time overcurrent protection can be changed over dynamically.

Applications

- It may be necessary to dynamically increase the pickup values if, during starting and for a short time thereafter, certain elements of the system have an increased power consumption after a long period of zero voltage (e.g. air-conditioning systems, heating installations). Thus a raise of pickup thresholds can be avoided by taking into consideration such starting conditions.
- As a further option, the pickup thresholds may be modified by an automatic reclosure function in accordance with its ready or not ready state.



NOTE

Dynamic cold load pickup must not be confused with the changeover option of the 4 setting groups (A to D). It is an additional feature.

It is possible to change pickup thresholds and delay times.

2.4.1 Functional Description

Effect

There are two methods by which the device can determine if the protected equipment is de-energized:

- Via binary inputs, the device is informed of the position of the circuit breaker (address 1702 **Start Condition = Breaker Contact**).
- As a criterion a set current threshold is undershot (address 1702 **Start Condition = No Current**).

If the device determines that the protected equipment is de-energized via one of the above methods, a time, **CB Open Time**, is started and after its expiration the increased thresholds take effect.

In addition, switching between parameters can be triggered by two other events:

- By signal "79M Auto Reclosing ready" of the internal automatic reclosure function (address 1702 **Start Condition = 79 ready**). Thus the protection thresholds and the tripping times can be changed if automatic reclosure is ready for reclosing (see also Section [2.15 Automatic Reclosing System 79](#)).
- Irrespective of the setting of parameter 1702 **Start Condition**, the release of cold load pickup may always be selected via the binary input **>ACTIVATE CLP**.

[Figure 2-35](#) shows the logic diagram for dynamic cold load pickup function.

If it is detected via the auxiliary contact or the current criterion that the system is de-energized, i.e. the circuit breaker is open, the **CB Open Time** is started. As soon as it has elapsed, the greater thresholds are enabled. When the protected equipment is re-energized (the device receives this information via the binary inputs or when threshold **BkrClosed I MIN** is exceeded), a second time delay referred to as the **Active Time** is initiated. Once it elapses, the pickup values of the relay elements return to their normal settings. This time may be reduced when current values fall below all normal pickup values for a set **Stop Time** after startup, i.e. after the circuit breaker has been closed. The starting condition of the fast reset time is made up of an OR-combination of the configured dropout conditions of all directional and non-directional overcurrent elements. When **Stop Time** is set to ∞ or when binary input **>BLK CLP stpTim** is active, no comparison is made with the "normal" thresholds. The function is inactive and the fast reset time, if applied, is reset.


If overcurrent elements are picked up while time **Active Time** is running, the fault generally prevails until pickup drops out, using the dynamic settings. Only then the parameters are set back to "normal".

If the dynamic setting values were activated via the binary input **>ACTIVATE CLP** or the signal "79M Auto Reclosing ready" and this cause drops out, the "normal" settings are restored immediately, even if a pickup is the result.

If the binary input **>BLOCK CLP** is enabled, all triggered timers are reset and, as a consequence, all "normal" settings are immediately restored. If blocking occurs during an on-going fault with dynamic cold load pickup functions enabled, the timers of all overcurrent relay elements are stopped and may then be restarted based on their "normal" duration.


During power up of the protective relay with an open circuit breaker, the time delay **CB Open Time** is started, and is processed using the "normal" settings. Therefore, when the circuit breaker is closed, the "normal" settings are effective.

The following figures show the timing sequence and the logic diagram of the dynamic cold load pickup feature.

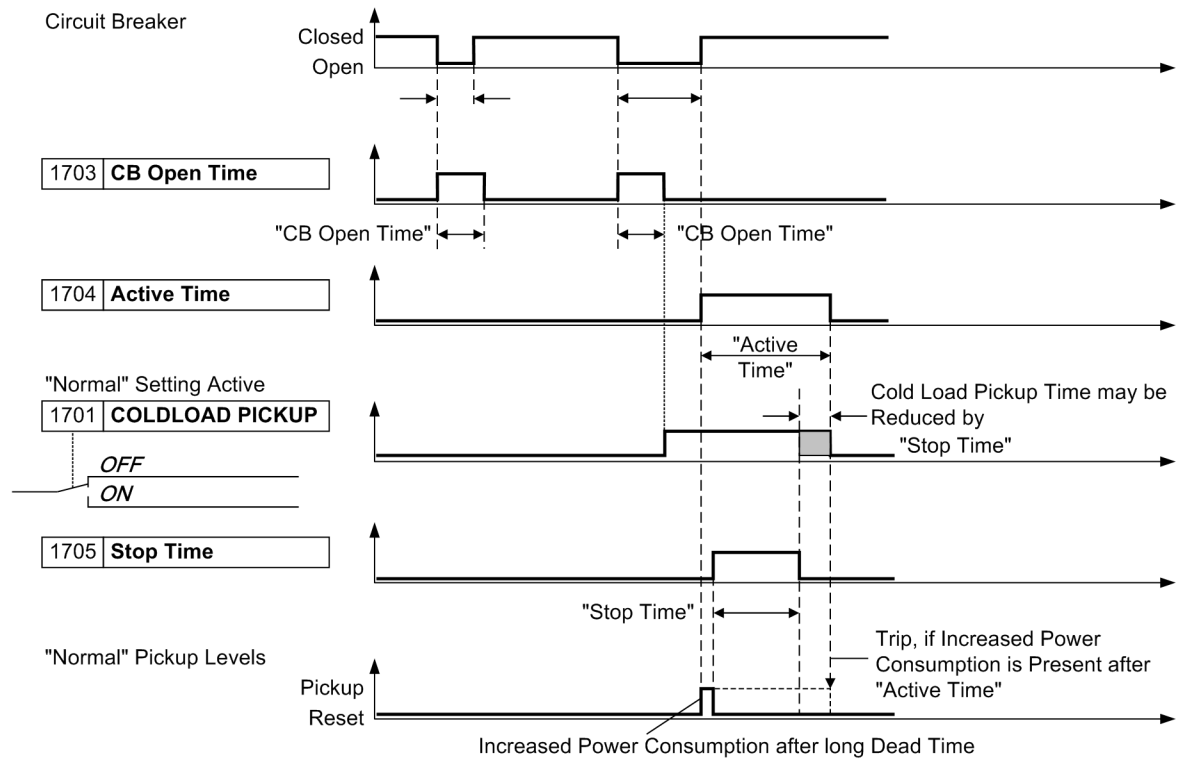

[zeitablaeufer-dynamischen-parameterumschaltung-260602-kn, 1, en_US]

Figure 2-34 Timing charts of the dynamic cold load pickup function

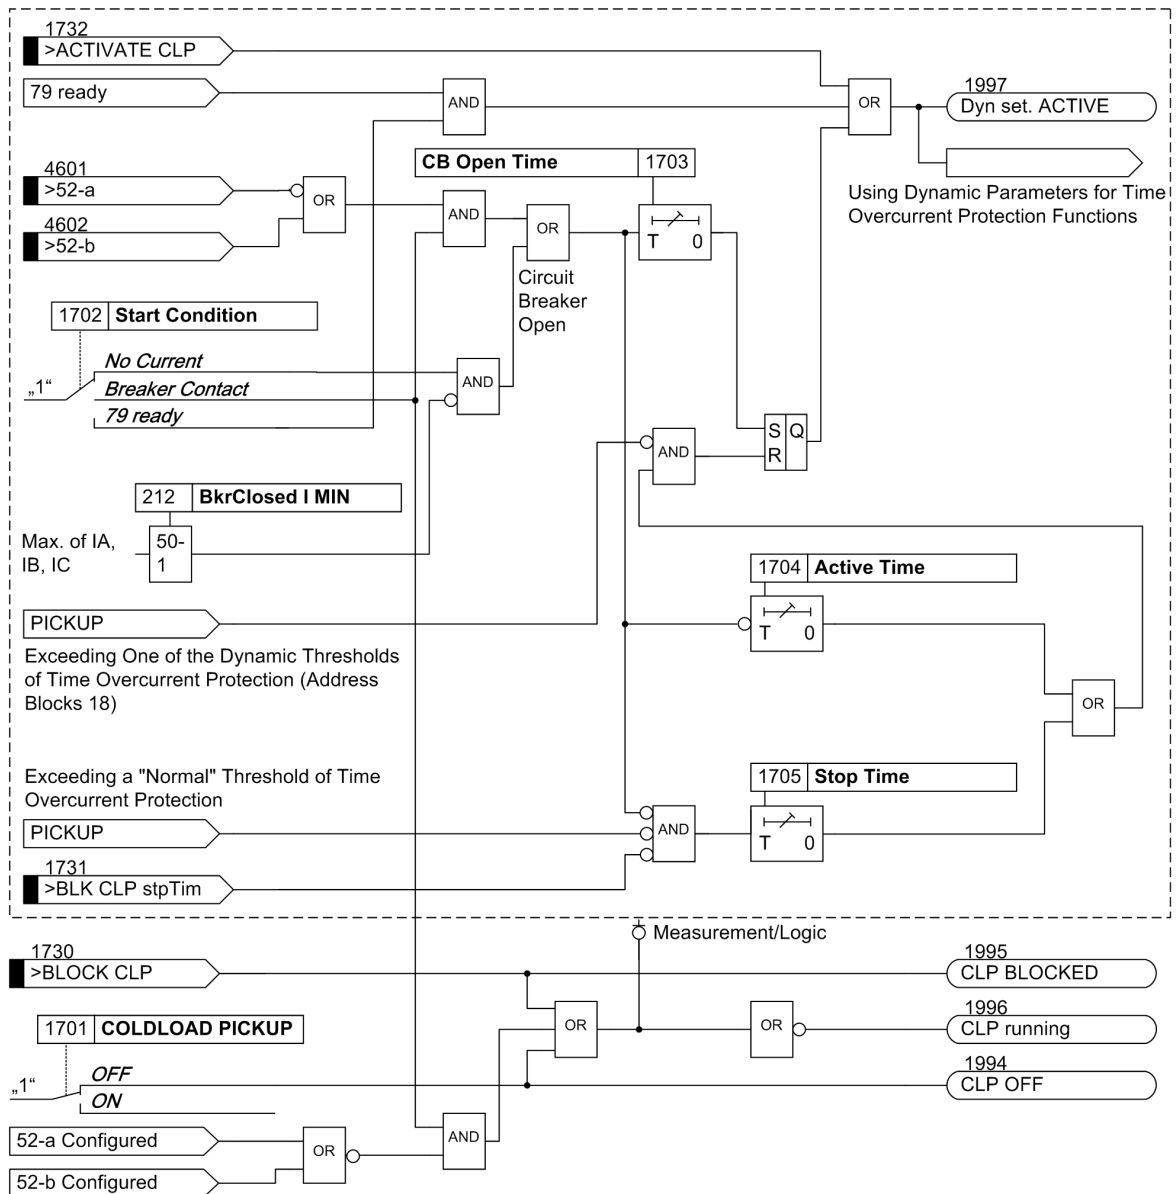

[7sj6x_dyn_paramschaltung-150502-kn, 1, en_US]

Figure 2-35 Logic diagram of the dynamic cold load pickup function (50c, 50Nc, 51c, 51Nc, 67c, 67Nc)

2.4.2 Setting Notes

General

The dynamic cold load pickup function can only be enabled if address 117 **Coldload Pickup** was set to **Enabled** during configuration of the protection functions. If not required, this function is set to **Disabled**. The function can be turned **ON** or **OFF** under address 1701 **Coldload Pickup**.

Depending on the condition that should initiate the cold load pickup function address 1702 **Start Condition** is set to either **No Current**, **Breaker Contact** or to **79 ready**. Naturally, the option **Breaker Contact** can only be selected if the device receives information regarding the switching state of the circuit breaker via at least one binary input. The option **79 ready** modifies dynamically the pickup thresholds of the directional and non-directional time overcurrent protection when the automatic reclosing function is ready. To initiate the cold load pickup, the automatic reclosing function provides the internal signal "**79M Auto Reclosing ready**". It is always active when the automatic reclosing function is available, activated, unblocked,

and ready for a further cycle (see also margin heading "Controlling Directional/Non-Directional Overcurrent Protection Elements via Cold Load Pickup" in Section [2.15.6 Setting Notes](#)).

Time Delays

There are no specific procedures on how to set the time delays at addresses 1703 **CB Open Time**, 1704 **Active Time** and 1705 **Stop Time**. These time delays must be based on the specific loading characteristics of the equipment being protected, and should be set to allow for brief overloads associated with dynamic cold load conditions.

Non-Directional 50/51 Elements (phases)

The dynamic pickup values and tripping times associated with the time overcurrent protection functions are set at address block **18** for the phase currents:

The dynamic pickup and delay settings for the high-set elements are set at addresses 1801 **50c-2 PICKUP** or 1808 **50c-3 PICKUP** and 1802 **50c-2 DELAY** or 1809 **50c-3 DELAY** respectively; the dynamic pickup and delay settings for the 67N-1 element are set at addresses 1803 **50c-1 PICKUP** and 1804 **50c-1 DELAY** respectively; and the pickup, time multiplier (for IEC curves), and time dial (for ANSI curves) settings for the 67N-TOC element are set at addresses 1805 **51c PICKUP**, 1806 **51c TIME DIAL** and 1807 **51c TIME DIAL** respectively.

Non-Directional 50N/51N Elements (ground)

The dynamic pickup values and time delays associated with non-directional time overcurrent ground protection are set at address block **19**:

The dynamic pickup and delay settings for the high-set elements are set at addresses 1901 **50Nc-2 PICKUP** or 1908 **50Nc-3 PICKUP** and 1902 **50Nc-2 DELAY** or 1909 **50Nc-3 DELAY** respectively; the dynamic pickup and delay settings for the 67N-1 element are set at addresses 1903 **50Nc-1 PICKUP** and 1904 **50Nc-1 DELAY** respectively; and the pickup, time multiplier (for IEC curves), and time dial (for ANSI curves) settings for the 67N-TOC element are set at addresses 1905 **51Nc PICKUP**, 1906 **51Nc T-DIAL** and 1907 **51Nc T-DIAL** respectively.

Directional 67/67-TOC Elements (phases)

The dynamic pickup values and time delays associated with directional overcurrent phase protection are set at address block **20**

Addresses 2001 **67c-2 PICKUP** or 2008 **67c-3 PICKUP** and 2002 **67c-2 DELAY** or 2009 **67c-3 DELAY** define the dynamic parameters for the high-current elements, 2003 **67c-1 PICKUP** and 2004 **67c-1 DELAY** for the directional definite time overcurrent element and 2005 **67c-TOC PICKUP** in combination with 2006 **67c-TOC T-DIAL** (for IEC characteristics) or 2006 **67c-TOC T-DIAL** (for ANSI characteristics) for the directional inverse time overcurrent protection element.

Directional 67/67N Elements (ground)

The dynamic pickup values and time delays associated with directional overcurrent ground protection are set at address block **21**:

Addresses 2101 **67Nc-2 PICKUP** or 2108 **67Nc-3 PICKUP** and 2102 **67Nc-2 DELAY** or 2109 **67Nc-3 DELAY** define the dynamic parameters for the high-current elements, 2103 **67Nc-1 PICKUP** and 2104 **67Nc-1 DELAY** for the directional definite time overcurrent element and 2105 **67Nc-TOC PICKUP** in combination with 2106 **67Nc-TOC T-DIAL** (for IEC characteristics) or 2107 **67Nc-TOC T-DIAL** (for ANSI characteristics) for the directional inverse time overcurrent protection element.

2.4.3 Settings

The table indicates region-specific presettings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
1701	COLDLOAD PICKUP		OFF ON	OFF	Cold-Load-Pickup Function
1702	Start Condition		No Current Breaker Contact 79 ready	No Current	Start Condition
1703	CB Open Time		0 .. 21600 sec	3600 sec	Circuit Breaker OPEN Time
1704	Active Time		0 .. 21600 sec	3600 sec	Active Time
1705	Stop Time		1 .. 600 sec; ∞	600 sec	Stop Time
1801	50c-2 PICKUP	1A	0.10 .. 35.00 A; ∞	10.00 A	50c-2 Pickup
		5A	0.50 .. 175.00 A; ∞	50.00 A	
1802	50c-2 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	50c-2 Time Delay
1803	50c-1 PICKUP	1A	0.10 .. 35.00 A; ∞	2.00 A	50c-1 Pickup
		5A	0.50 .. 175.00 A; ∞	10.00 A	
1804	50c-1 DELAY		0.00 .. 60.00 sec; ∞	0.30 sec	50c-1 Time Delay
1805	51c PICKUP	1A	0.10 .. 4.00 A	1.50 A	51c Pickup
		5A	0.50 .. 20.00 A	7.50 A	
1806	51c TIME DIAL		0.05 .. 3.20 sec; ∞	0.50 sec	51c Time dial
1807	51c TIME DIAL		0.50 .. 15.00 ; ∞	5.00	51c Time dial
1808	50c-3 PICKUP	1A	1.00 .. 35.00 A; ∞	∞ A	50c-3 Pickup
		5A	5.00 .. 175.00 A; ∞	∞ A	
1809	50c-3 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	50c-3 Time Delay
1901	50Nc-2 PICKUP	1A	0.05 .. 35.00 A; ∞	7.00 A	50Nc-2 Pickup
		5A	0.25 .. 175.00 A; ∞	35.00 A	
1902	50Nc-2 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	50Nc-2 Time Delay
1903	50Nc-1 PICKUP	1A	0.05 .. 35.00 A; ∞	1.50 A	50Nc-1 Pickup
		5A	0.25 .. 175.00 A; ∞	7.50 A	
1904	50Nc-1 DELAY		0.00 .. 60.00 sec; ∞	0.30 sec	50Nc-1 Time Delay
1905	51Nc PICKUP	1A	0.05 .. 4.00 A	1.00 A	51Nc Pickup
		5A	0.25 .. 20.00 A	5.00 A	
1906	51Nc T-DIAL		0.05 .. 3.20 sec; ∞	0.50 sec	51Nc Time Dial
1907	51Nc T-DIAL		0.50 .. 15.00 ; ∞	5.00	51Nc Time Dial
1908	50Nc-3 PICKUP	1A	0.05 .. 35.00 A; ∞	∞ A	50Nc-3 Pickup
1909	50Nc-3 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	50Nc-3 Time Delay
2001	67c-2 PICKUP	1A	0.10 .. 35.00 A; ∞	10.00 A	67c-2 Pickup
		5A	0.50 .. 175.00 A; ∞	50.00 A	
2002	67c-2 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	67c-2 Time Delay
2003	67c-1 PICKUP	1A	0.10 .. 35.00 A; ∞	2.00 A	67c-1 Pickup
		5A	0.50 .. 175.00 A; ∞	10.00 A	
2004	67c-1 DELAY		0.00 .. 60.00 sec; ∞	0.30 sec	67c-1 Time Delay
2005	67c-TOC PICKUP	1A	0.10 .. 4.00 A	1.50 A	67c Pickup
		5A	0.50 .. 20.00 A	7.50 A	
2006	67c-TOC T-DIAL		0.05 .. 3.20 sec; ∞	0.50 sec	67c Time Dial
2007	67c-TOC T-DIAL		0.50 .. 15.00 ; ∞	5.00	67c Time Dial
2008	67c-3 PICKUP	1A	1.00 .. 35.00 A; ∞	∞ A	67c-3 Pickup
		5A	5.00 .. 175.00 A; ∞	∞ A	
2009	67c-3 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	67c-3 Time Delay

Addr.	Parameter	C	Setting Options	Default Setting	Comments
2101	67Nc-2 PICKUP	1A	0.05 .. 35.00 A; ∞	7.00 A	67Nc-2 Pickup
		5A	0.25 .. 175.00 A; ∞	35.00 A	
2102	67Nc-2 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	67Nc-2 Time Delay
2103	67Nc-1 PICKUP	1A	0.05 .. 35.00 A; ∞	1.50 A	67Nc-1 Pickup
		5A	0.25 .. 175.00 A; ∞	7.50 A	
2104	67Nc-1 DELAY		0.00 .. 60.00 sec; ∞	0.30 sec	67Nc-1 Time Delay
2105	67Nc-TOC PICKUP	1A	0.05 .. 4.00 A	1.00 A	67Nc-TOC Pickup
		5A	0.25 .. 20.00 A	5.00 A	
2106	67Nc-TOC T-DIAL		0.05 .. 3.20 sec; ∞	0.50 sec	67Nc-TOC Time Dial
2107	67Nc-TOC T-DIAL		0.50 .. 15.00 ; ∞	5.00	67Nc-TOC Time Dial
2108	67Nc-3 PICKUP		0.25 .. 35.00 A; ∞	∞ A	67Nc-3 Pickup
2109	67Nc-3 DELAY		0.00 .. 60.00 sec; ∞	0.00 sec	67Nc-3 Time Delay

2.4.4 Information List

No.	Information	Type of Information	Comments
1730	>BLOCK CLP	SP	>BLOCK Cold-Load-Pickup
1731	>BLK CLP stpTim	SP	>BLOCK Cold-Load-Pickup stop timer
1732	>ACTIVATE CLP	SP	>ACTIVATE Cold-Load-Pickup
1994	CLP OFF	OUT	Cold-Load-Pickup switched OFF
1995	CLP BLOCKED	OUT	Cold-Load-Pickup is BLOCKED
1996	CLP running	OUT	Cold-Load-Pickup is RUNNING
1997	Dyn set. ACTIVE	OUT	Dynamic settings are ACTIVE

2.5 Single-Phase Overcurrent Protection

The single-phase overcurrent protection evaluates the current that is measured by the sensitive I_{N5} - or the normal I_N input. Which input is used depends on the device version according to the order number.


Applications

- Plain ground fault protection at a power transformer
- Sensitive tank leakage protection.

2.5.1 Functional Description

The single-phase definite time overcurrent ground protection is illustrated by the tripping characteristic as shown in [Figure 2-36](#). The current to be measured is filtered by numerical algorithms. Because of the high sensitivity a particularly narrow band filter is used. The current pickup thresholds and tripping times can be set. The detected current is compared to the pickup value **50 1Ph-1 PICKUP** or **50 1Ph-2 PICKUP** and reported if this is violated. After expiry of the respective delay time **50 1Ph-1 DELAY** or **50 1Ph-2 DELAY**, the trip command is issued. The two elements together form a two-stage protection. The dropout value is approximately 95% of the pickup value for currents greater than $I > 0.3 \cdot I_{Nom}$.


The current filter is bypassed if currents are extremely high in order to achieve a short tripping time. This occurs automatically as soon as the instantaneous value of the current exceeds the set value of the **50 1Ph-2 PICKUP** element by at least factor $2 \cdot \sqrt{2}$.

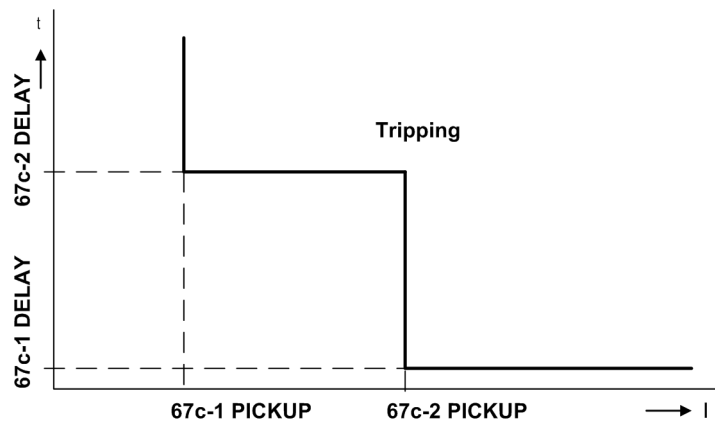

[ueb-einph-kennlinie-020926-rei, 1, en_US]

Figure 2-36 Two-stage characteristic of the single-phase time-overcurrent protection

The following figure shows the logic diagram of the single-phase overcurrent protection function.

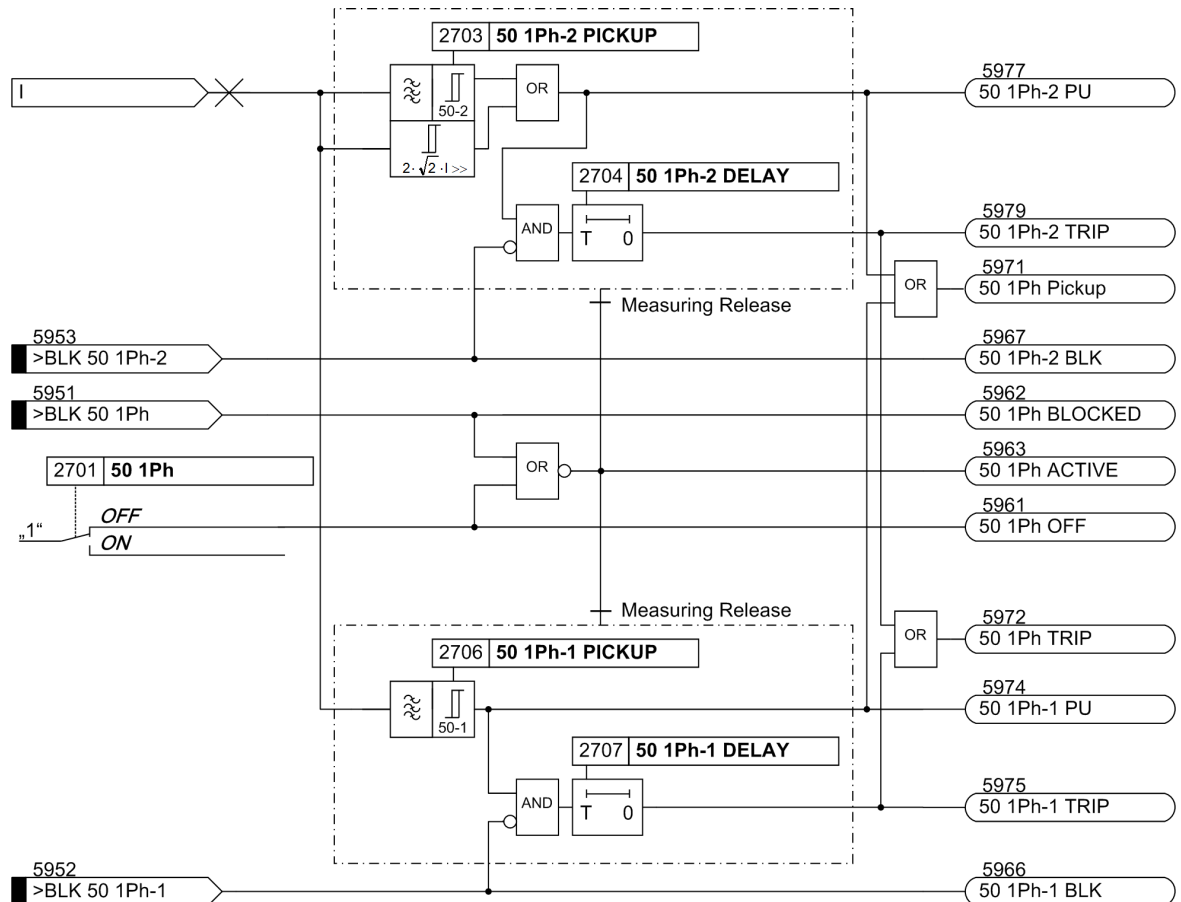

[logikdia-umz-1ph-strom-141103-kn, 1, en_US]

Figure 2-37 Logic diagram of the single-phase time overcurrent protection

2.5.2 High-impedance Ground Fault Unit Protection


Application Examples

The high impedance protection concept is based on measuring the voltage across the paralleled CT's to a common high-resistive resistor.

The CTs must be of the same design and feature at least a separate core for high-impedance protection. In particular, they must have the same transformer ratios and approximately identical knee-point voltage.

With 7SJ80, the high-impedance principle is particularly well suited for detecting ground faults in grounded networks at transformers, generators and shunt reactors.

[Figure 2-38](#) shows an application example for a grounded transformer winding or a grounded motor/generator. The right-hand example depicts an ungrounded transformer winding or an ungrounded motor/generator where the grounding of the system is assumed somewhere else.

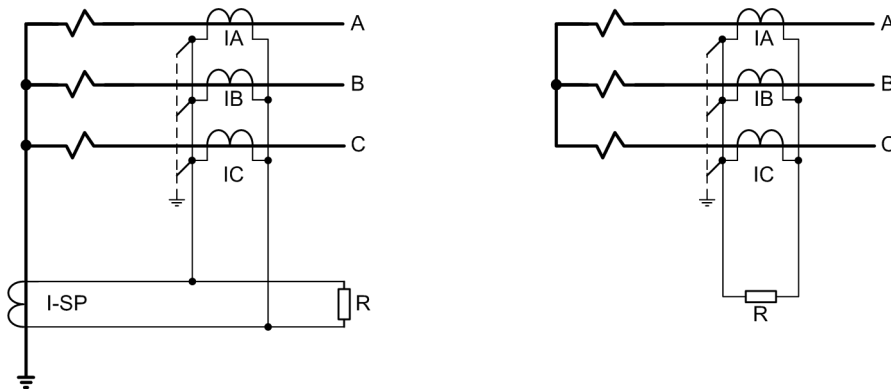

[ueb-einph-hochimpedanz-020926-rei, 1, en_US]


Figure 2-38 Ground fault protection according to the high-impedance principle

Function of the High-Impedance Principle

The high-impedance principle is explained on the basis of a grounded transformer winding.

No zero sequence current will flow during normal operation, i.e. the neutral point current is $I_{SP} = 0$ and the phase currents are $3 I_0 = I_A + I_B + I_C = 0$.

In case of an external ground fault (left in [Figure 2-39](#)), whose fault current is supplied via the grounded neutral point, the same current flows through the transformer neutral point and the phases. The corresponding secondary currents (all current transformers have the same transformation ratio) compensate each other; they are connected in series. Across resistor R only a small voltage is generated. It originates from the inner resistance of the transformers and the connecting cables of the transformers. Even if any current transformer experiences a partial saturation, it will become low-ohmic for the period of saturation and creates a low-ohmic shunt to the high-ohmic resistor R. Thus, the high resistance of the resistor also has a stabilizing effect (the so-called resistance stabilization).

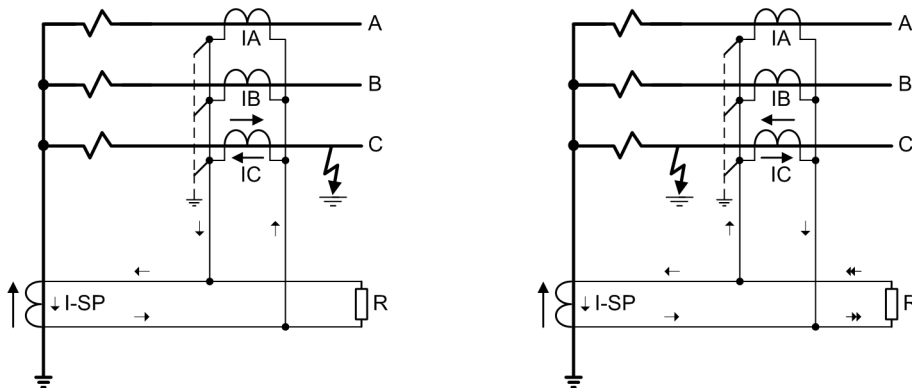

[ueb-einph-hochimpedanz-020926-rei, 1, en_US]

Figure 2-39 Principle of ground fault protection according to the high-impedance principle

When a ground fault occurs in the protected zone ([Figure 2-39](#) right), there is always a neutral point current I_{SP} . The grounding conditions in the rest of the network determine how strong a zero sequence current from the system is. A secondary current which is equal to the total fault current tries to pass through the resistor R. Since the latter is high-resistive, a high voltage emerges immediately. Therefore, the current transformers get saturated. The RMS voltage across the resistor approximately corresponds to the knee-point voltage of the current transformers.


Resistance R is sized such that, even with the very lowest ground fault current to be detected, it generates a secondary voltage, which is equal to half the saturation voltage of current transformers (see also notes on "Dimensioning" in Subsection [2.5.4 Setting Notes](#)).

High-impedance Protection with 7SJ80

With 7SJ80 the sensitive measuring input I_{NS} or the measuring input I_N is used for high-impedance protection. As this is a current input, the protection detects current through the resistor instead of the voltage across the resistor R.

Das [Figure 2-40](#) illustrates the connection scheme. The protection device is connected in series to resistor R and measures its current.

Varistor B limits the voltage when internal faults occur. High voltage peaks emerging with transformer saturation are cut by the varistor. At the same time, voltage is smoothed without reduction of the mean value.

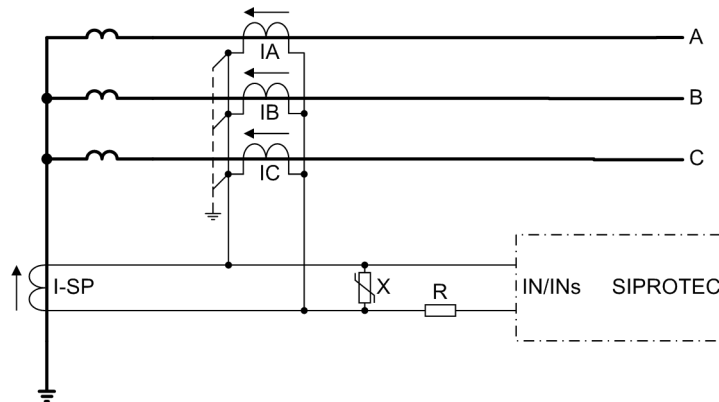

[sj6x-ueb-einph-hochimpedanz3-141103, 1, en_US]

Figure 2-40 Connection diagram of the ground fault differential protection according to the high-impedance principle

For protection against overvoltages it is also important that the device is directly connected to the grounded side of the current transformers so that the high voltage at the resistor can be kept away from the device. For generators, motors and shunt reactors, the high-impedance differential protection can be used analogously. All current transformers at the overvoltage side, the undervoltage side and the current transformer at the neutral point have to be connected in parallel when using auto-transformers.


In principle, this procedure can be applied to every protected object. When applied as busbar protection, for example, the device is connected to the parallel connection of all feeder current transformers via the resistor.

2.5.3 Tank Leakage Protection

Application Example

The tank leakage protection has the task to detect ground leakage — even high-ohmic — between a phase and the frame of a power transformer. The tank must be isolated from ground. A conductor links the tank to ground, and the current through this conductor is fed to a current input of the relay. When tank leakage occurs, a fault current (tank leakage current) will flow through the grounding conductor to ground. This tank leakage current is detected by the single-phase overcurrent protection as an overcurrent; an instantaneous or delayed trip command is issued in order to disconnect all sides of the transformer.

A high-sensitivity single-phase current input is used for tank leakage protection.

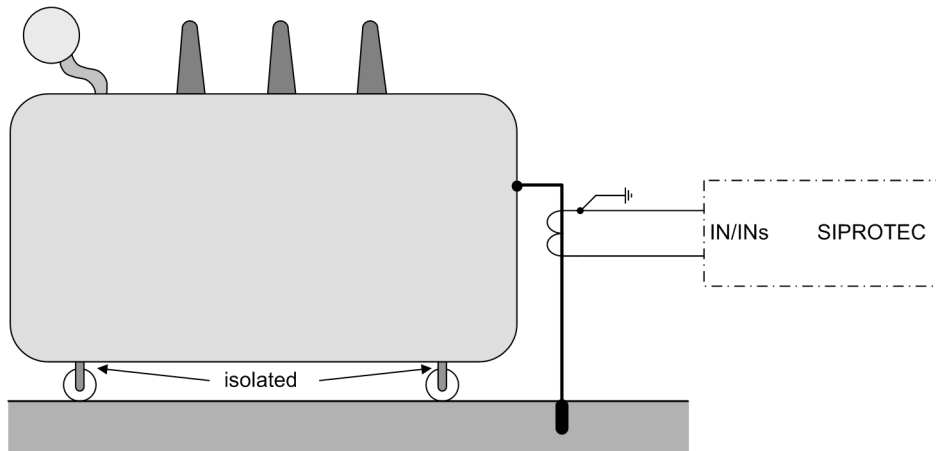

[sj6x-ueb-einph-kesselschut-020926-rei, 1, en_US]

Figure 2-41 Principle of tank-leakage protection

2.5.4 Setting Notes

General

Single-phase time overcurrent protection can be set **ON** or **OFF** at address 2701 **50 1Ph**.

The settings are based on the particular application.

The pickup value for **50 1Ph-2 PICKUP** is set in address 2703, the pickup value for **50 1Ph-1 PICKUP** at address 2706. If only one element is required, set the one not required to ∞ .

A trip time delay can be set in address 2704 **50 1Ph-2 DELAY** for the 50-2 element and for the 50-1 element in address 2707 **50 1Ph-1 DELAY**. With setting 0 s no delay takes place.

The selected times are additional time delays and do not include the operating time (measuring time, etc.) of the elements. The delay can also be set to ∞ ; the corresponding element will then not trip after pickup, but the pickup is reported.

Special notes are given in the following for the use as high-impedance unit protection and tank leakage protection.

Application as High-impedance Protection

The application as high-impedance protection requires that neutral point current detection is possible in the system in addition to phase current detection (see example in [Figure 2-40](#)). Furthermore, a sensitive input transformer must be available at device input I_{NS} . In this case, only the pickup value for single-phase overcurrent protection is set at the 7SJ80 device for the current at input I_{NS} .

The entire function of high-impedance protection is, however, dependent on the interaction of current transformer characteristics, external resistor R and voltage across R. The following section gives information on this topic.

Current Transformer Data for High-impedance Protection

All current transformers must have an identical transformation ratio and nearly equal knee-point voltage. This is usually the case if they are of equal design and identical rated data. The knee-point voltage can be approximately calculated from the rated data of a CT as follows:

$$V_{KPV} = \left(R_i + \frac{P_{Nom}}{I_{Nom}^2} \right) \cdot ALF \cdot I_{Nom}$$

[fo_ueb-einph-saetigungsspannung, 1, en_US]

V_{KVP} Knee-point voltage

R_i Internal burden of the CT

P_{Nom}	Nominal power of the CT
I_{Nom}	Secondary nominal current of CT
ALF	Rated accuracy limit factor of the CT

The nominal current, nominal power and accuracy limit factor are normally stated on the rating plate of the current transformer, e.g.

Current transformer 800/5; 5P10; 30 VA

That means

I_{Nom}	= 5 A (from 800/5)
ALF	= 10 (from 5P10)
P_{Nom}	= 30 VA

The internal burden is often stated in the test report of the current transformer. If not, it can be derived from a DC measurement on the secondary winding.

Calculation Example:

CT 800/5; 5P10; 30 VA with $R_i = 0.3 \, \Omega$

$$V_{\text{KPV}} = \left(R_i + \frac{P_{\text{Nom}}}{I_{\text{Nom}}^2} \right) \cdot \text{ALF} \cdot I_{\text{Nom}} = \left(0.3 \, \Omega + \frac{30 \, \text{VA}}{(5 \, \text{A})^2} \right) \cdot 10 \cdot 5 \, \text{A} = 75 \, \text{V}$$

[fo_ueb-einph-saettigungssp-beisp1, 1, en_US]

or

CT 800/1; 5P10; 30 VA with $R_i = 5 \, \Omega$

$$V_{\text{KPV}} = \left(R_i + \frac{P_{\text{Nom}}}{I_{\text{Nom}}^2} \right) \cdot \text{ALF} \cdot I_{\text{Nom}} = \left(5 \, \Omega + \frac{30 \, \text{VA}}{(5 \, \text{A})^2} \right) \cdot 10 \cdot 1 \, \text{A} = 350 \, \text{V}$$

[fo_ueb-einph-saettigungssp-beisp2, 1, en_US]

Besides the CT data, the resistance of the longest connection lead between the CTs and the 7SJ80 device must be known.


Stability with High-impedance Protection

The stability condition is based on the following simplified assumption: If there is an external fault, one of the current transformers gets totally saturated. The other ones will continue transmitting their (partial) currents. In theory, this is the most unfavorable case. Since, in practice, it is also the saturated transformer which supplies current, an automatic safety margin is guaranteed.

Figure 2-42 shows a simplified equivalent circuit. CT1 and CT2 are assumed as ideal transformers with their inner resistances R_{i1} and R_{i2} . R_a are the resistances of the connecting cables between current transformers and resistor R. They are multiplied by 2 as they have a forward and a return line. R_{a2} is the resistance of the longest connecting cable.

CT1 transmits current I_1 . CT2 shall be saturated. Because of saturation the transformer represents a low-resistance shunt which is illustrated by a dashed short-circuit line.

$R \gg (2R_{a2} + R_{i2})$ is a further prerequisite.

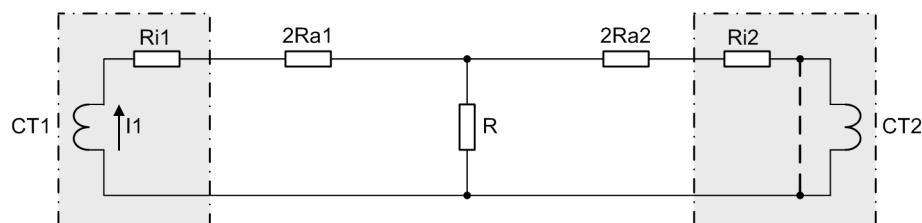

[ueb-einph-anordnung-020926-rei, 1, en_US]

Figure 2-42 Simplified equivalent circuit of a circulating current system for high-impedance protection

The voltage across R is then

$$V_R = I_1 \cdot (2R_{a2} + R_{i2})$$

It is assumed that the pickup value of the 7SJ80 corresponds to half the knee-point voltage of the current transformers. In the balanced case results

$$V_R = V_S / 2$$

This results in a stability limit I_{SL} , i.e. the maximum through-fault current below which the scheme remains stable:

$$I_{SL} = \frac{V_{KPV} / 2}{2 \cdot R_{a2} + R_{i2}}$$

[fo_ueb-einph-stabilitaetslimit, 1, en_US]

Calculation Example:

For the 5 A CT as above with $V_S = 75$ V and $R_i = 0.3$ Ω

longest CT connection lead 22 m (24.06 yd) with 4 mm² cross-section, this corresponds to $R_a = 0.1$ Ω

$$I_{SL} = \frac{V_{KPV} / 2}{2 \cdot R_{a2} + R_{i2}} = \frac{37.5 \text{ V}}{2 \cdot 0.1 \Omega + 0.3 \Omega} = 75 \text{ A}$$

[fo_ueb-einph-stabilitaetslimit-5a, 1, en_US]

that is 15 $\times$ rated current or 12 kA primary.

For the 1 A CT as above with $V_S = 350$ V and $R_i = 5$ Ω

longest CT connection lead 107 m (117.02 yd) with 2.5 mm² cross-section, this corresponds $R_a = 0.75$ Ω

$$I_{SL} = \frac{V_{KPV} / 2}{2 \cdot R_{a2} + R_{i2}} = \frac{175 \text{ V}}{2 \cdot 0.75 \Omega + 5 \Omega} = 27 \text{ A}$$

[fo_ueb-einph-stabilitaetslimit-1a, 1, en_US]

that is 27 $\times$ rated current or 21.6 kA primary.

Sensitivity with High-impedance Protection

The voltage present at the CT set is forwarded to the protective relay across a series resistor R as proportional current for evaluation. The following considerations are relevant for dimensioning the resistor:

As already mentioned, it is desired that the high-impedance protection should pick up at half the knee-point voltage of the CT's. The resistor R can be calculated on this basis.

Since the device measures the current flowing through the resistor, resistor and measuring input of the device must be connected in series. Since, furthermore, the resistance shall be high-resistance (condition: $R \gg 2R_{a2} + R_{i2}$, as mentioned above), the inherent resistance of the measuring input can be neglected. The resistance is then calculated from the pickup current I_{pu} and half the knee-point voltage:

$$R = \frac{V_{KPV} / 2}{I_{pu}}$$

[ueb-einph-widerstand-021026-rei, 1, en_US]

Calculation Example:

For the 5 A CT as above

desired pickup value $I_{pu} = 0.1$ A (equivalent to 16 A primary)

$$R = \frac{V_{KPV} / 2}{I_{pu}} = \frac{75 \text{ V} / 2}{0.1 \text{ A}} = 375 \Omega$$

[ueb-einph-widerstand-5a-021026-rei, 1, en_US]

For the 1 A CT as above

desired pickup value $I_{pu} = 0.05 \text{ A}$ (equivalent to 40 A primary)

$$R = \frac{V_{KPV}^2}{I_{pu}} = \frac{350 \text{ V}^2}{0.05 \text{ A}} = 3500 \text{ } \Omega$$

[ueb-einph-widerstand-1a-021026-rei, 1, en_US]

Series resistor R must be rated for a minimum permanent load $P_{\text{permanent}}$:

$$P_{\text{cont}} \geq \frac{(V_{KPV}^2)^2}{R} = \frac{37.5^2}{375} = 3.75 \text{ W} \quad \text{for the 5 A CT example}$$

[fohochimppcont5a-20120514, 1, en_US]

$$P_{\text{cont}} \geq \frac{(V_{KPV}^2)^2}{R} = \frac{175^2}{3500} = 8.75 \text{ W} \quad \text{for the 1 A CT example}$$

[fohochimppcont1a-20120514, 1, en_US]

Furthermore, series resistor R must be rated for a fault current applying for approx. 0.5 s. This time is usually sufficient for the backup protection to clear the fault.

The thermal load of the series resistor depends on the voltage $V_{\text{rms,stab}}$ applying during an internal fault. It is calculated according to the following formulas:

$$V_{\text{rms,stab}} = 1.3 \cdot \sqrt[4]{V_{KPV}^3 \cdot R \cdot I_{k,\text{max,int}}} = 1.3 \cdot \sqrt[4]{75^3 \cdot 375 \cdot 250} = 579.7 \text{ V} \quad \text{for 5 A CT}$$

[fohochimpprmsstab5a-20120514, 1, en_US]

$$V_{\text{rms,stab}} = 1.3 \cdot \sqrt[4]{V_{KPV}^3 \cdot R \cdot I_{k,\text{max,int}}} = 1.3 \cdot \sqrt[4]{350^3 \cdot 3500 \cdot 50} = 2151.6 \text{ V} \quad \text{for 1 A CT}$$

[fohochimpprmsstab1a-20120514, 1, en_US]

where $I_{k,\text{max,int}}$ corresponds to the maximum fault current during an internal fault.

For the 5 A current transformer 800/5 with 40 kA primary, $I_{k,\text{max,int}}$ equals 250 A secondary.

For the 1 A current transformer 800/1 with 40 kA primary $I_{k,\text{max,int}}$ 50 A secondary.

This yields a short-time load over 0.5 s for the series resistor of:

$$P_{0.5 \text{ s}} = \frac{V_{\text{rms,stab}}^2}{R} = \frac{579.7^2}{375} = 896 \text{ W} \quad \text{for the 5 A CT example}$$

[fohochimpp-5a-20120514, 1, en_US]

$$P_{0.5 \text{ s}} = \frac{V_{\text{rms,stab}}^2}{R} = \frac{2151.6^2}{3500} = 1322.7 \text{ W} \quad \text{for the 1 A CT example}$$


[fohochimpp-1a-20120514, 1, en_US]

Please bear in mind that when choosing a higher pickup value I_{pu} , the resistance must be decreased and, in doing so, power loss will increase significantly.

The varistor B (see following figure) must be dimensioned such that it remains high-resistive until reaching knee-point voltage, e.g.

approx. 100 V for 5 A CT,

approx. 500 V for 1 A CT.

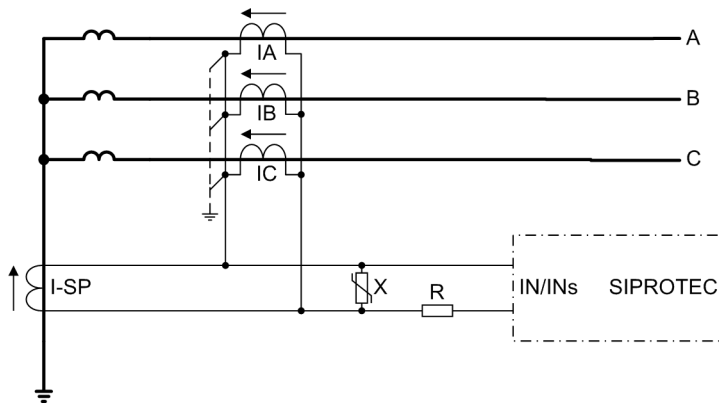

[sj6x-ueb-einph-hochimpedanz3-141103, 1, en_US]

Figure 2-43 Connection diagram of the ground fault differential protection according to the high-impedance principle

Even with an unfavorable external circuit, the maximum voltage peaks should not exceed 2 kV for safety reasons

If performance makes it necessary to switch several varistors in parallel, preference should be given to types with a flat characteristic to avoid asymmetrical loading. therefore recommend the following types from METROSIL:

600A/S1/S256 ($k = 450$, $\beta = 0.25$)

600A/S1/S1088 ($k = 900$, $\beta = 0.25$)

The pickup value (0.1 A or 0.05 A in the example) is set in address 2706 **50 1Ph-1 PICKUP** in the device.

The 50-2 element is not required (address 2703 **50 1Ph-2 PICKUP** = ∞).

The trip command of the protection can be delayed via address 2707 **50 1Ph-1 DELAY**. Normally, such delay is set to **0**.

If a higher number of CTs is connected in parallel, e.g. as busbar protection with several feeders, the magnetizing currents of the transformers connected in parallel cannot be neglected anymore. In this case, the magnetizing currents at half the knee-point voltage (corresponds to the setting value) have to be summed up. These magnetizing currents reduce the current through the resistor R. Therefore the actual pickup value will be correspondingly higher.

Application as Tank Leakage Protection

The use as tank leakage protection requires that a sensitive input transformer is available at the device input I_{NS} . In this case, only the pickup value for single phase overcurrent protection is set at the 7SJ80 device for the current at input I_{NS} .

The tank leakage protection is a sensitive overcurrent protection which detects the leakage current between the isolated transformer tank and ground. Its sensitivity is set in address 2706 **50 1Ph-1 PICKUP**. The 50-2 element is not required (address 2703 **50 1Ph-2 PICKUP** = ∞).

The trip command of the element can be delayed in address 2707 **50 1Ph-1 DELAY**. It is normally set to **0**.

2.5.5 Settings

The table indicates region-specific presettings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
2701	50 1Ph		OFF ON	OFF	50 1Ph
2703	50 1Ph-2 PICKUP	1A	0.001 .. 1.600 A; ∞	0.300 A	50 1Ph-2 Pickup
		5A	0.005 .. 8.000 A; ∞	1.500 A	
2704	50 1Ph-2 DELAY		0.00 .. 60.00 sec; ∞	0.10 sec	50 1Ph-2 Time Delay

Addr.	Parameter	C	Setting Options	Default Setting	Comments
2706	50 1Ph-1 PICKUP	1A	0.001 .. 1.600 A; ∞	0.100 A	50 1Ph-1 Pickup
		5A	0.005 .. 8.000 A; ∞	0.500 A	
2707	50 1Ph-1 DELAY		0.00 .. 60.00 sec; ∞	0.50 sec	50 1Ph-1 Time Delay

2.5.6 Information List

No.	Information	Type of Information	Comments
5951	>BLK 50 1Ph	SP	>BLOCK 50 1Ph
5952	>BLK 50 1Ph-1	SP	>BLOCK 50 1Ph-1
5953	>BLK 50 1Ph-2	SP	>BLOCK 50 1Ph-2
5961	50 1Ph OFF	OUT	50 1Ph is OFF
5962	50 1Ph BLOCKED	OUT	50 1Ph is BLOCKED
5963	50 1Ph ACTIVE	OUT	50 1Ph is ACTIVE
5966	50 1Ph-1 BLK	OUT	50 1Ph-1 is BLOCKED
5967	50 1Ph-2 BLK	OUT	50 1Ph-2 is BLOCKED
5971	50 1Ph Pickup	OUT	50 1Ph picked up
5972	50 1Ph TRIP	OUT	50 1Ph TRIP
5974	50 1Ph-1 PU	OUT	50 1Ph-1 picked up
5975	50 1Ph-1 TRIP	OUT	50 1Ph-1 TRIP
5977	50 1Ph-2 PU	OUT	50 1Ph-2 picked up
5979	50 1Ph-2 TRIP	OUT	50 1Ph-2 TRIP
5980	50 1Ph I:	VI	50 1Ph: I at pick up

2.6 Voltage Protection 27, 59

Voltage protection has the task to protect electrical equipment against undervoltage and overvoltage. Both operational states are abnormal as overvoltage may cause for example insulation problems or undervoltage may cause stability problems.

There are two elements each available for overvoltage protection and undervoltage protection.

Applications

- Abnormally high voltages often occur e.g. in low loaded, long distance transmission lines, in islanded systems when generator voltage regulation fails, or after full load rejection of a generator from the system.
- The undervoltage protection function detects voltage collapses on transmission lines and electrical machines and prevents inadmissible operating states and a possible loss of stability.

2.6.1 Measurement Principle

Connection/Measured Values

The voltages supplied to the device may correspond to the three phase-to-ground voltages V_{A-N} , V_{B-N} , V_{C-N} or the two phase-to-phase voltages (V_{A-B} , V_{B-C}) and the displacement voltage (ground voltage V_N) or - in the case of a single-phase connection - any phase-to-ground voltage. The connection type has been specified during the configuration in parameter 213 **VT Connect. 3ph** (see Section [General, Page 38](#)).

The following table indicates which voltages can be evaluated by the function. The settings for this are made in the **P.System Data 1** (see Section [General, Page 38](#)). Furthermore, it is indicated to which value the threshold must be set. All voltages are fundamental frequency values.

Table 2-8 Voltage protection, selectable voltages

Connection, threephase (parameter 213)	Selectable voltage parameter 614/ 615	Threshold to be set as
Overvoltage		
V_{an}, V_{bn}, V_{cn}	V_{phph} (largest phase-to-phase voltage)	Phase-to-phase voltage
	V_{ph-n} (largest phase-to-ground voltage)	Phase-to-ground voltage
	$V1$ (positive sequence voltage)	Positive sequence voltage calculated from phase-to-groundvoltage or phase-to-phase voltage / $\sqrt{3}$
	$V2$ (negative sequence voltage)	Negative sequence voltage
V_{ab}, V_{bc}, V_{Gnd} V_{ab}, V_{bc} V_{ab}, V_{bc}, V_{Syn} V_{ab}, V_{bc}, V_x	V_{phph} (largest phase-to-phase voltage)	Phase-to-phase voltage
	$V1$ (positive sequence voltage)	Positive sequence voltage
	$V2$ (negative sequence voltage)	Negative sequence voltage
	V_{ph-g}, V_{Syn}	None (direct evaluation of the voltage connected to voltage input 1)
Undervoltage		
V_{an}, V_{bn}, V_{cn}	V_{phph} (smallest phase-to-phase voltage)	Phase-to-phase voltage
	V_{ph-n} (smallest phase-to-ground voltage)	Phase-to-ground voltage
	$V1$ (positive sequence voltage)	Positive sequence voltage · $\sqrt{3}$

Connection, threephase (parameter213)	Selectable voltage parameter 614/ 615	Threshold to be set as
V_{ab} , V_{bc} , V_{Gnd}	V_{phph} (smallest phase-to-phase voltage)	Phase-to-phase voltage
V_{ab} , V_{bc} V_{ab} , V_{bc} , V_{Syn} V_{ab} , V_{bc} , V_x	V_1 (positive sequence voltage)	Positive sequence voltage $\cdot \sqrt{3}$
V_{ph-g} , V_{Syn}	None (direct evaluation of the voltage connected to voltage input 1)	Direct voltage value

The positive and negative sequence voltages stated in the table are calculated from the phase-to-ground voltages.

Current Criterion

Depending on the system, the primary voltage transformers are arranged either on the supply side or the load side of the associated circuit breaker. These different arrangements lead to different behaviour of the voltage protection function when a fault occurs. When a tripping command is issued and a circuit breaker is opened, full voltage remains on the supply side while the load side voltage becomes zero. When voltage supply is suppressed, undervoltage protection, for instance, will remain picked up. If pickup is to drop out, the current can be used as an additional criterion for pickup of undervoltage protection (current supervision CS). Undervoltage pickup can only be maintained when the undervoltage criterion satisfied and a settable minimum current level (**BkrClosed I MIN**) are exceeded. Here, the largest of the three phase currents is used. When the current decreases below the minimum current setting after the circuit breaker has opened, undervoltage protection drops out.



NOTE

If parameter **CURRENT SUPERV.** is set to disabled in address 5120, the device picks up immediately without measurement voltage and the undervoltage protection function in pickup. Apply measuring voltage or block the voltage protection to continue with configuration. Moreover you have the option of setting a flag via device operation for blocking the voltage protection. This initiates the reset of the pickup and device configuration can be resumed.


2.6.2 Overvoltage Protection 59

Function

The overvoltage protection has two elements. In case of a high overvoltage, tripping switch off is performed with a short-time delay, whereas in case of less severe overvoltages, the tripping is performed with a longer time delay. When one of the adjustable settings is exceeded, the 59 element picks up and trips after an adjustable time delay has elapsed. The time delay is not dependent on the magnitude of the overvoltage.

The dropout ratio for the two overvoltage elements ($= V_{\text{dropout value}} / V_{\text{pickup value}}$) can be set.

The following figure shows the logic diagram of the overvoltage protection function.

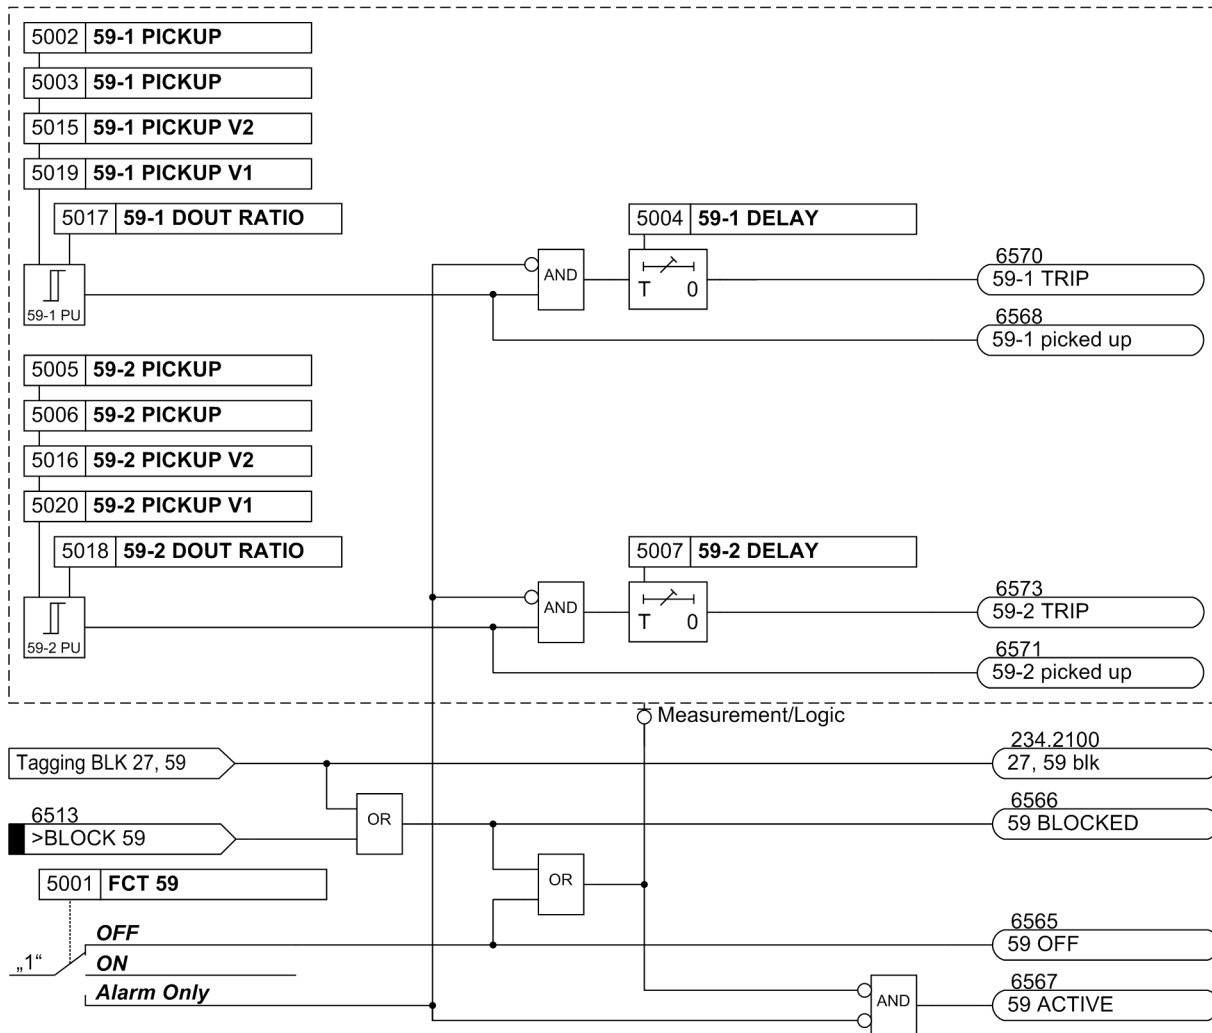

[7sj80-ueberspgs-schutz-20061219, 1, en_US]

Figure 2-44 Logic diagram of the overvoltage protection

2.6.3 Undervoltage Protection 27


Function

Undervoltage protection consists of two definite time elements (**27-1 PICKUP** and **27-2 PICKUP**). Therefore, tripping can be time-coordinated depending on how severe voltage collapses are. Voltage thresholds and time delays can be set individually for both elements.

The dropout ratio for the two undervoltage elements ($= V_{\text{dropout value}} / V_{\text{pickup value}}$) can be set.

Like the other protection functions, the undervoltage protection operates in an extended frequency range. This ensures that the protection function is ensured even for the protection of decelerating motors, for instance. However, the r.m.s. value of the positive voltage component is considered too small when the frequency deviates considerably so that the device will tend to overfunction.

[Figure 2-45](#) shows a typical voltage profile during a fault for source side connection of the voltage transformers. Because full voltage is present after the circuit breaker has been opened, current supervision CS described above is not necessary in this case. After the voltage has dropped below the pickup setting, tripping is initiated after time delay **27-1 DELAY**. As long as the voltage remains below the dropout setting, reclosing is blocked. Only after the fault has been cleared, i.e. when the voltage increases above the dropout level, the element drops out and allows reclosing of the circuit breaker.

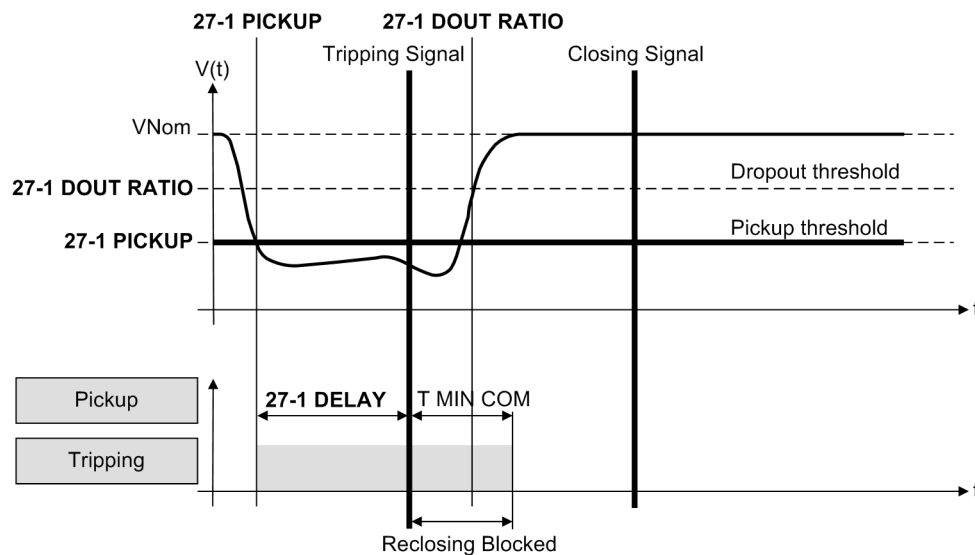


T MIN COM = Minimum Command Line

[stoerfallverlauf-ohne-stromkriterium-260602-kn, 1, en_US]

Figure 2-45 Typical fault profile for source side connection of the voltage transformer (without current supervision)

Figure 2-46 shows a fault profile for a load side connection of the voltage transformers. When the circuit breaker is open, the voltage disappears (the voltage remains below the pickup setting), and current supervision is used to ensure that pickup drops out after the circuit breaker has opened (**BkrClosed I MIN**).

After the voltage has dropped below the pickup setting, tripping is initiated after time delay **27-1 DELAY**. When the circuit breaker opens, voltage decreases to zero and undervoltage pickup is maintained. The current value also decreases to zero so that current criterion is reset as soon as the release threshold (**BkrClosed I MIN**) is exceeded. Pickup of the protection function is also reset by the action of the AND-combination of voltage and current. As a consequence, energization is admitted anew when the minimum command time elapsed.

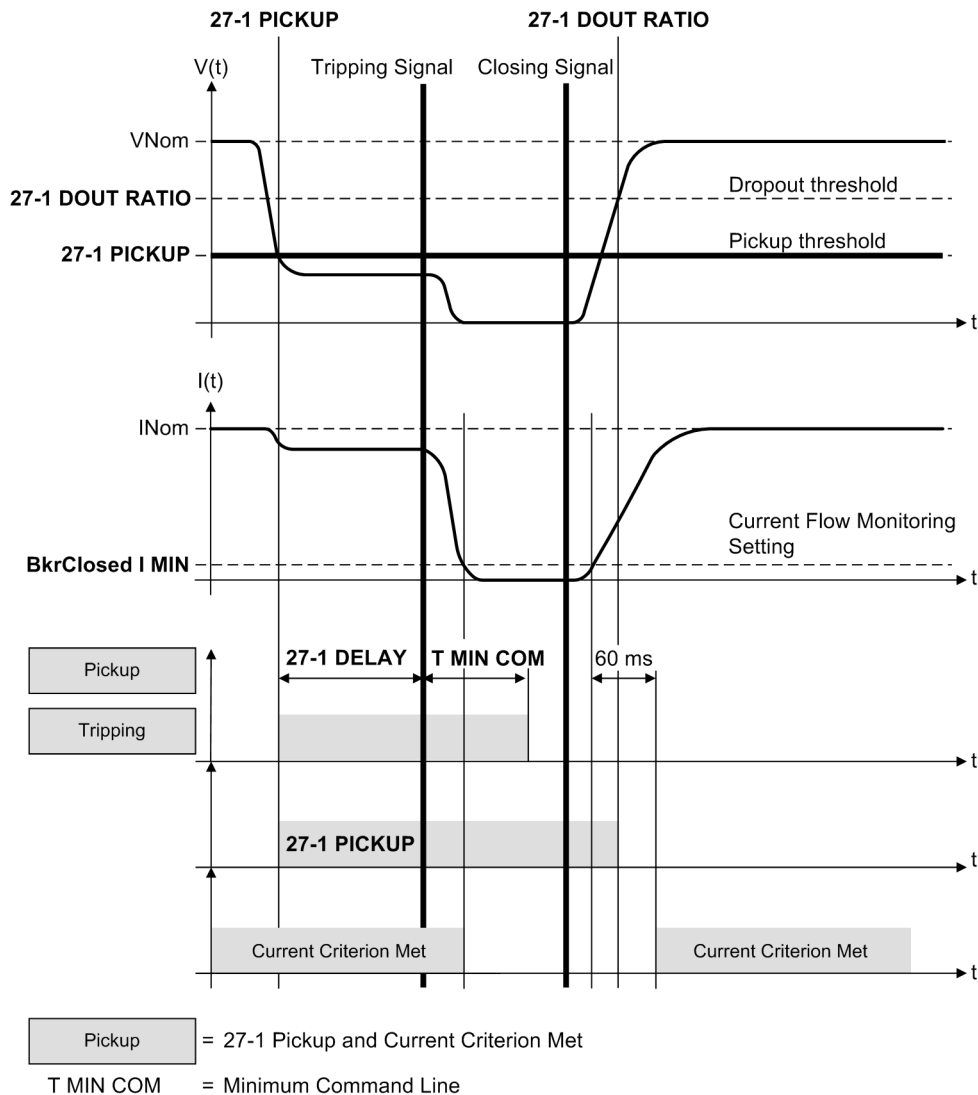


[stoerfallverlauf-mit-stromkriterium-260602-kn, 1, en_US]

Figure 2-46 Typical fault profile for load side connection of the voltage transformers (with current supervision)

Upon the closing of the circuit breaker, current criterion is delayed for a short period of time. If the voltage criterion drops out during this time period (about 60 ms), the protection function does not pick up. Therefore no fault record is created when voltage protection is activated in a healthy system. It is important to understand, however, that if a low voltage condition exists on the load after the circuit breaker is closed (unlike [Figure 2-46](#)), the desired pickup of the element will be delayed by 60 ms.

The following figure shows the logic diagram of the undervoltage protection function.

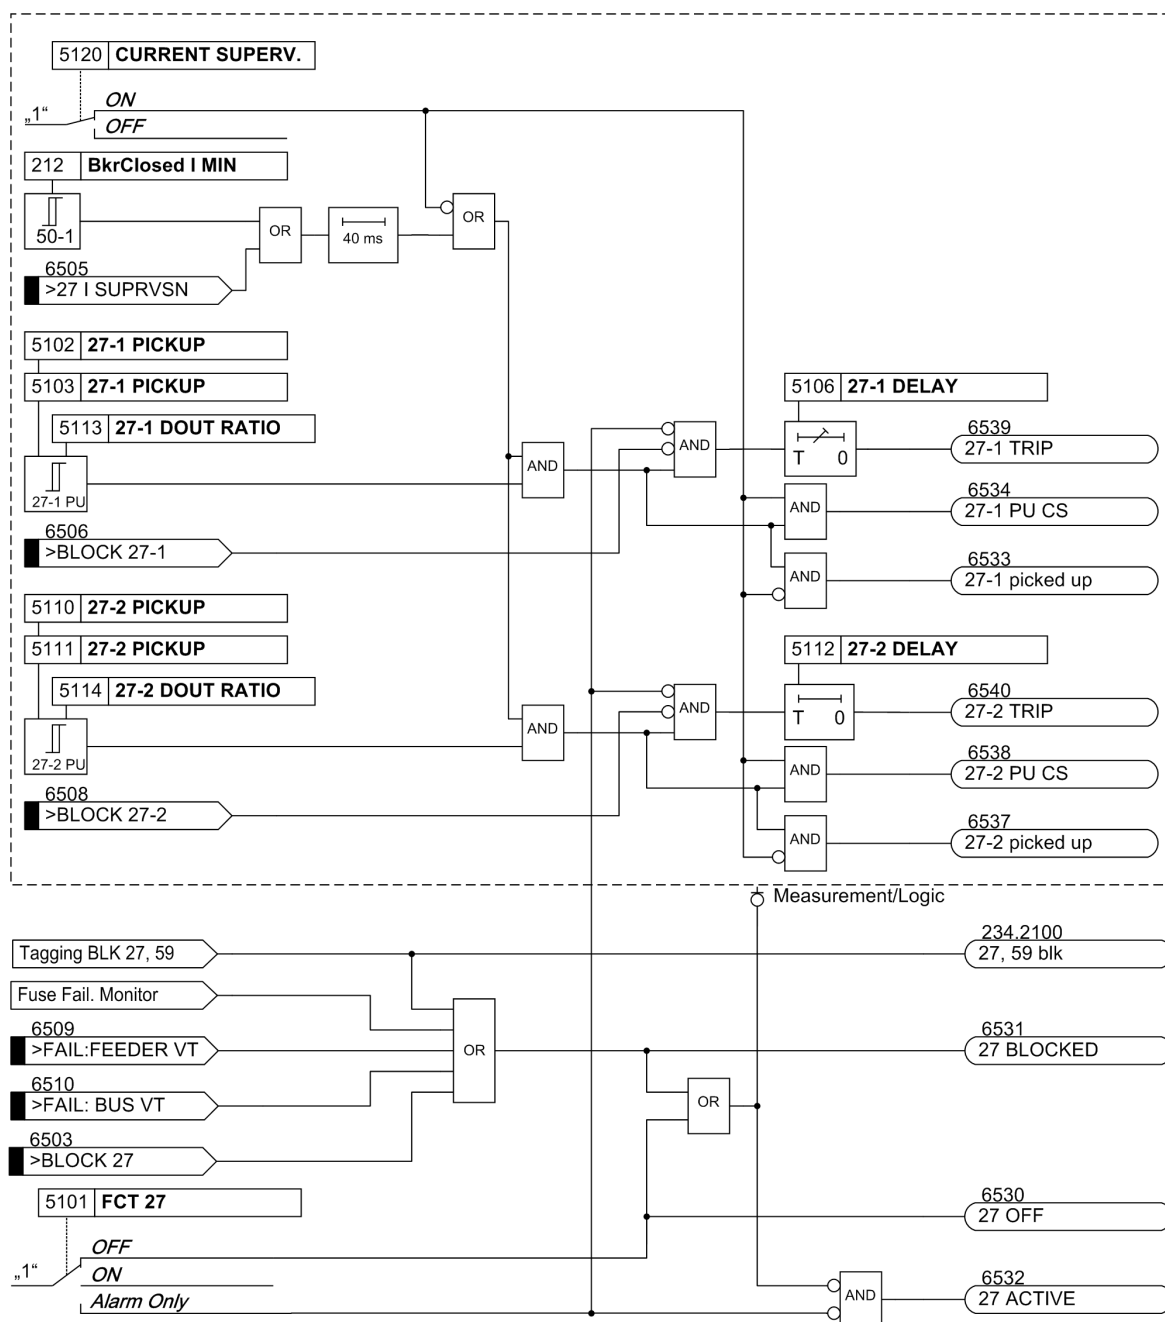

[7sj80-unterspgs-schutz-20061219, 1, en_US]

Figure 2-47 Logic diagram of the undervoltage protection

2.6.4 Setting Notes

General

Voltage protection is only effective and accessible if address 150 **27/59** is set to **Enabled** during configuration of protection functions. If this function is not required, then **Disabled** is set.

The voltage to be evaluated is selected in Power System Data 1 (see Chapter [2.6 Voltage Protection 27, 59, Table 2-8](#)).

Overvoltage protection can be turned **ON** or **OFF**, or set to **Alarm Only** at address 5001 **FCT 59**.

Undervoltage protection can be turned **ON** or **OFF** or set to **Alarm Only** at address 5101 **FCT 27**.

With the protection function **ON**, tripping, the clearing of a fault and fault recording are initiated when the thresholds are exceeded and the set time delays have expired.

With setting **Alarm Only** no trip command is given, no fault is recorded and no immediate fault annunciation is shown on the display

Overvoltage Protection with Phase-to-phase or Phase-to-ground Voltages

The largest of the applied voltages is evaluated for the phase-to-phase or phase-to-ground overvoltage protection.

The threshold values are set in the value to be evaluated (see Chapter [2.6 Voltage Protection 27, 59, Table 2-8](#)).

The overvoltage protection has two elements. The pickup value of the lower threshold (address 5002 or 5003, **59-1 PICKUP**, depending on the phase-to-ground or the phase-to-phase voltages, can be assigned a longer time delay (address 5004, **59-1 DELAY**) and the upper threshold element (address 5005 or 5006, **59-2 PICKUP**) a shorter (address 5007, **59-2 DELAY**) time delay. There are no specific procedures on how the pickup values are set. However, as the function is mainly used to prevent high insulation damage to system components and users, the threshold value 5002, 5003 **59-1 PICKUP** lies generally between 110 % and 115 % of the nominal voltage and setting value 5005, 5006 **59-2 PICKUP** at approximately 130 %.

The time delays of the overvoltage elements are entered at addresses 5004 **59-1 DELAY** and 5007 **59-2 DELAY**, and should be selected in such manner that they make allowance for brief voltage peaks that are generated during switching operations and also enable clearance of stationary overvoltages in due time.

The choice between phase-to-ground and phase-to-phase voltage allows voltage asymmetries (e.g. caused by a ground fault) to be taken into account (phase-to-ground) or to remain unconsidered (phase-to-phase) during evaluation.

Overvoltage Protection - Positive Sequence System V1

In a three-phase voltage transformer connection the positive sequence system can be evaluated for the overvoltage protection by means of configuring parameter 614 **OP. QUANTITY 59** to **V1**. In this case, the threshold values of the overvoltage protection must be set in parameters 5019 **59-1 PICKUP V1** or 5020 **59-2 PICKUP V1**.

Overvoltage Protection - Negative Sequence System V2

In a three-phase transformer connection, parameter 614 **OP. QUANTITY 59** can determine that the negative sequence system **V2** can be evaluated as a measured value for the overvoltage protection. The negative sequence system detects voltage unbalance and can be used for the stabilization of the time overcurrent protection. In backup protection of transformers or generators, the fault currents lie, in some cases, only slightly above the load currents. In order to obtain a pickup threshold of the time overcurrent protection that is as sensitive as possible, its stabilization via the voltage protection is necessary to avoid false tripping.

Overvoltage protection comprises two elements. Thus, with configuration of the negative system, a longer time delay (address 5004, **59-1 DELAY**) may be assigned to the lower element (address 5015, **59-1-V2 PICKUP**) and a shorter time delay (address 5007, **59-2 DELAY**) may be assigned to the upper element (address 5016, **59-2-V2 PICKUP**). There are not clear cut procedures on how to set the pickup values **59-1-V2 PICKUP** or **59-2-V2 PICKUP** as they depend on the respective station configuration.

The time delays of the overvoltage elements are entered at addresses 5004 **59-1 DELAY** and 5007 **59-2 DELAY**, and should be selected in such manner that they make allowance for brief voltage peaks that are generated during switching operations and also enable clearance of stationary overvoltages in due time.

Dropout Threshold of the Overvoltage Protection

The dropout thresholds of the 59-1 element and the 59-2 element can be configured via the dropout ratio $r = V_{\text{Dropout}} / V_{\text{Pickup}}$ at addresses 5017 **59-1 DOUT RATIO** or 5018 **59-2 DOUT RATIO**. The following marginal condition applies to r :

$r \cdot (\text{configured pickup threshold}) \leq 150 \text{ V}$ with connection of phase-to-phase voltages and phase-to-ground voltages or

$r \cdot (\text{configured pickup threshold}) \leq 260 \text{ V}$ with calculation of the measured values from the connected voltages (e.g. phase-to-phase voltages calculated from the connected phase-to-ground voltages).

The minimum hysteresis is 0.6 V.

Undervoltage Protection - Positive Sequence System V1

The positive sequence component (**V1**) can be evaluated for the undervoltage protection. Especially in case of stability problems, their acquisition is advantageous because the positive sequence system is relevant for the limit of the stable energy transmission. Concerning the pickup values there are no specific notes on how to set them. However, because the undervoltage protection function is primarily intended to protect induction machines from voltage dips and to prevent stability problems, the pickup values will usually be between 60 % and 85 % of the nominal voltage.

The threshold value is multiplied as positive sequence voltage and set to $\sqrt{3}$, thus realizing the reference to the nominal voltage.

Undervoltage protection comprises two elements. The pickup value of the lower threshold is set at address 5110 or 5111, **27-2 PICKUP** (depending on the voltage transformer connection, phase-to-ground or phase-to-phase), while time delay is set at address 5112, **27-2 DELAY** (short time delay). The pickup value of the upper element is set at address 5102 or 5103, **27-1 PICKUP**, while the time delay is set at address 5106, **27-1 DELAY** (a somewhat longer time delay). Setting these elements in this way allows the undervoltage protection function to closely follow the stability behavior of the system.

The time settings should be selected such that tripping occurs in response to voltage dips that lead to unstable operating conditions. On the other hand, the time delay should be long enough to avoid tripping on short-term voltage dips.

Undervoltage Protection with Phase-to-phase or Phase-to-ground Voltages

In parameter 615 **OP. QUANTITY 27** you can determine for undervoltage protection in a three-phase connection that instead of the positive-sequence system **V1**, the smallest of the phase-to-phase voltages **V_{phph}** or the smallest phase-to-ground voltage **V_{ph-n}** is configured as a measured quantity. The threshold values are set in the quantity to be evaluated (see Section 2.6 Voltage Protection 27, 59, Table 2-8).

Undervoltage protection comprises two elements. The pickup value of the lower threshold is set at address 5110 or 5111, **27-2 PICKUP** (depending on the voltage transformer connection, phase-to-ground or phase-to-phase), while time delay is set at address 5112, **27-2 DELAY** (short time delay). The pickup value of the upper element is set at address 5102 or 5103, **27-1 PICKUP**, while the time delay is set at address 5106, **27-1 DELAY** (a somewhat longer time delay). Setting these elements in this way allows the undervoltage protection function to closely follow the stability behavior of the system.

The time settings should be selected such that tripping occurs in response to voltage dips that lead to unstable operating conditions. On the other hand, the time delay should be long enough to avoid tripping on short-term voltage dips.

Dropout Threshold of the Undervoltage Protection

The dropout thresholds of the 59-1 element and the 59-2 element can be parameterized via the dropout ratio $r = V_{\text{dropout}} / V_{\text{pickup}}$ (5113 **27-1 DOUT RATIO** or 5114 **27-2 DOUT RATIO**). The following marginal condition applies to r :

$r \cdot (\text{configured pickup threshold}) \leq 130 \text{ V}$ with connection of phase-to-phase voltages and phase-to-ground voltages) or

$r \cdot (\text{configured pickup threshold}) \leq 225 \text{ V}$ with calculation of the measured values from the connected voltages (e.g. calculated phase-to-phase voltages from the connected phase-to-ground voltages).

The minimum hysteresis is 0.6 V.



NOTE

If a setting is selected such that the dropout threshold (= pickup threshold · dropout ratio) results in a greater value than 130 V/225 V, it will be limited automatically. No error message occurs.

Current Criterion for Undervoltage Protection

The 27-1 element and the 27-2 element can be supervised by the current flow monitoring setting. If the **CURRENT SUPERV.** is switched ON at address 5120 (factory setting), the release condition of the current

criterion must be fulfilled in addition to the corresponding undervoltage condition, which means that a configured minimum current (**BkrClosed I MIN**, address 212) must be present to make sure that this protective function can pick up. Thus it can be achieved that pickup of the undervoltage protection drops out when the line is disconnected from voltage supply. Furthermore, this feature prevents an immediate general pickup of the device when the device is powered-up without measurement voltage being present.



NOTE

If parameter **CURRENT SUPERV.** is set to disabled at address 5120, the device picks up immediately if the measuring-circuit voltage fails and the undervoltage protection is enabled. Furthermore, configuration can be performed by pickup of measuring-circuit voltage or blocking of the voltage protection. The latter can be initiated via device operation in DIGSI and via communication from the control center by means of a tagging command for blocking the voltage protection. This causes the dropout of the pickup and parameterization can be resumed.

Please note that the pickup threshold **BkrClosed I MIN** (address 212) also affects the overload protection, the cold load pickup function and the CB maintenance.

2.6.5 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

Addr.	Parameter	Setting Options	Default Setting	Comments
5001	FCT 59	OFF ON Alarm Only	OFF	59 Overvoltage Protection
5002	59-1 PICKUP	20 .. 260 V	110 V	59-1 Pickup
5003	59-1 PICKUP	20 .. 150 V	110 V	59-1 Pickup
5004	59-1 DELAY	0.00 .. 200.00 sec; ∞	0.50 sec	59-1 Time Delay
5005	59-2 PICKUP	20 .. 260 V	120 V	59-2 Pickup
5006	59-2 PICKUP	20 .. 150 V	120 V	59-2 Pickup
5007	59-2 DELAY	0.00 .. 200.00 sec; ∞	0.50 sec	59-2 Time Delay
5015	59-1 PICKUP V2	2 .. 150 V	30 V	59-1 Pickup V2
5016	59-2 PICKUP V2	2 .. 150 V	50 V	59-2 Pickup V2
5017A	59-1 DOUT RATIO	0.90 .. 0.99	0.95	59-1 Dropout Ratio
5018A	59-2 DOUT RATIO	0.90 .. 0.99	0.95	59-2 Dropout Ratio
5019	59-1 PICKUP V1	20 .. 150 V	110 V	59-1 Pickup V1
5020	59-2 PICKUP V1	20 .. 150 V	120 V	59-2 Pickup V1
5101	FCT 27	OFF ON Alarm Only	OFF	27 Undervoltage Protection
5102	27-1 PICKUP	10 .. 210 V	75 V	27-1 Pickup
5103	27-1 PICKUP	10 .. 120 V	45 V	27-1 Pickup
5106	27-1 DELAY	0.00 .. 200.00 sec; ∞	1.50 sec	27-1 Time Delay
5110	27-2 PICKUP	10 .. 210 V	70 V	27-2 Pickup
5111	27-2 PICKUP	10 .. 120 V	40 V	27-2 Pickup
5112	27-2 DELAY	0.00 .. 200.00 sec; ∞	0.50 sec	27-2 Time Delay
5113A	27-1 DOUT RATIO	1.01 .. 3.00	1.20	27-1 Dropout Ratio
5114A	27-2 DOUT RATIO	1.01 .. 3.00	1.20	27-2 Dropout Ratio
5120A	CURRENT SUPERV.	OFF ON	ON	Current Supervision

2.6.6 Information List

No.	Information	Type of Information	Comments
234.2100	27, 59 blk	IntSP	27, 59 blocked via operation
6503	>BLOCK 27	SP	>BLOCK 27 undervoltage protection
6505	>27 I SUPRVSN	SP	>27-Switch current supervision ON
6506	>BLOCK 27-1	SP	>BLOCK 27-1 Undervoltage protection
6508	>BLOCK 27-2	SP	>BLOCK 27-2 Undervoltage protection
6513	>BLOCK 59	SP	>BLOCK 59 overvoltage protection
6530	27 OFF	OUT	27 Undervoltage protection switched OFF
6531	27 BLOCKED	OUT	27 Undervoltage protection is BLOCKED
6532	27 ACTIVE	OUT	27 Undervoltage protection is ACTIVE
6533	27-1 picked up	OUT	27-1 Undervoltage picked up
6534	27-1 PU CS	OUT	27-1 Undervoltage PICKUP w/curr. superv
6537	27-2 picked up	OUT	27-2 Undervoltage picked up
6538	27-2 PU CS	OUT	27-2 Undervoltage PICKUP w/curr. superv
6539	27-1 TRIP	OUT	27-1 Undervoltage TRIP
6540	27-2 TRIP	OUT	27-2 Undervoltage TRIP
6565	59 OFF	OUT	59-Overvoltage protection switched OFF
6566	59 BLOCKED	OUT	59-Overvoltage protection is BLOCKED
6567	59 ACTIVE	OUT	59-Overvoltage protection is ACTIVE
6568	59-1 picked up	OUT	59-1 Overvoltage V> picked up
6570	59-1 TRIP	OUT	59-1 Overvoltage V> TRIP
6571	59-2 picked up	OUT	59-2 Overvoltage V>> picked up
6573	59-2 TRIP	OUT	59-2 Overvoltage V>> TRIP

2.7 Negative Sequence Protection 46

Negative sequence protection detects unbalanced loads on the system.

Applications


- This protection function can be used to detect interruptions, short-circuits and polarity problems in the connections to the current transformers.
- It is also useful in detecting single-phase and two-phase faults with fault currents lower than the maximum load currents.

Prerequisites

The unbalanced load protection becomes effective when:
at least one phase current is greater than $0.1 \times I_{Nom}$ and
all phase currents are smaller than $10 \times I_{Nom}$.

2.7.1 Definite Time characteristic

The definite time characteristic consists of two elements. As soon as the first settable threshold **46-1 PICKUP** is reached, a pickup message is output and time element **46-1 DELAY** is started. When the second element **46-2 PICKUP** is started, another message is output and time element **46-2 DELAY** is initiated. Once either time delay elapses, a trip signal is initiated.

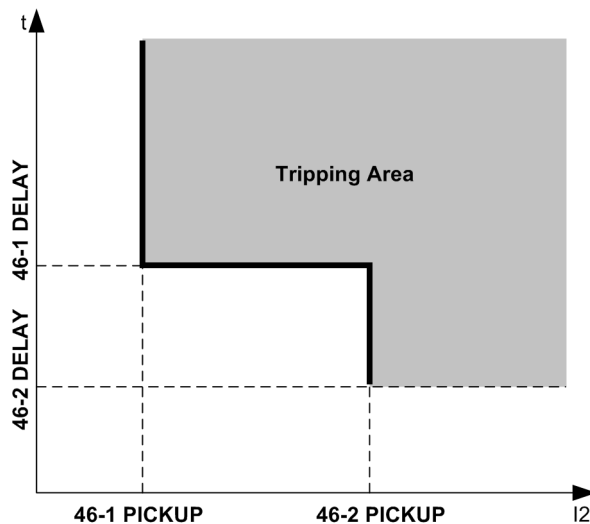

[unabhaeng-ausl_charakt-des-schiefelastschutzes-260602-ko, 1, en_US]

Figure 2-48 Definite time characteristic for negative sequence protection

Settable Dropout Times

Pickup stabilization for the definite-time tripping characteristic 46-1, 46-2 can be accomplished by means of settable dropout times. This facility is used in power systems with possible intermittent faults. Used together with electromechanical relays, it allows different dropout responses to be adjusted and a time grading of numerical and electromechanical relays to be implemented.


2.7.2 Inverse Time characteristic

The inverse time element is dependent on the ordered device version. It operates with IEC or ANSI characteristic tripping curves. The curves and associated formulas are given in the Technical Data. When programming

the inverse time characteristic also definite time elements **46-2 PICKUP** and **46-1 PICKUP** are available (see a foregoing paragraph).

Pickup and Tripping

The negative sequence current I is compared to the setting value **46-TOC PICKUP**. When the negative sequence current exceeds 1.1 times the setting value, a pickup annunciation is generated. The tripping time is calculated from the negative sequence current according to the characteristic selected. When tripping time is reached, a tripping command is issued. The characteristic curve is illustrated in the following Figure.

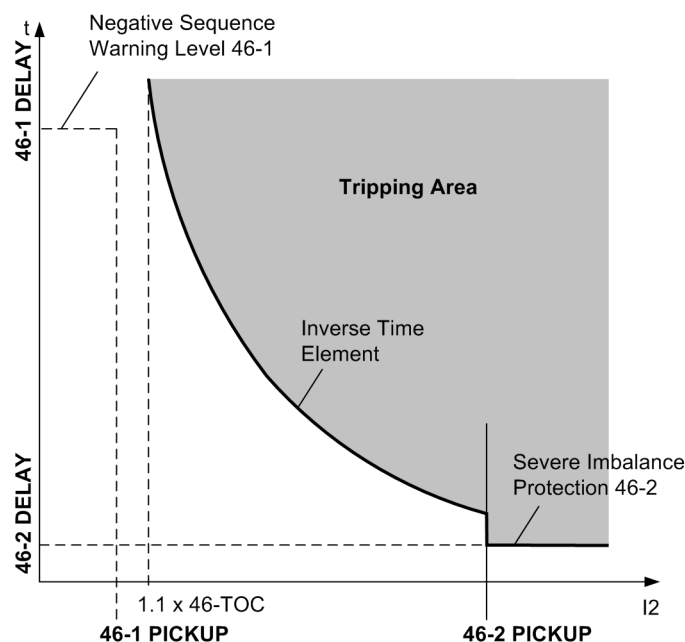

[abhaeng-ausl_charakt-des-schieflastschutzes-260602-kn, 1, en_US]

Figure 2-49 Inverse time characteristic for negative sequence protection

Dropout for IEC Curves

The element drops out when the negative sequence current decreases to approx. 95% of the pickup setting. The time delay resets immediately to be ready for another pickup operation.

Dropout for ANSI Curves

When using an ANSI curve it can be selected whether the dropout of the element is to occur instantaneously or whether dropout is to be performed by means of the disk emulation mechanism. „Instantaneous“ means that the drop out will occur when a 95 % of the pickup value is reached. For a new pickup the time counter starts at zero.


The disk emulation evokes a dropout process (timer counter is decrementing) which begins after de-energization. This process corresponds to the reset of a Ferraris-disk (explaining its denomination "disk emulation"). In case several faults occur in succession, the "history" is taken into consideration due to the inertia of the Ferraris-disk, and the time response is adapted. This ensures a proper simulation of the temperature rise of the protected object even for extremely fluctuating unbalanced load values. Reset begins as soon as 90 % of the setting value is reached, in accordance with the dropout curve of the selected characteristic. In the range between the dropout value (95 % of the pickup value) and 90 % of the setting value, the incrementing and decrementing process is in idle state.

Disk emulation offers advantages when the behavior of the negative sequence protection must be coordinated with other relays in the system based on electromagnetic measuring principles.

Logic

The following figure shows the logic diagram for the negative sequence protection function. The protection may be blocked via a binary input. This resets pickup and time elements and clears measured values.

When the negative sequence protection criteria are no longer satisfied (i.e. all phase currents below $0.1 \times I_N$ or at least one phase current is greater than $10 \times I_{Nom}$) all pickups issued by the negative sequence protection function are reset.

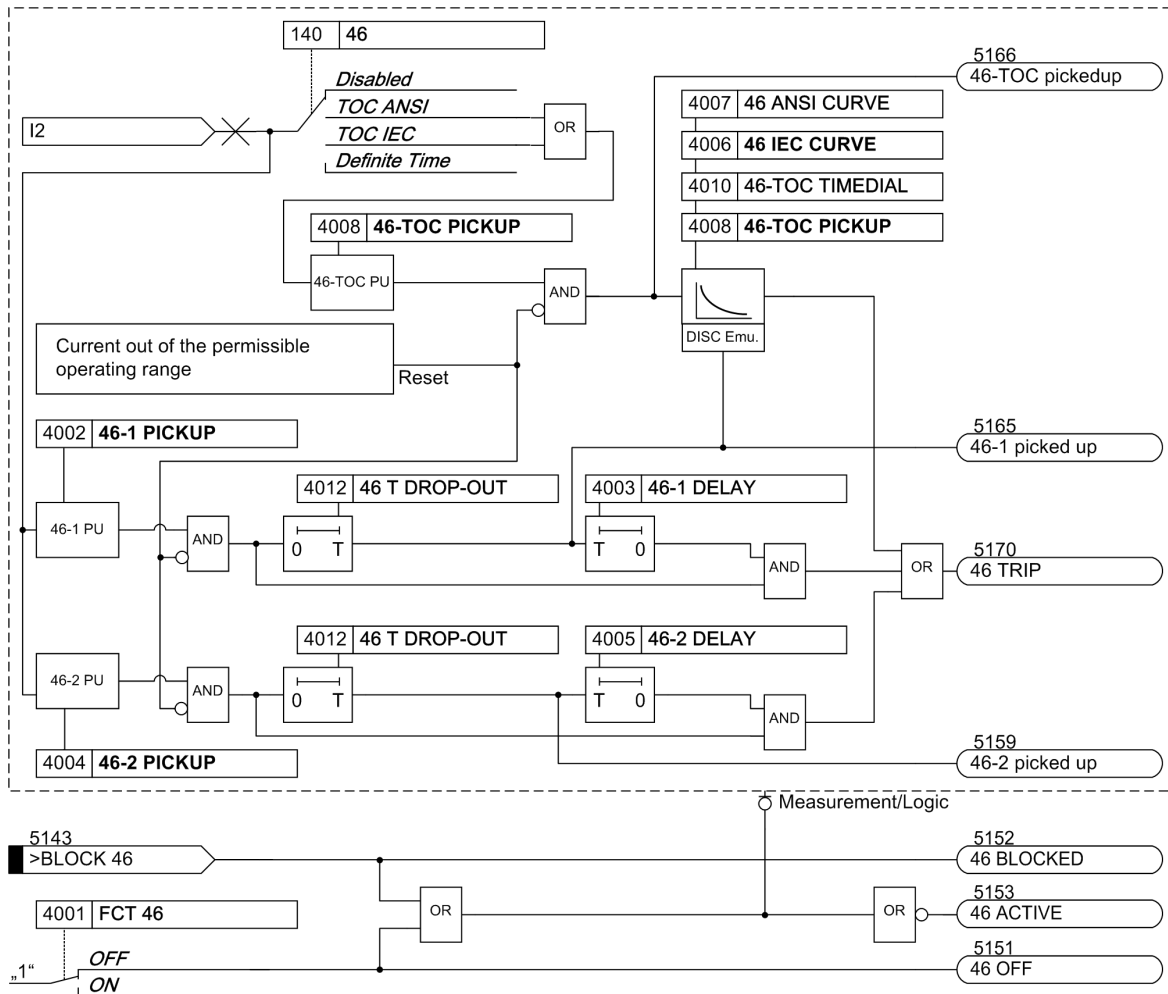

[7sj80-schiefelastschutz-20060109, 1, en_US]

Figure 2-50 Logic diagram of the unbalanced load protection

The pickup of the definite time overcurrent protection can be stabilized by the configured dropout time **46 T DROP-OUT**. This time is started and maintains the pickup condition if the current falls below the threshold. Therefore, the function does not drop out at high speed. The trip command delay time continues running. After the dropout delay time has elapsed, the pickup is reported OFF and the trip delay time is reset unless the threshold has been exceeded again. If the threshold is exceeded again during the dropout delay time, the time is canceled. The trip command delay time continues running. Should the threshold value be exceeded after its expiry, the trip command is issued immediately. If the threshold value is not exceeded at this time, there will be no reaction. If the threshold value is exceeded again after expiry of the trip-command delay time, while the dropout delay time is still running, tripping occurs immediately.

The configured dropout times do not influence the tripping times of the inverse time elements as these depend dynamically on the measured current value. For purposes of dropout coordination, disc emulation is used with electro-mechanical relays.

2.7.3 Setting Notes

General

The function type has been specified during configuration of the protection functions (see Section 2.1.1.2 *Setting Notes*, address 140, **46**). If only the definite time elements are desired, the address **46** should be set to **Definite Time**. Selecting **46 = TOC IEC** or **TOC ANSI** in address 140 will additionally make all parameters available that are relevant for the inverse time characteristics. If this function is not required, then **Disabled** is set.

The function can be turned **ON** or **OFF** in address 4001 **FCT 46**.

The default pickup settings and delay settings are generally sufficient for most applications.

Definite Time Elements

The unbalanced load protection function comprises two elements. Therefore, the upper element (address 4004 **46-2 PICKUP**) can be set to a short time delay 4005 **46-2 DELAY**) and the lower element (address 4002 **46-1 PICKUP**) can be set to a somewhat longer time delay (address 4003 **46-1 DELAY**). This allows the lower element to act, e.g. as an alarm, while the upper element will cut the inverse time characteristic as soon as high inverse currents are present. If **46-2 PICKUP** is set to about 60%, tripping is always performed with the thermal characteristic. On the other hand, with more than 60% of unbalanced load, a two-phase fault can be assumed. The delay time **46-2 DELAY** must be coordinated with the system grading of phase-to-phase faults. If power supply with current I is provided via just two phases, the following applies to the inverse current:

$$I_2 = \frac{1}{\sqrt{3}} \cdot I = 0.58 \cdot I$$

[fo_i2-058, 1, en_US]

Examples:

When protecting feeder or cable systems, unbalanced load protection may serve to identify low magnitude unsymmetrical faults below the pickup values of the directional and non-directional overcurrent elements.

Here, the following must be observed:

$$I_2 = \frac{1}{\sqrt{3}} \cdot I = 0.58 \cdot I$$

[fo_i2-058, 1, en_US]

A phase-to-ground fault with current I corresponds to the following negative sequence current:

$$I_2 = \frac{1}{3} \cdot I = 0.33 \cdot I$$

[fo_i2-033, 1, en_US]

On the other hand, with more than 60% of unbalanced load, a phase-to-phase fault can be assumed. The delay time **46-2 DELAY** must be coordinated with the system grading of phase-to-phase faults.

For a power transformer, unbalanced load protection may be used as sensitive protection for low magnitude phase-to-ground and phase-to-phase faults. In particular, this application is well suited for delta-wye transformers where low side phase-to-ground faults do not generate high side zero sequence currents (e.g. vector group Dy).

Since transformers transform symmetrical currents according to the transformation ratio "CTR", the relationship between negative sequence currents and total fault current for phase-to-phase faults and phase-to-ground faults are valid for the transformer as long as the turns ratio "CTR" is taken into consideration.

Consider a transformer with the following data:

Base Transformer Rating	$S_{\text{NomT}} = 16 \text{ MVA}$	
Primary Nominal Voltage	$V_{\text{Nom}} = 110 \text{ kV}$	
Secondary Nominal Voltage	$V_{\text{Nom}} = 20 \text{ kV}$	$(\text{TR}_V = 110/20)$
Vector Groups	Dy5	
High Side CT	100 A/1 A	$(\text{CT}_I = 100)$

The following fault currents may be detected at the low side:

If **46-1 PICKUP** on the high side of the devices is set to $= 0.1$, then a fault current of $I = 3 \cdot \text{TR}_V \cdot \text{TR}_I \cdot \mathbf{46-1 \text{ PICKUP}} = 3 \cdot 110/20 \cdot 100 \cdot 0.1 \text{ A} = 165 \text{ A}$ for single-phase faults and $\sqrt{3} \cdot \text{TR}_V \cdot \text{TR}_I \cdot \mathbf{46-1 \text{ PICKUP}} = 95 \text{ A}$ can be detected for two-phase faults at the low side. This corresponds to 36% and 20% of the transformer nominal current respectively. It is important to note that load current is not taken into account in this simplified example.

As it cannot be recognized reliably on which side the thus detected fault is located, the delay time **46-1 DELAY** must be coordinated with other downstream relays in the system.

Pickup Stabilization (definite-time overcurrent protection)

Pickup of the definite time elements can be stabilized by means of a configurable dropout time. This dropout time is set in 4012 **46 T DROP-OUT**.

Inverse Time Tripping Curve

Several IEC and ANSI curves are available if your operational equipment requires the use of a curve-dependent tripping characteristic. They are selected at address 4006 **46 IEC CURVE** or at address 4007 **46 ANSI CURVE**.

It must be noted that a safety factor of about 1.1 has already been included between the pickup value and the setting value when an inverse time characteristic is selected. This means that a pickup will only occur if an unbalanced load of about 1.1 times the setting value **46-TOC PICKUP** is present (address 4008). Dropout occurs as soon as the value falls below 95 % of the pickup value. When selecting the ANSI curve in address 4011 **46-TOC RESET** the *Disk Emulation*, dropout will be performed according to the dropout curve as explained in the function description.

The associated time multiplier is specified at address 4010, **46-TOC TIMEDIAL** or address 4009 **46-TOC TIMEDIAL**.

The time multiplier can also be set to ∞ . After pickup the element will then not trip. Pickup, however, will be signaled. If the inverse time element is not required at all, address 140 **46** should be set to *Definite Time* during the configuration of protection functions (Section 2.1.1.2 *Setting Notes*).

2.7.4 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
4001	FCT 46		OFF ON	OFF	46 Negative Sequence Protection
4002	46-1 PICKUP	1A	0.05 .. 3.00 A	0.10 A	46-1 Pickup
		5A	0.25 .. 15.00 A	0.50 A	
4003	46-1 DELAY		0.00 .. 60.00 sec; ∞	1.50 sec	46-1 Time Delay
4004	46-2 PICKUP	1A	0.05 .. 3.00 A	0.50 A	46-2 Pickup
		5A	0.25 .. 15.00 A	2.50 A	
4005	46-2 DELAY		0.00 .. 60.00 sec; ∞	1.50 sec	46-2 Time Delay

Addr.	Parameter	C	Setting Options	Default Setting	Comments
4006	46 IEC CURVE		Normal Inverse Very Inverse Extremely Inv.	Extremely Inv.	IEC Curve
4007	46 ANSI CURVE		Extremely Inv. Inverse Moderately Inv. Very Inverse	Extremely Inv.	ANSI Curve
4008	46-TOC PICKUP	1A	0.05 .. 2.00 A	0.90 A	46-TOC Pickup
		5A	0.25 .. 10.00 A	4.50 A	
4009	46-TOC TIMEDIAL		0.50 .. 15.00 ; ∞	5.00	46-TOC Time Dial
4010	46-TOC TIMEDIAL		0.05 .. 3.20 sec; ∞	0.50 sec	46-TOC Time Dial
4011	46-TOC RESET		Instantaneous Disk Emulation	Instantaneous	46-TOC Drop Out
4012A	46 T DROP-OUT		0.00 .. 60.00 sec	0.00 sec	46 Drop-Out Time Delay

2.7.5 Information List

No.	Information	Type of Information	Comments
5143	>BLOCK 46	SP	>BLOCK 46
5151	46 OFF	OUT	46 switched OFF
5152	46 BLOCKED	OUT	46 is BLOCKED
5153	46 ACTIVE	OUT	46 is ACTIVE
5159	46-2 picked up	OUT	46-2 picked up
5165	46-1 picked up	OUT	46-1 picked up
5166	46-TOC picked up	OUT	46-TOC picked up
5170	46 TRIP	OUT	46 TRIP
5171	46 Dsk picked up	OUT	46 Disk emulation picked up

2.8 Frequency Protection 81 O/U

The frequency protection function detects abnormally high and low frequencies in the system or in electrical machines. If the frequency lies outside the allowable range, appropriate actions are initiated, such as load shedding or separating a generator from the system.

Applications

- Decrease in system frequency occurs when the system experiences an increase in the real power demand, or when a malfunction occurs with a generator governor or automatic generation control (AGC) system. The frequency protection function is also used for generators which (for a certain time) operate to an island network. This is due to the fact that the reverse power protection cannot operate in case of a drive power failure. The generator can be disconnected from the power system by means of the frequency decrease protection.
- Increase in system frequency occurs e.g. when large blocks of load (island network) are removed from the system, or again when a malfunction occurs with a generator governor. This entails risk of self-excitation for generators feeding long lines under no-load conditions.

2.8.1 Functional Description

Detection of Frequency

The frequency is detected preferably from the positive sequence voltage. If this voltage is too low, the phase-to-phase voltage V_{A-B} at the device is used. If the amplitude of this voltage is too small, one of the other phase-to-phase voltages is used instead.

Through the use of filters and repeated measurements, the frequency evaluation is free from harmonic influences and very accurate.

Overfrequency/Underfrequency

Frequency protection consists of four frequency elements. To make protection flexible for different power system conditions, these elements can be used alternatively for frequency decrease or increase separately, and can be independently set to perform different control functions.

Operating Range


The frequency can be determined as long as in a three-phase voltage transformer connection the positive-sequence system of the voltages, or alternatively, in a single-phase voltage transformer connection, the respective voltage is present and of sufficient magnitude. If the measured voltage drops below a settable value V_{min} , the frequency protection is blocked because no precise frequency values can be calculated from the signal.

Time Delays / Logic

Each frequency element has an associated settable time delay. When the time delay elapses, a trip signal is generated. When a frequency element drops out, the tripping command is immediately terminated, but not before the minimum command duration has elapsed.

Each of the four frequency elements can be blocked individually via binary inputs.

The following figure shows the logic diagram for the frequency protection function.

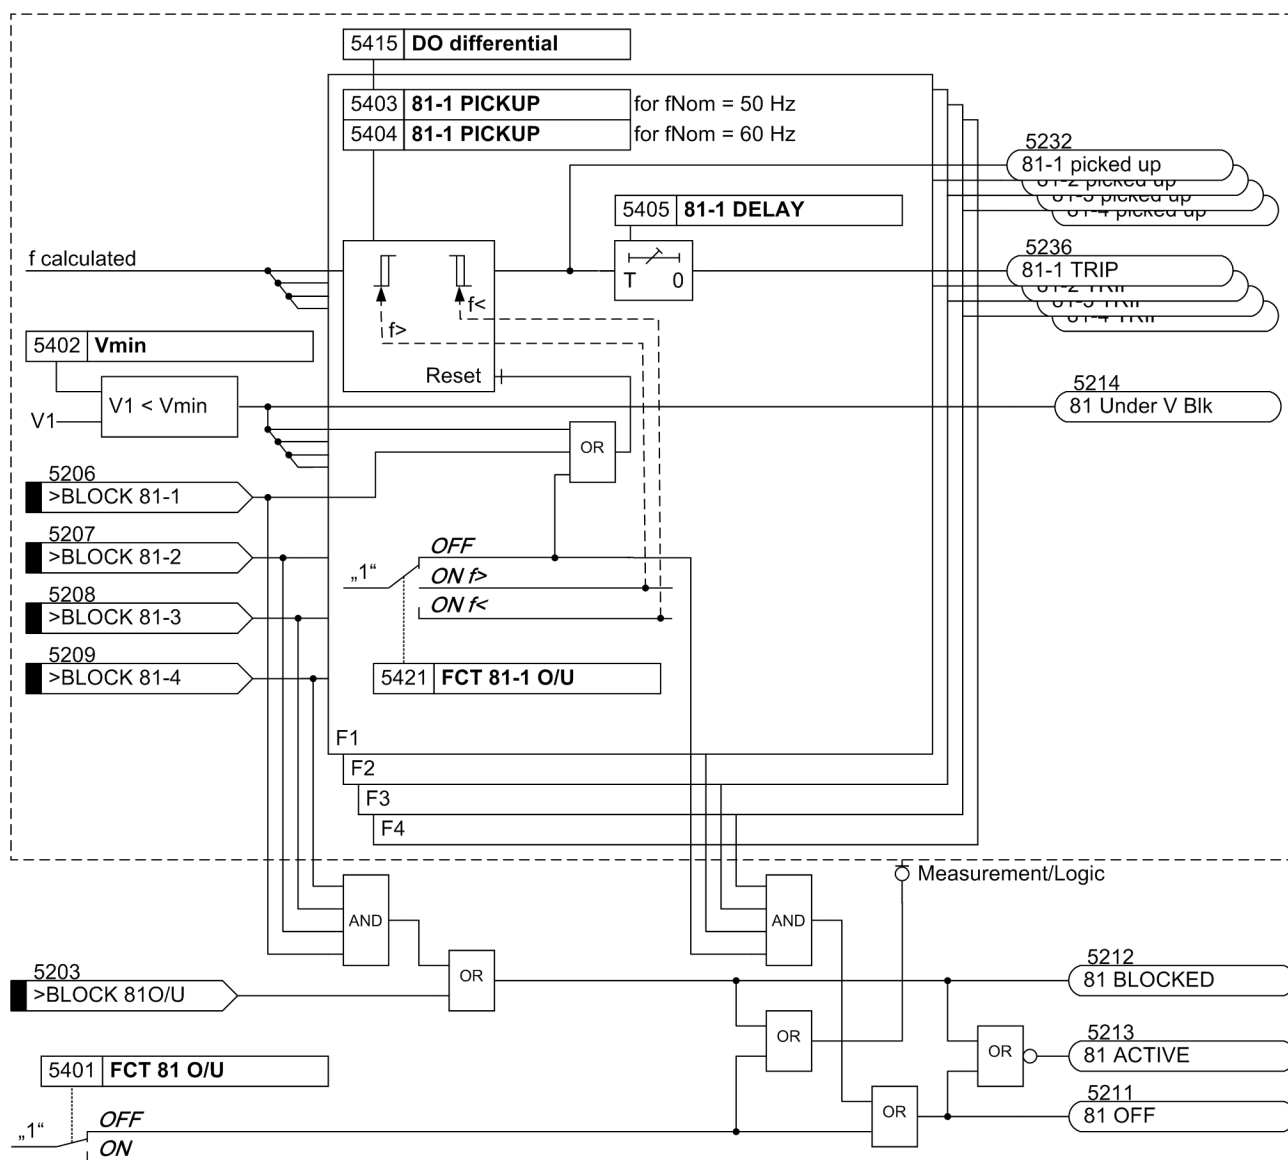

[7sj6x_frequenzschutz-070906-he, 1, en_US]

Figure 2-51 Logic diagram of the frequency protection

2.8.2 Setting Notes

General

Frequency protection is only in effect and accessible if address 154 **81 O/U** is set to **Enabled** during configuration of protective functions. If the function is not required **Disabled** is set. The function can be turned **ON** or **OFF** under address 5401 **FCT 81 O/U**.

By setting the parameters 5421 to 5424, the function of each of the elements **81-1 PICKUP** to **81-4 PICKUP** is set individually as overfrequency or underfrequency protection or set to **OFF**, if the element is not required.

Minimum Voltage

Address 5402 **Vmin** is used to set the minimum voltage. Frequency protection is blocked as soon as the minimum voltage is undershot.

The threshold value has to be set as phase-to-phase quantity if the connection is three-phase. With a single-phase phase-to-ground connection the threshold is set as phase voltage.

Pickup Values

The setting as overfrequency or underfrequency element does not depend on the parameter threshold values of the respective element. An element can also function, for example, as an overfrequency element if its threshold value is set below the nominal frequency and vice versa.

If frequency protection is used for load shedding purposes, the setting values depend on the actual power system conditions. Normally, a time coordinated load shedding is required that takes into account the importance of the consumers or consumer groups.

Further application examples exist in the field of power stations. Here too, the frequency values to be set mainly depend on the specifications of the power system / power station operator. The underfrequency protection safeguards the power station's own demand by disconnecting it from the power system on time. The turbo governor regulates the machine set to the nominal speed. Consequently, the station's own demands can be continuously supplied at nominal frequency.

Under the assumption that the apparent power is reduced by the same degree, turbine-driven generators can, as a rule, be continuously operated down to 95% of the nominal frequency. However, for inductive consumers, the frequency reduction not only means an increased current input, but also endangers stable operation. For this reason, only a short-term frequency reduction down to about 48 Hz (for $f_N = 50$ Hz) or 58 Hz (for $f_N = 60$ Hz) is permissible.

A frequency increase can, for example, occur due to a load shedding or malfunction of the speed regulation (e.g. in an island network). In this way, the frequency increase protection can, for example, be used as over-speed protection.

Dropout Thresholds

The dropout threshold is defined via the adjustable dropout-difference address 5415 **DO differential**. It can thus be adjusted to the network conditions. The dropout difference is the absolute-value difference between pickup threshold and dropout threshold. The default value of 0.02 Hz can usually remain. Should, however, frequent minor frequency fluctuations be expected, this value should be increased.

Time Delays

The delay times **81-1 DELAY** to **81-4 DELAY** (addresses 5405, 5408, 5411 and 5414) allow the frequency elements to be time coordinated, e.g. for load shedding equipment. The set times are additional delay times not including the operating times (measuring time, dropout time) of the protection function.

2.8.3 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

Addr.	Parameter	Setting Options	Default Setting	Comments
5401	FCT 81 O/U	OFF ON	OFF	81 Over/Under Frequency Protection
5402	Vmin	10 .. 150 V	65 V	Minimum required voltage for operation
5402	Vmin	20 .. 150 V	35 V	Minimum required voltage for operation
5403	81-1 PICKUP	40.00 .. 60.00 Hz	49.50 Hz	81-1 Pickup
5404	81-1 PICKUP	50.00 .. 70.00 Hz	59.50 Hz	81-1 Pickup
5405	81-1 DELAY	0.00 .. 100.00 sec; ∞	60.00 sec	81-1 Time Delay
5406	81-2 PICKUP	40.00 .. 60.00 Hz	49.00 Hz	81-2 Pickup
5407	81-2 PICKUP	50.00 .. 70.00 Hz	59.00 Hz	81-2 Pickup
5408	81-2 DELAY	0.00 .. 100.00 sec; ∞	30.00 sec	81-2 Time Delay
5409	81-3 PICKUP	40.00 .. 60.00 Hz	47.50 Hz	81-3 Pickup

Addr.	Parameter	Setting Options	Default Setting	Comments
5410	81-3 PICKUP	50.00 .. 70.00 Hz	57.50 Hz	81-3 Pickup
5411	81-3 DELAY	0.00 .. 100.00 sec; ∞	3.00 sec	81-3 Time delay
5412	81-4 PICKUP	40.00 .. 60.00 Hz	51.00 Hz	81-4 Pickup
5413	81-4 PICKUP	50.00 .. 70.00 Hz	61.00 Hz	81-4 Pickup
5414	81-4 DELAY	0.00 .. 100.00 sec; ∞	30.00 sec	81-4 Time delay
5415A	DO differential	0.02 .. 1.00 Hz	0.02 Hz	Dropout differential
5421	FCT 81-1 O/U	OFF ON f> ON f<	OFF	81-1 Over/Under Frequency Protection
5422	FCT 81-2 O/U	OFF ON f> ON f<	OFF	81-2 Over/Under Frequency Protection
5423	FCT 81-3 O/U	OFF ON f> ON f<	OFF	81-3 Over/Under Frequency Protection
5424	FCT 81-4 O/U	OFF ON f> ON f<	OFF	81-4 Over/Under Frequency Protection

2.8.4 Information List

No.	Information	Type of Information	Comments
5203	>BLOCK 81O/U	SP	>BLOCK 81O/U
5206	>BLOCK 81-1	SP	>BLOCK 81-1
5207	>BLOCK 81-2	SP	>BLOCK 81-2
5208	>BLOCK 81-3	SP	>BLOCK 81-3
5209	>BLOCK 81-4	SP	>BLOCK 81-4
5211	81 OFF	OUT	81 OFF
5212	81 BLOCKED	OUT	81 BLOCKED
5213	81 ACTIVE	OUT	81 ACTIVE
5214	81 Under V Blk	OUT	81 Under Voltage Block
5232	81-1 picked up	OUT	81-1 picked up
5233	81-2 picked up	OUT	81-2 picked up
5234	81-3 picked up	OUT	81-3 picked up
5235	81-4 picked up	OUT	81-4 picked up
5236	81-1 TRIP	OUT	81-1 TRIP
5237	81-2 TRIP	OUT	81-2 TRIP
5238	81-3 TRIP	OUT	81-3 TRIP
5239	81-4 TRIP	OUT	81-4 TRIP

2.9 Undervoltage-controlled reactive power protection (27/Q)

The undervoltage-controlled reactive power protection protects the system for mains decoupling purposes. To prevent a voltage collapse in energy systems, the generating side, e.g. a generator, must be equipped with voltage and frequency protection devices. An undervoltage-controlled reactive power protection is required at the supply system connection point. It detects critical power system situations and ensures that the power generation facility is disconnected from the mains. Furthermore, it ensures that reconnection only takes place under stable power system conditions. The associated criteria can be parameterized.

Applications

- High-voltage and extra-high voltage power systems
- Medium-voltage power systems
- Regenerative infeed types such as wind power stations, photovoltaics, cogeneration plants or hydro-power

2.9.1 Functional Description

General

To detect critical power system situations, the QU protection uses the phase-to-phase voltage, the positive-sequence current and the reactive power.

To release the reconnection, the results of voltage protection and frequency protection are additionally analyzed on the generating side.

If the frequency and voltage values are outside the operating range, the QU protection does not work.

It can also be blocked by the fuse-failure monitor or via a binary input.

Pickup of the QU protection causes the device to pick up. Simultaneously, fault recording is activated. But tripping of the QU protection does **not** cause the device to trip and should be routed to a separate binary output. No other fault record is started.

The QU protection can be used for all voltage connection types that enable detection of the displacement voltage (measured or calculated). The Appendix provides connection examples.

Signal transmission in the high-voltage power system requires the power system connection point and the generating facility to be connected via telecommunication cables (optical fiber or copper cable). Radio links, GPRS or satellite transmission with signal transit times <3 s can alternatively be used in medium-voltage systems.

Protection Function

The QU protection trips under the following conditions:


- All 3 phase-to-phase voltages are below the parameterized threshold value.
- The positive-sequence current I_1 is above the parameterized threshold value.
- The facility requires more than the set reactive power.

The pickup thresholds for undervoltage $U < \text{Pickup}$, the reactive power $Q > \text{Pickup}$ and the release current $I > \text{Release}$ can be set.

After detection of the tripping criteria, time-delayed trip signals are sent to the circuit breaker of the power system connection point and to the circuit breaker of the generating facility. The time delay can be set separately for both circuit breakers. Time-graded tripping is thus possible. The tripping of the circuit breaker at the power system connection point ultimately de-energizes the entire generating facility.

To prevent tripping of the QU protection during starting operations, parameterize and activate the inrush current detection. The inrush blocking of the QU protection can then be activated via parameter **Inrush blk**. The overcurrent protection detects the inrush. The QU protection evaluates the inrush indications of the overcurrent protection (see [Figure 2-15](#)).

The following figure shows the logic diagram of the QU protection.

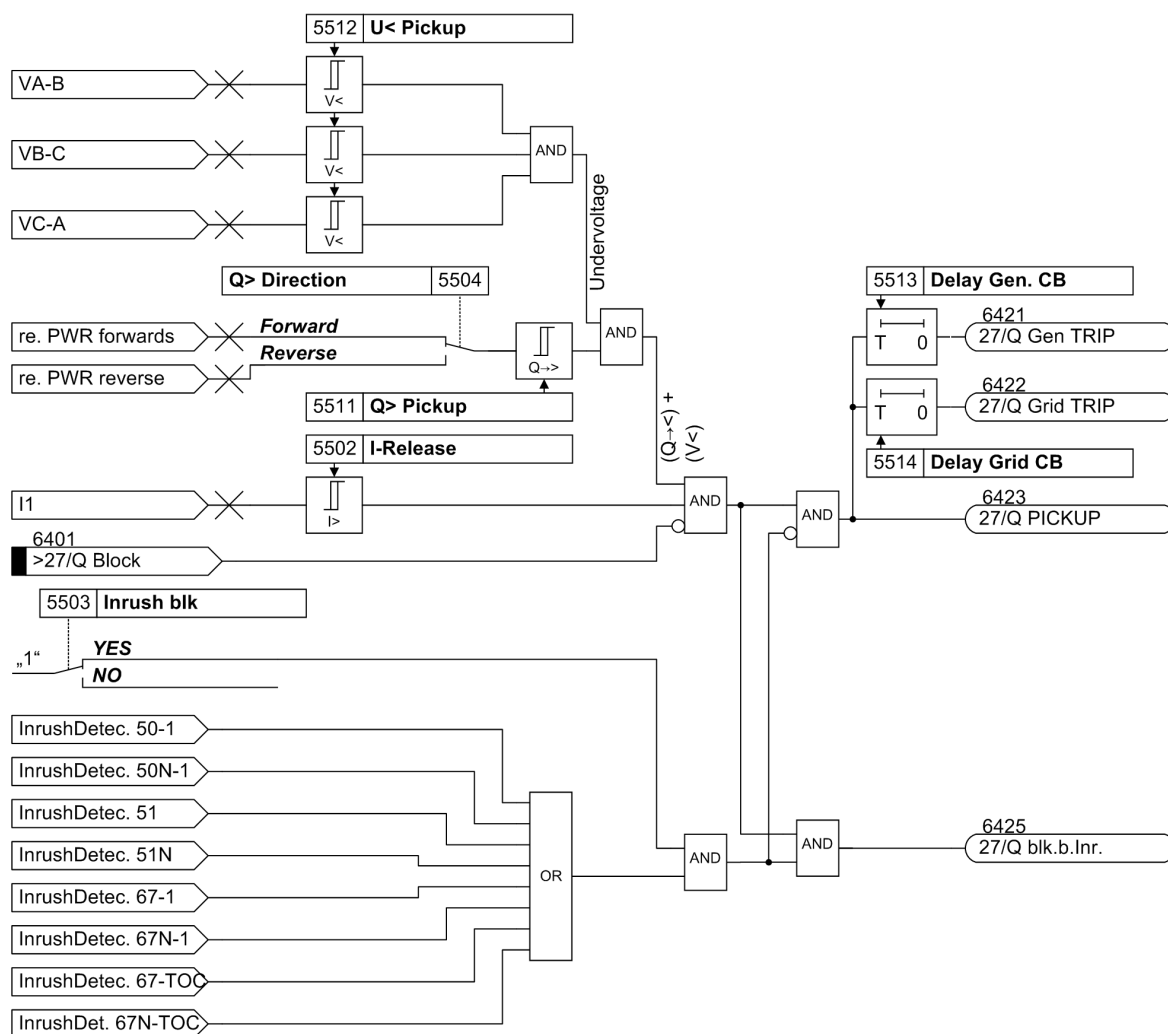

[7sj80_prot-lo-qvp, 1, en_US]

Figure 2-52 Logic diagram of the QU protection

Reconnection

The release for reconnecting the generating facility is given under the following conditions:


- All 3 phase-to-phase voltages are above the parameterized threshold value.
- The power system frequency is within the parameterized range.
- The delay time of the protection function has elapsed. The delay time is started by the first trip signal of any stage of the voltage or frequency protection.

The release criteria for reconnection can be set. The following parameters are used:

- Threshold for the release voltage at the power system connection point
- Frequency deviation in positive and negative direction
- Reconnection release can be delayed by a settable time.

You also define whether the tripping of the circuit breaker at the power system connection point is included in the formation of the release signal. The tripping of the protection stages of voltage and frequency protection is always included.

The following figure shows the logic diagram of the QU protection for reconnection.

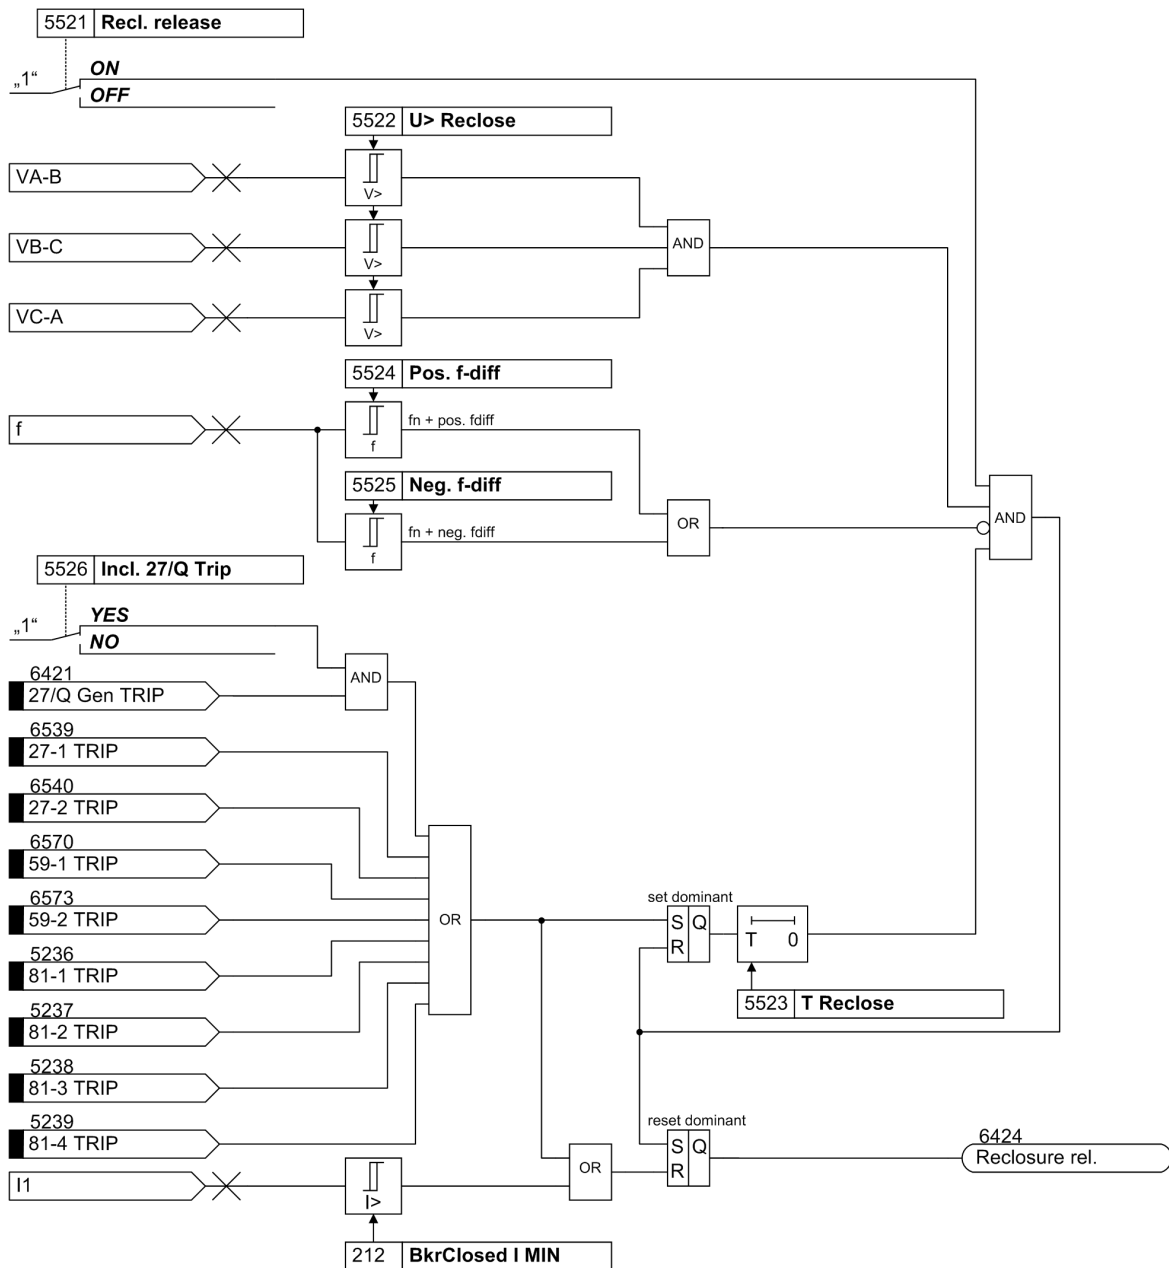

[lo-recl-rel-qvp-20120319, 2, en_US]

Figure 2-53 Logic diagram of QU protection restarting

2.9.2 Setting Notes

General

Configuration of the protection functions at address 155 **27/Q-Protection** defines whether the QU protection is **Enabled** or **Disabled**.

At address 5501 **27/Q-Protection** the QU protection function can be switched **ON** or **OFF**.

The release current is entered at address 5502 **I-Release**. The default setting is at 10 % of the rated current. The threshold is one of the pickup criteria for tripping.

At address 5503 **Inrush blk** you can activate the blocking when inrush has been detected.

Pickup Values

You can set the pickup value for the reactive power stage at address 5511 **Q> Pickup**.

Example:

$Q > 5\%$ of the supply system rating

$V_{\text{Nomsec}} = 100\text{ V}$

$I_{\text{Nomsec}} = 1\text{ A}$

this yields the (default) setting value **Q> Pickup** for **Q> Pickup**

$100\text{ V} \cdot 1\text{ A} \cdot \sqrt{3} \cdot 0.05 = 8.7\text{ VAR}$

At address 5512 **U< Pickup**, you can enter the pickup value for the voltage stage.

Delays

Address 5513 **Delay Gen. CB** is used to set the time delay for tripping the circuit breaker of the generation facility, e.g. at the generator.

Enter the time delay for tripping the circuit breaker at the supply system connection point at address 5514 **Delay Grid CB**. Always set the delay time longer than delay time Delay Gen. CB.

Close Release

At address 5521 **Rec1. release** the close release is switched **ON** or **OFF**.

At address 5522 **U> Reclose** you can specify the release voltage. Set the value to approx. 95 % of the rated voltage value (default).

Specify the delay time for releasing the generator reconnection at address 5523 **T Reclose**.

Furthermore, enter the admitted deviation from the rated frequency. At address 5524 **Pos. f-diff** enter the frequency deviation in positive direction and at address 5525 **Neg. f-diff** in negative direction. If the measured frequency is within this range, this reconnection condition is satisfied.

Address 5526 **Incl. 27/Q Trip** determines whether the tripping indication of the QU protection is taken into account for the reconnection release.

2.9.3 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
5501	27/Q-Protection		OFF ON	OFF	27 / Q dir. con. Protection
5502	I-Release	1A	0.02 .. 0.20 A; 0	0.10 A	Current-Rel. for Trip and Reclose
		5A	0.10 .. 1.00 A; 0	0.50 A	
5503	Inrush blk		NO YES	NO	blocking with inrush
5504	Q> Direction		Forward Reverse	Forward	Reactive power direction
5511	Q> Pickup	1A	1.70 .. 10000.00 VAR	8.70 VAR	Reactive power threshold for pickup
		5A	8.50 .. 50000.00 VAR	43.50 VAR	
5512	U< Pickup		10.00 .. 210.00 V	85.00 V	Undervoltage threshold for pickup
5513	Delay Gen. CB		0.00 .. 60.00 sec	0.50 sec	Trip time delay generator CB
5514	Delay Grid CB		0.00 .. 60.00 sec	1.50 sec	Trip time delay grid CB

Addr.	Parameter	C	Setting Options	Default Setting	Comments
5521	Recl. release		OFF ON	OFF	Reclosure release
5522	U> Reclose		10.00 .. 210.00 V	95.00 V	Voltage threshold for reclosure rel.
5523	T Reclose		0.00 .. 3600.00 sec	0.00 sec	Reclosure Delay Time
5524	Pos. f-diff		0.01 .. 5.00 Hz	0.05 Hz	Pos. f-diff threshold for reclosure rel.
5525	Neg. f-diff		-5.00 .. -0.01 Hz	-2.50 Hz	Neg. f-diff threshold for reclosure rel.
5526A	Incl. 27/Q Trip		NO YES	NO	Include 27/Q Trip for reclosure rel.

2.9.4 Information List

No.	Information	Type of Information	Comments
6401	>27/Q Block	SP	>QV-Protection Blocked
6411	27/Q OFF	OUT	27/Q -Protection off
6412	27/Q block	OUT	27/Q -Protection blocked
6413	27/Q ACT	OUT	27/Q -Protection active
6421	27/Q Gen TRIP	OUT	27/Q -Protection Gen TRIP
6422	27/Q Grid TRIP	OUT	27/Q -Protection Grid TRIP
6423	27/Q PICKUP	OUT	27/Q-Protection PICKUP
6424	Reclosure rel.	OUT	Reclosure release
6425	27/Q blk.b.Inr.	OUT	27/Q pickup blocked by Inrush

2.10 Thermal Overload Protection 49

The thermal overload protection is designed to prevent thermal overloads from damaging the protected equipment. The protection function represents a thermal replica of the equipment to be protected (overload protection with memory capability). Both the previous history of an overload and the heat loss to the environment are taken into account.

Applications

- The thermal condition particularly of generators and transformers can be monitored in this way.

2.10.1 Functional Description

Thermal Replica

The device calculates the overtemperature in accordance with a single-body thermal replica, based on the following differential equation:

$$\frac{d\Theta}{dt} + \frac{1}{\tau_{th}} \cdot \Theta = \frac{1}{\tau_{th}} \cdot \left(\left(\frac{I}{k \cdot I_{Nom\ Obj.}} \right)^2 + \Theta_v' \right)$$

[fo_thermdifferentialgleichung, 1, en_US]

with

Θ	Present overtemperature related to the final overtemperature at maximum allowed phase current $k \cdot I_{Nom\ Obj.}$
τ_{th}	Thermal time constant of the protected object's heating
I	Present true r.m.s value of phase current
k	k-factor indicating the maximum permissible constant phase current referred to the nominal current of the protected object
$I_{Nom\ Obj.}$	Nominal current of protected object

The protection function provides a thermal replica of the protected object (overload protection with memory capability). The history of an overload is taken into consideration.

When the calculated overtemperature reaches the first settable threshold **49** $\odot$ **ALARM**, an alarm annunciation is issued, e.g. to allow time for the load reduction measures to take place. When the calculated overtemperature reaches the second threshold, the protected equipment may be disconnected from the system. The highest overtemperature calculated from the three phase currents is used as the criterion.

The maximum thermally permissible continuous current I_{max} is described as a multiple of the object nominal current $I_{Nom\ Obj.}$:

$$I_{max} = k \cdot I_{Nom\ Obj.}$$

In addition to the k factor (parameter **49 K-FACTOR**) the **TIME CONSTANT** τ_{th} and the alarm temperature **49** $\odot$ **ALARM** (in percent of the trip temperature Θ_{TRIP}) must be specified.

Since the 7SJ80 does not offer a connection option for an RTD box, the current temperature Θ is always equal to zero.

Overload protection also features a current warning element (**I ALARM**) in addition to the temperature warning element. The current warning element may report an overload current prematurely, even if the calculated operating temperature has not yet attained the warning or tripping levels.

Extension of Time Constants

When using the device to protect motors, the varying thermal response at standstill or during rotation may be correctly evaluated. When running down or at standstill, a motor without external cooling loses heat more slowly, and a longer thermal time constant must be used for calculation. For a motor that is switched off, the

7SJ80 increases the time constant τ_{th} by a programmable factor (k_t factor). The motor is considered to be off when the motor currents drop below a programmable minimum current setting **BkrClosed I MIN** (refer to "Current Flow Monitoring" in Section [2.1.3 Power System Data 1](#)). For externally-cooled motors, cables and transformers, the **K_t-FACTOR** = 1.

Blocking

The thermal memory may be reset via a binary input (**>RES 49 Image**) and the current-related overtemperature value is thus reset to zero. The same is accomplished via the binary input (**>BLOCK 49 O/L**); in this case, the entire overload protection is blocked completely, including the current warning element.

When motors must be started for emergency reasons, temperatures above the maximum permissible overtemperatures can be allowed by blocking the trip signal via a binary input (**>EmergencyStart**). Since the thermal replica may have exceeded the tripping temperature after initiation and dropout of the binary input, the protection function features a programmable run-on time interval (**T EMERGENCY**) which is started when the binary input drops out and continues suppressing a trip signal. Tripping via the overload protection is suppressed until this time interval has elapsed. The binary input affects only the trip command. There is no effect on the trip log nor does the thermal replica reset.

Behavior in Case of Power Supply Failure

Depending on the setting in address 235 **ATEX100** of Power System Data 1 (see Section [2.1.3 Power System Data 1](#)) the value of the thermal replica is either reset to zero (**ATEX100 = NO**) if the power supply voltage fails, or cyclically buffered in a non-volatile memory (**ATEX100 = YES**) so that it is maintained in the event of auxiliary supply voltage failure. In the latter case, the thermal replica uses the stored value for calculation and matches it to the operating conditions. The first option is the default setting (see [/5/ Additional description for the protection of explosion-protected motors of protection type increased safety "e"](#)).

The following figure shows the logic diagram for the overload protection function.

2.10.2 Setting Notes

General

Overload protection is only in effect if address 142 **49** is set to **No ambient temp** during configuration. If this function is not required, select **Disabled**.

Transformers and cable are prone to damage by overloads that last for an extended period of time. Overloads cannot and should not be detected by fault protection. Time overcurrent protection should be set high enough to only detect faults since these must be cleared in a short time. Short time delays, however, do neither allow measures to discharge overloaded equipment nor do they permit to take advantage of its (limited) overload capacity.

The 7SJ80 devices feature an overload protection function with thermal tripping characteristic adaptable to the overload capability of the equipment being protected (overload protection with memory function).

Overload protection can be switched **ON** or **OFF** or set to **Alarm Only** at address 4201 **FCT 49**. If overload protection is **ON**, tripping, trip log and fault recording is possible.

When setting **Alarm Only** no trip command is given, no trip log is initiated and no spontaneous fault annunciation is shown on the display.

Since the 7SJ80 does not offer a connection option for an RTD box, the current temperature Θ is always equal to zero.

The overload protection is intended to protect lines and cables against thermal overload.



NOTE

Changing the function parameters resets the thermal replica. The thermal model is frozen (kept constant), as soon as the current exceeds the setting value 1107 **I MOTOR START**.

Overload Parameter k-factor

The overload protection is set in reference values. The nominal current $I_{\text{Nom Obj.}}$ of the protected object (motor, transformer, cable) is used as the basic current for overload protection. By means of the thermal consistently permissible current I_{max} , a factor k_{prim} can be calculated:

$$k_{\text{prim}} = \frac{I_{\text{max prim}}}{I_{\text{Nom Obj.}}}$$

[fo_kfaktor, 1, en_US]

The thermally admissible continuous current for the equipment being protected is generally obtainable from manufacturers specifications. For cables, the permissible continuous current is dependent on the cross-section, insulating material, design, and the cable routing, among other things. It can be taken from pertinent tables, or is specified by the cable manufacturer. If no specifications are available, select 1.1 times the nominal current. There are usually no specifications for overhead lines but we can also assume an admissible overload of 10% here.

For the **49 K-FACTOR** to be set in the device the following applies (address 4202)

$$k_{\text{sec}} = \frac{I_{\text{max prim}}}{I_{\text{nom obj.}}} \cdot \frac{I_{\text{nom obj.}}}{I_{\text{nom CT prim}}}$$

[fo_einstellwert-kfaktor-allg, 2, en_US]

with

$I_{\text{max prim}}$	Permissible thermal primary current of the motor
$I_{\text{Nom Obj.}}$	Nominal current of the protected object
$I_{\text{NomCT prim}}$	Nominal primary CT current



NOTE

The setting for **49 K-FACTOR** (address 4202) has always to be made as a secondary value.

Example: Belted cable 10 kV, 150 mm²:

Permissible continuous current	$I_{\text{max}} = 322 \text{ A}$
Nominal current with k-factor 1.1	$I_{\text{Nom Obj.}} = 293 \text{ A}$
Current Transformer	600 A/1 A

Setting value FACTOR K:

$$1.1 \cdot \frac{293 \text{ A}}{600 \text{ A}} = 0.54$$

[fo_einstellwert-k-faktor_02, 1, en_US]

Time Constant τ

In lines and cables it is only the thermal time constant that is decisive for reaching the temperature rise limit. For cable protection, the heat-gain time constant τ is determined by cable specifications and by the cable environment. If no time-constant specification is available, it may be determined from the short-term load capability of the cable. The 1-sec current, i.e. the maximum current permissible for a one-second period of time, is often known or available from tables. Then, the time constant may be calculated with the formula:

$$\text{Set Value } \tau_{\text{th}} [\text{min}] = \frac{1}{60} \cdot \left(\frac{\text{perm. 1-s-current}}{\text{perm. continuous current}} \right)^2$$

[fo_einstellwert-tau, 1, en_US]

If the short-term load capability is given for an interval other than one second, the corresponding short-term current is used in the above formula instead of the 1-second current, and the result is multiplied by the given duration. For example, if the 0.5-second current rating is known:

$$\text{Set Value } \tau_{th} [\text{min}] = \frac{0.5}{60} \cdot \left(\frac{\text{perm. 0.5-s-current}}{\text{perm. continuous current}} \right)^2$$

[fo_einstellwert-tau-05s, 1, en_US]

It is important to note, however, that the longer the effective duration, the less accurate the result.

Example: Cable and current transformer with the following data:

Permissible continuous current	$I_{max} = 500 \text{ A at } \Theta_u = 40 \text{ °C}$
Maximum current for 1 s	$I_{1s} = 45 \cdot I_{max} = 22.5 \text{ kA}$
Current transformer	600 A/1 A

Thus results:

$$k = \frac{I_{max}}{I_{Nom \text{ CT prim}}} = \frac{322 \text{ A}}{600 \text{ A}} = 0.54$$

[fo_faktor-k, 1, en_US]

$$\tau_{th} = \frac{1}{60} \cdot \left(\frac{I_{1s}}{I_{max}} \right)^2 = \frac{1}{60} \cdot 45^2 = 33.75 \text{ min}$$

[fo_tau-3375, 1, en_US]

The settings are: **49 K-FACTOR = 0.54; TIME CONSTANT = 33.75 min**

Current Limitation

To ensure that the overload protection, on occurrence of high fault currents (and with small time constants), does not result in extremely short trip times thereby perhaps affecting time grading of the fault protection, the thermal model is frozen (kept constant) as soon as the current exceeds the threshold value 1107 **I MOTOR START**.

Warning Elements

By setting the thermal warning element **49** **ALARM** (address 4204), a warning message can be issued before reaching the tripping temperature. Tripping can thus be avoided by initiating early load reduction measures. This warning element simultaneously represents the dropout level for the trip signal. Only when this threshold is undershot, the tripping command will be reset and the protected equipment can be switched on again.

The thermal element level is given in % of the tripping overtemperature.

A current warning level is also available (parameter 4205 **I ALARM**). The setting is set as the secondary current in A (mperes) and should be equal to or slightly less than the permissible current $k \cdot I_{Nom \text{ sec}}$. It can be used instead of the thermal warning element by setting the thermal warning element to **100 %** thus virtually disabling it.

Dropout Time after Emergency Starting

This function is not required for protection of lines and cables. Since it is activated by a binary input message, parameter **T EMERGENCY** (address 4208) is not in effect. The factory setting can be retained.

2.10.3 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
4201	FCT 49		OFF ON Alarm Only	OFF	49 Thermal overload protection
4202	49 K-FACTOR		0.10 .. 4.00	1.10	49 K-Factor
4203	TIME CONSTANT		1.0 .. 999.9 min	100.0 min	Time Constant
4204	49 Ø ALARM		50 .. 100 %	90 %	49 Thermal Alarm Stage
4205	I ALARM	1A	0.10 .. 4.00 A	1.00 A	Current Overload Alarm Setpoint
		5A	0.50 .. 20.00 A	5.00 A	
4207A	K _t -FACTOR		1.0 .. 10.0	1.0	K _t -FACTOR when motor stops
4208A	T EMERGENCY		10 .. 15000 sec	100 sec	Emergency time

2.10.4 Information List

No.	Information	Type of Information	Comments
1503	>BLOCK 49 O/L	SP	>BLOCK 49 Overload Protection
1507	>EmergencyStart	SP	>Emergency start of motors
1511	49 O / L OFF	OUT	49 Overload Protection is OFF
1512	49 O/L BLOCK	OUT	49 Overload Protection is BLOCKED
1513	49 O/L ACTIVE	OUT	49 Overload Protection is ACTIVE
1515	49 O/L I Alarm	OUT	49 Overload Current Alarm (I alarm)
1516	49 O/L Ø Alarm	OUT	49 Overload Alarm! Near Thermal Trip
1517	49 Winding O/L	OUT	49 Winding Overload
1521	49 Th O/L TRIP	OUT	49 Thermal Overload TRIP
1580	>RES 49 Image	SP	>49 Reset of Thermal Overload Image
1581	49 Image res.	OUT	49 Thermal Overload Image reset

2.11 Supervision Functions

The device is equipped with extensive monitoring capabilities - both for hardware and software. In addition, the measured values are also constantly monitored for plausibility, therefore, the current transformer and voltage transformer circuits are largely integrated into the monitoring.

2.11.1 Measurement Supervision

2.11.1.1 General

The device monitoring extends from the measuring inputs to the binary outputs. Monitoring checks the hardware for malfunctions and abnormal conditions.

Hardware and software monitoring described in the following are enabled continuously. Settings (including the possibility to activate and deactivate the monitoring function) refer to the monitoring of external transformer circuits or the measurement voltage failure detection.

2.11.1.2 Hardware Monitoring

Auxiliary and Reference Voltages

Failure of or switching off the supply voltage removes the device from operation and a message is immediately generated by a normally closed contact. Brief auxiliary voltage interruptions of less than 50 ms do not disturb the readiness of the device (for nominal auxiliary voltage > 110 VDC).

Buffer Battery

The buffer battery, which ensures operation of the internal clock and storage of counters and messages if the auxiliary voltage fails, is periodically checked for charge status. If it is less than an allowed minimum voltage, then the *Fail Battery* message is issued.

Memory Components

All working memories (RAMs) are checked during startup. If a malfunction occurs then, the starting sequence is interrupted and an LED blinks. During operation the memories are checked with the help of their checksum. For the program memory, the cross sum is formed cyclically and compared to the stored program cross sum.

For the settings memory, the cross sum is formed cyclically and compared to the cross sum that is freshly generated each time a setting process takes place.

If a fault occurs the processor system is restarted.

Scanning

Scanning and the synchronization between the internal buffer components are constantly monitored. If any deviations cannot be removed by renewed synchronization, then the processor system is restarted.

Measurement Value Acquisition – Currents


The monitoring of the device-internal measured-value acquisition of the currents can be effected via the current sum monitoring.

Up to four input currents are measured by the device. If the three phase currents and the ground current from the current transformer neutral point are connected with the device, the sum of the four digitized currents must be zero. This also applies in the event of a possible transformer saturation. For that reason – in order to eliminate pickup upon transformer saturation – this function is only available in a Holmgreen-connection (see also Section 2.1.3.2). Faults in the current circuits are recognized if

$$I_F = | \dot{I}_A + \dot{I}_B + \dot{I}_C + \dot{I}_E | > \Sigma I \text{ THRESHOLD} + \Sigma I \text{ FACTOR} \cdot \Sigma | I |$$

$\Sigma I \text{ THRESHOLD}$ (address 8106) and $\Sigma I \text{ FACTOR}$ (address 8107) are setting parameters. The component $\Sigma I \text{ FACTOR} \cdot \Sigma | I |$ takes into account the permissible current proportional ratio errors of the input transducers

which are particularly prevalent during large short-circuit currents (Figure 2-54). The dropout ratio is about 97 %.

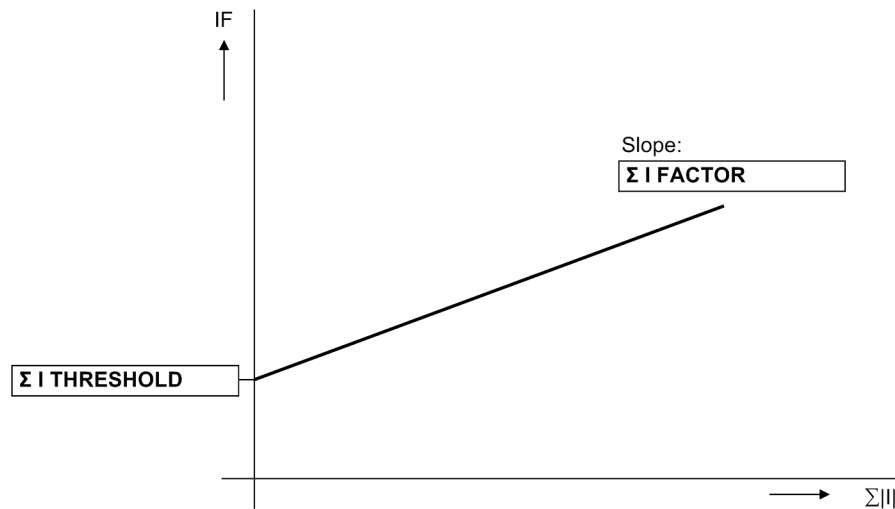

[stromsummenueberwachung-020313-kn, 1, en_US]

Figure 2-54 Current sum monitoring


An error in the current sum results in the message *Failure Σ I* (No. 162) and blocking of the protection function. Furthermore, a fault log is initiated for a period of 100 ms.

The monitoring can be switched off.

The monitoring is available subject to the following conditions:

- The three phase currents are connected to the device (address 251 **A**, **B**, **C**, (**Gnd**))
- The ground current of the current transformer neutral point is connected to the fourth current input (I_4) (Holmgreen-connection). This is communicated to the device in the Power System Data 1 via address 280 **YES**.
- The fourth current input is normally designed for a I_4 -transformer. In case of a sensitive transformer type, this monitoring is not available.
- The settings **CT PRIMARY** (address 204) and **Ignd-CT PRIM** (address 217) must be the same.
- The settings **CT SECONDARY** (address 205) and **Ignd-CT SEC** (address 218) must be the same.

The following logic diagram illustrates the operational mode of the current sum monitoring.

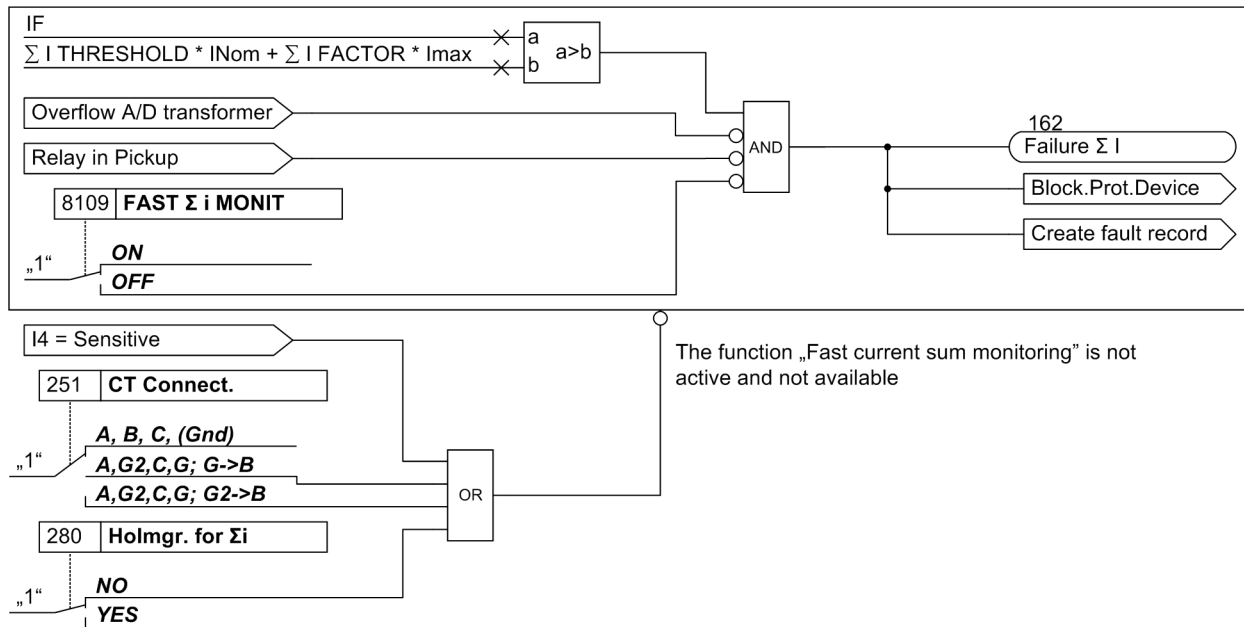

[7s]6x-stromsummenueberw-20070315, 1, en_US]

Figure 2-55 Logic Diagram of the fast current sum monitoring

**NOTE**

If the current input IN is configured as a sensitive transformer or if the connection mode **A, G2, C, G; G->B** or **A, G2, C, G; G2->B** was set for the current transformers at parameter 251 **CT Connect.**, current sum monitoring is not possible.

AD Transformer Monitoring

The digitized sampled values are being monitored in respect of their plausibility. If the result is not plausible, message 181 *Error A/D-conv.* is issued. The protection is blocked, thus preventing unwanted operation. Furthermore, a fault record is generated for recording of the internal fault.

2.11.1.3 Software Monitoring**Watchdog**

For continuous monitoring of the program sequences, a time monitor is provided in the hardware (hardware watchdog) that expires upon failure of the processor or an internal program, and causes a complete restart of the processor system.

An additional software watchdog ensures that malfunctions during the processing of programs are discovered. This also initiates a restart of the processor system.

If such a malfunction is not cleared by the restart, an additional restart attempt is begun. After three unsuccessful restarts within a 30 second window of time, the device automatically removes itself from service and the red "Error" LED lights up. The readiness relay drops out and indicates „device malfunction" with its normally closed contact.

Offset Monitoring

This monitoring function checks all ring buffer data channels for corrupt offset replication of the analog/digital transformers and the analog input paths using offset filters. Possible offset errors are detected using DC filters, and the associated sampled values are corrected up to a specific limit. If this limit is exceeded, an indication is generated (191 *Error Offset*) and integrated into the warning group indication (160). As increased offset values impair the measurements, we recommend sending the device to the OEM plant for corrective action should this indication persist.

2.11.1.4 Monitoring of the Transformer Circuits


Open circuits or short circuits in the secondary circuits of the current and voltage transformers, as well as faults in the connections (important during commissioning!), are detected and reported by the device. The measured quantities are periodically checked in the background for this purpose, as long as no system fault is present.

Current Symmetry

During normal system operation, symmetry among the input currents is expected. The monitoring of the measured values in the device checks this balance. The smallest phase current is compared to the largest phase current. Asymmetry is detected if $|I_{\min}| / |I_{\max}| < \text{BAL. FACTOR I}$ as long as $I_{\max} > \text{BALANCE I LIMIT}$ is valid.

Thereby $I_{\max}$ is the largest of the three phase currents and $I_{\min}$ the smallest. The symmetry factor **BAL. FACTOR I** (address 8105) represents the allowable asymmetry of the phase currents while the limit value **BALANCE I LIMIT** (address 8104) is the lower limit of the operating range of this monitoring (see [Figure 2-56](#)). Both parameters can be set. The dropout ratio is about 97 %.

This fault is signalled after settable delay time with *Fail I balance*.

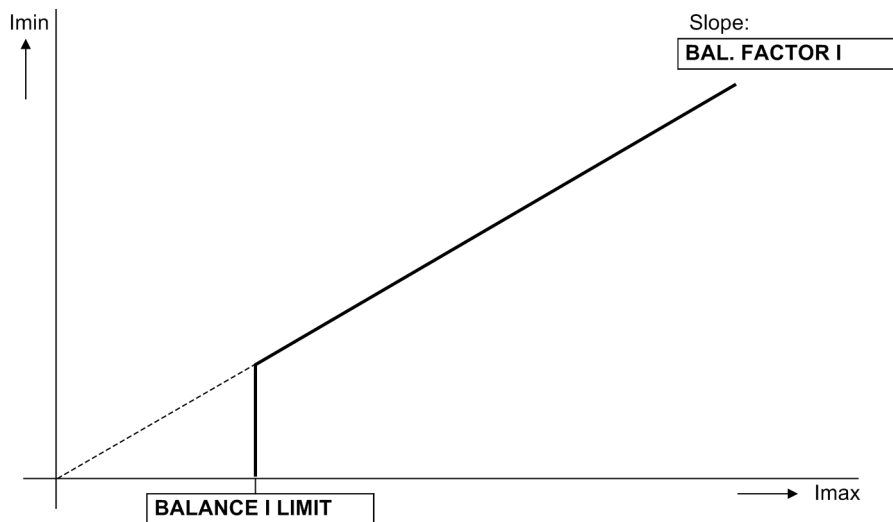

[stromsymmetriueberwachung-020313-ko, 1, en_US]

Figure 2-56 Current symmetry monitoring


Voltage Symmetry

During normal system operation, balance among the voltages is expected. Since the phase-to-phase voltages are insensitive to ground faults, the phase-to-phase voltages are used for balance monitoring. If the device is connected to the phase-to-ground voltages, then the phase-to-phase voltages are calculated accordingly, whereas, if the device is connected to phase-to-phase voltages and the displacement voltage V_0 , then the third phase-to-phase voltage is calculated accordingly. From the phase-to-phase voltages, the device generates the rectified average values and checks the balance of their absolute values. The smallest phase voltage is compared with the largest phase voltage.

Asymmetry is recognized if

$|V_{\min}| / |V_{\max}| < \text{BAL. FACTOR V}$ as long as $|V_{\max}| > \text{BALANCE V-LIMIT}$. Where $V_{\max}$ is the highest of the three voltages and $V_{\min}$ the smallest. The symmetry factor **BAL. FACTOR V** (address 8103) represents the allowable asymmetry of the conductor voltages while the limit value **BALANCE V-LIMIT** (address 8102) is the lower limit of the operating range of this monitoring (see [Figure 2-70](#)). Both parameters can be set. The dropout ratio is about 97%.

This fault is signalled after settable delay time with *Fail V balance*.

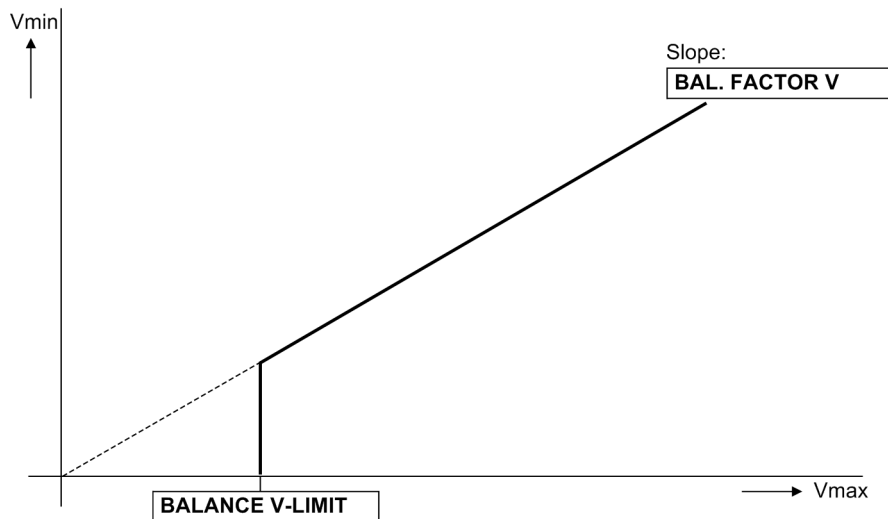

[spannungssymmetriueberwachung-020313-kn, 1, en_US]

Figure 2-57 Voltage symmetry monitoring

**NOTE**

If the connection mode **Vph-g**, **VSyn** was set for the voltage transformers at parameter 213 **VT Connect**. **3ph**, voltage symmetry monitoring is not possible.

Phase Sequence of Voltage and Current

To detect swapped phase connections in the voltage and current input circuits, the phase sequence of the phase-to-phase measured voltages and the phase currents are checked by monitoring the sequence of same polarity zero crossing of the voltages.

Direction measurement with normal voltages, path selection for fault location, and negative sequence detection all assume a phase sequence of "abc". Phase rotation of measurement quantities is checked by verifying the phase sequences. For that purpose, the phase-sequence monitoring uses the phase-to-phase voltages V_{A2} , V_{B3} , V_{C1} .

Voltages: V_{A2} before V_{B3} vor V_{C1} and

Currents: I_A before I_B before I_C .

Verification of the voltage phase rotation is done when each measured voltage is at least

$$|V_{A2}|, |V_{B3}|, |V_{C1}| > 40 \text{ V}$$

Verification of the current phase rotation is done when each measured current is at least:

$$|I_A|, |I_B|, |I_C| > 0.5 I_N$$

For abnormal phase sequences, the messages *Fail Ph. Seq. Vor Fail Ph. Seq. I* are issued, along with the switching of this message *Fail Ph. Seq..*

For applications in which an opposite phase sequence is expected, the protective relay should be adjusted via a binary input or the respective parameter **PHASE SEQ.** (address 209). If the phase sequence is changed in the relay, phases B and C internal to the relay are reversed, and the positive and negative sequence currents are thereby exchanged (see also Section 2.21.2 [Setting Notes](#)). The phase-related messages, malfunction values, and measured values are not affected by this.

2.11.1.5 Measurement Voltage Failure Detection**Requirements**

The measuring voltage failure detection function - referred to as "Fuse Failure Monitor" (FFM) - only operates if parameter 213 **VT Connect**. **3ph** is set to **Van**, **Vbn**, **Vcn** or **Vab**, **Vbc**, **VGnd**. With all other voltage transformer connection modes, FFM is not operative.

Purpose of the Fuse Failure Monitor

In case of a measuring voltage failure caused by a fault or a broken wire in the voltage transformer secondary system, a zero voltage can be simulated to individual measuring loops.

The displacement voltage element of the (sensitive) ground fault detection, the directional overcurrent protection and the undervoltage protection can thereby acquire incorrect measuring results.

The blocking of this function by the FFM is configurable.

The FFM can become effective in grounded as well as in isolated systems provided that the connection mode **V_{an}**, **V_{bn}**, **V_{cn}** or **V_{ab}**, **V_{bc}**, **V_{Gnd}** was set. Of course, the miniature circuit breaker and FFM can also be used for the detection of a measuring voltage failure at the same time.

The displacement voltage element of the (sensitive) ground fault detection, the time overcurrent protection ground and the undervoltage protection can thereby obtain incorrect measuring results.

Mode of Operation – Grounded System

The device is informed of the application of the FFM in a grounded system via address 5301 **FUSE FAIL MON. Solid grounded.**



NOTE

On systems where the ground fault current is very small or absent (e.g. ungrounded supply transformers), fuse failure monitoring must be disabled or set to **Coil.gnd./isol.**

The logic diagram on the operating mode in a grounded system is illustrated in [Figure 2-58](#). Depending on the configuration and MLFB, the FFM operates with measured or calculated values V_N or I_N . If zero sequence voltage occurs without a ground fault current being registered simultaneously, then there is an asymmetrical fault in the secondary circuit of the voltage transformer.


The displacement voltage element of the (sensitive) ground fault detection, the directional overcurrent protection (phase and ground function) and the undervoltage protection are blocked if parameter 5310 **BLOCK PROT.** is set to **YES**.

The FFM picks up if the ground voltage V_N is higher than the set limit value under address 5302 **FUSE FAIL 3Vo** and if the ground current I_N lies below the set limit value under address 5303 **FUSE FAIL RESID**.

Pickup occurs in accordance with the configured values. A hysteresis of 105% for the dropout is integrated for I_N or 95% for V_N . In case of low-current asymmetrical faults in systems with weak infeed, the ground current caused by the fault could lie below the pickup threshold of the Fuse Failure Monitor. Overfunctioning of the Fuse Failure Monitor can, however, cause the feeder protection device to underfunction since all protection functions that use voltage signals are blocked. In order to prevent overfunctioning of the FFM, the phase currents are also checked. If at least one phase current lies above the pickup threshold of 5303 **FUSE FAIL RESID**, it can be assumed that the zero current created by a fault will equally exceed this threshold.

In order to immediately detect an existing fault after switching in, the following applies: If a ground current I_N is detected within 10 seconds after recognition of the Fuse Failure criterion, the protection assumes a fault and removes the blocking by the Fuse Failure Monitor for the duration of the fault. If, on the other hand, the voltage failure criterion is present for longer than approx. 10 s, the blocking is permanently activated. After this time has elapsed, it can be assumed that a fuse failure has actually occurred. Only 10 s after the voltage criterion has been removed by correction of the secondary circuit failure, will the blocking automatically reset, thereby releasing the blocked protection functions.

The generation of the internal signal "Alarm FFM" for the operation in isolated systems is shown in [Figure 2-59](#).

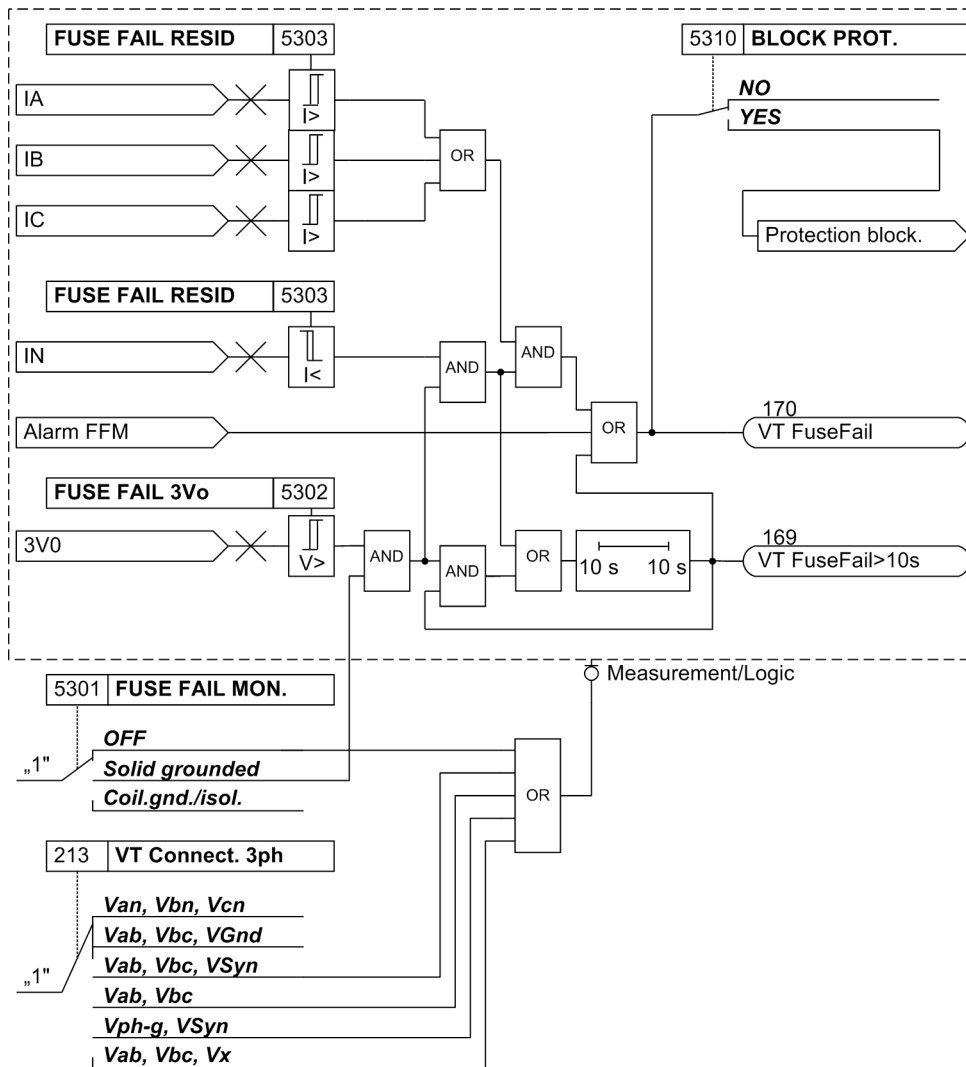

[7sj80-fuse-failure-monitor-20061215, 1, en_US]

Figure 2-58 Logic diagram of the Fuse Failure Monitor for grounded networks only

Mode of Operation – Isolated System and 3-phase Fuse Failure

The FFM can also function in isolated and compensated (grounded) systems where only low ground currents are expected. This is indicated to the device via address 5301 **FUSE FAIL MON.**

The logic diagram on the functioning in an isolated system and for 3-phase fuse failure is shown in [Figure 2-59](#). The following is a description of the principles for 1-phase, 2-phase and 3-phase faults in a secondary voltage transformer system. If this part of the FFM logic picks up, the internal signal "Alarm FFM" is generated. The processing of this signal is shown in [Figure 2-58](#).



NOTE

In isolated systems, only the following logic is used.




Figure 2-59 Logic diagram of the Fuse Failure Monitor for isolated and grounded systems

Single- and Two-phase Failures in Voltage Transformer Circuits

The measuring voltage failure detection is based on the fact that a significant negative sequence system is formed in the voltage during single- or two-phase voltage failure, however without influencing the current. This enables a clear distinction from asymmetries impressed by the power system. If the negative sequence system is related to the current positive sequence system, the following rules apply to the **Fault-free Case**:

$$\frac{V_2}{V_1} = 0 \quad \text{and} \quad \frac{I_2}{I_1} = 0$$

[u2-u1-fehlerfreier-fall-020828-ho, 1, en US]

If a fault occurs in the voltage transformer secondary system, the following rules apply to the **Single-phase Failure**:

$$\frac{V_2}{V_1} = \frac{0.33}{0.66} = 0.5 \quad \text{and} \quad \frac{I_2}{I_1} = 0 \quad \left(\frac{V_2}{V_1} > \frac{I_2}{I_1} \right)$$

[u2-u1-einpoliger-ausfall-020828-ho, 1, en_US]

If a fault occurs in the voltage transformer secondary system, the following rules apply to the **Two-phase Failure**:

$$\frac{V_2}{V_1} = \frac{0.33}{0.33} = 1 \quad \text{and} \quad \frac{I_2}{I_1} = 0 \quad \left(\frac{V_2}{V_1} > \frac{I_2}{I_1} \right)$$

[u2-u1-zweipoliger-ausfall-020828-ho, 1, en_US]

In case of a failure of one or two phases of the primary system, the current also shows a negative sequence system of 0.5 or 1. Consequently, the voltage monitoring does not respond since no voltage transformer fault can be present. In order to avoid occurrence of an overfunctioning of the measuring voltage failure detection due to inaccuracy, the function is blocked below a minimum threshold of the positive sequence systems of voltage ($V_1 < 0.1 V_{\text{Nom}}$) and current ($I_1 < 0.1 I_{\text{Nom}}$).

If the absolute values of the positive or negative sequence voltage are below 20 % of $V_{\text{Nom}} / \sqrt{3}$, the 1-pole or 2-pole FFM detection is blocked.

Three-phase Failures in Voltage Transformer Circuits

A 3-phase failure in the voltage transformer secondary system cannot be detected via the positive- and negative- sequence system as described above. The monitoring of the progress of current and voltage over time is required here. If a voltage dip to almost zero occurs (or if the voltage is zero), and the current remains unchanged, a 3-phase failure in the voltage transformer secondary system can be concluded. The jump detection is used for this purpose. The sensitivity of the jump detection for current can be increased via parameter **FFM Idiff (3ph)**.

2.11.1.6 Broken Wire Monitoring of Voltage Transformer Circuits

Requirements

This function is only available in device version "World" or "Chinese" Ordering Information Pos. 10 = B or K), as it is only used in certain regions.

Furthermore, the measurement of all three phase-to-ground voltages (**V_{an}**, **V_{bn}**, **V_{cn}**) is a requirement.

If only two phase-to-phase voltages were measured, it would not be possible to evaluate two of the required criteria.

Task

The "Broken Wire" monitoring function monitors the voltage transformer circuits of the secondary system with regard to failure. One distinguishes between single-phase, two-phase and three-phase failures.

Mode of Operation / Logic

All three phase-to-ground voltages, the displacement voltage and the three phase currents are measured. The required values are calculated for the respective criteria and eventually a decision is made. The resulting alarm message may be delayed. A blocking of the protection functions is however not effected. This is done by the measuring voltage failure detection.

The "Broken Wire" monitoring is also active during a fault. The function may be enabled or disabled.

The following logic diagram shows how "Broken Wire" monitoring functions.

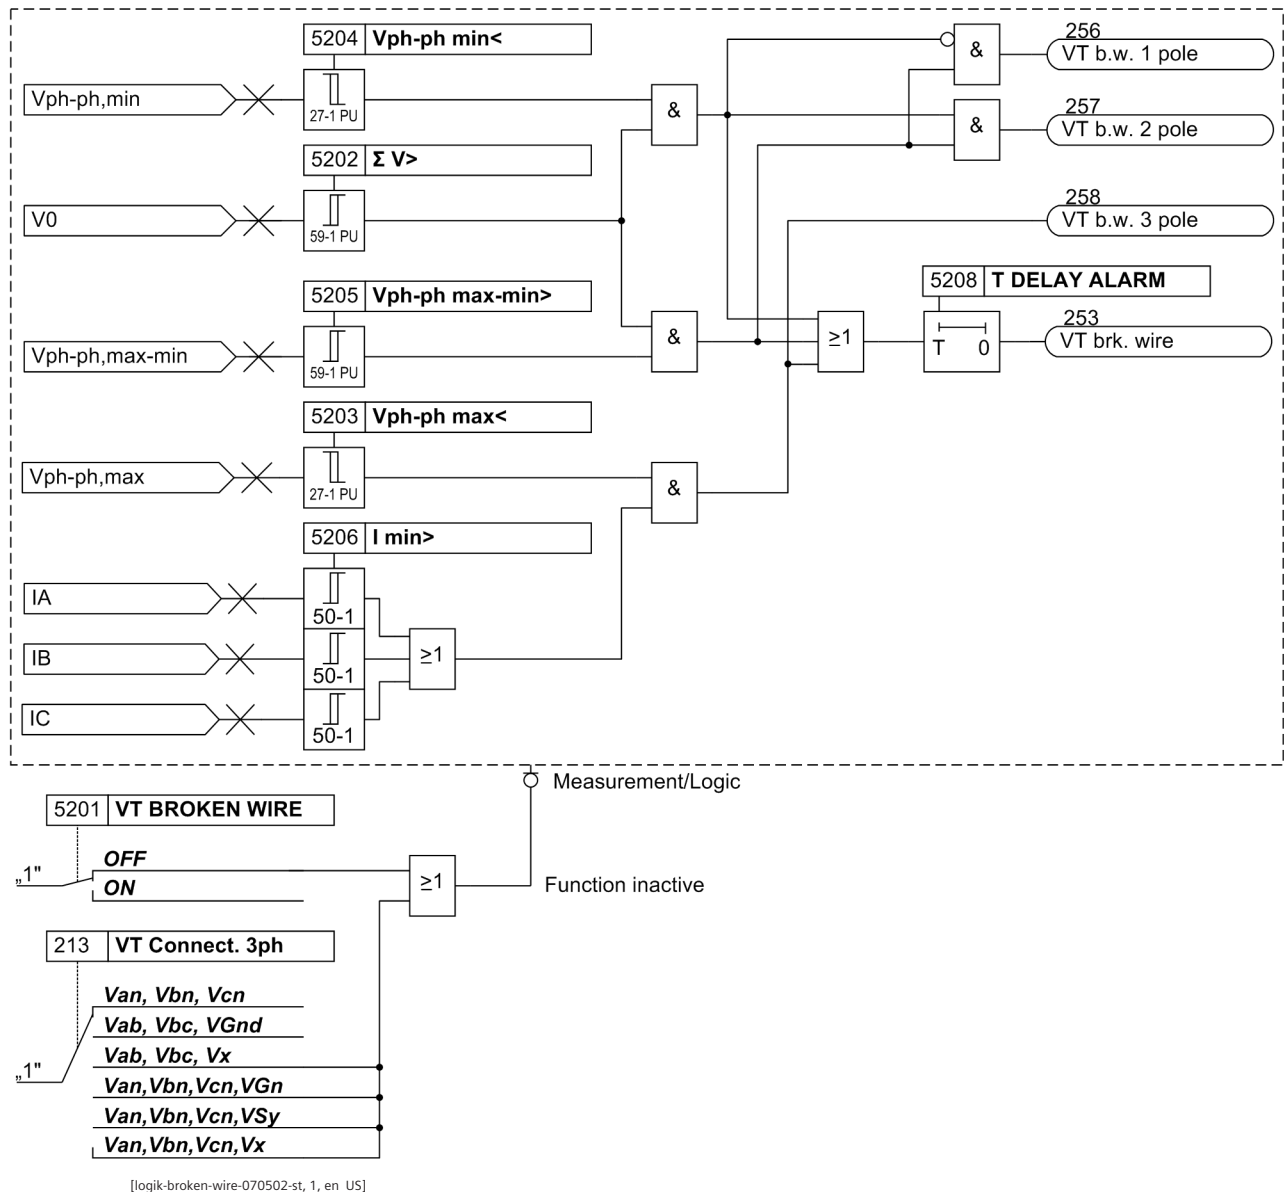


Figure 2-60 Logic diagram for broken wire monitoring

2.11.1.7 Setting Notes

Measured Value Monitoring

The sensitivity of measured value monitor can be modified. Default values which are sufficient in most cases are preset. If especially high operating asymmetries in the currents and/or voltages are to be expected during operation, or if it becomes apparent during operation that certain monitoring functions activate sporadically, then the setting should be less sensitive.

Address 8102 **BALANCE V-LIMIT** determines the limit voltage (phase-to-phase) above which the voltage symmetry monitor is effective. Address 8103 **BAL. FACTOR V** is the associated symmetry factor; that is, the slope of the symmetry characteristic curve. In address 8110 **T BAL. V LIMIT** you set the delay time of fault message no. 167 *Fai1 V balance*.

Address 8104 **BALANCE I LIMIT** determines the limit current above which the current symmetry monitor is effective. Address 8105 **BAL. FACTOR I** is the associated symmetry factor; that is, the slope of the symmetry characteristic curve. In address 8111 **T BAL. I LIMIT** you set the delay time for fault message no. 163 *Fai1 I balance*.

Address 8106 Σ I **THRESHOLD** determines the limit current above which the current sum monitoring is activated (absolute portion, only relative to $I_{N_{\text{nom}}}$). The relative portion (relative to the maximum conductor current) for activating the current sum monitor is set at address 8107 Σ I **FACTOR**.

**NOTE**

Current sum monitoring can operate properly only when the residual current of the protected line is fed to the fourth current input (I_N) of the relay (see Power System Data 1). Furthermore, the fourth current input (I_N) may not be sensitive.

**NOTE**

The connections of the ground paths and their adaption factors were set when configuring the general Power System Data. These settings must be correct for the measured values monitoring to function properly.

Measured value monitoring can be set to **ON** or **OFF** at address 8101 **MEASURE . SUPERV.**

Fuse Failure Monitor (FFM)

Via address 5301 **FUSE FAIL MON.** you select under which system conditions the FFM works. Depending on that, make the required settings in the grounded system via the parameters 5302, 5303 and 5308. In a grounded/isolated system, only the parameter 5308 is relevant.

The settings for the fuse failure monitor must be selected in such manner that reliable activation occurs if a phase voltage fails, but that false activation does not occur during ground faults in a grounded network.

Address 5303 **FUSE FAIL RESID** must be set as sensitive as required (with ground faults, below the smallest fault current).

The FFM picks up if the ground voltage V_N is higher than the set limit value under address 5302 **FUSE FAIL 3Vo** and if the ground current I_N lies below the set limit value under address 5303 **FUSE FAIL RESID**.

In order to detect a three-phase failure, the progress in time of current and voltage is monitored. If the voltage sinks below the threshold value without a change in the current value, a three-phase failure is detected. This threshold value of the current element must be set under address 5308 FFM I_{diff} (3ph). The threshold value should be identical with the definite time overcurrent protection.

Under address 5310 **BLOCK PROT.** it can be determined whether the protection functions should be blocked upon pickup by the FFM.

**NOTE**

The setting under address 5310 **BLOCK PROT.** has no effect on the flexible protection functions. A separate blocking can be selected for that purpose.

The function may be disabled in address 5301 **FUSE FAIL MON.**, e.g. when performing asymmetrical tests.

2.11.1.8 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
5201	VT BROKEN WIRE		ON OFF	OFF	VT broken wire supervision
5202	Σ V>		1.0 .. 100.0 V	8.0 V	Threshold voltage sum
5203	V _{ph-ph} max<		1.0 .. 100.0 V	16.0 V	Maximum phase to phase voltage

Addr.	Parameter	C	Setting Options	Default Setting	Comments
5204	Vph-ph min<		1.0 .. 100.0 V	16.0 V	Minimum phase to phase voltage
5205	Vph-ph max-min>		10.0 .. 200.0 V	16.0 V	Symmetry phase to phase voltages
5206	I min>	1A	0.04 .. 1.00 A	0.04 A	Minimum line current
		5A	0.20 .. 5.00 A	0.20 A	
5208	T DELAY ALARM		0.00 .. 32.00 sec	1.25 sec	Alarm delay time
5301	FUSE FAIL MON.		OFF Solid grounded Coil.gnd./isol.	OFF	Fuse Fail Monitor
5302	FUSE FAIL 3Vo		10 .. 100 V	30 V	Zero Sequence Voltage
5303	FUSE FAIL RESID	1A	0.10 .. 1.00 A	0.10 A	Residual Current
		5A	0.50 .. 5.00 A	0.50 A	
5308A	FFM Idiff (3ph)	1A	0.05 .. 1.00 A	0.10 A	Differential Current Threshold (3phase)
		5A	0.25 .. 5.00 A	0.50 A	
5310	BLOCK PROT.		NO YES	YES	Block protection by FFM
8101	MEASURE. SUPERV		OFF ON	ON	Measurement Supervision
8102	BALANCE V-LIMIT		10 .. 100 V	50 V	Voltage Threshold for Balance Monitoring
8103	BAL. FACTOR V		0.58 .. 0.90	0.75	Balance Factor for Voltage Monitor
8104	BALANCE I LIMIT	1A	0.10 .. 1.00 A	0.50 A	Current Threshold for Balance Monitoring
		5A	0.50 .. 5.00 A	2.50 A	
8105	BAL. FACTOR I		0.10 .. 0.90	0.50	Balance Factor for Current Monitor
8106	Σ I THRESHOLD	1A	0.05 .. 2.00 A; ∞	0.10 A	Summated Current Moni- toring Threshold
		5A	0.25 .. 10.00 A; ∞	0.50 A	
8107	Σ I FACTOR		0.00 .. 0.95	0.10	Summated Current Moni- toring Factor
8109	FAST Σ i MONIT		OFF ON	ON	Fast Summated Current Monitoring
8110A	T BAL. V LIMIT		0 .. 100 sec	5 sec	T Balance Factor for Voltage Monitor
8111A	T BAL. I LIMIT		0 .. 100 sec	5 sec	T Current Balance Monitor

2.11.1.9 Information List

No.	Information	Type of Informa- tion	Comments
161	Fail I Superv.	OUT	Failure: General Current Supervision
162	Failure Σ I	OUT	Failure: Current Summation
163	Fail I balance	OUT	Failure: Current Balance
167	Fail V balance	OUT	Failure: Voltage Balance
169	VT FuseFail>10s	OUT	VT Fuse Failure (alarm >10s)
170	VT FuseFail	OUT	VT Fuse Failure (alarm instantaneous)
171	Fail Ph. Seq.	OUT	Failure: Phase Sequence

No.	Information	Type of Information	Comments
175	Fail Ph. Seq. I	OUT	Failure: Phase Sequence Current
176	Fail Ph. Seq. V	OUT	Failure: Phase Sequence Voltage
197	MeasSup OFF	OUT	Measurement Supervision is switched OFF
253	VT brk. wire	OUT	Failure VT circuit: broken wire
255	Fail VT circuit	OUT	Failure VT circuit
256	VT b.w. 1 pole	OUT	Failure VT circuit: 1 pole broken wire
257	VT b.w. 2 pole	OUT	Failure VT circuit: 2 pole broken wire
258	VT b.w. 3 pole	OUT	Failure VT circuit: 3 pole broken wire
6509	>FAIL:FEEDER VT	SP	>Failure: Feeder VT
6510	>FAIL: BUS VT	SP	>Failure: Busbar VT

2.11.2 Trip Circuit Supervision 74TC

Devices 7SJ80 are equipped with an integrated trip circuit supervision. Depending on the number of available binary inputs (not connected to a common potential), supervision with one or two binary inputs can be selected. If the allocation of the required binary inputs does not match the selected supervision type, then a message to this effect is generated (*74TC ProgFai 1*).

Applications

- When using two binary inputs, malfunctions in the trip circuit can be detected under all circuit breaker conditions.
- When only one binary input is used, malfunctions in the circuit breaker itself cannot be detected.

Prerequisites


A requirement for the use of trip circuit supervision is that the control voltage for the circuit breaker is at least twice the voltage drop across the binary input ($V_{Ct} > 2 \cdot V_{Bmin}$).

Since at least 19 V are needed for the binary input, the supervision can only be used with a system control voltage of over 38 V.

2.11.2.1 Functional Description

Supervision with Two Binary Inputs

When using two binary inputs, these are connected according to [Figure 2-61](#), parallel to the associated trip contact on one side, and parallel to the circuit breaker auxiliary contacts on the other.

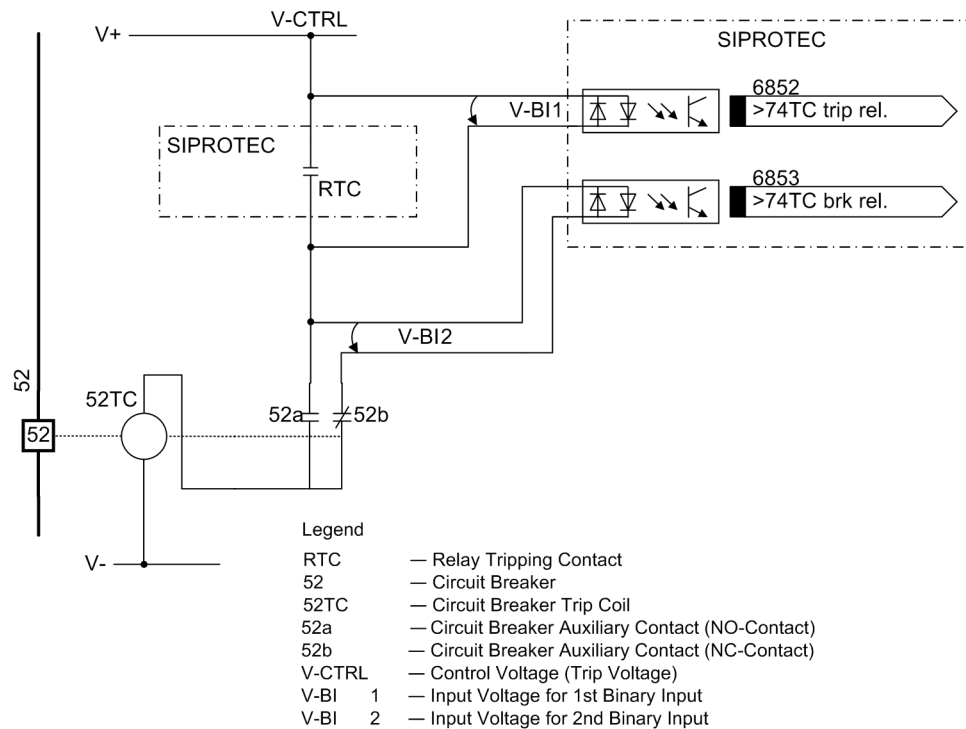

[prinzip-ausloesekreisueberwachung-2-binein-150502-kn, 1, en_US]

Figure 2-61 Principle of the trip circuit supervision with two binary inputs


Supervision with two binary inputs not only detects interruptions in the trip circuit and loss of control voltage, it also supervises the response of the circuit breaker using the position of the circuit breaker auxiliary contacts. Depending on the conditions of the trip contact and the circuit breaker, the binary inputs are activated (logical condition "H" in [Table 2-9](#)), or not activated (logical condition "L").

In healthy trip circuits the condition that both binary inputs are not actuated ("L") is only possible during a short transition period (trip contact is closed but the circuit breaker has not yet opened). A continuous state of this condition is only possible when the trip circuit has been interrupted, a short-circuit exists in the trip circuit, a loss of battery voltage occurs, or malfunctions occur with the circuit breaker mechanism. Therefore, it is used as supervision criterion.

Table 2-9 Condition table for binary inputs, depending on RTC and CB position

No.	Trip contact	Circuit breaker	52a Contact	52b Contact	BI 1	BI 2
1	Open	Closed	Closed	Open	H	L
2	Open	Open	Open	Closed	H	H
3	Closed	Closed	Closed	Open	L	L
4	Closed	Open	Open	Closed	L	H

The conditions of the two binary inputs are checked periodically. A check takes place about every 600 ms. If three consecutive conditional checks detect an abnormality (after 1.8 s), an annunciation is reported (see [Figure 2-62](#)). The repeated measurements determine the delay of the alarm message and avoid that an alarm is output during short transition periods. After the malfunction in the trip circuit is cleared, the fault annunciation is reset automatically after the same time period.

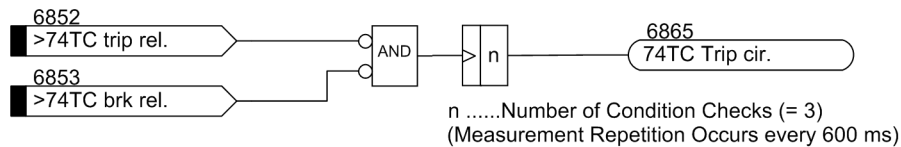


[7sj6x_ausloesekreis_2_binaerein-150502-kn, 1, en_US]

Figure 2-62 Logic diagram of the trip circuit supervision with two binary inputs

Supervision with One Binary Input

The binary input is connected according to the following figure in parallel with the associated trip contact of the protection relay. The circuit breaker auxiliary contact is bridged with a bypass resistor R.

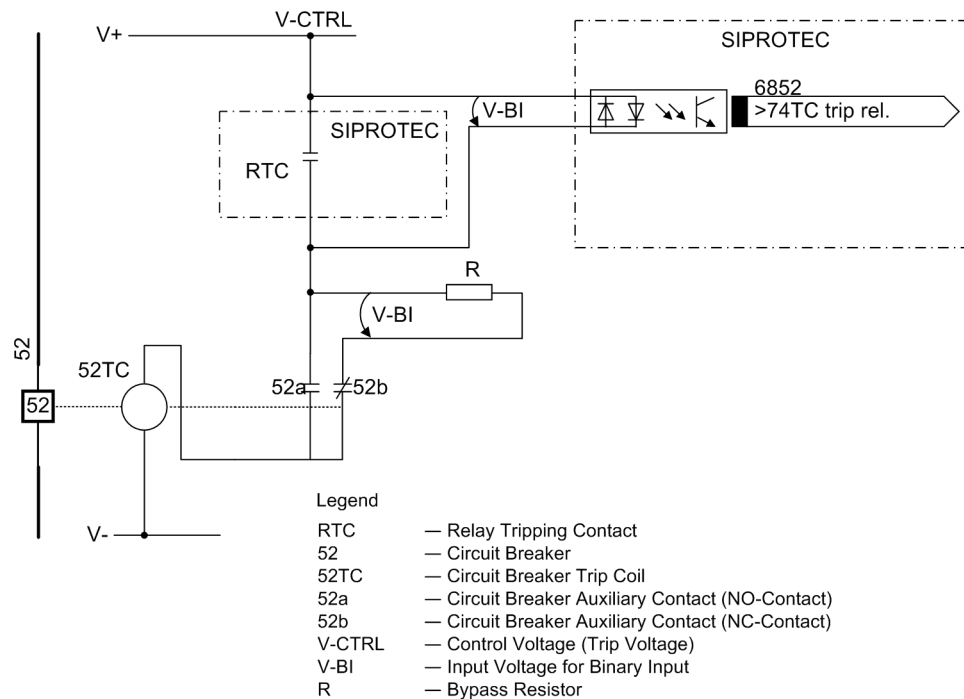

[prinzip-ausloesekreisueberwachung-1-binein-150502-kn, 1, en_US]


Figure 2-63 Trip circuit supervision with one binary input

During normal operation, the binary input is activated (logical condition "H") when the trip contact is open and the trip circuit is intact, because the monitoring circuit is closed by either the 52a circuit breaker auxiliary contact (if the circuit breaker is closed) or through the bypass resistor R by the 52b circuit breaker auxiliary contact. Only as long as the trip contact is closed, the binary input is short circuited and thereby deactivated (logical condition "L").

If the binary input is continuously deactivated during operation, this leads to the conclusion that there is an interruption in the trip circuit or loss of control voltage.

As the trip circuit supervision does not operate during system faults, the closed trip contact does not lead to a fault message. If, however, tripping contacts from other devices operate in parallel with the trip circuit, then the fault message must be delayed (see also [Figure 2-64](#)). The delay time can be set via parameter 8202


Alarm Delay. A message is only released after expiry of this time. After clearance of the fault in the trip circuit, the fault message is automatically reset.

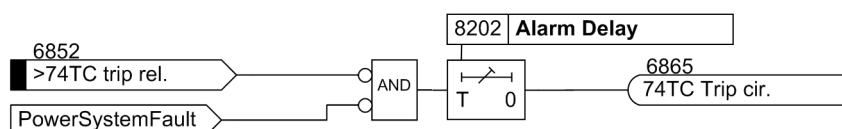

[7sj6x_ausloesekreis_1_binaerein-050906-he, 1, en_US]

Figure 2-64 Logic diagram of trip circuit supervision with one binary input

The following figure shows the logic diagram for the message that can be generated by the trip circuit monitor, depending on the control settings and binary inputs.

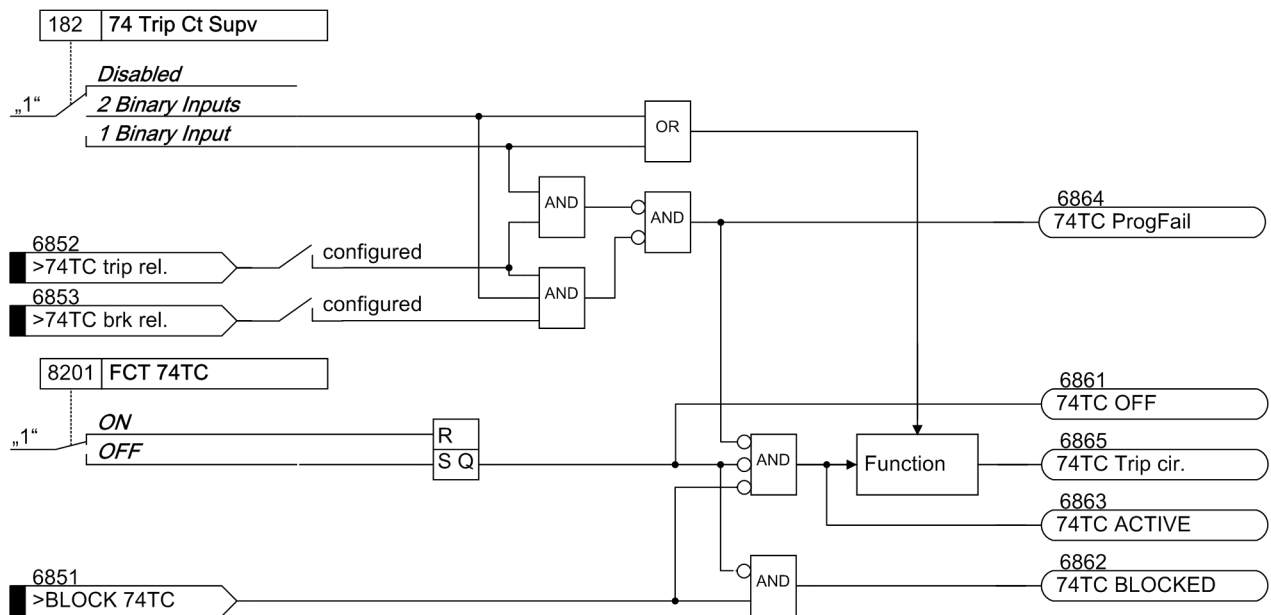

[7sj6x_ausloesekreis_meldelogik-150502-kn, 1, en_US]

Figure 2-65 Message logic for trip circuit supervision

2.11.2.2 Setting Notes

General

The function is only effective and accessible if address 182 (Section [2.1.1.2 Setting Notes](#)) was set to either **2 Binary Inputs** or **1 Binary Input** during configuration, the appropriate number of binary inputs has been configured accordingly for this purpose and the function **FCT 74TC** is **ON** at address 8201. If the allocation of the required binary inputs does not match the selected supervision type, a message to this effect is generated (*74TC ProgFail*). If the trip circuit monitor is not to be used at all, then *Disabled* is set at address 182.

In order to ensure that the longest possible duration of a trip command can be reliably bridged, and an indication is generated in case of an actual fault in the trip circuit, the indication regarding a trip circuit interruption is delayed. The time delay is set under address 8202 **Alarm Delay**.

Supervision with One Binary Input

Note: When using only one binary input (BI) for the trip circuit monitor, malfunctions, such as interruption of the trip circuit or loss of battery voltage are detected in general, but trip circuit failures while a trip command is active cannot be detected. Therefore, the measurement must take place over a period of time that bridges the longest possible duration of a closed trip contact. This is ensured by the fixed number of measurement repetitions and the time between the state checks.

When using only one binary input, a resistor R is inserted into the circuit on the system side, instead of the missing second binary input. Through appropriate sizing of the resistor and depending on the system conditions, a lower control voltage is mostly sufficient.

Information for dimensioning resistor R is given in the Chapter "Installation and Commissioning" under Configuration Notes in the Section "Trip Circuit Supervision".

2.11.2.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
8201	FCT 74TC	ON OFF	ON	74TC TRIP Circuit Supervision
8202	Alarm Delay	1 .. 30 sec	2 sec	Delay Time for alarm

2.11.2.4 Information List

No.	Information	Type of Information	Comments
6851	>BLOCK 74TC	SP	>BLOCK 74TC
6852	>74TC trip rel.	SP	>74TC Trip circuit superv.: trip relay
6853	>74TC brk rel.	SP	>74TC Trip circuit superv.: bkr relay
6861	74TC OFF	OUT	74TC Trip circuit supervision OFF
6862	74TC BLOCKED	OUT	74TC Trip circuit supervision is BLOCKED
6863	74TC ACTIVE	OUT	74TC Trip circuit supervision is ACTIVE
6864	74TC ProgFail	OUT	74TC blocked. Bin. input is not set
6865	74TC Trip cir.	OUT	74TC Failure Trip Circuit

2.11.3 Malfunction Responses of the Monitoring Functions

In the following malfunction responses of monitoring equipment are clearly listed.

2.11.3.1 Description

Malfunction Responses

Depending on the type of malfunction discovered, an annunciation is sent, a restart of the processor system is initiated, or the device is taken out of service. After three unsuccessful restart attempts, the device is taken out of service. The operational readiness NC contact operates to indicate the device is malfunctioning. Also, the red LED "ERROR" lights up on the front cover, if the internal auxiliary voltage is present, and the green "RUN" LED goes out. If the internal auxiliary voltage fails, all LEDs are dark. [Table 2-10](#) provides a summary of the monitoring functions and the malfunction responses of the relay.

Table 2-10 Summary of malfunction responses by the protection relay

Monitoring	Possible Causes	Malfunction Response	Message (No.)	Output
AC/DC supply voltage loss	External (Nominal voltage) internal (power supply)	Device shutdown	All LEDs dark	DOK ⁽²⁾ drops out
Buffer battery	Internal (buffer battery)	Message	<i>Fail Battery</i> (177)	
Hardware watchdog	Internal (processor failure)	Device shutdown ¹⁾	LED "ERROR"	DOK ⁽²⁾ drops out
Software watchdog	Internal (processor failure)	Restart attempt ¹⁾	LED "ERROR"	DOK ⁽²⁾ drops out
Working memory ROM	Internal (hardware)	Relay aborts restart, device shutdown	LED blinkt	DOK ⁽²⁾ drops out

Monitoring	Possible Causes	Malfunction Response	Message (No.)	Output
Program memory RAM	Internal (hardware)	During boot sequence Detection during operation: Restart attempt ¹⁾	LED "ERROR" LED "ERROR"	DOK ²⁾ drops out
Settings memory	Internal (hardware)	Restart attempt ¹⁾	LED "ERROR"	DOK ²⁾ drops out
Sampling frequency	Internal (hardware)	Device shutdown	LED "ERROR"	DOK ²⁾ drops out
Measured value acquisition	External (hardware)	Blocking by the protection function	<i>Error A/D-conv.</i> (181), LED "ERROR"	DOK ²⁾ drops out
Error in the I/O-board	Internal (hardware)	Device shutdown	<i>I/O-Board error</i> (178), LED "ERROR"	DOK ²⁾ drops out
Offset monitoring	Internal (hardware)	Device shutdown	<i>Error offset</i> (191)	DOK ²⁾ drops out
Current sum	Internal (measured value acquisition)	Device shutdown	<i>Failure ΣI</i> (162)	DOK ²⁾ drops out
Current symmetry	External (power system or current transformer)	Message	<i>Fail I balance</i> (163)	As allocated
Voltage symmetry	External (power system or voltage transformer)	Message	<i>Fail v balance</i> (167)	As allocated
Voltage phase sequence	External (power system or connection)	Message	<i>Fail Ph. Seq. v</i> (176)	As allocated
Current phase sequence	External (power system or connection)	Message	<i>Fail Ph. Seq. I</i> (175)	As allocated
Fuse Failure Monitor	External (voltage transformer)	Message	<i>VT FuseFail > 10s</i> (169) <i>VT FuseFail</i> (170)	As allocated
Trip circuit monitoring	External (trip circuit or control voltage)	Message	<i>74TC Trip cir.</i> (6865)	As allocated
Secondary voltage transformer circuit monitoring	External (voltage transformer circuit interruption)	Message	<i>VT brk. wire</i> (253)	As allocated
Calibration data fault	Internal (hardware)	Message	<i>Alarm NO calibr</i> (193)	As allocated

¹⁾ After three unsuccessful restart attempts, the device is shut down.

²⁾ DOK = "Device Okay" = Ready for service relay drops off, protection and control functions are blocked.

Group Alarms

Certain messages of the monitoring functions are already combined to group alarms. A listing of the group alarms and their composition is given in the Appendix [F.4 Group Indications](#). In this case, it must be noted that message 160 *Alarm Sum Event* is only issued when the measured value monitoring functions (8101 **MEASURE. SUPERV**) are activated.

2.12 Ground Fault Protection 64, 67N(s), 50N(s), 51N(s)

Depending on the variant, the fourth current input of the multi-functional protection relays 7SJ62/64 is equipped either with a sensitive input transformer or a standard transformer for 1/5 A. is equipped either with a sensitive input transformer or a standard transformer for 1/5 A.

In the first case, the protective function is designed for ground fault detection in isolated or compensated systems due to its high sensitivity. It is not really suited for ground fault detection with large ground currents since the linear range is transcended at about 1.6 A at the sensitive ground fault detection relay terminals. If the relay is equipped with a standard transformer for 1/5 A currents, large currents can also be detected correctly.

This function can operate in two modes. The standard procedure, the "cos-φ / sin-φ measurement", evaluates the part of the ground current perpendicular to the settable directional characteristic.

The second procedure, the "U0/I0-φ measurement", calculates the angle between ground current and displacement voltage. For this procedure, two different directional characteristics can be set.

Applications

- Sensitive ground fault detection may be used in isolated or compensated systems to detect ground faults, to determine phases affected by ground faults, and to specify the direction of ground faults.
- In solidly or low-resistance grounded systems, sensitive ground fault detection is used to detect high impedance ground faults.
- This function can also be used as supplementary ground fault protection.

2.12.1 Ground Fault Detection for cos-φ / sin-φ Measurement (Standard Method)

Voltage Element

The voltage element relies on a pickup initiated by the displacement voltage V_0 or $3 \cdot V_0$. Additionally, the faulty phase is determined. The displacement voltage V_0 can be directly applied to the device, or the summation voltage $3 \cdot V_0$ can be calculated according to the connection type of the voltage transformer (see also Parameter 213 **VT Connect**. **3ph** in Section 2.1.3 *Power System Data 1*). When setting **Van**, **Vbn**, **Vcn**, the calculation of the summation voltage $3 \cdot V_0$ is based on the three phase-to-ground voltages. The three voltage inputs must therefore be connected to the voltage transformers in a grounded-wye configuration. When setting **Vab**, **Vbc**, **VGnd**, the three phase-to-ground voltages of both connected phase-to-phase voltages and the connected displacement voltage are calculated. If the device is only provided with phase-to-phase voltages, it is not possible to calculate a displacement voltage from them. In this case the direction cannot be determined.

If the displacement voltage is calculated, then:

$$3 \cdot V_0 = \underline{V}_A + \underline{V}_B + \underline{V}_C$$

If the displacement voltage is directly applied to the device, then V_0 is the voltage at the device terminals. It is not affected by parameter **Vph / Vdelta** (address 206).


The displacement voltage is used both to detect a ground fault and to determine direction. When the voltage element picks up, a preset time delay must elapse before detection of the displacement voltage is reported to be able to record stable measurement quantities. The time delay can be configured (**T-DELAY Pickup**) and its factory setting is 1 s.

Pickup performed by the displacement voltage can be delayed (**64-1 DELAY**) for tripping.

It is important to note that the total tripping time then consists of the displacement voltage measurement time (about 50 ms) plus the pickup time delay **T-DELAY Pickup** plus the tripping delay **64-1 DELAY**.

After the voltage element picks up due to detection of a displacement voltage, the grounded phase is identified, if possible. For this purpose, the individual phase-to-ground voltages are measured or calculated, irrespective of the connection type of the voltage transformers. If the voltage magnitude for any given phase falls

below the set threshold **VPH MIN**, that phase is detected as the grounded phase as long as the remaining phase-to-ground voltages exceed the set threshold **VPH MAX**.

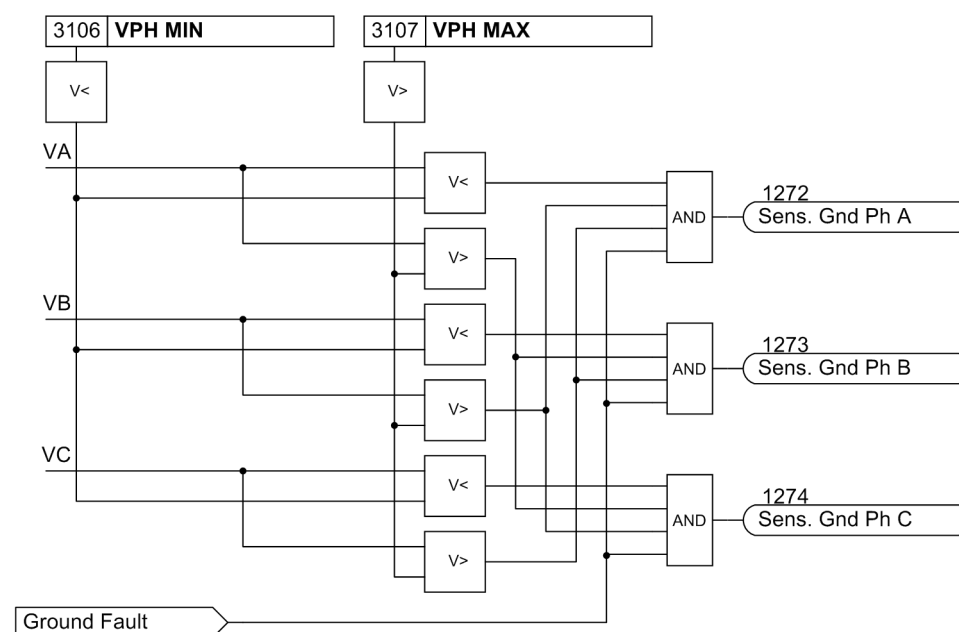

From Logic Diagram of the Sensitive Ground Fault Detection

[7sj6x_erdschlussbehaftete_phase-150502-1, 1, en_US]

Figure 2-66 Determination of Grounded Phase

Current Elements

The current elements for ground faults operate with the magnitudes of the ground current. It is sensible to employ them only where the magnitude of the ground current can be used to specify the ground fault. This may be the case on grounded systems (solid or low-resistance) or on electrical machines which are directly connected to the busbar of an isolated power system, when in case of a network ground fault the machine supplies only a negligible ground fault current across the measurement location, which must be situated between the machine terminals and the network, whereas in case of a machine ground fault the higher ground fault current produced by the total network is available. Ground current protection is mostly used as backup protection for high resistance ground faults in solid or low resistance grounded systems when the main fault protection does not pickup.

For ground current detection, a two-element current/time characteristic can be set. Analogous to the time overcurrent protection, the high-set current stage is designated as **50Ns-2 PICKUP** and **50Ns-2 DELAY** and is provided with a definite time characteristic. The overcurrent element may be operated with either a definite time delay (**50Ns-1 PICKUP** and **50Ns-1 DELAY**) or with a user-defined Curve (**51Ns PICKUP** and **51NsTIME DIAL**). The characteristics of these current elements can be configured. Each of these elements may be directional or non-directional.

The pickup of the definite time overcurrent protection can be stabilized by the configured dropout delay time (address 3121 **50Ns T DROP-OUT**).


The dropout delay only works if the current stage is operated independently of the voltage stage. Parameter 3130 **PU CRITERIA** is set to **Vgnd OR INs**.

Determination of Direction

When determining the sensitive ground fault direction it is not the current value that is crucial, but the part of the current which is perpendicular to a settable directional characteristic (axis of symmetry). As a prerequisite for determining the direction, the displacement voltage V_0 must be exceeded as well as a configurable current part influencing the direction (active or reactive component).

The following figure illustrates an example using a complex vector diagram in which the displacement voltage V_0 is the reference magnitude of the real axis. The active part $3I_{O_{real}}$ of current 3I0 is calculated with reference


to the displacement voltage V_0 and compared with setting value **RELEASE DIRECT**. The example is therefore suitable for ground fault direction in resonant grounded systems where quantity $3I_0 \cdot \cos \phi$ is relevant. The directional limit lines are perpendicular to axis $3I_{0\text{real}}$.

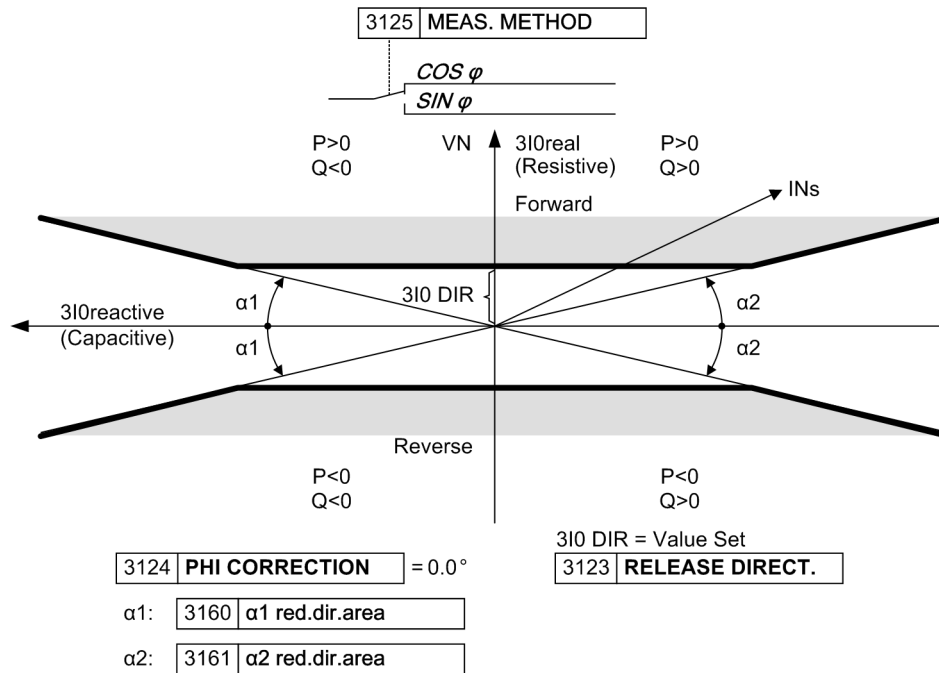

[7sj6-richtungskennlinie-bei-cos-messung-101210, 1, en_US]

Figure 2-67 Directional characteristic for $\cos\phi$ -measurement

The directional limit lines may be rotated by a correction angle (address **PHI CORRECTION**) up to $\pm 45^\circ$. Therefore, in grounded systems it is possible e.g. to increase sensitivity in the resistive-inductive range with a rotation of -45° , or in case of electric machines connected to the busbar of an ungrounded power system in the resistive- capacitive range with a rotation of $+45^\circ$ (see the following Figure). Furthermore the directional limit lines may be rotated by 90° to determine ground faults and their direction in isolated systems.

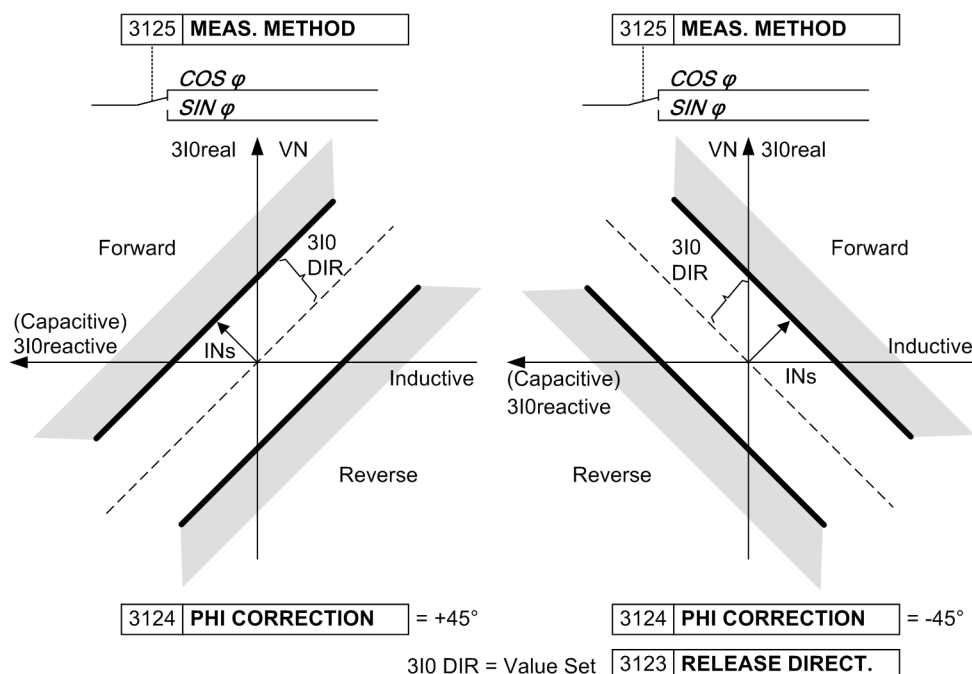

[richtungskennlinien-260602-ko, 1, en_US]

Figure 2-68 Directional characteristic for $\cos\phi$ -measurement

Fault direction is calculated with the zero sequence values from the ground current $3I_0$ and displacement voltage V_0 or $3 \cdot V_0$. With these quantities ground active power and ground reactive power is calculated.

The calculation algorithm used filters the measured values so that it is highly accurate and insensitive to higher harmonics (particularly the 3rd and 5th harmonics – which are often present in zero sequence currents). Direction determination relies on the sign of active and reactive power.

Since active and reactive components of the current - not the power - are relevant for pickup, current components are calculated from the power components. When determining the ground fault direction the active or reactive components of the ground current in reference to the displacement voltage as well as the direction of the active and reactive power are evaluated.

For measurements of $\sin\phi$ (for ungrounded systems) the following applies

- Ground fault (forward direction), if $Q_0 < 0$ and $I_{Eb} > \text{setting value (RELEASE DIRECT.)}$,
- Ground fault (reverse direction), if $Q_0 > 0$ and $I_{Eb} > \text{setting value (RELEASE DIRECT.)}$.

For measurements $\cos\phi$ (for resonant grounded systems) the following applies

- Ground fault (forward direction), if $P_0 > 0$ and $I_{EEW} > \text{setting value (RELEASE DIRECT.)}$,
- Ground fault (reverse direction), if $P_0 < 0$ and $I_{EEW} > \text{setting value (RELEASE DIRECT.)}$.

If **PHI CORRECTION** is unequal 0° , the angle of the directional limit lines is calculated by adding up active and reactive power components.

The forward and reverse zone can be reduced at its boundaries at address 3160 **α1 red.dir.area** and address 3161 **α2 red.dir.area** (see [Figure 2-67](#)).

Logic

The following figure illustrates the activation criteria of the sensitive ground fault protection. The operational mode of the ground fault detection can be set under address 3101.

If set to **ON**, tripping is possible and a fault log is generated.

If set to **Alarm Only**, tripping is not possible and only a ground fault log is generated.


The pickup of the displacement voltage element V_0 starts the ground fault recording. As the pickup of the V_0 element drops out, fault recording is terminated (see logic diagrams [Figure 2-70](#) and [Figure 2-71](#)).

The entire function can be blocked under the following conditions:

- A binary input is set,
- the Fuse Failure Monitor or the voltage transformer protection breaker pick up and parameter 3130 **PU CRITERIA** is set to **V_{gnd} AND I_{Ns}**,
- the Fuse Failure Monitor or the voltage transformer protection breaker pick up and parameter 3130 **PU CRITERIA** is set to **V_{gnd} OR I_{Ns}**, and both current elements are in directional operation mode.

Switching off or blocking means that measurement is deactivated. Therefore, time delays and pickup messages are reset.

All elements can be blocked individually via binary inputs. In this case pickup and, if possible, direction and grounded phase will still be reported, however, tripping does not take place since the time elements are blocked.

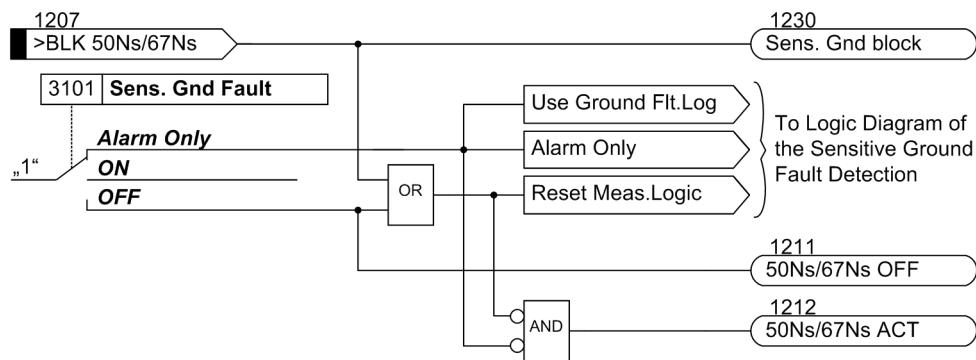


[7sj80-aktiv-cos-sin-empf-ef-070309, 1, en_US]

Figure 2-69 Activation of the sensitive ground-fault detection for $\cos\phi$ -/sin ϕ measurement

Generation of a pickup message, for both current elements, is dependent on the direction selection for each element and the setting of parameters 3130 **PU CRITERIA**. If the element is set to **Non-Directional** and parameter **PU CRITERIA** = **V_{gnd} OR I_{Ns}**, a pickup message is generated as soon as the current threshold is exceeded, irrespective of the status of the V₀ element. If, however, the setting of parameter **PU CRITERIA** is **V_{gnd} AND I_{Ns}**, the V₀-element must have picked up also for non-directional mode.


However, if a direction is programmed, the current element must be picked up and the direction determination results must be present to generate a message. Once again, a condition for valid direction determination is that the voltage element V₀ be picked up.

Parameter **PU CRITERIA** specifies, whether a fault is generated by means of the AND-function or the ORcombination of displacement voltage and pickup of the ground current. The former may be advantageous if the pickup setting of displacement voltage element V₀ was chosen to be very low.

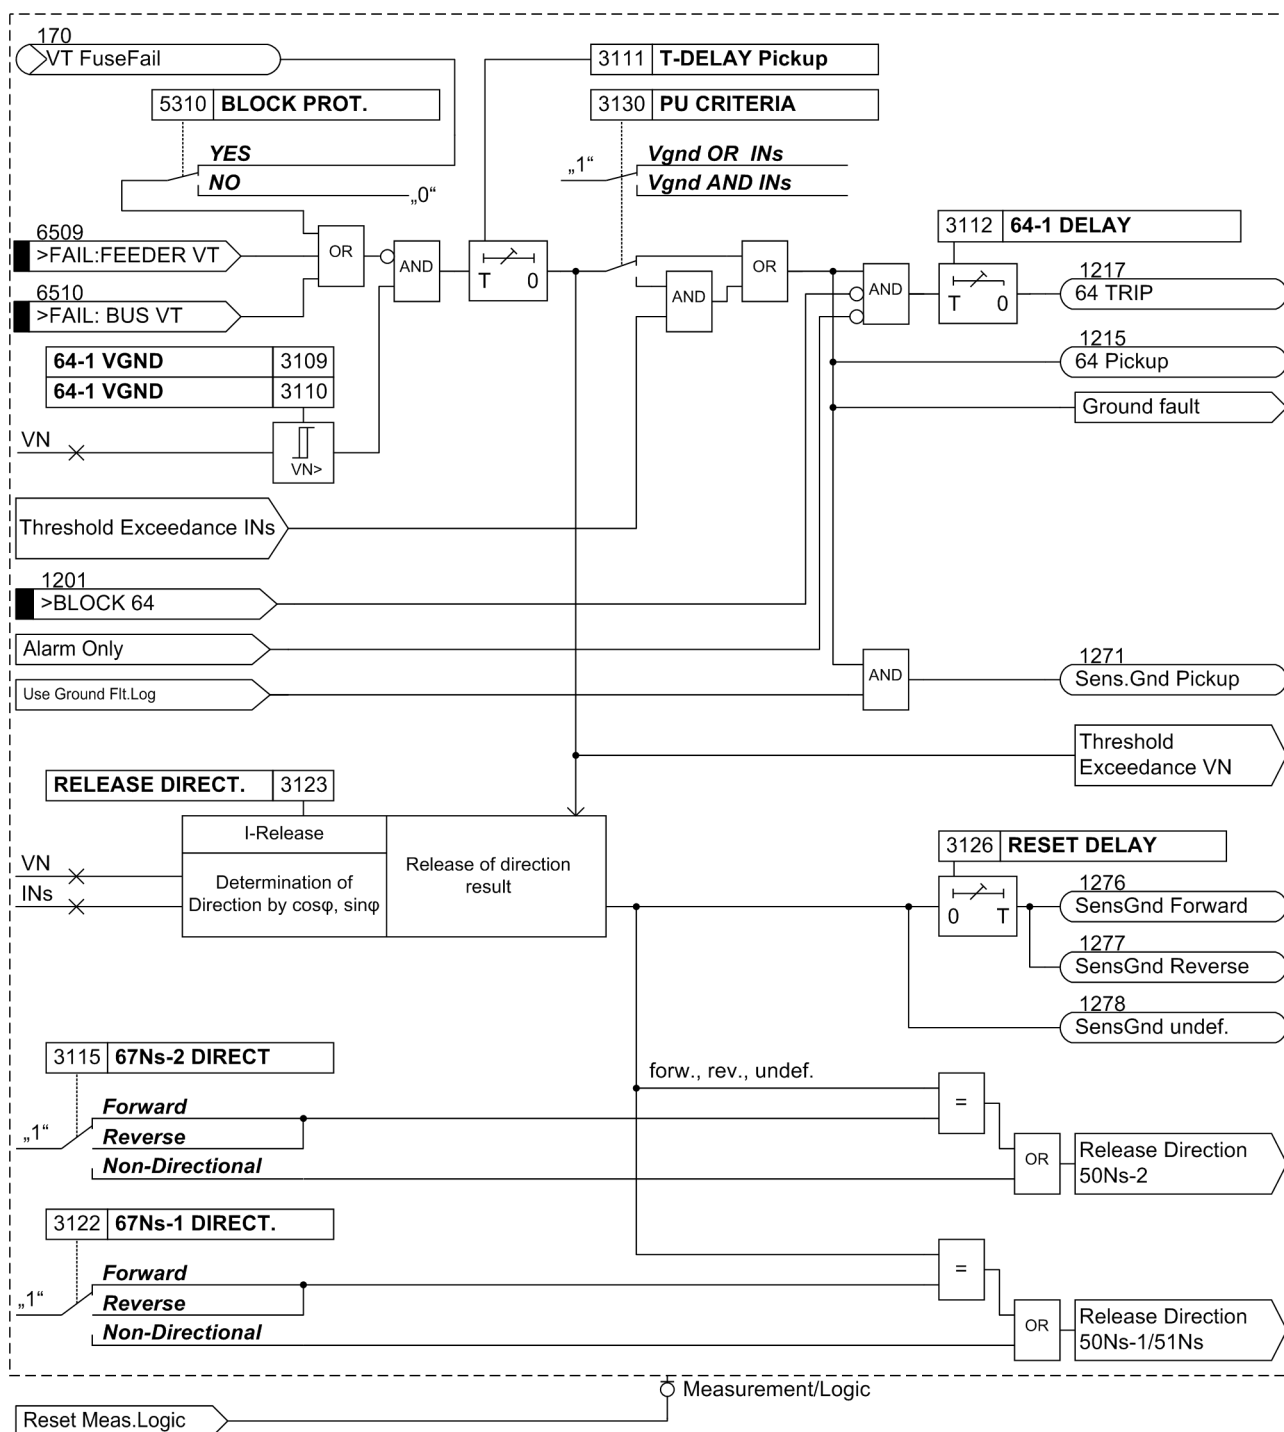

[7sj80-erdfehler-ue-cos-sin-20061206, 1, en_US]

Figure 2-70 Logic diagram of the $V_0>$ element for $\cos\phi$ / $-\sin\phi$ measurement

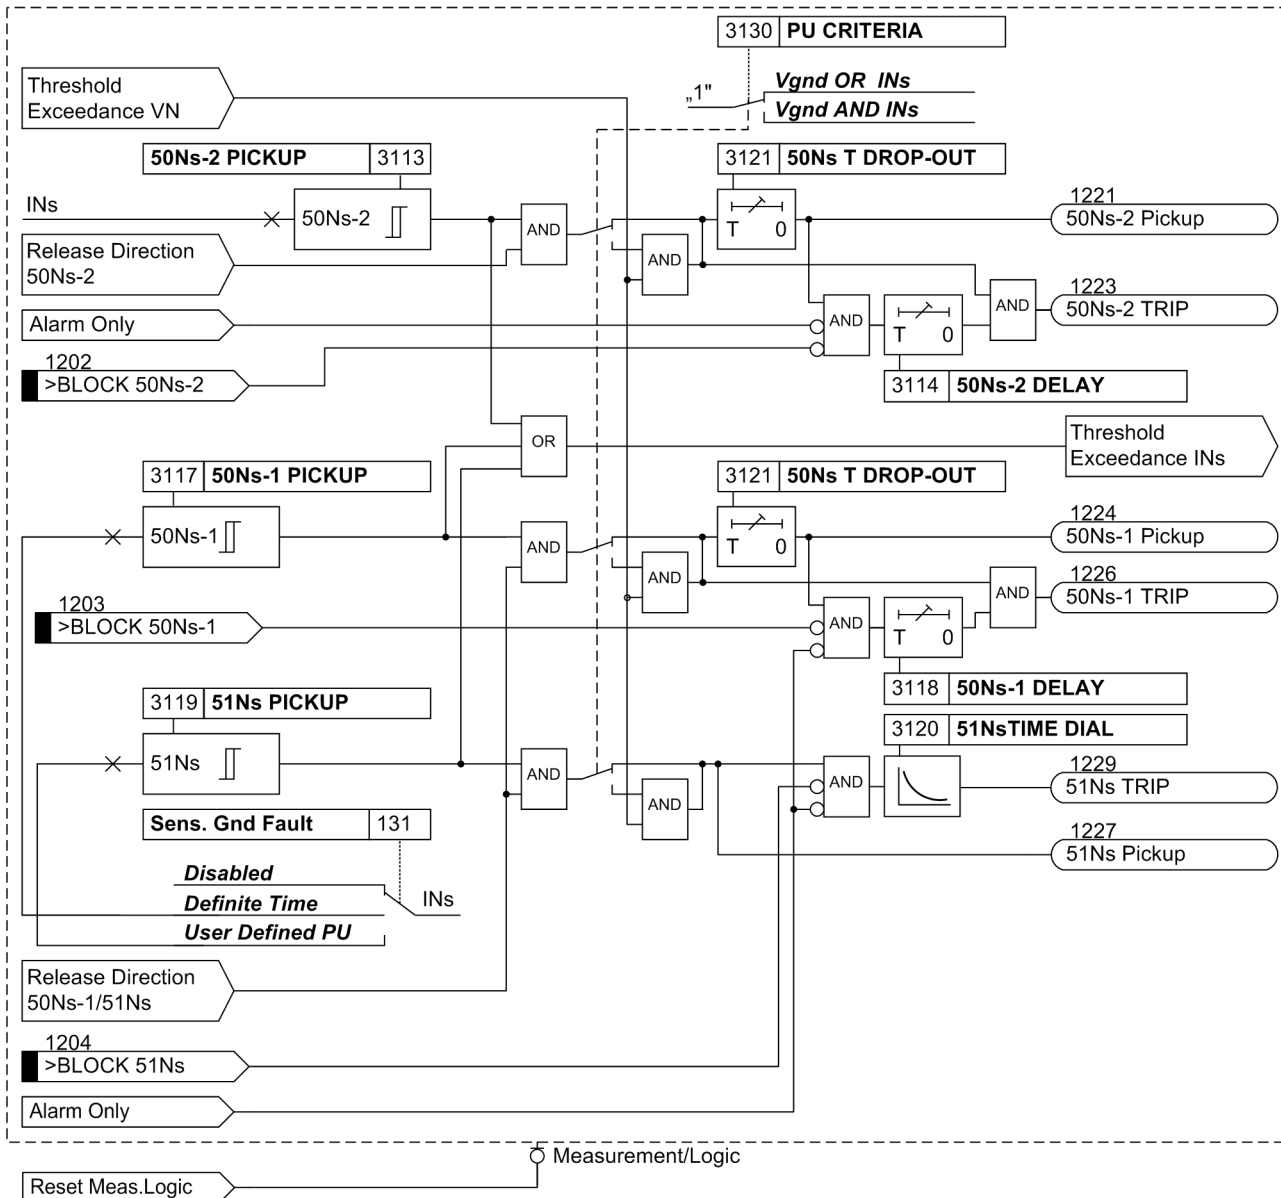

[7s]80-erdfehler-ieee-cos-sin-20061206, 1, en_US]

Figure 2-71 Logic diagram of the I_{Ns} elements for $\cos\phi$ / $\sin\phi$ measurement

2.12.2 Ground Fault Detection for V_0/I_0 - ϕ Measurement

Voltage Element

The voltage element relies on a pickup initiated by the displacement voltage V_0 or $3 \cdot V_0$. Additionally, the faulty phase is determined. The displacement voltage V_0 can be directly applied to the device, or the summation voltage $3 \cdot V_0$ can be calculated according to the connection type of the voltage transformer (see also Parameter 213 **VT Connect. 3ph** in Section 2.1.3 *Power System Data 1*). When setting V_{an} , V_{bn} , V_{cn} , the calculation of the summation voltage $3 \cdot V_0$ is based on the three phase-to-Ground voltages. The three voltage inputs must therefore be connected to the voltage transformers in a grounded-wye configuration. When setting V_{ab} , V_{bc} , V_{Gnd} , the three phase-to-Ground voltages of both connected phase-to-phase voltages and the connected displacement voltage are calculated. If the device is only provided with phase-to-phase voltages, it is not possible to calculate a displacement voltage from them. In this case, the direction cannot be determined.

If the displacement voltage is calculated, then:


$$3 \cdot \underline{V}_0 = \underline{V}_A + \underline{V}_B + \underline{V}_C$$

If the displacement voltage is directly applied to the device, then V_0 is the voltage at the device terminals. It is not affected by parameter **Vph / Vdelta** (address 206).

Pickup performed by the displacement voltage can be delayed (**64-1 DELAY**) for tripping.

It is important to note that the total trip-command time then consists of the displacement voltage measurement time (about 50 ms) plus the pickup delay time **64-1 DELAY**.

After the voltage element picks up due to detection of a displacement voltage, the grounded phase is identified, if possible. To do this, the individual phase-to-ground voltages are measured. Of course, this is only possible if three phase-to-ground voltages are obtained from voltage transformers connected in a grounded wye configuration. If the voltage magnitude for any given phase is below the setting value $V_{Ph\ min}$, that phase is detected as the grounded phase as long as the remaining phase-to-ground voltages are simultaneously above the setting value $V_{Ph\ max}$.

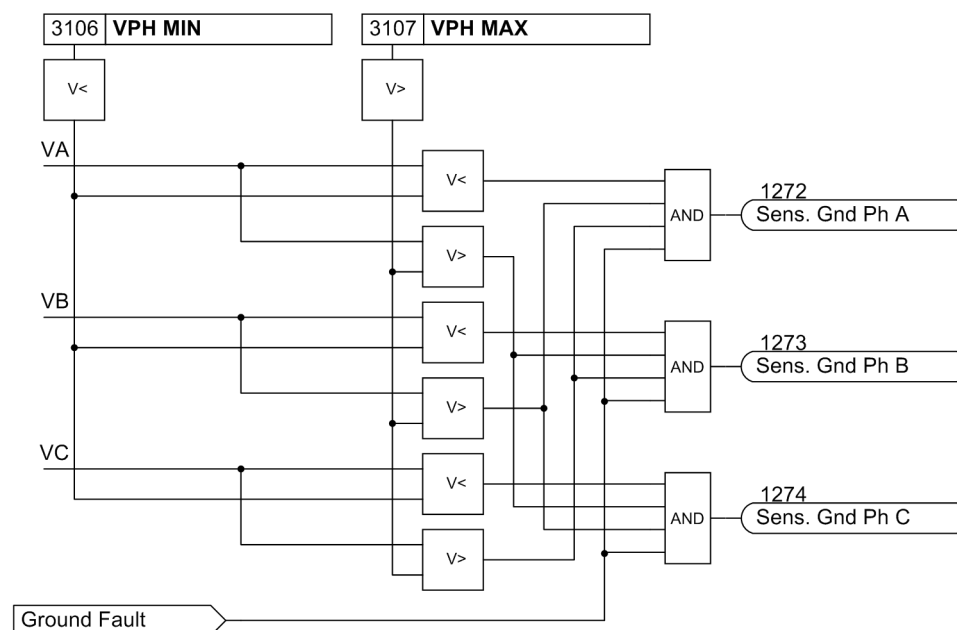

From Logic Diagram of the Sensitive Ground Fault Detection

[7sj6x_erdschlussbehaftete_phase-150502-1, 1, en_US]

Figure 2-72 Determination of Ground-faulted Phase

Current Elements

There are two current elements. Both elements operate directionally, whereby the tripping zones can be set individually for each element (see margin heading "Tripping Area"). Both current elements are provided with a definite time characteristic. Two current/time elements are used for ground fault protection. Analog to the time overcurrent protection function, the overcurrent element is named **50Ns-1 PICKUP** and **50Ns-1 DELAY** and the high-set element **50Ns-2 PICKUP** and **50Ns-2 DELAY**.

The pickup of the definite time overcurrent protection can be stabilized by the configured dropout delay time (address 3121 **50Ns T DROP-OUT**).


Tripping Area

The U0/I0-φ characteristic is illustrated as a sector in the U0/I0 phasor diagram (see [Figure 2-73](#)). This sector corresponds to the tripping area. If the cursor of the ground current is in this sector, the function picks up.

The tripping area is defined via several parameters: Via the angle φ (parameter 3154 **50Ns-1 Phi** or 3151 **50Ns-2 Phi**), the center of the zone with reference to the displacement voltage V_0 is set. Via the angle Δφ (parameter 3155 **50Ns-1 DeltaPhi** or 3152 **50Ns-2 DeltaPhi**), the zone is extended to both sides of the center.

The zone is further limited downwards by minimum values of the displacement voltage and ground current. These settable threshold values must be exceeded in order to be picked up.

Negative angle settings turn the tripping area in the “inductive” direction, i.e. ground current inductive compared to ground voltage.

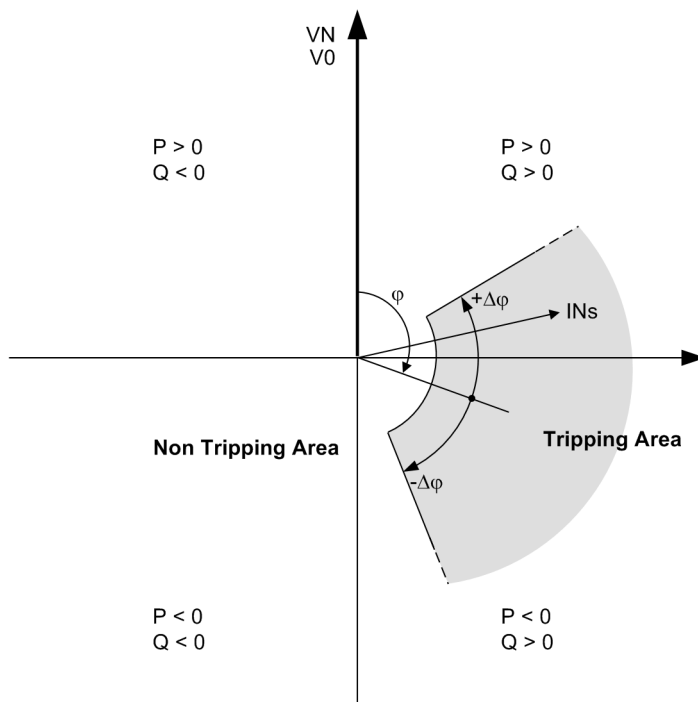

[enel-character, 1, en_US]

Figure 2-73 Tripping range of V_0 - I_0 - ϕ characteristic

Logic

The following figure illustrates the activation criteria of the sensitive ground fault protection. The operational mode of the ground fault detection can be set under address 3101.

If set to **ON**, tripping is possible and a fault log is generated.

If set to **ON with GF log**, tripping is possible, a fault log and a ground fault log are generated.

If set to **Alarm Only**, tripping is not possible and only a ground fault log is generated.

The pickup of the displacement voltage V_0 or pickup of the 50Ns-2 element or pickup of the 50Ns-1 or 51Ns element start the ground fault recording. As the pickup of the element drops out, fault recording is terminated (see the following logic diagrams).


The entire function can be blocked under the following conditions:

- A binary input is set,
- the Fuse Failure Monitor or the voltage transformer protection breaker pick up.

Switching off or blocking means that measurement is deactivated. Therefore, time delays and pickup messages are reset.


All elements can be blocked individually via binary inputs. In this case pickup and, if possible, direction and grounded phase will still be reported, however, tripping does not take place since the time elements are blocked.

To support the commissioning, a message is issued if the current and voltage threshold of an element is exceeded but the ground fault phasor is not inside of the trip range.

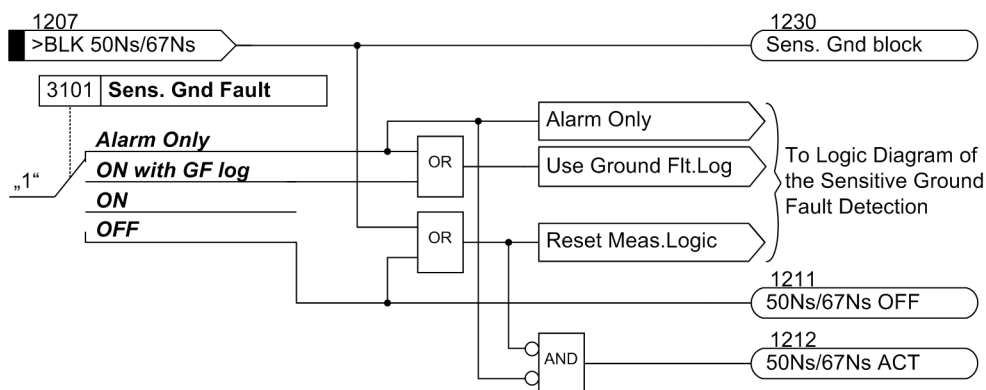


[7sj80-aktiv-empf-erdfehler-20061218, 1, en_US]

Figure 2-74 Activation of the sensitive ground fault detection for V0/I0-φ measurement

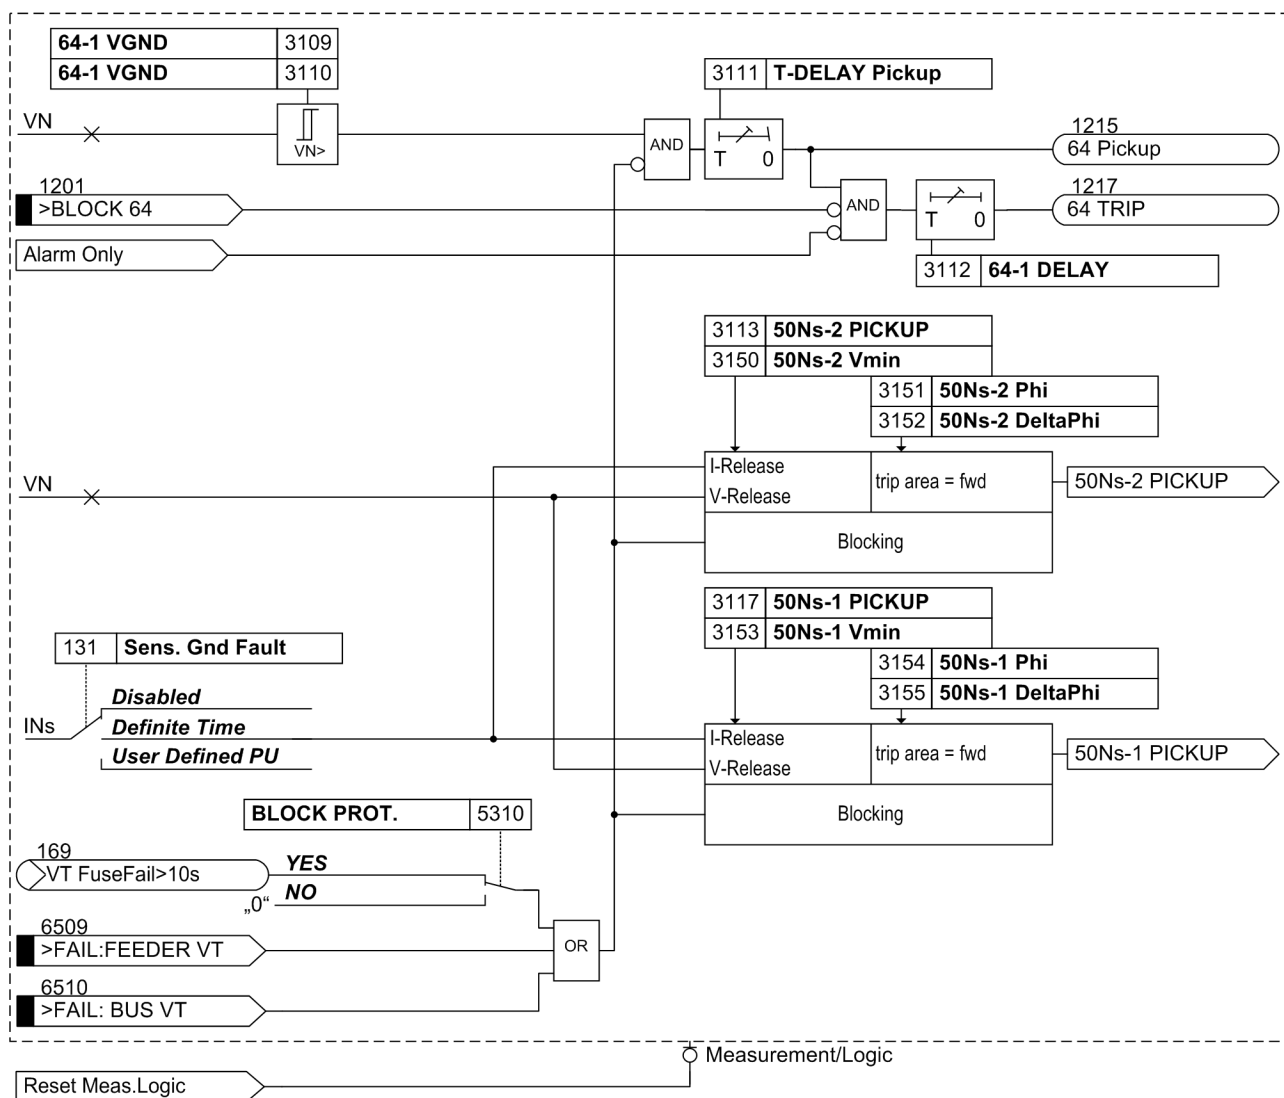

[7sj80-erdfehler-ue-u0-i0-messung-20061206, 1, en_US]

Figure 2-75 Logic diagram during V0/I0-φ measurement, part 1

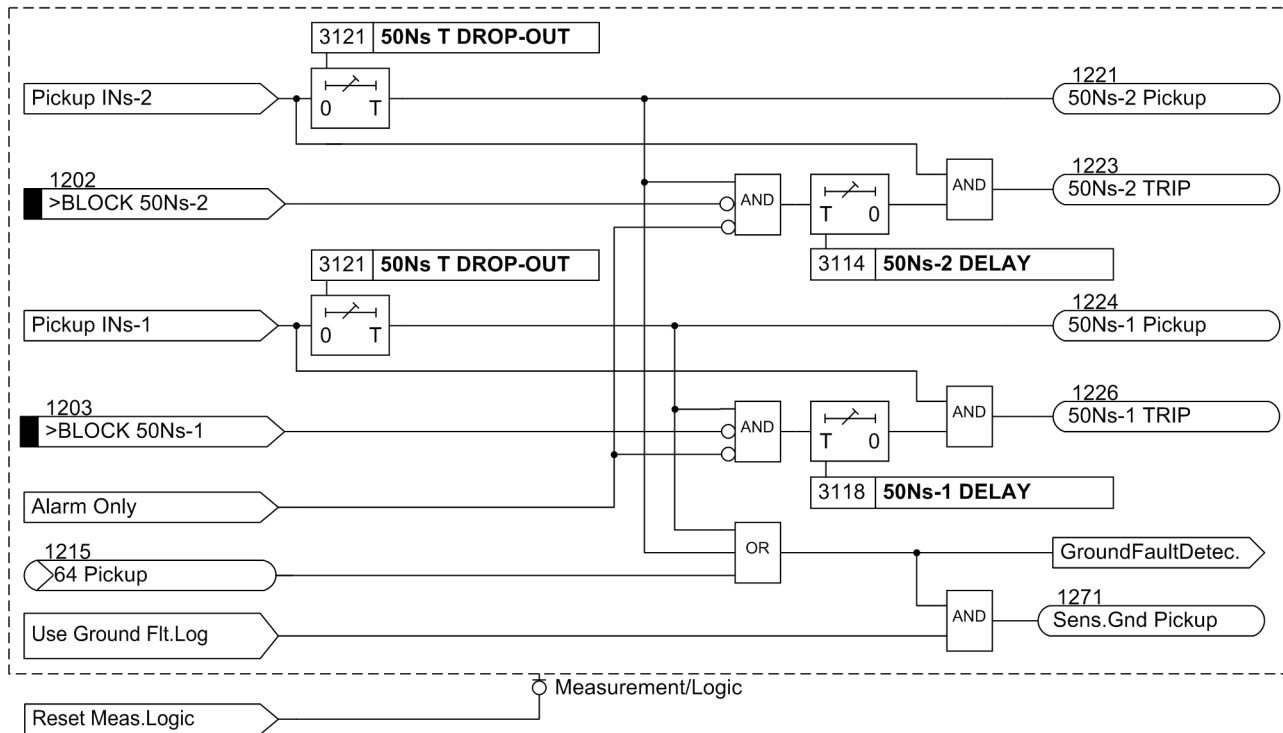

[7sj80-erdfehler-ieee-u0-i0-messung-20061206, 1, en_US]

Figure 2-76 Logic diagram for V0-I/O -φ measurement, part 2

2.12.3 Extended Ground Fault Protection EPTR/TNP


2.12.3.1 General Information

Additionally to the sensitive and non-sensitive ground-fault detection, the 7SJ80 device offers further functions for detecting ground faults in the 20-kV power system.

- Protection against ground faults in grounded feeders (EPTR)
- Protection against thermal overload of transformers with grounded neutral point (TNP)

The functions can only be used as an alternative. They work independently from the setting of address 130 **S.Gnd.F.Dir.Ch.**

The following figure shows the used input variables and the activation criteria of the functions.

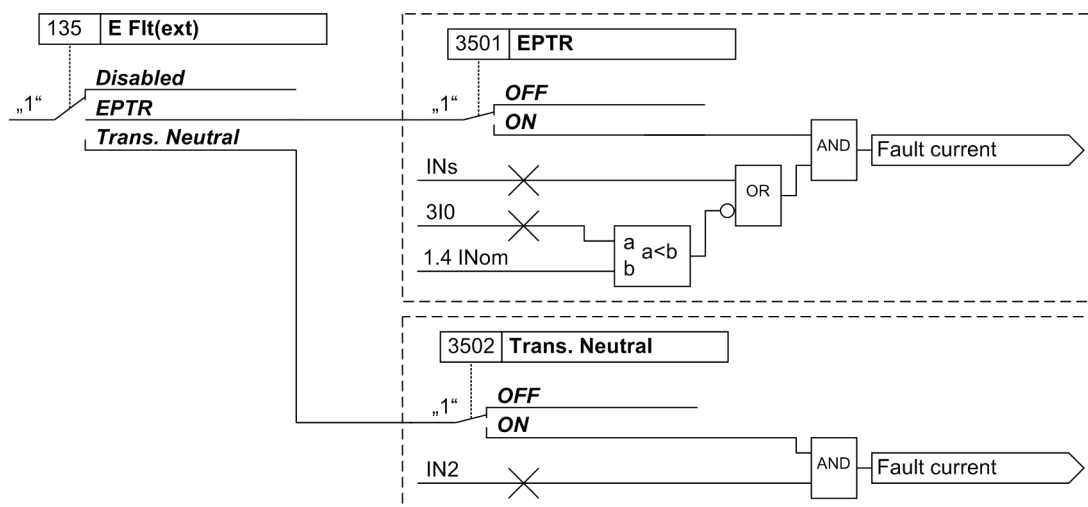

[7sj80-eptr-tss, 2, en_US]

Figure 2-77 Activation of the Functions EPTR or Transformer Neutral Point (TNP)

2.12.3.2 Ground-Fault Protection EPTR - B


For low fault currents ($< 0.95 \cdot 1.4 I_n$), the function works with the ground current measured on the 4th current input. For higher fault currents ($\geq 1.4 I_n$), the current 310 built from the phase currents is used. You can find a connection example in the Appendix ([C.1 Connection Examples for Current and Voltage Transformers](#)).

If you use the function EPTR, you must set the connection type (**CT Connect.**, address 251) to **A**, **B**, **C**, (**Gnd**).

If you use the function EPTR, you must set the connection type ([2.12.5 Setting Notes](#)). The pickup current of the function and the course of the characteristic curve can be set. You can find information on the setting values in [Section 2.12.5 Setting Notes](#).

Logic

The following figure shows the logic diagram of the function EPTR.

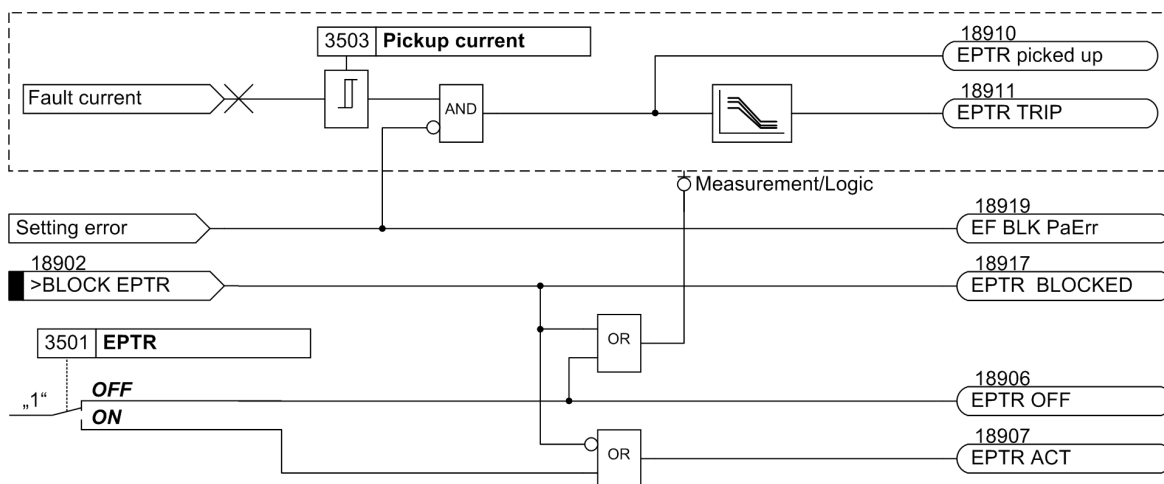

[7sj80-lo-eptr, 2, en_US]

Figure 2-78 Logic of the Ground-Fault Detection EPTR

2.12.3.3 Transformer Neutral-Point Protection TNP

General Information


The function analyzes low fault currents. The transformer neutral-point current IE2 measured on the 4th current input is used as an input variable. You can find a connection example in the Appendix ([C.1 Connection Examples for Current and Voltage Transformers, Figure C-12](#)).

If you use the function TNP, you must set the connection type (**CT Connect.**, address 251) to **A, G2, C, G;** **G->B** or **A, G2, C, G;** **G2->B**.

The Transformer neutral-point protection works in a non-directional way with an inverse-time logarithmic-inverse knee-point characteristic curve ([2.12.5 Setting Notes](#)). The pickup current of the function and the course of the characteristic curve can be set. You can find information on the setting values in Section [2.12.5 Setting Notes](#).

Logic

The following figure shows the logic diagram of the function TNP.

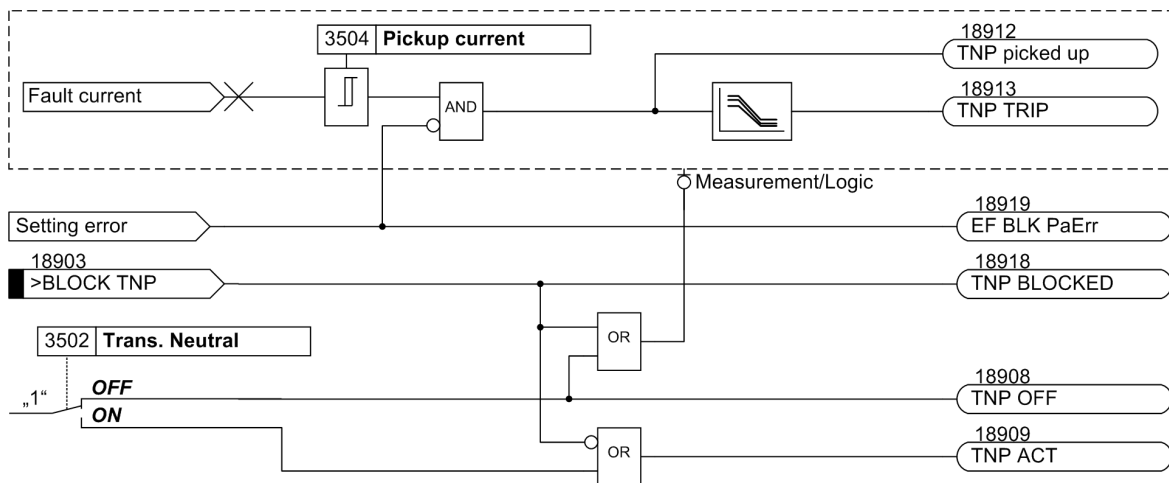


[7s]80-lo-tss, 2, en_US]

Figure 2-79 Logic of the Ground-Fault Detection for a Transformer with Grounded Neutral Point

2.12.4 Ground Fault Location

Application Example


Directional determination may often be used to locate ground faults. In radial systems, locating the ground fault is relatively simple. Since all feeders from a common bus ([Figure 2-80](#)) deliver a capacitive charging current, nearly the total ground fault current of the system is available at the measuring point of the faulty line in the ungrounded system. In the resonant grounded system it is the residual wattmetric current of the Petersen coil that flows via the measuring point. Therefore, on the faulty cables a clear "forward" decision is made whereas in other feeders either "reverse" direction is sent back or no measurement is carried out in case ground current is too low. Definitely the faulty line can be determined clearly.

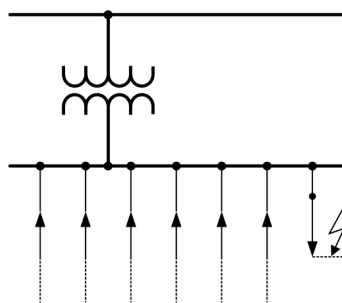

[erdschlussortung-im-strahlennetz-260602-kn, 1, en_US]

Figure 2-80 Location of ground faults in a radial network

In meshed or looped systems, the measuring points of the faulty line also receive the maximum ground fault current (residual current). Only in this line, "forward" direction is signaled at both ends (Figure 2-81). The rest of the direction indications in the system may also be useful for ground fault detection. However, some indications may not be given when the ground current is too low.

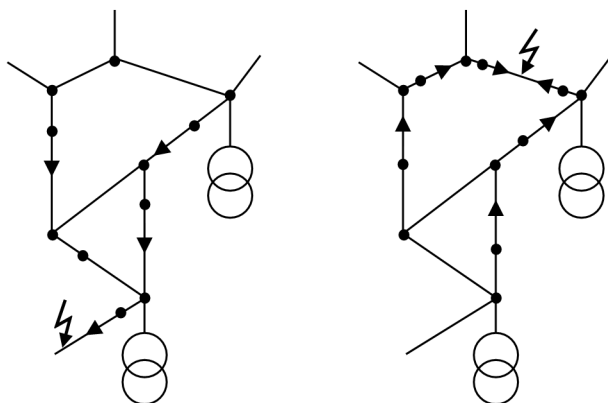

[ortung-des-erdschlusses-260602-kn, 1, en_US]

Figure 2-81 Determination of the ground fault location basing on directional indicators in the meshed system

2.12.5 Setting Notes

General Settings

During configuration of the protection functions (Section 2.1.1 *Functional Scope*, under address 131 **Sens. Gnd Fault**) it was determined with which parameters the ground fault detection is functioning.

If address **Sens. Gnd Fault = Definite Time** is selected, then the settings for the definite-time elements are available here.

If **Sens. Gnd Fault = User Defined PU** is selected, a user-specified characteristic can be used for the overcurrent protection elements 50Ns-1 or 51Ns.

The superimposed high-current element 50Ns-1 is available in all these cases.

If this function is not required, then **Disabled** is set.

The user characteristics are only available, if the standard measurement procedure $\cos \varphi / \sin \varphi$ has been set at address 130.

The characteristic for determining the direction is set at address 130 **S.Gnd.F.Dir.Ch.** It is optional to select either the standard measurement method $\cos \varphi / \sin \varphi$ or the $V0/I0 \varphi mea.$ with one sector characteristic.

At address 3101 **Sens. Gnd Fault**, the function **ON** or **OFF** can be set to either **ON with GF log** or **Alarm Only**. If settings **ON** and **ON with GF log** are applied, tripping is also possible, otherwise a fault log is created. A ground fault log is created for **ON with GF log** and **Alarm Only**. Setting **ON with GF log** is only available if characteristic $V0/I0 \varphi mea.$ has been selected at address 130 **S.Gnd.F.Dir.Ch.**

The parameters 3111 **T-DELAY Pickup** and 3130 **PU CRITERIA** are only visible if the standard measurement method $\cos \varphi / \sin \varphi$ has been selected when setting the direction characteristic. The ground fault is detected and reported when the displacement voltage was sustained a certain time **T-DELAY Pickup**). Address 3130 **PU CRITERIA** specifies whether ground fault detection is enabled only for pickups of V_N and I_{NS} (**Vgnd AND INs**) or as soon as one of the two has picked up (**Vgnd OR INs**).

The pickup can be stabilized for ground fault protection with definite time curve by a settable dropout time delay (address 3121 **50Ns T DROP-OUT**). This facility is used in power systems with intermittent faults. Used together with electro-mechanical relays, it allows different dropout responses to be adjusted and time grading of digital and electro-magnetic relays to be implemented. The setting depends on the dropout time delay of the electro-magnetic relay. If no coordination is required, the preset value (zero = no dropout time delay) remains.



NOTE

Please note that under address 213 **VT Connect. 3ph** the connection type of the voltage transformer **Van, Vbn, Vcn** or **Vab, Vbc, VGnd** must be set. Additionally, adjustment factor **Vph/Vdelta** for the displacement voltage must be set correctly under address 206. Depending on the type of connection of the current transformer, the primary and secondary rated current in the ground path must be set under address 217 and 218, and, if required, the primary and secondary rated current of the second ground current transformer must be set under address 238 and 239.

Overcurrent Elements Definite Time/Inverse Time

A two-element current/time characteristic can be set at addresses 3113 to 3120. These elements operate with the amounts of the ground current. They are therefore only useful where the magnitude of the ground current and maybe its direction can be used to specify the ground fault. This may be the case for grounded systems (solid or low-resistance) or on electrical machines connected to the busbar of an ungrounded power system, when in case of a network ground fault the machine supplies only a negligible ground fault current across the measurement location, which must be situated between the machine terminals and the network, whereas in case of a machine ground fault the total ground fault current produced by the total network is available.

User-defined characteristic (Inverse Time)

User-defined characteristics are only used for the standard measurement method $\cos \varphi / \sin \varphi$ (address 130 **S.Gnd.F.Dir.Ch**). During configuration of a user-defined characteristic, it should be noted that there is a safety factor of approx. 1.1 between pickup and setting value - as is standard for inverse curves. This means that pickup will only be initiated when current of 1.1 times the setting value flows.

The value pairs (current and time) are entered as multiples of the values at addresses 3119 **51Ns PICKUP** and 3120 **51NsTIME DIAL**. Therefore, it is recommended that these addresses are initially set to 1.00 for simplicity reasons. Once the curve has been entered, the settings at addresses 3119 and/or 3120 can be modified if necessary.

The default setting of current values is ∞ . They are, therefore, not enabled — and no pickup or tripping of these protective functions will occur.

Up to 20 value pairs (current and time) may be entered at address 3131 **M.of PU TD**. The device then approximates the characteristic, using linear interpolation.

The following must be observed:

- The value pairs should be entered in increasing sequence. If desired, fewer than 20 pairs can be entered. In most cases, about 10 pairs is sufficient to define the characteristic accurately. A value pair which will not be used has to be made invalid by entering " ∞ " for the threshold! The user must ensure that the value pairs produce a clear and constant characteristic


The current values entered should be those from [Table 2-11](#), along with the matching times. Deviating values I/I_p are rounded. This, however, will not be indicated.

Current below the current value of the smallest curve point will not lead to an extension of the tripping time. The pickup curve (see [Figure 2-82](#)) continues, from the smallest current point parallel to the current axis.

Current flows greater than the highest current value entered will not result in a reduced tripping time. The pickup curve (see [Figure 2-82](#)) continues, from the highest current point parallel to the current axis.

Table 2-11 Preferential Values of Standardized Currents for User-specific Tripping Curves

MofPU = 1 to 1.94		MofPU = 2 to 4.75		MofPU = 5 to 7.75		MofPU = 8 to 20	
1.00	1.50	2.00	3.50	5.00	6.50	8.00	15.00
1.06	1.56	2.25	3.75	5.25	6.75	9.00	16.00
1.13	1.63	2.50	4.00	5.50	7.00	10.00	17.00
1.19	1.69	2.75	4.25	5.75	7.25	11.00	18.00
1.25	1.75	3.00	4.50	6.00	7.50	12.00	19.00
1.31	1.81	3.25	4.75	6.25	7.75	13.00	20.00
1.38	1.88					14.00	
1.44	1.94						

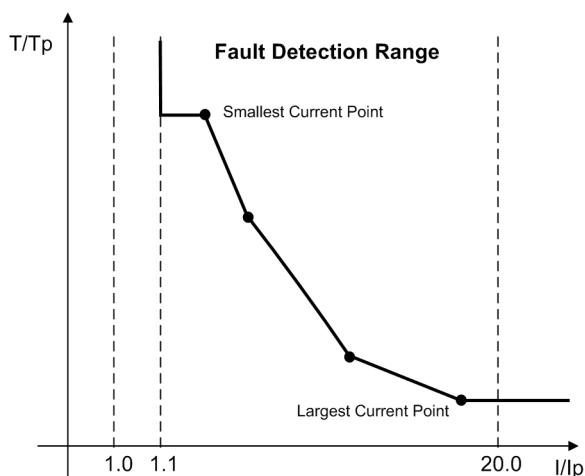

[verwendung-einer-anwenderspezifischen-kennlinie-260602-ken, 1, en_US]

Figure 2-82 Use of a user-defined characteristic

Determination of Ground-Faulted Phase

The ground-faulted phase may be identified in an ungrounded or resonant-grounded system, if the device is supplied by three voltage transformers connected in a grounded-wye configuration. The phase in which the voltage lies below setting **VPH MIN** at address 3106 is identified as the faulty phase as long as the other two phase voltages simultaneously exceed the setting **VPH MAX** at address 3107. The setting **VPH MIN** must be set less than the minimum expected operational phase-to-ground voltage. A typical setting for this address would be 40 V. Setting **VPH MAX** must be greater than the maximum expected operational phase-to-ground voltage, but less than the minimum expected operational phase-to-phase voltage. For $V_{Nom} = 100$ V, approximately 75 V is a typical setting. These settings have no significance in a grounded system.

Displacement Voltage Element V_0

The displacement voltage **64-1 VGND** (address 3109) or **64-1 VGND** (address 3110) is used to pick up ground fault detection. At the same time, pickup of the voltage element is a condition for initiation of direction determination (when setting the direction characteristic to *cos φ / sin φ*). If the direction characteristic is set to *V0/I0 φ mea.*, the displacement voltage element is not relying on the current elements at all. Depending on the configuration at address 213 **VT Connect. 3ph**, only the applicable limit value at address 3109 **64-1 VGND** or 3110 **64-1 VGND** is accessible.

If two phase-to-phase voltages and the displacement voltage V_0 are supplied to the device, the measured displacement voltage is used directly for ground fault recognition. The threshold for V_0 is set at address 3109 **64-1 VGND**, where a more sensitive setting can be made than with a calculated displacement voltage.

Please note that when the V_0 voltage is connected, the factor (normally = 1.73; see also Section [2.1.3.2 Setting Notes](#)) specified with parameter 206 **Vph/Vdelta** is used. For display of parameter 3109 **64-1 VGND** in primary values, the following conversion formula applies:

$$V_{N \text{ prim}} = V_{ph/Vdelta} \cdot \frac{V_{nom \text{ primary}}}{V_{nom \text{ secondary}}} \cdot V_{N \text{ sec}}$$

[formel-uenprim-uensek-120503-kn, 1, en_US]

If three phase-to-ground voltages are connected to the device, the displacement voltage $3 \cdot V_0$ is calculated from the momentary values of phase-to-ground voltages, and address 3110 is where the threshold is to be set. For the display of parameter 3110 in primary values, the following applies:

$$3V0_{\text{prim}} = \frac{V_{nom \text{ Primary}}}{V_{nom \text{ Secondary}}} \cdot 3V0_{\text{sec}}$$

[formel-3u0prim-3u0sek-120503-kn, 1, en_US]

If the secondary values of (for example) parameters 3109 and 3110 are set equally, then their primary values differ by adjustment value **Vph/Vdelta**.

Example:

Parameter 202	Vnom PRIMARY	= 12 kV
Parameter 203	Vnom SECONDARY	= 100 V
Parameter 206	Vph/Vdelta	= 1.73
Parameter 213	VT Connect. 3ph	= Vab, Vbc, VGnd
Parameter 3109	64-1 VGND	= 40 V

The following applies when switching to primary values:

$$3109 \quad VGND \text{ (measured)} = 40 \text{ V} \cdot 1.73 \cdot \frac{12 \text{ kV}}{100 \text{ V}} = 8.3 \text{ kV}$$

[beispiel-uen-83kv-130503-kn, 1, en_US]

With the following configuration

Parameter 213	VT Connect. 3ph	= Van, Vbn, Vcn
Parameter 3110	64-1 VGND	= 40 V

the following applies when switching to primary values:

$$3110 \quad VGND \text{ calculated} = 40 \text{ V} \cdot \frac{12 \text{ kV}}{100 \text{ V}} = 4.8 \text{ kV}$$

[beispiel-3u0-48kv-130503-kn, 1, en_US]

With regard to a ground fault in a ungrounded or resonant-grounded system, nearly the entire displacement voltage appears at the device terminals, therefore the pickup setting is not critical, and typically lies between

30 V and 60 V (for **64-1 VGND** with a standard V_0 -connection) or 50 V and 100 V (for **64-1 VGND**). Large fault resistances may require higher sensitivity (i.e. a lower pickup setting).

With regard to a grounded system, a more sensitive (lower) pickup value may be set, but it must be above the maximum anticipated displacement voltage during normal (unbalanced) system operation.

Pickup of just the voltage element may initiate time delayed tripping assumed that ground fault detection is configured to perform tripping (address 3101 **Sens. Gnd Fault = ON or ON with GF log**) and moreover address 3130 **PU CRITERIA** is configured **Vgnd OR INs**. The tripping delay is then set at address 3112 **64-1 DELAY**. It is important to note that the total tripping time consists of the displacement voltage measurement time (about 50 ms) plus the pickup time delay (address 3111 **T-DELAY Pickup**) plus the tripping time delay (address 3112 **64-1 DELAY**).

Direction Determination for $\cos\phi$ / $\sin\phi$

Addresses 3115 to 3126 are important for direction determination.

Address 3115 **67Ns-2 DIRECT** determines the direction of the definite high-set current element 50Ns-2 and can be set to either **Forward** or **Reverse** or **Non-Directional**, i.e. to both directions. The direction of the current element 50Ns-1 or 51Ns can be set to **Forward** or **Reverse** or **Non-Directional**, i.e. to both directions, at address 3122 **67Ns-1 DIRECT**.

Current value **RELEASE DIRECT**. (address 3123) is the release threshold for directional determination. It is based on the current components which are perpendicular to the directional limit lines. The position of the directional limit lines themselves are based on the settings entered at addresses 3124 and 3125.


The following applies to the determination of direction during ground faults: The pickup current 310 DIR. (=RELEASE DIRECT. address 3123) must be set as high as possible to avoid false pickup of the device provoked by asymmetrical currents in the system and by current transformers (especially in the Holmgreen-connection).

If direction determination is used in conjunction with one of the current elements discussed above (**50Ns-1 PICKUP**, addresses 3117 ff, or **51Ns PICKUP**, addresses 3119 ff), it is sensible to select a value for address **RELEASE DIRECT**. that is lower than or equal to the above pickup value.

A corresponding message (reverse, forward, or undefined) is issued upon direction determination. To avoid chatter for this message resulting from extremely varying ground connection currents, a dropout delay **RESET DELAY**, entered at address 3126, is initiated when directional determination drops out, and the message is held for this period of time.

When address 3124 **PHI CORRECTION** is set to **0.0°**, in address 3125 the following signifies

- **MEAS. METHOD = COS ϕ**
the resistive component of the ground current with respect to the displacement voltage is most relevant for the current value **RELEASE DIRECT**. (310 DIR.),
MEAS. METHOD = SIN ϕ
the reactive (capacitive) component of the ground current with respect to the displacement voltage is most relevant for the current value **RELEASE DIRECT**. (310 DIR.) ([Figure 2-83](#)).

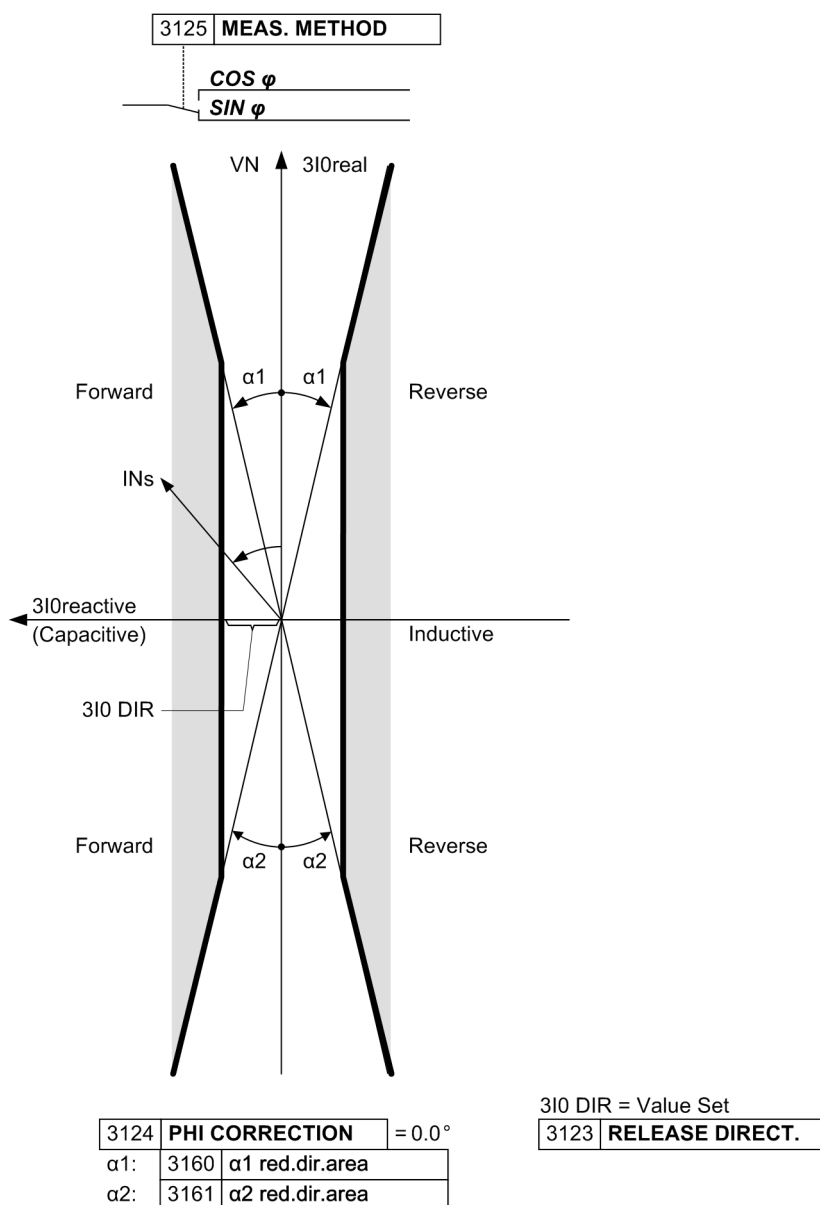

[7sj6-richtkennl-bei-sin-mess-20110113, 1, en_US]

Figure 2-83 Directional characteristic for $\sin\phi$ -measurement

- In address 3124 **PHI CORRECTION** the directional line, in this respect, may be rotated within the range $\pm 45^\circ$. [Figure 2-68](#) "Directional characteristic for $\cos\phi$ -measurement" in the functional description of the sensitive ground fault detection gives an example regarding this topic.

The forward and reverse zone can be reduced at its boundaries at address 3160 **α1 red.dir.area** and address 3161 **α2 red.dir.area** (see [Figure 2-83](#)). Siemens recommends using the default setting of 2° (this corresponds to the behavior of versions without this setting option). In a grounded system in feeders with very high capacitive current, it can be reasonable to set a slightly larger angle α_1 to prevent erroneous pickup due to transformer and algorithm tolerances.

Direction Determination for $V0/I0 \phi$ Measurement

With the minimum voltage **50Ns-2 Vmin**, address 3150 and the level of the pickup current **50Ns-2 PICKUP**, address 3113, the lower limit of the circuit segment of element 50Ns-2 is set. The thresholds of the tripping range in respect of the displacement voltage is set by means of the matching phase angle **50Ns-2**

Phi, address 3151 and angle **50Ns-2 DeltaPhi**, address 3152. The trip delay time is set under address 3114 **50Ns-2 DELAY**. The actual settings are based on the respective application.

The minimum voltage **50Ns-1 Vmin** of the high-current element 50Ns-1 is set under address 3153, the pickup current **50Ns-1 PICKUP** under 3117. The respective phase angle **50Ns-1 Phi** is set under address 3154, the angle **50Ns-1 DeltaPhi** is entered under address 3155. The angle should be set to 180° so that the element functions non-directionally. The trip delay time is set under address 3118 **50Ns-1 DELAY**.

Positive angle settings (address 3151 and 3154) turn the tripping area in the „capacitive“ direction, i.e. ground current capacitive compared to ground voltage.

Negative angle settings turn the tripping area in the „inductiv“ direction, i.e. ground current inductive compared to ground voltage.

Angular Error Compensation (I Transformer)

The high reactive component in a resonant grounded system and the inevitable air gap of the toroidal current transformer often require the angle error of the toroidal current transformer to be compensated. In addresses 3102 to 3105 the maximum angle error **CT Err. F1** and the associated secondary current **CT Err. I1** as well as another operating point **CT Err. F2/CT Err. I2** are set for the actually connected burden. The device thus approximates the transformation characteristic of the transformer with considerable accuracy. In ungrounded or grounded systems angle compensation is not required.

Ungrounded System

In an ungrounded system with a ground fault on a cable, capacitive ground currents of the galvanically connected system flow via the measuring point, except for the ground current generated in the grounded cable, since the current last-mentioned will flow directly to the fault location (i.e. not via the measuring point). A setting equal to about half the ground current is to be selected. The measurement method should be **SIN ϕ** , since capacitive ground current is most relevant here.

Resonant-Grounded System

In resonant-grounded systems, directional determination on the occurrence of a ground fault is more difficult since the low residual wattmetric current for measurement is usually dwarfed by a reactive current (be it capacitive or inductive) which is much higher. Therefore, depending on the system configuration and the position of the arc-compensating coil, the total ground current supplied to the device may vary considerably in its values with regard to magnitude and phase angle. The relay, however, must evaluate only the active component of the ground fault current, that is, $I_{Ns} \cos \phi$. This demands extremely high accuracy, particularly with regard to phase angle measurement of all instrument transformers. Furthermore, the device must not be set to operate too sensitive. When applying this function in resonant-grounded systems, a reliable direction determination can only be achieved when toroidal current transformers are connected. Here the following rule of thumb applies: Set pickup values to about half of the expected measured current, thereby considering only the residual wattmetric current. Residual wattmetric current predominantly derives from losses of the Petersen coil. Here, the **COS ϕ** measurement method is used since the resistive residual wattmetric current is most relevant.

Grounded System

In grounded systems, a value is set below the minimum anticipated ground fault current. It is important to note that 310 DIR (current value **RELEASE DIRECT.**) only detects the current components that are perpendicular to the directional limit lines defined at addresses 3124 and 3125. **COS ϕ** is the method of measurement used, and the correction angle is set to **-45°**, since the ground fault current is typically resistive-inductive (right section of Figure 2-81 "Directional curve for cos- ϕ -measurement" in the functional description of the sensitive ground fault detection).

Electrical Machines

One may set the value **COS ϕ** for the measurement method and use a correction angle of **+45°** for electrical motors supplied from a busbar in an ungrounded system, since the ground current is often composed of an overlap of the capacitive ground current from the system and the resistive current of the load resistance (left

part of Figure "Directional characteristic for $\cos\phi$ -measurement" in the functional description of the sensitive ground fault detection).

Information on the Configuration of the Current Threshold

With devices with sensitive ground fault input, generally settings may be entered in primary values with consideration given to the ratio of the applicable current transformer. However, problems related to the resolution of the pickup currents can occur when very small settings and small nominal primary currents are involved. The user is therefore encouraged to enter settings for the sensitive ground fault detection in secondary values.

EPTR, TNP - General Information

The function EPTR is switched on or off at address 3501 **EPTR**.

The function TNP is switched on or off at address 3502 **Trans. Neutral**.

You can switch between the functions using the connection-type setting **CT Connect.**, address 251). If **A, B, C, (Gnd)** is set, EPTR works. If **A, G2, C, G; G→B** or **A, G2, C, G; G2→B** is set, TNP works.

EPTR, TNP - Logarithmic-Inverse Knee-Point Characteristic Curve (AMZ)

The logarithmic-inverse characteristic curve for **EPTR** is set at the following addresses:

3503 **Pickup current**

3505 **EPTR I Tmax**, pickup current with maximum delay

3507 **EPTR I Tmin**, pickup current with minimum delay

3509 **EPTR I Tknee**, current at the knee-point

3511 **T knee**, tripping time for the knee-point, the transition of the 2 characteristic-curve sections with different slope.

3512 **T min**, minimum delay when the current threshold **EPTR I Tmin** picks up.

3513 **T max**, picks up **EPTR I Tmax** picks up

T min and **T max** determine the range of the tripping time.

The logarithmic-inverse characteristic curve for **TNP** is set at the following addresses:

3504 **Pickup current**

3506 **TNP I Tmax**, pickup current with maximum delay

3508 **TNP I Tmin**, pickup current with minimum delay

3510 **TNP I Tknee**, Strom an Kniepunkt


3511 **T knee**, tripping time for the knee-point, the transition of the 2 characteristic-curve sections with different slope.

3512 **T min**, minimum delay when the current threshold **TNP I Tmin** picks up.

3513 **T max**, maximum delay when the current threshold **TNP I Tmax** picks up.

T min and **T max** determine the range of the tripping time.

With address 3514 **T Function** you set the time delay for the complete function.

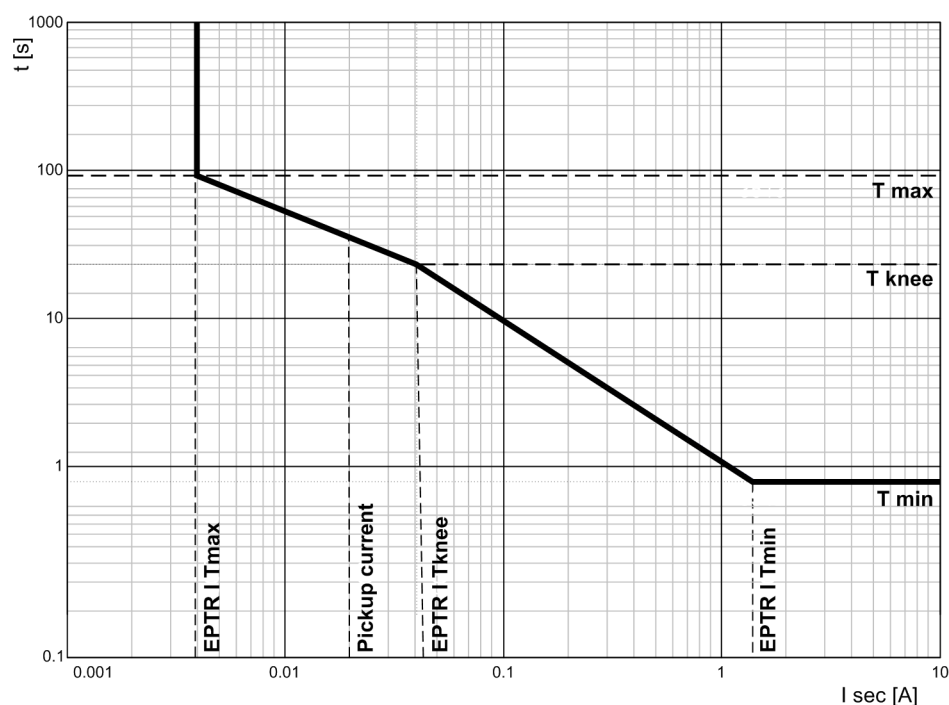

[7SJ80_knickpkt-kennlinie, 1, en_US]

Figure 2-84 Tripping Time Characteristic Curves of the Inverse-Time Ground-Fault Protection with Logarithmic-Inverse Knee-Point Characteristic Curve, Example EPTR

2.12.6 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
3101	Sens. Gnd Fault		OFF ON ON with GF log Alarm Only	OFF	(Sensitive) Ground Fault
3102	CT Err. I1	1A	0.001 .. 1.600 A	0.050 A	Current I1 for CT Angle Error
		5A	0.005 .. 8.000 A	0.250 A	
3102	CT Err. I1	1A	0.05 .. 35.00 A	1.00 A	Current I1 for CT Angle Error
		5A	0.25 .. 175.00 A	5.00 A	
3103	CT Err. F1		0.0 .. 5.0 °	0.0 °	CT Angle Error at I1
3104	CT Err. I2	1A	0.001 .. 1.600 A	1.000 A	Current I2 for CT Angle Error
		5A	0.005 .. 8.000 A	5.000 A	
3104	CT Err. I2	1A	0.05 .. 35.00 A	10.00 A	Current I2 for CT Angle Error
		5A	0.25 .. 175.00 A	50.00 A	
3105	CT Err. F2		0.0 .. 5.0 °	0.0 °	CT Angle Error at I2
3106	VPH MIN		10 .. 100 V	40 V	L-Gnd Voltage of Faulted Phase Vph Min
3107	VPH MAX		10 .. 100 V	75 V	L-Gnd Voltage of Unfaulted Phase Vph Max
3109	64-1 VGND		1.8 .. 200.0 V; ∞	40.0 V	64-1 Ground Displacement Voltage

Addr.	Parameter	C	Setting Options	Default Setting	Comments
3110	64-1 VGND		10.0 .. 225.0 V; ∞	70.0 V	64-1 Ground Displacement Voltage
3111	T-DELAY Pickup		0.04 .. 320.00 sec; ∞	1.00 sec	Time-DELAY Pickup
3112	64-1 DELAY		0.10 .. 40000.00 sec; ∞	10.00 sec	64-1 Time Delay
3113	50Ns-2 PICKUP	1A	0.001 .. 1.600 A	0.300 A	50Ns-2 Pickup
		5A	0.005 .. 8.000 A	1.500 A	
3113	50Ns-2 PICKUP	1A	0.05 .. 35.00 A	10.00 A	50Ns-2 Pickup
		5A	0.25 .. 175.00 A	50.00 A	
3114	50Ns-2 DELAY		0.00 .. 320.00 sec; ∞	1.00 sec	50Ns-2 Time Delay
3115	67Ns-2 DIRECT		Forward Reverse Non-Directional	Forward	67Ns-2 Direction
3117	50Ns-1 PICKUP	1A	0.001 .. 1.600 A	0.100 A	50Ns-1 Pickup
		5A	0.005 .. 8.000 A	0.500 A	
3117	50Ns-1 PICKUP	1A	0.05 .. 35.00 A	2.00 A	50Ns-1 Pickup
		5A	0.25 .. 175.00 A	10.00 A	
3118	50Ns-1 DELAY		0.00 .. 320.00 sec; ∞	2.00 sec	50Ns-1 Time delay
3119	51Ns PICKUP	1A	0.001 .. 1.400 A	0.100 A	51Ns Pickup
		5A	0.005 .. 7.000 A	0.500 A	
3119	51Ns PICKUP	1A	0.05 .. 4.00 A	1.00 A	51Ns Pickup
		5A	0.25 .. 20.00 A	5.00 A	
3120	51NsTIME DIAL		0.10 .. 4.00 sec; ∞	1.00 sec	51Ns Time Dial
3121A	50Ns T DROP-OUT		0.00 .. 60.00 sec	0.00 sec	50Ns Drop-Out Time Delay
3122	67Ns-1 DIRECT.		Forward Reverse Non-Directional	Forward	67Ns-1 Direction
3123	RELEASE DIRECT.	1A	0.001 .. 1.200 A	0.010 A	Release directional element
		5A	0.005 .. 6.000 A	0.050 A	
3123	RELEASE DIRECT.	1A	0.05 .. 30.00 A	0.50 A	Release directional element
		5A	0.25 .. 150.00 A	2.50 A	
3124	PHI CORRECTION		-45.0 .. 45.0 °	0.0 °	Correction Angle for Dir. Determination
3125	MEAS. METHOD		COS ϕ SIN ϕ	COS ϕ	Measurement method for Direction
3126	RESET DELAY		0 .. 60 sec	1 sec	Reset Delay
3130	PU CRITERIA		Vgnd OR INs Vgnd AND INs	Vgnd OR INs	Sensitive Ground Fault PICKUP criteria
3131	M.of PU TD		1.00 .. 20.00 MofPU; ∞ 0.01 .. 999.00 TD		Multiples of PU Time-Dial
3150	50Ns-2 Vmin		10.0 .. 90.0 V	10.0 V	50Ns-2 minimum voltage
3150	50Ns-2 Vmin		0.4 .. 50.0 V	2.0 V	50Ns-2 minimum voltage
3151	50Ns-2 Phi		-180.0 .. 180.0 °	-90.0 °	50Ns-2 angle phi
3152	50Ns-2 DeltaPhi		0.0 .. 180.0 °	30.0 °	50Ns-2 angle delta phi
3153	50Ns-1 Vmin		10.0 .. 90.0 V	15.0 V	50Ns-1 minimum voltage
3153	50Ns-1 Vmin		0.4 .. 50.0 V	6.0 V	50Ns-1 minimum voltage
3154	50Ns-1 Phi		-180.0 .. 180.0 °	-160.0 °	50Ns-1 angle phi
3155	50Ns-1 DeltaPhi		0.0 .. 180.0 °	100.0 °	50Ns-1 angle delta phi

Addr.	Parameter	C	Setting Options	Default Setting	Comments
3160	$\alpha 1$ red.dir.area		1 .. 15 °	2 °	Alpha1 (reduction directional area)
3161	$\alpha 2$ red.dir.area		1 .. 15 °	2 °	Alpha2 (reduction directional area)

2.12.7 Settings EPTR, TNP

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
3501	EPTR		OFF ON	OFF	EPTR
3502	Trans. Neutral		OFF ON	OFF	Transformer Neutral protection(TNP)
3503	Pickup current	1A	0.001 .. 1.400 A	0.008 A	Pickup current
		5A	0.005 .. 7.000 A	0.040 A	
3504	Pickup current		0.05 .. 4.00 A	0.12 A	Pickup current
3505	EPTR I Tmax	1A	0.001 .. 1.400 A	0.008 A	Current at Maximum Time Delay
		5A	0.005 .. 7.000 A	0.040 A	
3506	TNP I Tmax		0.05 .. 4.00 A	0.12 A	Current at Maximum Time Delay
3507	EPTR I Tmin	1A	0.003 .. 4.000 A	3.333 A	Current at Minimum Time Delay
		5A	0.015 .. 20.000 A	16.665 A	
3508	TNP I Tmin		0.05 .. 20.00 A	1.00 A	Current at Minimum Time Delay
3509	EPTR I Tknee	1A	0.003 .. 1.400 A	0.100 A	Current at Knee Point
		5A	0.015 .. 7.000 A	0.500 A	
3510	TNP I Tknee		0.05 .. 17.00 A	0.20 A	Current at Knee Point
3511	T knee		0.20 .. 100.00 sec	26.70 sec	Time Delay at Knee Point
3512	T min		0.10 .. 30.00 sec	0.80 sec	Minimum Time Delay
3513	T max		0.50 .. 300.00 sec	139.90 sec	Maximum Time Delay
3514	T Function		-0.50 .. 30.00 sec	0.00 sec	Delay time T of the whole function

2.12.8 Information List

No.	Information	Type of Information	Comments
1201	>BLOCK 64	SP	>BLOCK 64
1202	>BLOCK 50Ns-2	SP	>BLOCK 50Ns-2
1203	>BLOCK 50Ns-1	SP	>BLOCK 50Ns-1
1204	>BLOCK 51Ns	SP	>BLOCK 51Ns
1207	>BLK 50Ns/67Ns	SP	>BLOCK 50Ns/67Ns
1211	50Ns/67Ns OFF	OUT	50Ns/67Ns is OFF
1212	50Ns/67Ns ACT	OUT	50Ns/67Ns is ACTIVE
1215	64 Pickup	OUT	64 displacement voltage pick up

No.	Information	Type of Information	Comments
1217	64 TRIP	OUT	64 displacement voltage element TRIP
1221	50Ns-2 Pickup	OUT	50Ns-2 Pickup
1223	50Ns-2 TRIP	OUT	50Ns-2 TRIP
1224	50Ns-1 Pickup	OUT	50Ns-1 Pickup
1226	50Ns-1 TRIP	OUT	50Ns-1 TRIP
1227	51Ns Pickup	OUT	51Ns picked up
1229	51Ns TRIP	OUT	51Ns TRIP
1230	Sens. Gnd block	OUT	Sensitive ground fault detection BLOCKED
1264	IEEa =	VI	Corr. Resistive Earth current
1265	IEEr =	VI	Corr. Reactive Earth current
1266	IEE =	VI	Earth current, absolute Value
1267	VGND, 3Vo	VI	Displacement Voltage VGND, 3Vo
1271	Sens.Gnd Pickup	OUT	Sensitive Ground fault pick up
1272	Sens. Gnd Ph A	OUT	Sensitive Ground fault picked up in Ph A
1273	Sens. Gnd Ph B	OUT	Sensitive Ground fault picked up in Ph B
1274	Sens. Gnd Ph C	OUT	Sensitive Ground fault picked up in Ph C
1276	SensGnd Forward	OUT	Sensitive Gnd fault in forward direction
1277	SensGnd Reverse	OUT	Sensitive Gnd fault in reverse direction
1278	SensGnd undef.	OUT	Sensitive Gnd fault direction undefined
16029	51Ns BLK PaErr	OUT	Sens.gnd.flt. 51Ns BLOCKED Setting Error
16030	$\varphi(3Vo, INs) =$	VI	Angle between 3Vo and INsens.

2.12.9 Information List EPTR, TNP

No.	Information	Type of Information	Comments
18901	>BLK E Flt(ext)	SP	>BLOCK Earth fault (extend)
18902	>BLOCK EPTR	SP	>BLOCK EPTR
18903	>BLOCK TNP	SP	>BLOCK Transformer Neutral (TNP)
18904	E Flt(ext) OFF	OUT	Earth fault (extend) is OFF
18905	E Flt(ext) ACT	OUT	Earth fault (extend) is ACTIVE
18906	EPTR OFF	OUT	EPTR is OFF
18907	EPTR ACT	OUT	EPTR is ACTIVE
18908	TNP OFF	OUT	Transformer Neutral(TNP) is OFF
18909	TNP ACT	OUT	Transformer Neutral(TNP) is ACTIVE
18910	EPTR picked up	OUT	EPTR picked up
18911	EPTR TRIP	OUT	EPTR TRIP
18912	TNP picked up	OUT	Transformer Neutral (TNP) picked up
18913	TNP TRIP	OUT	Transformer Neutral (TNP) TRIP
18914	E Flt(ext) PU	OUT	Earth fault (extend) picked up
18915	E Flt(ext) Trip	OUT	Earth fault (extend) TRIP
18916	E Flt(ext) BLK	OUT	Earth fault (extend) is BLOCKED
18917	EPTR BLOCKED	OUT	EPTR is BLOCKED

No.	Information	Type of Information	Comments
18918	TNP BLOCKED	OUT	Transformer Neutral(TNP) is BLOCKED
18919	EF BLK PaErr	OUT	Earth fault (extend) BLOCK Setting Error

2.13 Intermittent Ground Fault Protection

A typical characteristic of intermittent ground faults is that they often disappear automatically to strike again after some time. They can last between a few milliseconds and several seconds. This is why such faults are not detected at all or not selectively by the ordinary time overcurrent protection. If pulse durations are extremely short, not all protection devices in a short-circuit path may pick up; selective tripping is thus not ensured.

Due to the time delay of the overcurrent protection function such faults are too short to initiate shutdown of the faulted cable. Only when they have become permanent such ground faults can be removed selectively by the short-circuit protection.

But such intermittent ground faults already bear the risk of causing thermal damage to equipment. This is why devices 7SJ80 feature a protective function that is able to detect such intermittent ground faults and accumulates their duration. If the sum reaches a configurable value within a certain time, the limit of the thermal load capacity has been reached. If the ground faults are distributed over a long period of time or if the ground fault goes off and does not re-ignite after some time, the equipment under load is expected to cool down. Tripping is not necessary in this case.

Applications

- Protection from intermittent ground faults which occur, e.g. in cables due to poor insulation or water ingress in cable joints.

2.13.1 Functional Description

Acquisition of Measured Quantities

The intermittent ground fault can either be detected via the ordinary ground current input (I_N), the sensitive ground current input (I_N), or it is calculated from the sum of the three phase currents (3I0). Unlike the overcurrent protection which uses the fundamental wave, the intermittent ground fault protection creates the r.m.s. value of this current and compares it to a settable threshold **Iie>**. This method accounts for higher order harmonics contents (up to 400 Hz) and for the direct component since both factors contribute to the thermal load.

Pickup/Tripping

If the pickup value **Iie>** is exceeded, the pickup indication **IIE Fault det** (see [Figure 2-85](#)) is generated. The pickups are also counted; when the counter content reaches the value of parameter **Nos.det.**, the indication **Intermitt.EF** is output. A stabilized pickup is obtained by prolonging the pickup indication **IIE Fault det** by a settable time **T-det.ext.**. This stabilization is especially important for the coordination with existing static or electromechanical overcurrent relays.

The duration of the stabilized pickups **IIE stab.Flt** is summated with an integrator **T-sum det.**. If the accumulated pickup time reaches a settable threshold value, a corresponding message is generated (**IEF Tsum exp.**). Tripping takes place, however, only while a ground fault is present (message **IEF Trip**). The trip command is maintained during the entire minimum tripping time specified for the device, even if the ground fault is of short duration. After completion of the tripping command all memories are reset and the protection resumes normal condition.

The (much longer) resetting time **T-reset** (message **IEF Tres run.**) is launched simultaneously with **T-sum det.** when a ground fault occurs. Unlike **T-sum det.**, each new ground fault resets this time to its initial value and it expires anew. If **T-reset** expires and no new ground fault is recorded during that time, all memories are reset and the protection resumes normal position. **T-reset** thus determines the time during which the next ground fault must occur to be processed yet as intermittent ground fault in connection with the previous fault. A ground fault that occurs later will be considered a new fault event.

The message **IIE Fault det** will be entered in the fault log and reported to the system interface only until the message **Intermitt.EF** is issued. This prevents a burst of messages. If the message is allocated to an LED or a relay, this limitation does not apply. This is accomplished by doubling the message (message numbers 6924, 6926).

Interaction with the Automatic Reclosure Function


Automatic reclosure is not an effective measure against intermittent ground faults as the function only trips after repeated detection of a fault or after expiration of the summation monitoring time **T-sum det.** and besides this, its basic design is to prevent thermal overload. For these reasons, the intermittent ground fault protection is not implemented as starting feature of the automatic reclosing function.

Interaction with Breaker Failure Protection

A pickup that is present when the time delay **TRIP-Timer** has expired is interpreted by the breaker failure protection as a criterion for a tripping failure. Since permanent pickup is not ensured after a tripping command by the intermittent ground fault protection, cooperation with the breaker failure protection is not sensible. Therefore, this function is not activated by the intermittent ground fault protection.

Logic Diagram

The following figure shows the logic diagram for the intermittent ground fault protection function.

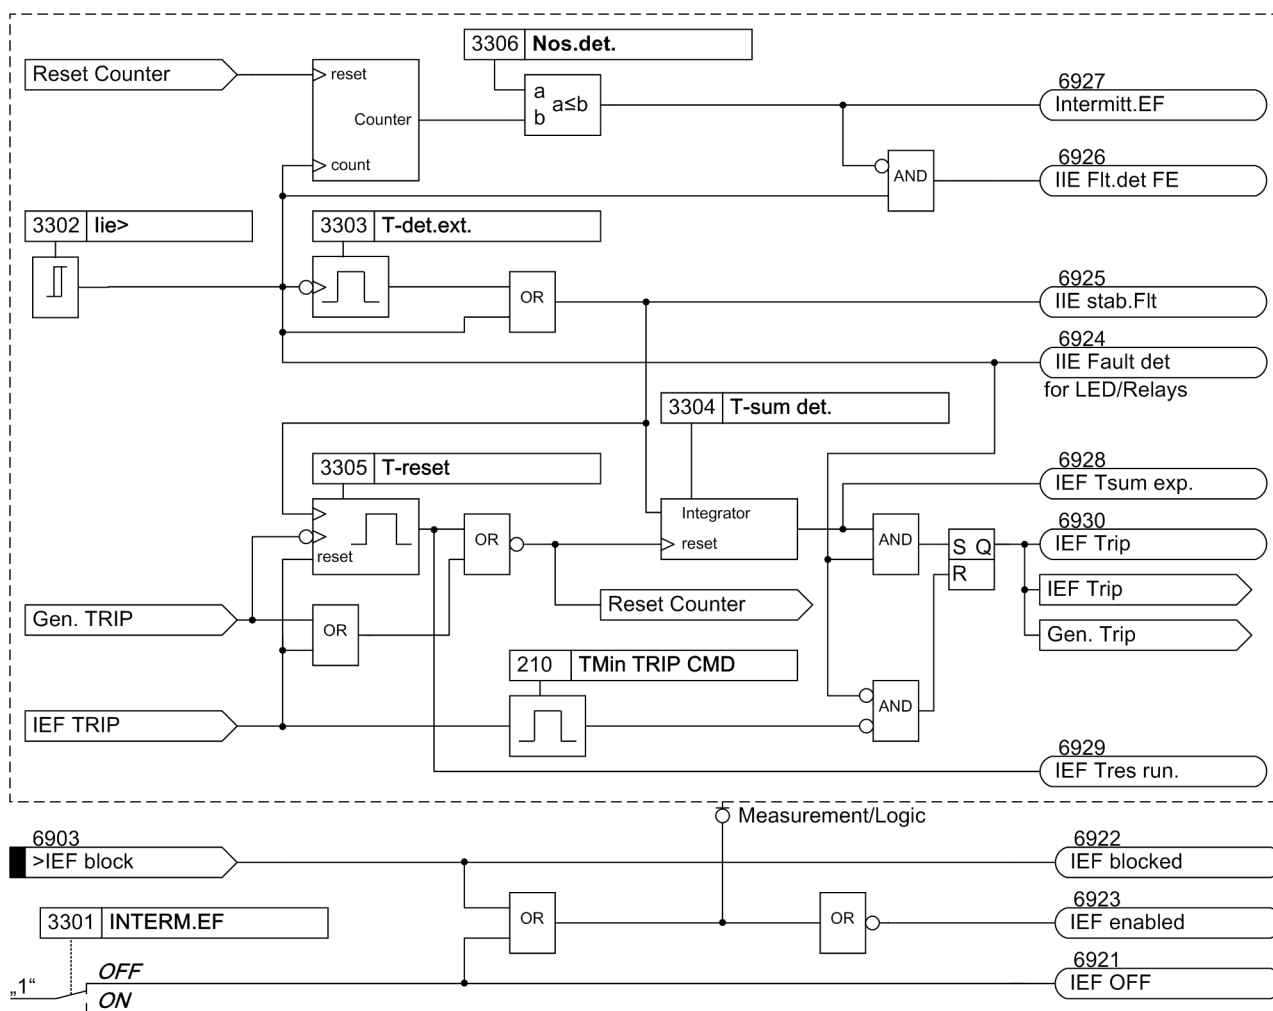

[7sj6x_intermit_erdfehler-150502-kn, 1, en_US]

Figure 2-85 Logic diagram of the intermittent ground fault protection – principle

Fault Logging

A fault event and thus fault logging is initiated when the non-stabilized IIE element picks up for the first time. A message **IIE Fault det** is produced. The message **IIE Fault det** is issued and entered in the fault log (and reported to the system interface) so often until the number of pickups **IIE Fault det** has reached the value set for parameter **Nos.det.** When this happens, the message **Intermitt.EF** is issued and **IIE**

Fault det is blocked for the fault log and the system interface. This method accounts for the fact that the IIE element may also pick up for a normal short-circuit. In this case the pickup does not launch the alarm *Intermitt.EF*.

Intermittent ground faults may cause other overcurrent elements to pick up (e.g. 50-1, 50N-1, 50Ns-1), which may result in a burst of messages. In order to avoid an overflow of the fault log, its messages are no longer entered in the fault log after detection of intermittent ground faults (indication *Intermitt.EF*), unless they cause a trip command. If an intermittent ground fault has been detected, the following pickup messages of the time overcurrent protection will still be reported without restraint (see *Intermitt.EF*):

Table 2-12 Unrestricted Messages

FNo.	Message	Description
1800	<i>50-2 picked up</i>	50-2 picked up
2642	<i>67-2 picked up</i>	67-2 picked up
7551	<i>50-1 InRushPU</i>	50-1 InRush picked up
7552	<i>50N-1 InRushPU</i>	50N-1 InRush picked up
7553	<i>51 InRushPU</i>	51 InRush picked up
7554	<i>51N InRushPU</i>	51N InRush picked up
7559	<i>67-1 InRushPU</i>	67-1 InRush picked up
7560	<i>67N-1 InRushPU</i>	67N-1 InRush picked up
7561	<i>67-TOC InRushPU</i>	67-TOC InRush picked up
7562	<i>67N-TOC InRushPU</i>	67N-TOC InRush picked up
7565	<i>Ia InRush PU</i>	Phase A InRush picked up
7566	<i>Ib InRush PU</i>	Phase B InRush picked up
7567	<i>Ic InRush PU</i>	Phase C InRush picked up
7564	<i>Gnd InRush PU</i>	ground InRush picked up

Table 2-13 shows all messages subject to a restraint mechanism avoiding a message burst during an intermittent ground fault:

Table 2-13 Buffered Messages

FNo.	Message	Description
1761	<i>50(N)/51(N) PU</i>	50(N)/51(N) picked up
1762	<i>50/51 Ph A PU</i>	50/51 Phase A picked up
1763	<i>50/51 Ph B PU</i>	50/51 Phase B picked up
1764	<i>50/51 Ph C PU</i>	50/51 Phase C picked up
1767	<i>50-3 picked up</i>	50-3 element picked up
1810	<i>50-1 picked up</i>	50-1 element picked up
1820	<i>51 picked up</i>	51 element picked up
1765	<i>50N/51NPickedup</i>	50N element picked up
1768	<i>50N-3 picked up</i>	50N-3 element picked up
1831	<i>50N-2 picked up</i>	50N-2 element picked up
1834	<i>50N-1 picked up</i>	50N-1 element picked up
1837	<i>51N picked up</i>	51N element picked up
2691	<i>67/67N pickedup</i>	67/67N picked up
2697	<i>67-3 picked up</i>	67-3 element picked up
2660	<i>67-1 picked up</i>	67-1 element picked up
2670	<i>67-TOC pickedup</i>	67-TOC element picked up
2692	<i>67 A picked up</i>	67/67-TOC Phase A picked up
2693	<i>67 B picked up</i>	67/67-TOC Phase B picked up
2694	<i>67 C picked up</i>	67/67-TOC Phase C picked up

FNo.	Message	Description
2698	<i>67N-3 picked up</i>	67N-3 element picked up
2646	<i>67N-2 picked up</i>	67N-2 element picked up
2681	<i>67N-1 picked up</i>	67N-1 element picked up
2684	<i>67N-TOCPickedup</i>	67N-TOC element picked up
2695	<i>67N picked up</i>	67N/67N-TOC element picked up
5159	<i>46-2 picked up</i>	46-2 picked up
5165	<i>46-1 picked up</i>	46-1 picked up
5166	<i>46-TOC pickedup</i>	46-TOC picked up
1215	<i>64 Pickup</i>	64 displacement voltage pick up
1221	<i>50Ns-2 Pickup</i>	50Ns-2 elementpicked up
1224	<i>50Ns-1 Pickup</i>	50Ns-1 elementpicked up
1227	<i>51Ns Pickup</i>	51Ns elementpicked up
6823	<i>48 pickup</i>	48 Startup supervision Pickup

Before they are entered in the fault log (event buffer) and transmitted to the system interface or CFC, the indications of [Table 2-13](#) are buffered (starting with the incoming indication *Intermitt.EF*). The buffering does not apply to signaling to relays and LEDs as it is required by time-graded protection systems for reverse interlocking. The buffer can store a maximum of two status changes (the most recent ones) for each indication. Buffered messages are signaled to the fault log, CFC and to the system interface with the original time flag only when a TRIP command is initiated by a protection function other than the intermittent ground fault protection. This ascertains that a pickup, although delayed, is always signaled in association with each TRIP command.

All pickup messages which usually do not occur during an intermittent ground fault are not affected by this mechanism. Among others this includes the pickup and TRIP commands of the following protective functions:

- Breaker failure protection,
- Overload protection,
- Frequency protection
- Voltage protection
- QU protection.

The pickup signals of these functions will still be logged immediately. A TRIP command of one of these protective functions will cause the buffered messages to be cleared since no connection exists between tripping function and buffered message.

A fault event is cleared when the time **T-reset** has expired or the TRIP command *IEF Trip* has been terminated.

Terminating a fault event for the intermittent ground fault protection thus is a special case. It is the time **T-reset** that keeps the fault event opened and not the pickup.

2.13.2 Setting Notes

General

The protection function for intermittent ground faults can only take effect and is only accessible if the current to be evaluated was configured in address 133, **INTERM.EF** (*with Ignd* or with *with 3I0* or with *Ignd, sens.*). If not required, this function is set to *Disabled*.


The function can be turned **ON** or **OFF** under address 3301 **INTERM.EF**.

The pickup threshold (r.m.s. value) is set in address 3302 **Iie>**. A rather sensitive setting is possible to respond also to short ground faults since the pickup time shortens as the current in excess of the setting increases. The setting range depends on the selection of the current to be evaluated at address 133 **INTERM.EF**.

The pickup time can be prolonged at address 3303 **T-det.ext.**. This pickup stabilization is especially important for the coordination with existing analog or electromechanical overcurrent relays. The time **T-det.ext.** can also be disabled (**T-det.ext.** = 0).

The stabilized pickup starts the counter **T-sum det.**. This counter is stopped but not reset when the picked up function drops out. Based on the last counter content the counter resumes counting when the stabilized function picks up next. This sum of individual pickup times, which are to initiate tripping, is set at address 3304 **T-sum det.**. It represents one of the four selectivity criteria (pickup value **I_{ie>}**, detection extension time **T-det.ext.**, counter **T-sum det.** and reset time **T-reset**) for coordinating the relays on adjacent feeders and is comparable to the time grading of the time overcurrent protection. The relay in the radial network which is closest to the intermittent fault and picks up, will have the shortest summation time **T-sum det.**.

The reset time, after which the summation is reset in healthy operation and the protection resumes normal status, is configured to **T-reset** at address 3305.

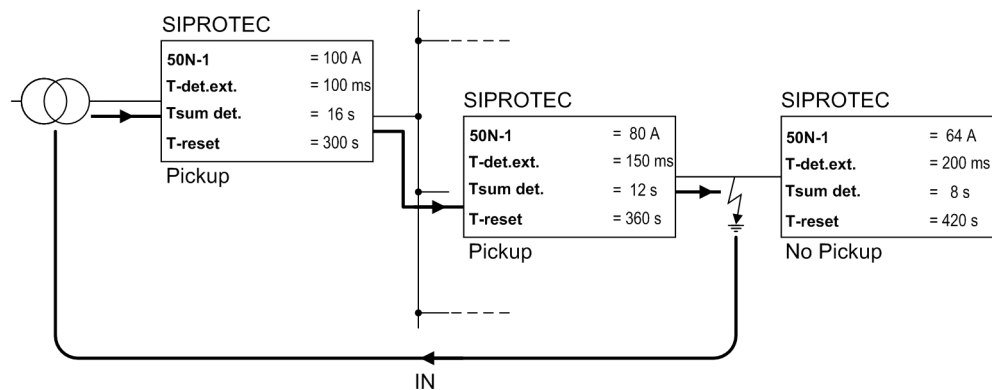

[selektivitaetskrit-intermitt-erdfehler-120902-oz, 1, en_US]

Figure 2-86 Example of selectivity criteria of the intermittent ground fault protection

Address 3306 **Nos.det.** specifies the number of pickups after which a ground fault is considered intermittent.

2.13.3 Settings

The table indicates region-specific presettings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
3301	INTERM.EF		OFF ON	OFF	Intermittent earth fault protection
3302	I _{ie>}	1A	0.05 .. 35.00 A	1.00 A	Pick-up value of interm. E/F stage
		5A	0.25 .. 175.00 A	5.00 A	
3302	I _{ie>}	1A	0.05 .. 35.00 A	1.00 A	Pick-up value of interm. E/F stage
		5A	0.25 .. 175.00 A	5.00 A	
3302	I _{ie>}		0.005 .. 1.500 A	1.000 A	Pick-up value of interm. E/F stage
3303	T-det.ext.		0.00 .. 10.00 sec	0.10 sec	Detection extension time
3304	T-sum det.		0.00 .. 100.00 sec	20.00 sec	Sum of detection times
3305	T-reset		1 .. 600 sec	300 sec	Reset time
3306	Nos.det.		2 .. 10	3	No. of det. for start of int. E/F prot

2.13.4 Information List

No.	Information	Type of Information	Comments
6903	>IEF block	SP	>block interm. E/F prot.
6921	IEF OFF	OUT	Interm. E/F prot. is switched off
6922	IEF blocked	OUT	Interm. E/F prot. is blocked
6923	IEF enabled	OUT	Interm. E/F prot. is active
6924	IIE Fault det	OUT	Interm. E/F detection stage lie>
6925	IIE stab.Flt	OUT	Interm. E/F stab detection
6926	IIE Flt.det FE	OUT	Interm.E/F det.stage lie> f.Flt. ev.Prot
6927	Intermitt.EF	OUT	Interm. E/F detected
6928	IEF Tsum exp.	OUT	Counter of det. times elapsed
6929	IEF Tres run.	OUT	Interm. E/F: reset time running
6930	IEF Trip	OUT	Interm. E/F: trip
6931	lie/In=	VI	Max RMS current value of fault =
6932	Nos.IIE=	VI	No. of detections by stage lie>=

2.14 Dir. Intermittent earth fault protection

The directional intermittent ground fault protection is designed to selectively detect intermittent ground faults in compensated or grounded cable systems.

Intermittent ground faults are usually characterized by the following properties:

- Very short high ground current pulses (up to several hundred amperes) with a duration of less than 1 ms;
- They are self-extinguishing and re-ignite within one half period up to several periods, depending on the power system conditions and the fault characteristic.
- They can persist over longer periods (many seconds to minutes) and develop into static faults.

Such intermittent ground faults are frequently caused by weak insulation, e.g. due to decreased water resistance of old cables.

Ground fault functions based on fundamental component measured values are primarily designed to detect static ground faults and do not always operate correctly in the event of intermittent ground faults. The function described here evaluates specifically the ground current pulses and puts them into relation with the displacement voltage to determine the direction.

Applications

- Directional protection against intermittent ground faults which occur, e.g. in cables due to poor insulation or water ingress in cable joints.

2.14.1 Functional Description


Activating the Function

The function is only available if the device is equipped with a sensitive ground current input.

For voltage connection 213 **VT Connect. 3ph = Vab, Vbc** oder **Vab, Vbc, Vx** or **Vab, Vbc, VSyn** oder **Vph-g, VSyn** and for 250 50/51 **2-ph prot = ON**, the directional intermittent ground fault protection is ineffective. V_0 cannot be formed for these connection types.

The function is blocked in case of a measuring voltage failure under the condition that the fuse-failure monitor is configured for the functioning in a grounded system (see Section [2.11.1 Measurement Supervision](#), Fuse-Failure Monitor).

Furthermore, the function can be blocked externally using the binary input signal **>dIEF block**.

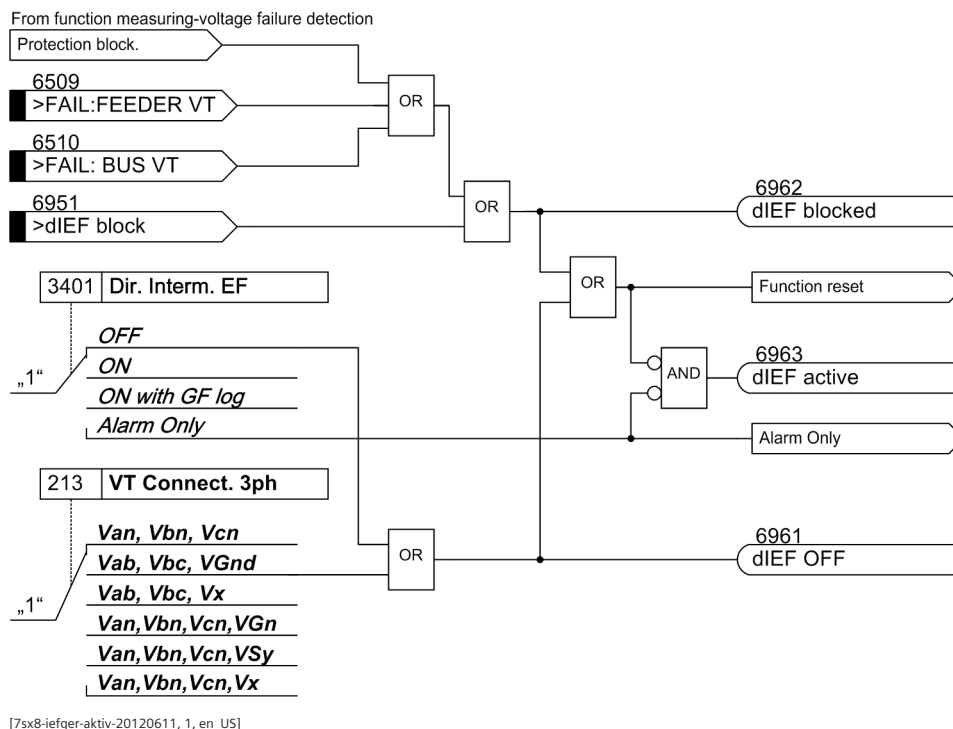

[7sx8-iefger-aktiv-20120611, 1, en_US]

Figure 2-87 Activation of the directional intermittent ground fault protection

Measurand Acquisition

The intermittent ground fault current 3I₀ is measured exclusively via the sensitive ground current input INs (4th current transformer input) of the device.

Also the displacement voltage V_0 or $3 \cdot V_0$ is required to determine the direction. The displacement voltage V_0 can be applied directly to the device, or the summation voltage $3 \cdot V_0$ can be calculated from the three phase-to-ground voltages.

If the displacement voltage is calculated, then:

$$3 \cdot \underline{V}_0 = \underline{V}_A + \underline{V}_B + \underline{V}_C$$

If the displacement voltage is directly applied to the device, then V_0 is the voltage at the device terminals. It is not affected by parameter **V_{ph}** / **V_{delta}** (address 206).

Fault Log, Ground Fault Log, Fault Recording

Parameter **Dir. Interm. EF** allows you to define the type of fault handling and fault logging. If set to ON, tripping is possible and a fault log is generated. If set to **ON with GF log**, tripping is possible, a fault log and a ground fault log are generated. If set to **Alarm Only**, no tripping is possible. Only an alarm is generated. Furthermore, only a ground fault log is created.

The raising pickup of the function (indication 6972 *dIEF pick up*) is the criterion for opening the ground fault log.

Logic Diagram

The following figure shows the logic diagram of the directional intermittent ground fault protection function.



Figure 2-88 Logic diagram of the directional intermittent ground fault protection

The ground fault is detected by evaluating the fundamental component of the displacement voltage. The sensitivity is determined using the settable threshold value $v_{\text{gnd}} / 3V_0$. Direction determination is started after the ground fault has been detected. For this purpose, the igniting current pulses are extracted from the ground current signal. The igniting current pulse and the associated maximum displacement voltage over time are compared with regard to their phase relationship. The fault direction forward or reverse is derived from this comparison. Each detected ignition pulse receives a direction information. If no clear direction determination is possible, the direction information pertaining to the pulse is undefined. The direction results of the recurring ignition pulses are counted and are available as value indication if their value is different than zero.

The setting of parameter **Pickup** defines under which conditions pickup is detected and fault recording started. For *with Vgnd/3V0>*, pickup is initiated once the threshold **Vgnd> / 3V0>** has been exceeded. For *with oper. dir.*, pickup is initiated when a pulse is detected in the direction specified at

address 3402. The pickup disappears when the displacement voltage has fallen below the threshold **Vgnd> / 3V0>** and the time **Monitoring time** has expired.

Alarm/Trip

The setting of parameter **Direction** defines whether the function operates in forward or in reverse direction. The pulses in the specified direction are counted. If the pulse counter reaches the threshold value set in parameter **No. of pulses**, the function trips or generates an alarm. It is possible that not every ignition pulse is recognized as such. If two ignition pulses are very close to one another in respect of time, they may not be detected separately. This is not relevant from the protection perspective, because during an intermittent fault many ignition pulses occur and the counter threshold is certainly reached.

The directional pulse counter is reset under the following conditions:

- A different direction than the set **Direction** is detected. An undefined direction result does not reset the counter.
- The monitoring time **Monitoring time** has elapsed. No other pulse in the set direction was detected during that time. This time can be understood as a criterion for the disappearing of the intermittent fault. The function thus also drops out if the intermittent fault develops into a static fault.
- V_0 is lower than the set threshold **Vgnd> / 3V0>** and the time **Monitoring time** has expired.

Interaction with other Functions

The directional intermittent ground fault protection does not interact with the automatic reclosing function. The function cannot start the automatic reclosing function.

The directional intermittent ground fault protection interacts with the circuit-breaker failure protection. The function starts the circuit-breaker failure protection.

2.14.2 Setting Notes

General

Configuration of the protection functions at address 134 **Dir. Interm. EF** defines whether the directional intermittent ground fault protection is **Enabled Disabled**.

At address 3401 **Dir. Interm. EF** the directional ground fault protection is switched on or off. The following setting options are available:

- **ON** enables the function with tripping and fault record log.
- **ON with GF log** enables the function with tripping, fault record log and ground fault log.
- **Alarm Only** generates the ground fault log only. Tripping and fault record log are not possible.
- **OFF** disables the function.

The pickup threshold for the displacement voltage is set at address 3405 **Vgnd> / 3V0>**. Exceeding this threshold is the criterion for detecting the intermittent ground fault.

The direction to be protected **Forward** or **Reverse** is set in address 3402 **Direction**.

Address 3403 **No. of pulses** allows you to specify how many pulses must be detected in the set direction before the alarm or tripping is initiated. It is possible that not every ignition pulse is recognized as such. If two ignition pulses are very close to one another in respect of time, they may not be detected separately. This is not relevant from the protection perspective, because during an intermittent fault many ignition pulses occur and the counter threshold is certainly reached.

At address 3404 **Monitoring time** you set the monitoring time after detection of the direction pulse in the direction parameterized at 3402. If the time has expired before the number set at 3403 **No. of pulses** has been reached, the associated counter is reset. This time is a criterion for the disappearing of the intermittent fault.

At address 3406 **Pickup** you can set the criterion for the pickup of the function. For with **with Vgnd/3V0>** pickup takes place as soon as the threshold **Vgnd> / 3V0>** has been exceeded, regardless of whether a real

intermittent ground fault is present or not. For **with oper. dir.**, recording starts when a direction pulse in the direction parameterized at 3402 has been detected.

2.14.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
3401	Dir. Interm. EF	OFF ON ON with GF log Alarm Only	OFF	Dir. Intermittent earth fault protection
3402	Direction	Forward Reverse	Forward	Direction to be protected
3403	No. of pulses	2 .. 50	5	Pulse no. for detecting the interm. E/F
3404	Monitoring time	0.04 .. 10.00 sec	2.00 sec	Monitoring time after pickup detected
3405	Vgnd> / 3V0>	2.0 .. 100.0 V	20.0 V	Vgnd> measured / 3V0> calculated
3406	Pickup	with Vgnd/3V0> with oper. dir.	with Vgnd/3V0>	Pickup of the function

2.14.4 Information List

No.	Information	Type of Information	Comments
6951	>dIEF block	SP	>Block directional interm. E/F prot.
6961	dIEF OFF	OUT	Dir. Interm. E/F prot. is switched off
6962	dIEF blocked	OUT	Dir. Interm. E/F prot. is blocked
6963	dIEF active	OUT	Dir. Interm. E/F prot. is active
6972	dIEF pick up	OUT	dIEF: pick up
6973	dIEF TRIP	OUT	dIEF: Trip
6974	No.forward=	VI	dIEF: No. of detected forward pulses =
6975	No.reverse=	VI	dIEF: No. of detected reverse pulses =
6976	No.undef.=	VI	dIEF: No. of detected undefined pulses =
6979	dIEF ALARM	OUT	dIEF: Alarm

2.15 Automatic Reclosing System 79


From experience, about 85 % of insulation faults associated with overhead lines are arc short circuits which are temporary in nature and disappear when protection takes effect. This means that the line can be connected again. The reconnection is accomplished after a dead time via the automatic reclosure function. If the fault still exists after automatic reclosure (arc has not disappeared, there is a metallic fault), then the protective elements will re-trip the circuit breaker. In some systems, several reclosing attempts are performed.

Applications

- The automatic reclosure system integrated in the 7SJ80 can also be controlled by an external protection device (e.g. backup protection). For this application, a signal exchange must occur between 7SJ80 and the external protection device via binary inputs and outputs.
- It is also possible to allow the relay 7SJ80 to work in conjunction with an external reclosing device.
- The automatic reclosure system can also operate in interaction with the integrated synchronization function or with an external synchrocheck.
- Since the automatic reclosing function is not applied when the 7SJ80 is used to protect generators, motors, transformers, cables and reactors etc., it should be disabled for this application.

2.15.1 Program Execution

The 7SJ80 is equipped with an integrated three-pole, single-shot and multi-shot automatic reclosure (AR). Figure 2-100 shows an example of a timing diagram for a successful second reclosure.

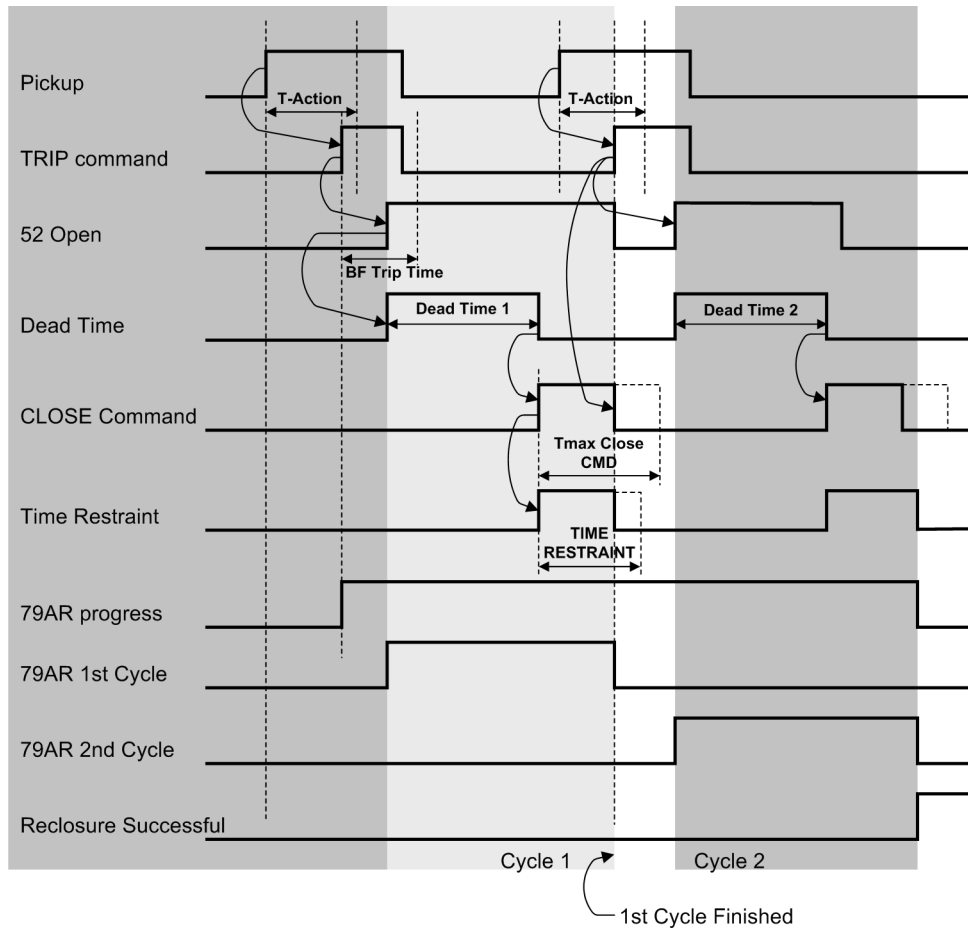


[ablaufdiagramm-2-malige-wiedereinschaltung-erfolgreich-260602-2kn, 1, en_US]

Figure 2-89 Timing diagram showing two reclosing shots, first cycle unsuccessful, second cycle successful

The following figure shows an example of a timing diagram showing for two unsuccessful reclosing shots, with no additional reclosing of the circuit breaker.

The number of reclose commands initiated by the automatic reclosure function are counted. A statistical counter is available for this purpose for the first and all subsequent reclosing commands.

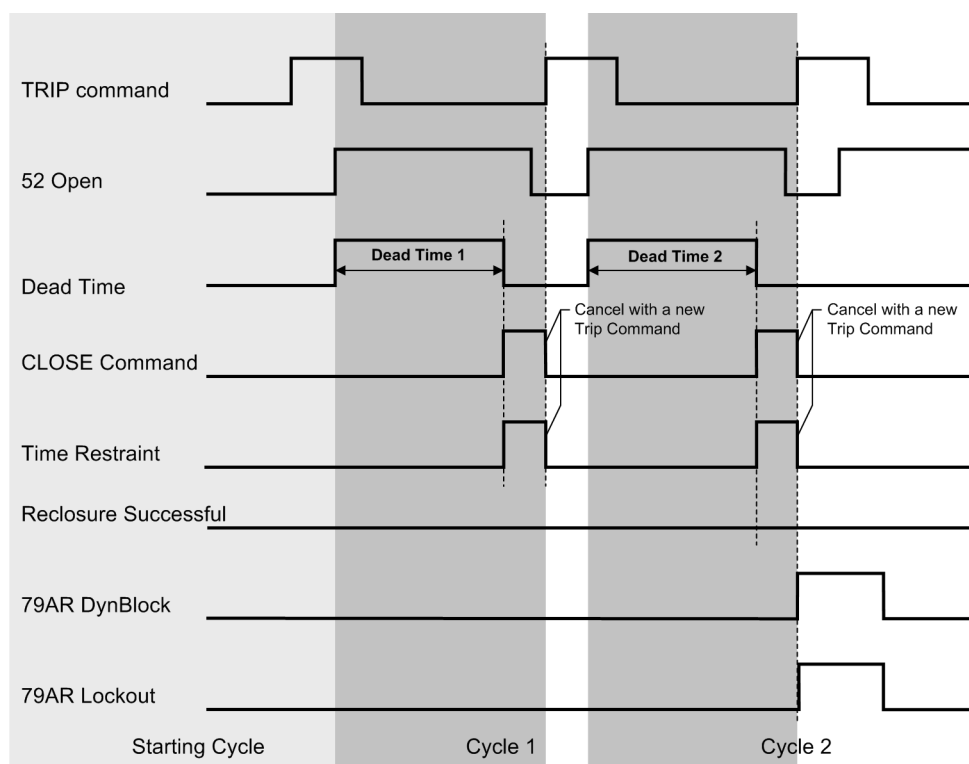

[ablaufdiagramm-2-malige-wiedereinschaltung-erfolglos-260602-*kn*, 1, *en_US*]

Figure 2-90 Timing diagram showing two unsuccessful reclosing shots

Initiation

Initiation of the automatic reclosing function can be caused by internal protection functions or externally via binary inputs. The automatic reclosing function can be programmed in such manner that any of the elements of the following Table can initiate (**Starts 79**), not initiate (**No influence**), or block reclosing (**Stops 79**):

Table 2-14 Anwurf AWE

Non-directional start	Directional start	Start other
50-1	67-1	Sensitive Ground Fault Protection (50Ns, 51Ns)
50N-1	67N-1	Negative Sequence Protection 46
50-2	67-2	BINARY INPUT
50-3	67-3	
50N-2	67N-2	
50N-3	67N-3	
51	67-TOC	
51N	67N-TOC	

On initiation, the automatic reclosure function is informed that a trip command was issued and the respective reclosing program is now being executed.

The binary input messages 2715 **>Start 79 Gnd** and 2716 **>Start 79 Ph** for starting an automatic reclosure program can also be activated via CFC (fast PLC task processing). Automatic reclosure can thus be initiated via any messages (e.g. protective pickup) if address 7164 **BINARY INPUT** is set to **Starts 79**.

Action Time

The action time (address 7117) monitors the time between a device pickup and the trip command of a protection function configured as starter. The action time is launched when pickup of any function is detected, which is set as source of the automatic reclosure program. Protection functions which are set to **Alarm Only** or which in principle should not start a reclosing program do not trigger the action time.

If a protection function configured as starter initiates a trip command during the action time, the automatic reclosure program is started. Trip commands of a protection function configured as starter occurring in the time between expiration of the action time and dropout of the device pickup cause the dynamic blocking of the automatic reclosing program. Trip commands of protection functions which are not configured as starter do not affect the action time.

If the automatic reclosure program interacts with an external protection device, the general device pickup for starting the operating time is communicated to the automatic reclosing program via binary input 2711 >79 *Start*.

Delay of Dead Time Start

After start of the automatic reclosure function, the dead time start can be delayed by pickup of the binary input message 2754 >79 *DT St.Delay*. The dead time is not initiated as long as the binary input is active. Start occurs only on cleared binary input. The delay of the dead time start can be monitored via parameter 7118 **T DEAD DELAY**. If the time elapses and the binary input is still active, the Automatic Reclosing System 79 changes to the status of the dynamic blocking via (2785 79 *DynBlock*). The maximum time delay of the dead time start is logged by message 2753 79 *DT delay ex..*

Reclosing Programs

Depending on the type of fault, two different reclosing programs can be used. Here the following applies:

- The single phase fault (**ground** fault) reclosing program applies if all fault protection functions that initiate automatic reclosure detected a phase-to-ground fault. The following conditions must apply: only one phase, only one phase and ground or only ground have picked up. This program can also be started via a binary input.
- The multiple phase fault (**phase** fault) reclosing program applies to all other cases. That is, when elements associated with two or more phases pick up, with or without the pickup of ground elements, such as negative sequence elements. This program can be started via a binary input as well.

The reclosure program evaluates only elements during pickup as elements dropping out may corrupt the result if they drop out at different times when opening the circuit breaker. Therefore, the ground fault reclosure program is executed only when the elements associated with one particular phase pick up until the circuit breaker is opened; all other conditions will initiate the phase fault program.

For each of the programs, up to 9 reclosing attempts can be separately programmed. The first four reclosing attempts can be set differently for each of the two reclosing programs. The fifth and each of the following automatic reclosures will correspond to the fourth dead time.

Reclosing Before Selectivity

For the automatic reclosure sequence to be successful, faults on any part of the line must be cleared from the feeding line end(s) within the same – shortest possible – time. Usually, therefore, an instantaneous protection element is set to operate before an automatic reclosure. Fast fault termination has thus priority over selectivity aspects as the reclosing action aims at maintaining normal system operation. For this purpose, all protection functions which can initiate the automatic reclosure function are set in such manner that they may trip instantaneously or with a very small time delay before automatic reclosure.

With the final reclosing attempt, i.e. when no automatic reclosing is expected, protection is to trip with delay according to the grading coordination chart of the system, since selectivity has priority. For details see also information at margin heading "Interaction with the Automatic Reclosing Function" which can be found with the setting notes of the overcurrent protection functions and the functional description of the intermittent ground fault protection.

Single-Shot Reclosing

When a trip signal is programmed to initiate the automatic reclosure, the appropriate automatic reclosing program will be executed. Once the circuit breaker has opened, a dead time interval in accordance with the type of fault is started (see also margin heading "Reclosing Programs"). Once the dead time interval has elapsed, a closing signal is issued to reclose the circuit breaker. A blocking time interval **TIME RESTRAINT** is started at the same time. Within this restraint time it is checked whether the automatic reclosure was performed successfully. If a new fault occurs before the restraint time elapses, the automatic reclosing function is dynamically blocked causing the final tripping of the circuit breaker. The dead time can be set individually for each of the two reclosing programs.

Criteria for opening the circuit breaker may either be the auxiliary contacts of the circuit breaker or the dropout of the general device pickup if auxiliary contacts are not configured.

If the fault is cleared (successful reclosing attempt), the blocking time expires and automatic reclosing is reset in anticipation of a future fault. The fault is terminated.

If the fault has not been cleared (unsuccessful reclosing attempt), then a final trip signal is initiated by one or more protective elements.

Multi-shot Reclosing

7SJ80 permits up to 9 reclosings. The number can be set differently for the phase fault reclosing program and the ground fault reclosing program.

The first reclose cycle is, in principle, the same as the single-shot auto-reclosing. If the first reclosing attempt is unsuccessful, this does not result in a final trip, but in a reset of the restraint time interval and start of the next reclose cycle with the next dead time. This can be repeated until the set number of reclosing attempts for the corresponding reclose program has been reached.

The dead time intervals preceding the first four reclosing attempts can be set differently for each of the two reclosing programs. The dead time intervals preceding the fifth reclosing attempts will be equal to the dead time interval that precedes the fourth reclosing attempt.

If one of the reclosing attempts is successful, i.e. the fault disappeared after reclosure, the restraint time expires and the automatic reclosing function is reset. The fault is cleared.

If none of the reclosing attempts is successful, then a final circuit breaker trip (according to the grading coordination chart) will take place after the last allowable reclosing attempt has been performed by the protection function. All reclosing attempts were unsuccessful.

After the final circuit breaker tripping, the automatic reclosing function is dynamically blocked (see below).

Blocking Time

The function of the blocking time has already been described under section "Single-/Multi-Shot Reclosing". The blocking time can be prolonged if the following conditions have been fulfilled.

The time 211 **TMax CLOSE CMD** defines the maximum time during which a close command can apply. If a new trip command occurs before this time has run out, the close command will be canceled. If the time **TMax CLOSE CMD** is set longer than the restraint time **TIME RESTRAINT**, the restraint time will be extended to the remaining close command duration after expiry!

A pickup from a protection function that is set to initiate the automatic reclosing function will also lead to an extension of the blocking time should it occur during this time!

2.15.2 Blocking

Static Blocking

Static blocking means that the automatic reclosing function is not ready to initiate reclosing, and cannot initiate reclosing as long as the blocking signal is present. A corresponding message *79 is NOT ready* (FNo. 2784) is generated. The static blocking signal is also used internally to block the protection elements that are only supposed to work when reclosing is enabled (see also side title "Reclosing Before Selectivity" further above).

The automatic reclosing function is statically blocked if:

- The signal **>BLOCK 79** (FNo. 2703) is present at a binary input, as long as the automatic reclosing function is not initiated (associated message: **>BLOCK 79**),
- The signal **>CB Ready** (FNo. 2730) indicates that the circuit breaker disappears via the binary input, if the automatic reclosing function is not initiated (associated message: **>CB Ready**),
- The number of allowable reclosing attempts set for both reclosing programs is zero (associated message: **79 no cycle**),
- No protection functions (parameters 7150 to 7163) or binary inputs are set to initiate the automatic reclosing function (associated message: **79 no starter**),
- The circuit breaker position is reported as being "open" and no trip command applies (associated message: **79 BLK: CB open**). This presumes that 7SJ80 is informed of the circuit breaker position via the auxiliary contacts of the circuit breaker.

Dynamic Blocking

Dynamic blocking of the automatic reclosing function occurs in those cases where the reclosing program is active and one of the conditions for blocking is fulfilled. The dynamic blocking is signaled by the message **79 DynBlock**. The dynamic blocking is associated with the configurable blocking time **SAFETY 79 ready**. This blocking time is usually started by a blocking condition that has been fulfilled. After the blocking time has elapsed, the device checks whether or not the blocking condition can be reset. If the blocking condition is still present or if a new blocking condition is fulfilled, the blocking time is restarted. If, however, the blocking condition no longer exists after the blocking time has elapsed, the dynamic blocking will be reset.

Dynamic blocking is initiated if:

- The maximum number of reclosure attempts has been achieved. If a trip command now occurs within the dynamic blocking time, the automatic reclosure program will be blocked dynamically (indicated by **79 Max. No. Cyc**).
- The protection function has detected a three-phase fault and the device is programmed not to reclose after three-phase faults (indicated by **79 BLK:3ph p.u.**).
- if the maximum waiting period **T DEAD DELAY** for the delay of the dead time initiation by binary inputs expires without binary input **>79 DT St.Delay** having been disabled during this time period.
- The action time has elapsed without a TRIP command being issued. Each TRIP command that occurs after the action time has expired and before the picked-up element drops out, will initiate the dynamic blocking (indicated by **79 Tact expired**).
- A protection function trips which is to block the automatic reclosure function (as configured). This applies irrespective of the status of the automatic reclosure system (started / not started) if a TRIP command of a blocking element occurs (indicated by **79 BLK by trip**).
- The circuit breaker failure function is initiated.
- The circuit breaker does not trip within the configured time **T-Start MONITOR** after a trip command was issued, thus leading to the assumption that the circuit breaker has failed. (The breaker failure monitoring is primarily intended for commissioning purposes. Commissioning safety checks are often conducted with the circuit breaker disconnected. The breaker failure monitoring prevents unexpected reclosing after the circuit breaker has been reconnected, indicated by **79 T-Start Exp**).
- wenn der Leistungsschalter nach Ablauf der Leistungsschalterüberwachungszeit nicht schaltbereit ist, vorausgesetzt die Leistungsschalterabfrage ist wirksam gestellt (Adresse 7113 **CHECK CB? = Chk each cycle**, signalisiert durch die Meldung **79 T-CBreadyExp**),
- The circuit breaker is not ready after maximum extension of the dead time **Max. DEAD EXT.**. The monitoring of the circuit breaker status and the synchrocheck may cause undesired extension of the dead time. To prevent the automatic reclosure system from assuming an undefined state, the extension of the dead time is monitored. The extension time is started when the regular dead time has elapsed. When it has elapsed, the automatic reclosure function is blocked dynamically and the lock-out time launched. The automatic reclosure system resumes normal state when the lock-out time has elapsed and new blocking conditions do not apply (indicated by **79 TdeadMax Exp**).

- Manual closing has been detected (externally) and parameter **BLOCK MC Dur.** ($T \neq 0$) was set so that the automatic reclosing function responds to manual closing,
- Via a correspondingly routed binary input (FNo. 2703 >**BLOCK 79**). If the blocking takes place while the automatic recloser is in normal state, the latter will be blocked statically (*79 is NOT ready*). The blocking is terminated immediately when the binary input has been cleared and the automatic reclosure function resumes normal state. If the automatic reclosure function is already running when the blocking arrives, the dynamic blocking takes effect (*79 DynBlock*). In this case, the activation of the binary input starts the dynamic blocking time **SAFETY 79 ready**. Upon its expiration, the device checks if the binary input is still activated. If this is the case, the automatic reclosure program changes from dynamic blocking to static blocking. If the binary input is no longer active when the time has elapsed and if no new blocking conditions apply, the automatic reclosure system resumes normal state.

2.15.3 Status Recognition and Monitoring of the Circuit Breaker

Circuit Breaker Status

The detection of the actual circuit breaker status is necessary for the correct functionality of the automatic reclosure function. The circuit breaker status is detected by the circuit breaker auxiliary contacts and is communicated to the device via binary inputs 4602 >**52-b** and 4601 >**52-a**.

Here the following applies:

- If binary input 4601 >**52-a** and binary input 4602 >**52-b** are used, the automatic reclosure function can detect whether the circuit breaker is open, closed or in intermediate position. If both auxiliary contacts detect that the circuit breaker is open, the dead time is started. If the circuit breaker is open or in intermediate position without a trip command being present, the automatic reclosure function is blocked dynamically if it is already running. If the automatic reclosure system is in normal state, it will be blocked statically. When checking whether a trip command applies, all trip commands of the device are taken into account irrespective of whether the function acts as starting or blocking element on behalf of the automatic reclosure program.
- If only the binary input 4601 >**52-a** is allocated, the circuit breaker is considered open if the binary input is not active. If the binary input gets inactive while no trip command of (any) function applies, the automatic reclosure function is blocked. The blocking will be of static nature if the automatic reclosure function is in normal state at this time. If the automatic reclosing function is already running, there will be a dynamic blocking. The dead time is started if the binary input gets inactive following the trip command of a starting element (4601 >**52-a** = inactive). An intermediate position of the circuit breaker cannot be detected for this type of allocation.
- If binary input 4602 >**52-b** alone is allocated, the circuit breaker is considered open while the binary input is active. If the binary input gets active while no trip command of (any) function applies, the automatic reclosure function is blocked dynamically provided it is already running. Otherwise, there will be a static blocking. The dead time is started if the binary input gets active following the trip command of a starting element. An intermediate position of the circuit breaker cannot be detected for this type of allocation.
- If neither binary input 4602 >**52-b** nor 4601 >**52-a** are allocated, the automatic reclosure program cannot detect the position of the circuit breaker. In this case, the automatic reclosure function will be controlled exclusively via pickups and trip commands. Monitoring for "52-b without TRIP" and starting the dead time in dependence of the circuit breaker feedback is not possible in this case.

Circuit Breaker Monitoring

The time needed by the circuit breaker to perform a complete reclose cycle can be monitored by the 7SJ80. Breaker failure is detected:

A precondition for a reclosing attempt, following a trip command initiated by a protective relay element and subsequent initiation of the automatic reclosing function, is that the circuit breaker is ready for at least one TRIP-CLOSE-TRIP cycle. The readiness of the circuit breaker is monitored by the device using a binary input >**CB Ready**. In the case where this signal from the breaker is not available, the circuit breaker monitoring feature should be disabled, otherwise reclosing attempts will remain blocked.

- Especially when multiple reclosing attempts are programmed, it is a good idea to monitor the circuit breaker condition not only prior to the first but also to each reclosing attempt. A reclosing attempt will be blocked until the binary input indicates that the circuit breaker is ready to complete another CLOSE-TRIP cycle.
- The time needed by the circuit-breaker to regain the ready state can be monitored by the 7SJ80. The monitoring time **CB TIME OUT** expires for as long as the circuit breaker does not indicate that it is ready via binary input **>CB Ready** (FNo. 2730). That means if the binary input **>CB Ready** is cleared, the monitoring time **CB TIME OUT** is started. If the binary input returns before the monitoring time has elapsed, the monitoring time will be canceled and the reclosure process is continued. If the monitoring time runs longer than the dead time, the dead time will be extended accordingly. If the monitoring time elapses before the circuit breaker signals its readiness, the automatic reclosure function will be blocked dynamically.

Interaction with the synchronism check may cause the dead time to extend inadmissibly. To prevent the automatic reclosure function from remaining in an undefined state, dead time extension is monitored. The maximum extension of the dead time can be set at **Max. DEAD EXT.**. The monitoring time **Max. DEAD EXT.** is started when the regular dead time has elapsed. If the synchronism check responds before the time has elapsed, the monitoring time will be stopped and the close command generated. If the time expires before the synchronism check reacts, the automatic reclosure function will be blocked dynamically.

Please make sure that the above mentioned time is not shorter than the monitoring time **CB TIME OUT**.

The time 7114 **T-Start MONITOR** serves for monitoring the response of the automatic reclosure function to a breaker failure. It is activated by a trip command arriving before or during a reclosing operation and marks the time that passes between tripping and opening of the circuit breaker. If the time elapses, the device assumes a breaker failure and the automatic reclosure function is blocked dynamically. If parameter **T-Start MONITOR** is set to ∞ , the start monitoring is disabled.

2.15.4 Controlling Protection Elements

Depending on the reclosing cycle it is possible to control elements of the directional and non-directional overcurrent protection by means of the automatic reclosure system (Protective Elements Control). There are three mechanisms:


- Time overcurrent protection and the sensitive ground fault protection elements may trip instantaneously depending on the automatic reclosure cycle ($T = 0$), they may remain unaffected by the auto reclosing function AR ($T = T$) or may be blocked ($T = \infty$). For further information see side title "Cyclic Control".
- The automatic reclosing states "Auto Reclosing ready" and "Auto Reclosing not ready" can activate or deactivate the dynamic cold load pickup function. This function is designed to influence overcurrent stages (see also Section 2.16.6 and Section [2.15.6 Setting Notes](#)) regarding thresholds and tripping time delays.
- The time overcurrent protection parameter 1X14A 50(N)-2 ACTIVE or 1X16A 50(N)-3 ACTIVE defines whether the elements 50(N)-2 or 50(N)-3 are to operate always or only with "79M Auto Reclosing ready" (see Section [2.2 Overcurrent Protection 50, 51, 50N, 51N](#)).

Cyclic Control

Control of the time overcurrent protection and sensitive ground fault protection elements takes effect by releasing the cycle marked by the corresponding parameter. The cycle zone release is indicated by the messages **79 1. CycZoneRel** to **79 4. CycZoneRel**. If the automatic reclosure function is in normal state, the settings for the starting cycle apply. These settings always take effect when the automatic reclosure function assumes normal state.

The settings are released for each following cycle when issuing the close command and starting the blocking time. Following a successful reclosure (blocking time expired) or after returning from the blocking, the automatic reclosure function goes into normal state. Control of the protection is again assumed by the parameters for the starting cycle.

The following figure illustrates the control of the protection elements 50-2 and 50N-2.

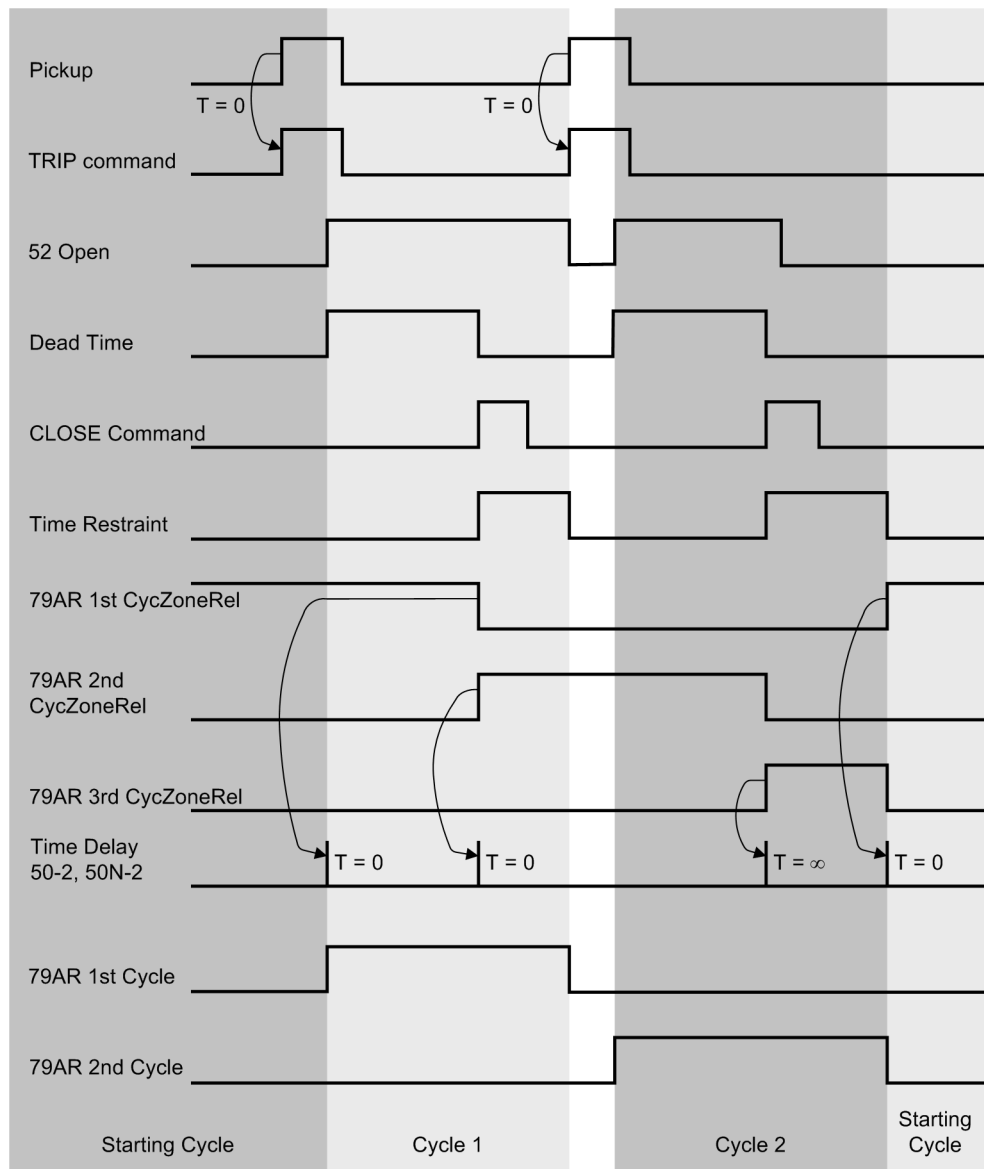

[schutzstufensteuerung-bei-zweimaliger-erfolgreicher-awe-260602-kn, 1, en_US]

Figure 2-91 Control of protection elements for two-fold, successful automatic reclosure

Example

Before the first reclosing, faults are to be eliminated quickly applying elements 50-2 or 50N-2. Fast fault termination thus has priority over selectivity aspects as the reclosing action aims at maintaining normal system operation. If the fault prevails, a second tripping is to take place instantaneously and subsequently, a second reclosing.

After the second reclosing, however, elements 50-2 or 50N-2 are to be blocked so the fault can be eliminated by applying elements 50-1 or 50N-1 according to the grading coordination chart of the system giving priority to selectivity concerns.

Addresses 7202 **bef. 1.Cy: 50-2**, 7214 **bef. 2.Cy: 50-2** and 7203 **bef. 1.Cy: 50N-2** und 7215 **bef. 2.Cy: 50N-2** are set to **instant**. $T=0$ to enable the elements after the first reclosing. Addresses 7226 **bef. 3.Cy: 50-2** and 7227 **bef. 3.Cy: 50N-2**, however, are set to **blocked** $T=\infty$, to ensure that elements 50-2 and 50N-2 are blocked when the second reclosing applies. The back-up elements, e.g. 50-1 and 50N-1, must obviously not be blocked (addresses 7200, 7201, 7212, 7213, 7224 and 7225).

The blocking applies only after reclosure in accordance with the set address. Hence, it is possible to specify again other conditions for a third reclosure.

The blocking conditions are also valid for the zone sequence coordination, provided it is available and activated (address 7140, see also margin heading "Zone Sequencing").

2.15.5 Zone Sequencing / Fuse Saving Scheme

Zone Sequencing / Fuse Saving Scheme is not available for models 7SJ6***-***A**.

It is the task of the zone sequence coordination to harmonize the automatic reclosure function of this device with that of another device that forms part of the same power system. It is a complementary function to the automatic reclosure function and allows, for example, to perform group reclosing operations in radial systems. In case of multiple reclosures, groups may also be in nested arrangement and further high-voltage fuses can be overgraded or undergraded.

Zone sequencing works by blocking certain protection functions depending on the reclosing cycle. This is implemented by the protection elements control (see margin heading "Controlling Protection Elements").

As a special feature, changing from one reclosing cycle to the next is possible without trip command only via pickup/dropout of 50-1 or 50N-1.

The following figure shows an example of a group reclosure at feeder 3. It is assumed that reclosure is performed twice.

With fault F1 on feeder 5, protection devices in the infeed and on feeder 3 pick up. The time delay of the 50-2 element at protecting feeder 3 is set in such a way that the feeder 3 circuit breaker will clear the fault before the fuse at feeder 5 is damaged. If the fault is cleared, all functions are reset after the restraint time has expired and the fault is terminated. The fuse has therefore also been protected.


If the fault continues to exist, a second reclosing cycle is performed in the same way.

High speed element 50-2 is now blocked at relay protecting Feeder 3. If the fault still remains, only the 50-1 element continues to be active in Feeder 3 which, however, **overgrades** the fuse with a time delay of 0.4 s. After the fuse operated to clear the fault, the series-connected devices drop out. If the fuse fails to clear the fault, then the 50-1 element protecting Feeder 3 will operate as backup protection.

The 50-2 element at the busbar relay is set with a delay of 0.4 seconds, since it supposed to trip the 50-2 elements and the fuses as well. For the second reclosing, the 50-2 element also has to be blocked to give preference to the feeder relay (50-1 element with 0.4 s). For this purpose, the device has to "know" that two reclosing attempts have already been performed.

In this device, zone sequence coordination must be switched on: When pickup of 50-1 or 50N-1 drops out, zone sequence coordination provokes that the reclosing attempts are counted as well. If the fault still persists after the second reclosure, the 50-1 element, which is set to 0.9 seconds, would serve as backup protection.

For the busbar fault F2, the 50-2 element at the bus would have cleared the fault in 0.4 seconds. Zone sequencing enables the user to set a relatively short time period for the 50-2 elements. The 50-1 element is only used as backup protection. If zone sequencing is not applied, the 50-1 element is to be used only with its relatively long time period (0.9 s).

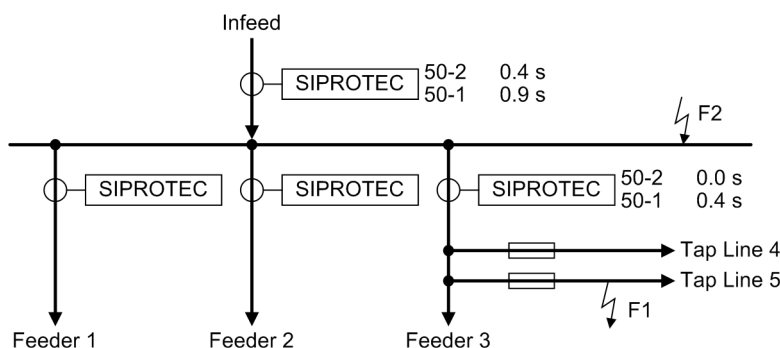

[ablaufkoordination-fehler-am-abgang-5-ss-260602-kn, 1, en_US]

Figure 2-92 Zone sequencing with a fault occurring at Tap Line 5 and at the busbar

2.15.6 Setting Notes

General Settings

The internal automatic reclosure function will only be effective and accessible if address 171 **79 Auto Recl.** is set **Enabled** during configuration. If not required, this function is set to **Disabled**. The function can be turned **ON** or **OFF** under address 7101 **FCT 79**.

If no automatic reclosures are performed on the feeder for which the 7SJ80 is used (e.g. cables, transformers, motors, etc.), the automatic reclosure function is disabled by configuration. The automatic reclosure function is then completely disabled, i.e. the automatic reclosure function is not processed in the 7SJ80. No messages exist for this purpose and binary inputs for the automatic reclosure function are ignored. All parameters of block **71** are inaccessible and of no significance.

Blocking Duration for Manual-CLOSE Detection

Parameter 7103 **BLOCK MC Dur.** defines the reaction of the automatic reclosure function when a manual closing signal is detected. The parameter can be set to specify how long the auto reclosure function will be blocked dynamically in case of an external Manual close-command being detected via binary input (356 **>Manual Close**). If the setting is **0**, the automatic reclosure function will not respond to a Manual close signal.

Restraint Time and Dynamic Blocking

The blocking time **TIME RESTRAINT**(address 7105) defines the time that must elapse, after a successful reclosing attempt, before the automatic reclosing function is reset. If a protective function configured for initiation of the automatic reclosure function provokes a new trip before this time elapses, the next reclosing cycle is started in case of multiple reclosures. If no further reclosure is allowed, the last reclosure will be classed as unsuccessful.

In general, a few seconds are sufficient. In areas with frequent thunderstorms or storms, a shorter blocking time may be necessary to avoid feeder lockout due to sequential lightning strikes or flashovers.

A longer restraint time should be chosen if there is no possibility to monitor the circuit breaker (see below) during multiple reclosing (e.g. because of missing auxiliary contacts and information on the circuit breaker ready status). In this case, the restraint time should be longer than the time required for the circuit breaker mechanism to be ready.

If a dynamic blocking of the automatic reclosing function was initiated, then reclosing functions remain blocked until the cause of the blocking has been cleared. The functional description gives further information on this topic, see side title "Dynamic Blocking". The dynamic blocking is associated with the configurable blocking time **SAFETY 79 ready**. Blocking time is usually started by a blocking condition that has picked up.

Circuit Breaker Monitoring

Reclosing after a fault clearance presupposes that the circuit breaker is ready for at least one TRIP-CLOSE-TRIP cycle at the time when the reclosing function is initiated (i.e. at the beginning of a trip command):

The readiness of the circuit breaker is monitored by the device using a binary input **>CB Ready** (FNo. 2730).

- It is possible to check the status of the circuit breaker before each reclosure or to disable this option (address 7113, **CHECK CB?**):

CHECK CB? = No check, deactivates the circuit breaker check,

CHECK CB? = Chk each cycle, to verify the circuit breaker status before each reclosing command.

Checking the status of the circuit breaker is usually recommended. Should the breaker not provide such a signal, you can disable the circuit breaker check at address 7113 **CHECK CB? (No check)**, as otherwise auto-reclosure would be impossible.

The status monitoring time **CB TIME OUT** can be configured at address 7115 if the circuit breaker check was enabled at address 7113. This time is set slightly higher than the maximum recovery time of the circuit breaker following reclosure. If the circuit breaker is not ready after the time has expired, reclosing is omitted and dynamic blocking is initiated. Automatic reclosure thus is blocked.

Time **Max. DEAD EXT.** serves for monitoring the dead time extension. The extension can be initiated by the circuit breaker monitoring time **CB TIME OUT** and by an external synchronism check.

The monitoring time **Max. DEAD EXT.** is started after the configured dead time has elapsed.

This time must not be shorter than **CB TIME OUT**. When using the monitoring time **CB TIME OUT**, the time **Max. DEAD EXT.** should be set to a value $\geq$ **CB TIME OUT**.

Since the synchronization is used as synchrocheck, the monitoring time can be set quite short, for example to a few seconds. The synchronization function merely "checks" the synchronism of the power systems. If synchronism is detected, it will be connected instantaneously, otherwise it will not.

Generally, the monitoring time should be longer than the maximum duration of the synchronization process (parameter 6112).

The breaker failure monitoring time 7114 **T-Start MONITOR** determines the time between tripping (closing the trip contact) and opening the circuit breaker (checkback of the CB auxiliary contacts or disappearing device pickup if no auxiliary contacts are allocated). This time is started each time a tripping operation takes place. When time has elapsed, the device assumes breaker failure and blocks the automatic reclosure function dynamically.

Action Time

The action time monitors the time between pickup of the device and trip command of a protective function configured as starter while the automatic reclosure function is ready but not yet running. A trip command issued by a protective function configured as starter occurring within the action time will start the automatic reclosing function. If this time differs from the setting value of **T-ACTION** (address 7117), the automatic reclosure function will be blocked dynamically. The trip time of inverse tripping characteristics is considerably determined by the fault location or fault resistance. The action time prevents reclosing in case of far remote or high-resistance faults with long tripping time. Trip commands of protective functions which are not configured as starter do not affect the action time.

Delay of Dead Time Start


The dead time start can be delayed by pickup of the binary input message 2754 *>79 DT St.Delay*. The maximum time for this can be parameterized under 7118 **T DEAD DELAY**. The binary input message must be deactivated again within this time in order to start the dead time. The exact sequence is described in the functional description at margin heading "Delay of Dead Time Start".

Number of Reclosing Attempts

The number of reclosing attempts can be set separately for the "phase program" (address 7136, **# OF RECL. PH**) and "ground program" (address 7135 **# OF RECL. GND**). The exact definition of the programs is described in the functional description at margin heading "Reclosing Programs".

Close Command: Direct or via Control

Address 7137 **Cmd.via control** can be set to either generate directly the close command via the automatic reclosing function (setting **Cmd.via control = none**) or have the closing initiated by the control function. If the automatic reclosure function is to be closed via the control function, the manual closing command has to be suppressed during an automatic reclose command. The example in the Section [2.2.11 Setting Notes](#) of a MANUAL CLOSE for commands via the integrated control function has to be extended in this case (see [Figure 2-93](#)). The messages 2878 *79 L-N Sequence* and 2879 *79 L-L Sequence* indicate that the AR has been started and wants to carry out a reclosure after the dead time. The annunciations set the flipflop and suspend the manual signal until the AR has finished the reclosure attempts. The flipflop is reset via the OR-combination of the annunciations 2784 *79 is NOT ready*, 2785 *79 DynBlock* and 2862 *79 Successful*. Manual closing is initiated if a CLOSE command comes from the control function.

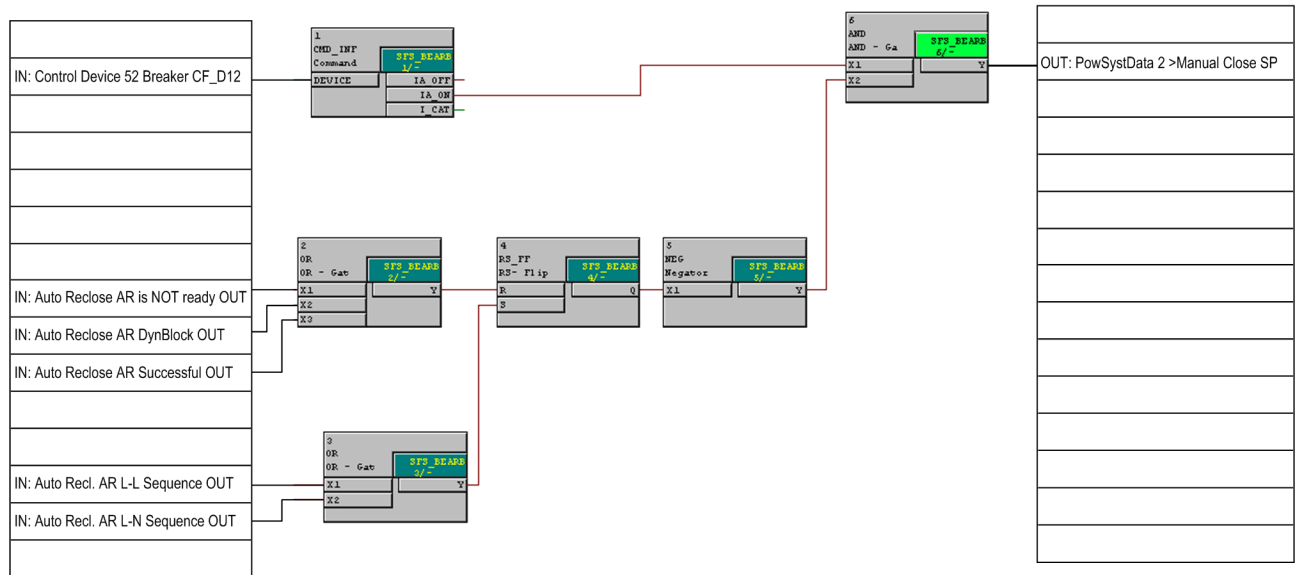

[cfc-logik-handein-awe-steuerung-140503-ko, 1, en_US]

Figure 2-93 CFC logic for Manual Close with automatic reclosing via control

The selection list for parameter 7137 is created dynamically depending on the allocated switchgear components. If one of the switchgear components is selected, usually the circuit breaker *52Breaker*, reclosure is accomplished via control. In this case, the automatic reclosure function does not create a close command but issues a close request. It is forwarded to the control which then takes over the switching. Thus, the properties defined for the switchgear component such as interlocking and command times apply. Hence, it is possible that the close command will not be carried out due to an applying interlocking condition.

If this behavior is not desired, the auto-reclose function can also generate the close command *79 Close* directly which must be allocated to the associated contact. The CFC chart as in [Figure 2-93](#) is not needed in this case.

Connection to the Internal Synchronism Check

The auto-reclose function can interact with the internal synchronization function of the device. If this is desired as well as the Manual Close functionality, the CFC chart illustrated in [Figure 2-93](#) is a definite prerequisite since the synchronization function always interacts with the control function. Additionally, one of the four synchronization groups must be selected via parameter 7138 **Internal SYNC**. The synchronization conditions for automatic reclosure are thereby specified. In that case the selected synchronization group defines the switchgear component to be used (usually the circuit breaker *52Breaker*). The defined switchgear component and the one specified at 7137 **Cmd.via control** must be identical. Synchronous reclosing via the close command *79 Close* is not possible.

If interaction with the internal synchronization is not desired, the CFC Chart, as in [Figure 2-93](#), is not required and the parameter 7138 is set to **none**.

Automatic Reclosure with External Synchronism Check

Parameter 7139 **External SYNC** can be set to determine that the automatic reclosure function operates with external synchrocheck. An external synchronization is possible if the parameter is set to **YES** and the device is connected to the external synchronization check via indication 2865 *79 Sync.Request* and the binary input *>Sync.release*.

Note: The automatic reclosure function cannot be connected to the internal and external synchrocheck at the same time !

Initiation and Blocking of Automatic Reclosure by Protective Elements (configuration)

At addresses 7150 through 7164, and 7166 through 7174, reclosing can be started or blocked for various types of protection functions. Together they constitute the wiring between protection elements and auto-

matic reclosing function. Each address designates a protection element or protection function together with its ANSI synonym, for example **50-2** for the high-set element 50-2 of the non-directional time overcurrent protection (address 7152).

The setting options have the following meaning:

- **Starts 79** the protective element initiates the automatic reclosure via its trip command;
No influence the protective element does not start the automatic reclosure, it may however be initiated by other functions;
Stops 79 the protective element blocks the automatic reclosure, it cannot be started by other functions; a dynamic blocking is initiated.

Dead Times (1st AR)

Addresses 7127 and 7128 are used to determine the duration of the dead times of the 1st cycle. The time defined by this parameter is started when the circuit breaker opens (if auxiliary contacts are allocated) or when the pickup drops out following the trip command of a starter. Dead time before first automatic reclosure for reclosing program "Phase" is set in address 7127 **DEADTIME 1: PH**, for reclosing program "ground" in address 7128 **DEADTIME 1: G**. The exact definition of the programs is described in the functional description at margin heading "Reclosing Programs". The length of the dead time should relate to the type of application. With longer lines, they should be long enough to make sure that the fault arc disappears and that the air surrounding it is de-ionized and auto-reclosure can successfully take place (usually 0.9 s to 1.5 s). For lines supplied by more than one side, mostly system stability has priority. Since the de-energized line cannot transfer synchronizing energy, only short dead times are allowed. Standard values are 0.3 s to 0.6 s. In radial systems, longer dead times are allowed.

Cyclic Control of Protective Functions via Automatic Reclosure

The addresses 7200 to 7211, 7248, 7249, 7256 and 7257 allow the different protection functions to be controlled cyclically by the AR. This enables protection elements to be blocked selectively, set to operate instantaneously or according to the configured delay times. The following settings are available:

The following options are available:

- **Set value $T=T$** The protection element is delayed as configured, i.e. the automatic reclosing function does not effect this element;
instant. $T=0$ The protection element becomes instantaneous if the automatic reclosing function is ready to perform the mentioned cycle;
blocked $T=\infty$ The protection element is blocked if the auto-reclose function reaches the cycle defined in the parameter. The element picks up, however, time expiry of the element is blocked by this setting.

Dead Times (2nd to 4th AR)

If more than one reclosing cycle was set, you can now configure the individual reclosing settings for the 2nd to 4th cycle. The same options are available as for the first cycle.

For the 2nd cycle:

Address 7129	DEADTIME 2: PH	Dead time for the 2nd reclosing attempt phase
Address 7130	DEADTIME 2: G	Dead time for the 2nd reclosing attempt ground
Addresses 7212 to 7223, 7250, 7251, 7258, 7259		Cyclic control of the various protection functions by the 2nd reclosing attempt

For the 3rd cycle:

Address 7131	DEADTIME 3: PH	Dead time for the 3rd reclosing attempt phase
Address 7132	DEADTIME 3: G	Dead time for the 3rd reclosing attempt ground
Addresses 7224 to 7235, 7252, 7253, 7260, 7261		Cyclic control of the various protection functions by the 3rd reclosing attempt

For the 4th cycle:

Address 7133	DEADTIME 4: PH	Dead time for the 4th reclosing attempt phase
Address 7134	DEADTIME 4: G	Dead time for the 4th reclosing attempt ground
Addresses 7236 to 7247, 7254, 7255, 7262, 7263		Cyclic control of the various protection functions by the 4th reclosing attempt

Fifth to Ninth Reclosing Attempt


If more than four cycles are configured, the dead times set for the fourth cycle also apply to the fifth to ninth cycle.

Blocking Three-Phase Faults

Regardless of which reclosing program is executed, automatic reclosing can be blocked for trips following three-phase faults (address 7165 **3Po1.PICKUP BLK**). The pickup of all three phases for a overcurrent element is the criterion required.

Blocking of Automatic Reclosure via Internal Control

The automatic reclosure function can be blocked, if control commands are issued via the integrated control function of the device. The information must be routed via CFC (interlocking task-level) using the CMD_Information function block (see the following figure).

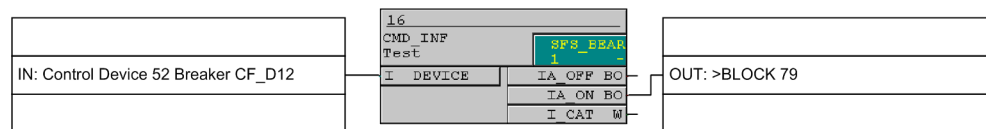

[blockierung-der-wiedereinschaltautomatik-26-06-02-kn, 1, en_US]

Figure 2-94 Blocking of the automatic reclose function using the internal control function

Zone Sequencing / Fuse Saving Scheme

At address 7140 **ZONE SEQ.COORD.**, the zone sequencing feature can be turned **ON** or **OFF**.

If multiple reclosing operations are performed and the zone sequencing function is deactivated, only those reclosing cycles are counted which the device has conducted after a trip command. If the zone sequencing function is switched on, an additional sequence counter also counts such automatic reclosures which (in radial systems) are carried out by relays connected on load side. This presupposes that the pickup of the 50-1/50N-1 elements drops out without a trip command being issued by a protection function starting the automatic reclosing function. The parameters at addresses 7200 to 7263 (see paragraphs below at "Start and Blocking of Automatic Reclosing by Protection Functions" and "Controlling Directional/Non-Directional Overcurrent Protection Elements via Cold Load Pickup") can thus be set to determine which protection elements are active or blocked during what dead time cycles (for multiple reclosing attempts carried out by relays on the load side). In the example shown in Figure "Zone sequencing with a fault occurring at Tap Line 5 and the busbar" (see [Figure 2-92](#)) in the functional description, the zone sequencing was applied in the bus relay. Furthermore, as from the second automatic reclosure, the 50-2 elements (also applicable to the 50-3 elements) must be blocked, i.e. address 7214 **bef.2.Cy:50-2** must be set to **blocked T=∞**. The zone sequencing of the feeder relays is switched off but the 50-2 elements must also be blocked after the second reclosing attempt. Moreover, it must be ensured that the 50-2 elements start the automatic reclosing function: Set address 7152 **50-2** to **Starts 79**.

All settings of the 50-2 and 50-3 elements apply analogously to the 50N-2 and 50N-3 elements.

Controlling Overcurrent Protection Stages via Cold Load Pickup

The dynamic cold load pickup function provides a further alternative to control the protection via the automatic reclosing function (see also Section [2.4 Dynamic Cold Load Pickup](#)). This function contains the parameter 1702 **Start Condition**. It determines the starting conditions for the increased setting values of current and time of the dynamic cold load pickup that must apply for directional and non-directional overcurrent protection.

If address 1702 **Start Condition** = **79 ready**, the overcurrent protection always employs the increased setting values if the automatic reclosing system is ready. The auto-reclosure function provides the signal **79**

ready for controlling the cold load pickup. The signal **79 ready** is always active if the auto-reclosing system is available, active, unblocked and ready for another cycle. Control via the cold load pickup function is not ARcycle- related.

Since control via cold load pickup and cyclic control via auto-reclosing system can run simultaneously, the overcurrent protection must coordinate the input values of the two interfaces. In this context the cyclic auto-reclosing control has the priority and thus overwrites the release of the cold load pickup function.

If the protective elements are controlled via the automatic reclosure function, changing the control variables (e.g. by blocking) has no effect on elements that are already running. The elements in question are continued.

Note Regarding Settings List for Automatic Reclosure Function

The setting options of address 7137 **Cmd.via control** are generated dynamically according to the current configuration.

2.15.7 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
7101	FCT 79	OFF ON	OFF	79 Auto-Reclose Function
7103	BLOCK MC Dur.	0.50 .. 320.00 sec; 0	1.00 sec	AR blocking duration after manual close
7105	TIME RESTRAINT	0.50 .. 320.00 sec	3.00 sec	79 Auto Reclosing reset time
7108	SAFETY 79 ready	0.01 .. 320.00 sec	0.50 sec	Safety Time until 79 is ready
7113	CHECK CB?	No check Chk each cycle	No check	Check circuit breaker before AR?
7114	T-Start MONITOR	0.01 .. 320.00 sec; ∞	0.50 sec	AR start-signal monitoring time
7115	CB TIME OUT	0.10 .. 320.00 sec	3.00 sec	Circuit Breaker (CB) Supervision Time
7116	Max. DEAD EXT.	0.50 .. 1800.00 sec; ∞	100.00 sec	Maximum dead time extension
7117	T-ACTION	0.01 .. 320.00 sec; ∞	∞ sec	Action time
7118	T DEAD DELAY	0.0 .. 1800.0 sec; ∞	1.0 sec	Maximum Time Delay of Dead-Time Start
7127	DEADTIME 1: PH	0.01 .. 320.00 sec	0.50 sec	Dead Time 1: Phase Fault
7128	DEADTIME 1: G	0.01 .. 320.00 sec	0.50 sec	Dead Time 1: Ground Fault
7129	DEADTIME 2: PH	0.01 .. 320.00 sec	0.50 sec	Dead Time 2: Phase Fault
7130	DEADTIME 2: G	0.01 .. 320.00 sec	0.50 sec	Dead Time 2: Ground Fault
7131	DEADTIME 3: PH	0.01 .. 320.00 sec	0.50 sec	Dead Time 3: Phase Fault
7132	DEADTIME 3: G	0.01 .. 320.00 sec	0.50 sec	Dead Time 3: Ground Fault
7133	DEADTIME 4: PH	0.01 .. 320.00 sec	0.50 sec	Dead Time 4: Phase Fault
7134	DEADTIME 4: G	0.01 .. 320.00 sec	0.50 sec	Dead Time 4: Ground Fault
7135	# OF RECL. GND	0 .. 9	1	Number of Reclosing Cycles Ground
7136	# OF RECL. PH	0 .. 9	1	Number of Reclosing Cycles Phase
7137	Cmd.via control	(Einstellmöglichkeiten anwendungsabhängig)	none	Close command via control device
7138	Internal SYNC	(Einstellmöglichkeiten anwendungsabhängig)	none	Internal 25 synchronisation
7139	External SYNC	YES NO	NO	External 25 synchronisation
7140	ZONE SEQ.COORD.	OFF ON	OFF	ZSC - Zone sequence coordination

Addr.	Parameter	Setting Options	Default Setting	Comments
7150	50-1	No influence Starts 79 Stops 79	No influence	50-1
7151	50N-1	No influence Starts 79 Stops 79	No influence	50N-1
7152	50-2	No influence Starts 79 Stops 79	No influence	50-2
7153	50N-2	No influence Starts 79 Stops 79	No influence	50N-2
7154	51	No influence Starts 79 Stops 79	No influence	51
7155	51N	No influence Starts 79 Stops 79	No influence	51N
7156	67-1	No influence Starts 79 Stops 79	No influence	67-1
7157	67N-1	No influence Starts 79 Stops 79	No influence	67N-1
7158	67-2	No influence Starts 79 Stops 79	No influence	67-2
7159	67N-2	No influence Starts 79 Stops 79	No influence	67N-2
7160	67 TOC	No influence Starts 79 Stops 79	No influence	67 TOC
7161	67N TOC	No influence Starts 79 Stops 79	No influence	67N TOC
7162	sens Ground Flt	No influence Starts 79 Stops 79	No influence	(Sensitive) Ground Fault
7163	46	No influence Starts 79 Stops 79	No influence	46
7164	BINARY INPUT	No influence Starts 79 Stops 79	No influence	Binary Input
7165	3Pol.PICKUP BLK	YES NO	NO	3 Pole Pickup blocks 79

Addr.	Parameter	Setting Options	Default Setting	Comments
7166	50-3	No influence Starts 79 Stops 79	No influence	50-3
7167	50N-3	No influence Starts 79 Stops 79	No influence	50N-3
7168	67-3	No influence Starts 79 Stops 79	No influence	67-3
7169	67N-3	No influence Starts 79 Stops 79	No influence	67N-3
7200	bef.1.Cy:50-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50-1
7201	bef.1.Cy:50N-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50N-1
7202	bef.1.Cy:50-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50-2
7203	bef.1.Cy:50N-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50N-2
7204	bef.1.Cy:51	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 51
7205	bef.1.Cy:51N	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 51N
7206	bef.1.Cy:67-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67-1
7207	bef.1.Cy:67N-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67N-1
7208	bef.1.Cy:67-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67-2
7209	bef.1.Cy:67N-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67N-2
7210	bef.1.Cy:67 TOC	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67 TOC
7211	bef.1.Cy:67NTOC	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67N TOC

Addr.	Parameter	Setting Options	Default Setting	Comments
7212	bef.2.Cy:50-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50-1
7213	bef.2.Cy:50N-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50N-1
7214	bef.2.Cy:50-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50-2
7215	bef.2.Cy:50N-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50N-2
7216	bef.2.Cy:51	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 51
7217	bef.2.Cy:51N	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 51N
7218	bef.2.Cy:67-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67-1
7219	bef.2.Cy:67N-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67N-1
7220	bef.2.Cy:67-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67-2
7221	bef.2.Cy:67N-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67N-2
7222	bef.2.Cy:67 TOC	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67 TOC
7223	bef.2.Cy:67NTOC	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67N TOC
7224	bef.3.Cy:50-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50-1
7225	bef.3.Cy:50N-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50N-1
7226	bef.3.Cy:50-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50-2
7227	bef.3.Cy:50N-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50N-2

Addr.	Parameter	Setting Options	Default Setting	Comments
7228	bef.3.Cy:51	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 51
7229	bef.3.Cy:51N	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 51N
7230	bef.3.Cy:67-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67-1
7231	bef.3.Cy:67N-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67N-1
7232	bef.3.Cy:67-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67-2
7233	bef.3.Cy:67N-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67N-2
7234	bef.3.Cy:67 TOC	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67 TOC
7235	bef.3.Cy:67NTOC	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67N TOC
7236	bef.4.Cy:50-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50-1
7237	bef.4.Cy:50N-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50N-1
7238	bef.4.Cy:50-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50-2
7239	bef.4.Cy:50N-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50N-2
7240	bef.4.Cy:51	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 51
7241	bef.4.Cy:51N	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 51N
7242	bef.4.Cy:67-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67-1
7243	bef.4.Cy:67N-1	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67N-1

Addr.	Parameter	Setting Options	Default Setting	Comments
7244	bef.4.Cy:67-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67-2
7245	bef.4.Cy:67N-2	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67N-2
7246	bef.4.Cy:67 TOC	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67 TOC
7247	bef.4.Cy:67NTOC	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67N TOC
7248	bef.1.Cy:50-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50-3
7249	bef.1.Cy:50N-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50N-3
7250	bef.2.Cy:50-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50-3
7251	bef.2.Cy:50N-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50N-3
7252	bef.3.Cy:50-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50-3
7253	bef.3.Cy:50N-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50N-3
7254	bef.4.Cy:50-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50-3
7255	bef.4.Cy:50N-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50N-3
7256	bef.1.Cy:67-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67-3
7257	bef.1.Cy:67N-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: IE>>> directional
7258	bef.2.Cy:67-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67-3
7259	bef.2.Cy:67N-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: IE>>> directional

Addr.	Parameter	Setting Options	Default Setting	Comments
7260	bef.3.Cy:67-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67-3
7261	bef.3.Cy:67N-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: IE>>> directional
7262	bef.4.Cy:67-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67-3
7263	bef.4.Cy:67N-3	Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67N-3

2.15.8 Information List

No.	Information	Type of Information	Comments
127	79 ON/OFF	IntSP	79 ON/OFF (via system port)
2701	>79 ON	SP	>79 ON
2702	>79 OFF	SP	>79 OFF
2703	>BLOCK 79	SP	>BLOCK 79
2711	>79 Start	SP	>79 External start of internal A/R
2715	>Start 79 Gnd	SP	>Start 79 Ground program
2716	>Start 79 Ph	SP	>Start 79 Phase program
2722	>ZSC ON	SP	>Switch zone sequence coordination ON
2723	>ZSC OFF	SP	>Switch zone sequence coordination OFF
2730	>CB Ready	SP	>Circuit breaker READY for reclosing
2731	>Sync.release	SP	>79: Sync. release from ext. sync.-check
2753	79 DT delay ex.	OUT	79: Max. Dead Time Start Delay expired
2754	>79 DT St.Delay	SP	>79: Dead Time Start Delay
2781	79 OFF	OUT	79 Auto recloser is switched OFF
2782	79 ON	IntSP	79 Auto recloser is switched ON
2784	79 is NOT ready	OUT	79 Auto recloser is NOT ready
2785	79 DynBlock	OUT	79 - Auto-reclose is dynamically BLOCKED
2788	79 T-CBreadyExp	OUT	79: CB ready monitoring window expired
2801	79 in progress	OUT	79 - in progress
2808	79 BLK: CB open	OUT	79: CB open with no trip
2809	79 T-Start Exp	OUT	79: Start-signal monitoring time expired
2810	79 TdeadMax Exp	OUT	79: Maximum dead time expired
2823	79 no starter	OUT	79: no starter configured
2824	79 no cycle	OUT	79: no cycle configured
2827	79 BLK by trip	OUT	79: blocking due to trip
2828	79 BLK:3ph p.u.	OUT	79: blocking due to 3-phase pickup
2829	79 Tact expired	OUT	79: action time expired before trip
2830	79 Max. No. Cyc	OUT	79: max. no. of cycles exceeded
2844	79 1stCyc. run.	OUT	79 1st cycle running

No.	Information	Type of Information	Comments
2845	79 2ndCyc. run.	OUT	79 2nd cycle running
2846	79 3rdCyc. run.	OUT	79 3rd cycle running
2847	79 4thCyc. run.	OUT	79 4th or higher cycle running
2851	79 Close	OUT	79 - Close command
2862	79 Successful	OUT	79 - cycle successful
2863	79 Lockout	OUT	79 - Lockout
2865	79 Sync.Request	OUT	79: Synchro-check request
2878	79 L-N Sequence	OUT	79-A/R single phase reclosing sequence
2879	79 L-L Sequence	OUT	79-A/R multi-phase reclosing sequence
2883	ZSC active	OUT	Zone Sequencing is active
2884	ZSC ON	OUT	Zone sequence coordination switched ON
2885	ZSC OFF	OUT	Zone sequence coordination switched OFF
2889	79 1.CycZoneRel	OUT	79 1st cycle zone extension release
2890	79 2.CycZoneRel	OUT	79 2nd cycle zone extension release
2891	79 3.CycZoneRel	OUT	79 3rd cycle zone extension release
2892	79 4.CycZoneRel	OUT	79 4th cycle zone extension release
2899	79 CloseRequest	OUT	79: Close request to Control Function

2.16 Fault Locator

The measurement of the distance to a short-circuit fault is a supplement to the protection functions. Power transmission within the system can be increased when the fault is located and cleared faster.

2.16.1 Functional Description

General

The fault locator is a stand-alone and independent function which uses the line and power system parameters set in other functions. In the event of a fault, it is addressed by the protection functions provided in the 7SJ80 device.

The protected object can e.g. be an inhomogeneous line. For calculation purposes, the line can be divided into different sections, for example, a short cable followed by an overhead line. In such protected objects, you can configure each section individually. Without this information, the fault locator uses the general line data (see Section 2.1.6.2 *Setting Notes*).

The fault locator also calculates double ground faults with different base points, reverse faults and faults that are located behind the configured sections. For faults that are not located within the configured sections, the fault locator uses the general line data.

The fault locator can be triggered by the trip command of the non-directional or directional time overcurrent protection, or by each fault detection. In the latter case, fault location calculations is even possible if another protection relay cleared the fault. Additionally, the fault location can be initiated via a binary input. However, it is a prerequisite that pickup of the time overcurrent protection is performed at the same time (directional or nondirectional).

Fault Location Determination

The measurement principle of the fault locator is based on the calculation of impedances.

Sampled value pairs of short-circuit current and short-circuit voltage are stored in a buffer (at a sampling rate of 1/16 cycle) shortly after the trip command. At that time, even with very fast circuit breakers, no errors in the measured values have occurred during the shutdown procedure. Measured value filtering and the number of impedance calculations are adjusted automatically to the number of stable measured value pairs in the determined data window. If no sufficient data windows with reliable values could be determined for fault location, message *Flt.Loc.invalid* is issued.

The fault locator evaluates the short-circuit loops and uses the loops with the lowest fault impedance (see margin heading "Loop Selection").

Loop Selection

Using the pickup of the time overcurrent protection (directional or non-directional), the valid measurement loops for the calculation of fault impedance are selected.

The following table shows the assignment of the evaluated loops to the possible pickup scenarios of the protection elements.

Pickup by				Fault Type	Measured Loop	Signaled Loop
A	B	C	N			
x				A	A-N	A-N
	x			B	B-N	B-N
		x		C	C-N	C-N
			x	N	A-N, B-N, C-N	signaled loop
x			x	A-N	A-N	A-N
	x		x	B-N	B-N	B-N
		x	x	C-N	C-N	C-N
x	x			A-B	A-B	A-B
x		x		A-C	A-C	A-C

Pickup by				Fault Type	Measured Loop	Signaled Loop
A	B	C	N			
	x	x		B-C	B-C	B-C
x	x		x	A-B-N	A-B, A-N, B-N	signaled loop
x		x	x	A-C-N	C-A, A-N, B-N	signaled loop
	x	x	x	B-C-N	B-C, B-N, C-N	signaled loop
x	x	x		A-B-C	A-B, B-C, C-A	signaled loop
x	x	x	x	A-B-C-N	A-B, B-C, C-A, A-N, B-N, C-N	signaled loop

Output of Fault Location

The following information is output as result of the fault location:

- the short-circuit loop from which the fault reactance was determined,
- the fault reactance X in Ω primary and Ω secondary,
- the fault resistance R in Ω primary and Ω secondary,
- the distance to fault d in kilometers or miles of the line proportional to the reactance, converted on the basis of the set line reactance per unit line length,
- the distance to fault d in % of the line length, calculated on the basis of the set reactance per unit length and the set line length.

Line Sections

The line type is determined by the line section settings. If, for instance, the line includes a cable and an overhead line, two different sections must be configured. The system can distinguish between up to three different line types. When configuring this line data, please note that the different tabs for setting the line sections will only be displayed if more than one line section has been configured under the functional scope (address 181). The parameters for a line section are entered in the Setting tab .

2.16.2 Setting Notes

General

The fault location is only enabled if address 180 was set to **Enabled** during configuration of the function extent.

Under address 181 **L-sections FL** the number of line section must be selected, which is required for the accurate description of the line. If the number is set to **2 Sections** or **3 Sections**, further setting sheets appear in the Power System Data 2 in DIGSI. Default setting is **1 Section**.

Line Data

To calculate the fault distance in kilometers or miles, the device needs the per distance reactance of the line in $\Omega/\text{kilometer}$ or Ω/mile . Furthermore, the line length in km or miles, the angle of the line impedance, and resistance and reactance ratios are required. These parameters have already been set in the Power System Data 2 for a maximum of 3 line sections (see Section 2.1.6.2 [Setting Notes](#) under "Ground Impedance Ratios" and "Reactance per Unit Length").

Initiation of Measurement

Normally the fault location calculation is started when a directional or non-directional time overcurrent protection initiates a trip signal (address 8001 **START = TRIP**). However, it may also be initiated when pickup drops out (address 8001 **START = Pickup**), e.g. when another protection element clears the fault. Irrespective of this fact, calculation of the fault location can be triggered externally via a binary input. (FNo. 1106 **>Start Flt. Loc**) provided the device has picked up.

2.16.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
8001	START	Pickup TRIP	Pickup	Start fault locator with

2.16.4 Information List

No.	Information	Type of Information	Comments
1106	>Start Flt. Loc	SP	>Start Fault Locator
1114	Rpri =	VI	Flt Locator: primary RESISTANCE
1115	Xpri =	VI	Flt Locator: primary REACTANCE
1117	Rsec =	VI	Flt Locator: secondary RESISTANCE
1118	Xsec =	VI	Flt Locator: secondary REACTANCE
1119	dist =	VI	Flt Locator: Distance to fault
1120	d[%] =	VI	Flt Locator: Distance [%] to fault
1122	dist =	VI	Flt Locator: Distance to fault
1123	FL Loop AG	OUT	Fault Locator Loop AG
1124	FL Loop BG	OUT	Fault Locator Loop BG
1125	FL Loop CG	OUT	Fault Locator Loop CG
1126	FL Loop AB	OUT	Fault Locator Loop AB
1127	FL Loop BC	OUT	Fault Locator Loop BC
1128	FL Loop CA	OUT	Fault Locator Loop CA
1132	Flt.Loc.invalid	OUT	Fault location invalid

2.17 Breaker Failure Protection 50BF

The breaker failure protection function monitors proper tripping of the relevant circuit breaker..

2.17.1 Functional Description

General

If after a programmable time delay, the circuit breaker has not opened, breaker failure protection issues a trip signal to isolate the failure breaker by tripping other surrounding backup circuit breaker (see example in the figure below).

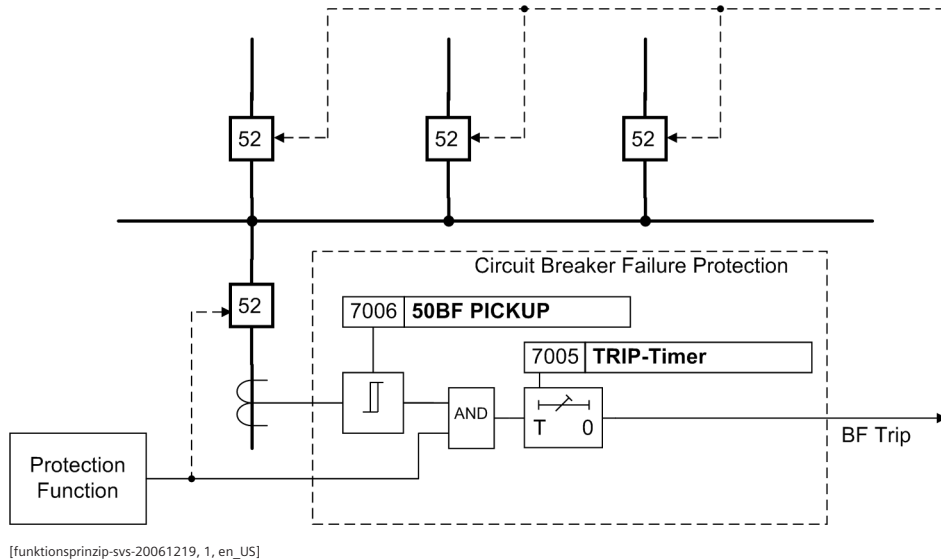


Figure 2-95 Function principle of the breaker failure protection

Initiation

The breaker failure protection function can be initiated by two different sources:

- Trip signals of internal protective functions of the 7SJ80,
- external trip signals via binary inputs (>50BF ext SRC).

For each of the two sources, a unique pickup message is generated, a unique time delay is initiated, and a unique trip signal is generated. The setting values of current threshold and delay time apply to both sources.

Criteria

There are two criteria for breaker failure detection:

- Check whether the current flow has effectively disappeared after a tripping command was issued,
- Evaluate the circuit breaker's auxiliary contacts.


The criteria used to determine if the circuit breaker has operated are selectable and also depend on the protection function that initiated the breaker failure function. On tripping without fault current, e.g. via voltage protection, the current below the threshold **50BF PICKUP** is not a reliable indication of the proper functioning of the circuit breaker. In such cases, pickup exclusively depends on the auxiliary contact criterion. In protection functions based on the measurement of currents (including all short-circuit protection functions), the current flow is a preferential criterion, i.e. it is given priority, as opposed to the auxiliary contacts. If current flows above the set threshold or thresholds (**enabled w/ 3I0**) are detected, the breaker failure protection trips even if the auxiliary criterion indicates "Breaker Open".

Monitoring of the Current Flow

Address 170 **50BF** can be set in such a way that either the current criterion can already be met by a single phase current (setting **Enabled**) or that another current is taken into consideration in order to check the plausibility (setting **enabled w/ 3I0>**), see [Figure 2-96](#).

The currents are filtered through numerical filters to evaluate only the fundamental harmonic. They are monitored and compared to the set threshold values. Besides the three phase currents, two additional currents are provided to enable a plausibility check. Separate threshold values can be used for this plausibility check if this is configured accordingly. To detect ground faults more quickly, the threshold value for the ground current can also be used for checking the plausibility of the phase currents. This function is activated via binary input **>50BFactiv. 3I0>** (see [Figure 2-96](#)).

The ground current I_N ($3 \cdot I_0$) is preferably used as plausibility current. Via the parameters 613 you decide whether the measured (**I_{gnd} (measured)**) or the calculated (**3I0 (calcul.)**) values are to be used. In case of system faults not involving ground currents, no increased ground currents/residual currents are flowing, and therefore the calculated triple negative sequence current $3 \cdot I_{2I_2}$ or a second phase current is used as plausibility current.

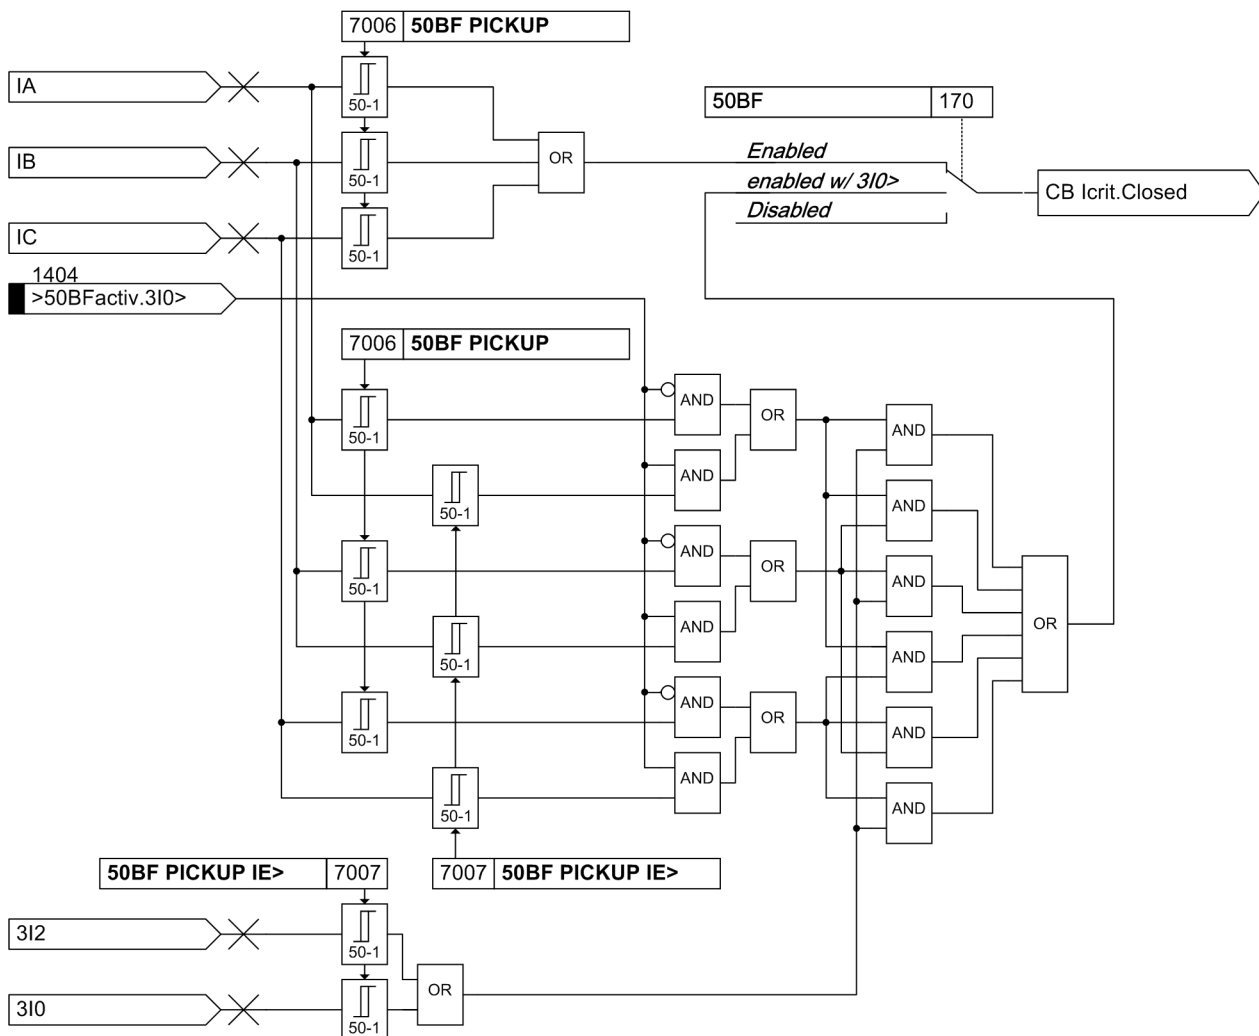

[7sj80-plausibilitaet-i-sv-20061218, 1, en_US]

Figure 2-96 Monitoring of the current flow


Monitoring of the Circuit Breaker Auxiliary Contacts

Evaluation of the circuit breaker's auxiliary contacts depends on the type of contacts, and how they are connected to the binary inputs:

- the auxiliary contacts for circuit breaker "open" (4602 >52-b) and "closed" (4601 >52-a) are configured,
- only the auxiliary contact for circuit breaker "open" is configured (4602 >52-b),
- only the auxiliary contact for circuit breaker "closed" is configured (4601 >52-a),
- none of the two auxiliary contacts is configured.

Feedback information of the auxiliary status of the circuit breaker is evaluated, depending on the allocation of binary inputs and auxiliary contacts. After a trip command has been issued it is the aim to detect — if possible — by means of the feedback of the circuit breaker's auxiliary contacts whether the breaker is open or in intermediate position. If valid, this information can be used for a proper initiation of the breaker failure protection function.

The logic diagram illustrates the monitoring of the circuit breaker's auxiliary contacts.

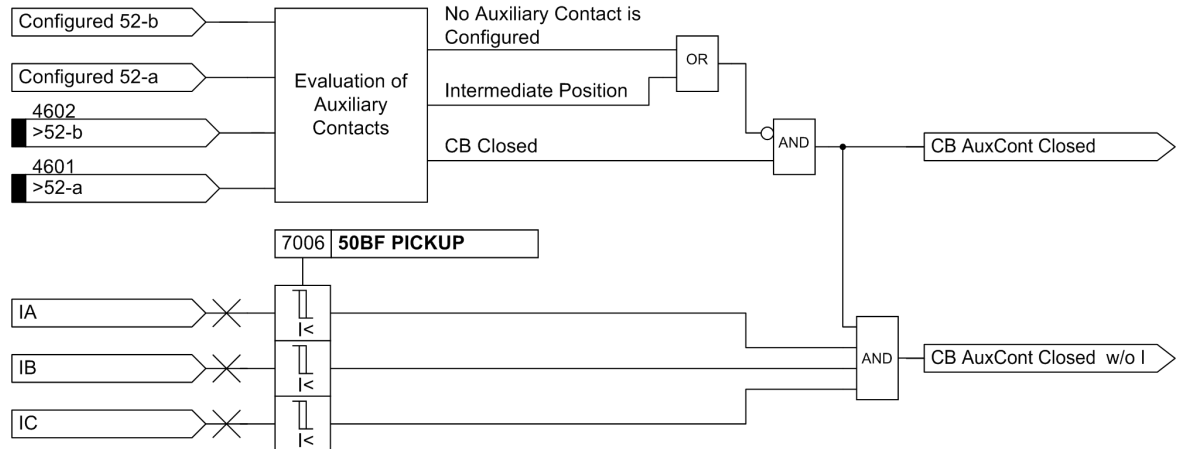

[7sj80-erzeug-svs-int-sign, 1, en_US]

Figure 2-97 Logic diagram for breaker failure protection, monitoring of the circuit-breaker auxiliary contacts

Logic

The entire breaker failure protection function may be turned on or off, or it can be blocked dynamically via binary inputs. If breaker failure protection is initiated, an alarm message is generated. With the initiation, two setable delay times are started. One delay time can be used to repeat the trip command to the local circuit breaker. The other is used to trip the higher-level circuit breaker. If criteria for a pickup are still met once the time delays have elapsed, the trip signals are issued successively

If the criteria that led to the pickup are no longer met, after the time delays have elapsed, then the pickup will drop out and no trip signal is issued by the breaker failure protection function.

To protect against nuisance tripping due to excessive contact bounce, a stabilization of the binary inputs for external trip signals takes place. This external signal must be present during the entire period of the delay times, otherwise the timer is reset and no tripping signal is issued.

The following figure shows the logic diagram for the breaker failure protection function.



Figure 2-98 Logic diagram of the breaker failure protection

2.17.2 Setting Notes

Breaker failure protection is only effective and accessible if address 170 50BF is set to **Enabled** or **enabled** w/ 3I0>. Setting **Enabled** considers the three phase currents for total current monitoring. Setting **enabled** w/ 3I0> additionally evaluates the ground current or the negative sequence system when only one phase current occurs.

If this function is not required, then *Disabled* is set. The function can be set to *ON* or *OFF* under address 7001 **FCT** 50BF.


Criteria

Address 7004 **Chk BRK CONTACT** establishes whether or not the breaker auxiliary contacts connected via binary inputs are to be used as a criterion for pickup. If this address is set to **ON**, then current criterion and/or the auxiliary contact criterion apply. This setting must be selected if the breaker failure protection is started by functions, which do not always have a certain criterion for detection of an open circuit breaker, e.g. voltage protection.

Single-Element Breaker Failure Protection

In single-element breaker failure protection, the adjacent circuit breakers, i.e. the breakers of the busbar or the busbar section affected, and where applicable also the breaker at the remote end, are tripped after the time delay **TRIP-Timer** (address 7005) has elapsed. The time **50BF-2 Delay** (address 7008) is in this case set to infinite because it is not needed.

The time delay to be set should be based on the maximum circuit breaker operating time plus the dropout time of the current flow monitoring element plus a safety margin which takes into consideration the tolerance of the time delay. In case of an external start, the set time delay is reduced automatically by 10 ms in order to compensate the residual time of the external start. [Figure 2-99](#) illustrates the time sequences in an example.

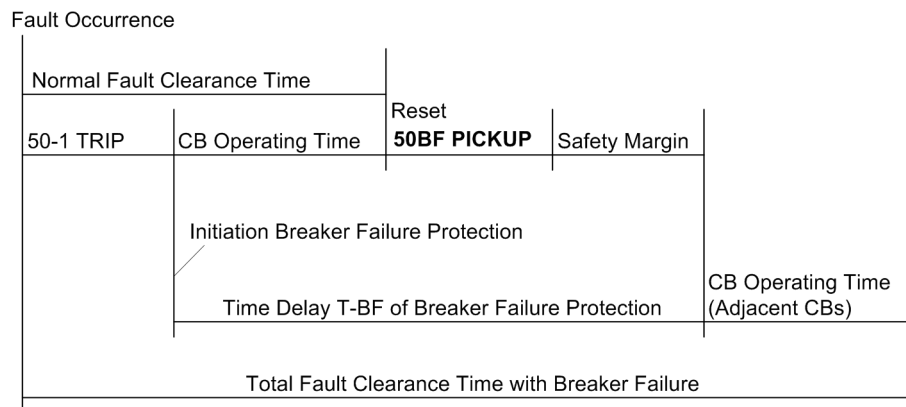

[abl-bei-norm-fehlerkllaer-u-bei-lsvs-20061220, 1, en_US]

Figure 2-99 Time sequence example for normal clearance of a fault, and for circuit breaker failure with single-element breaker failure protection


Two-Element Breaker Failure Protection

In two-element breaker failure protection, the trip command is output again to the local feeder circuit breaker, normally to a separate set of trip coils of the feeder breaker, after the time delay **TRIP-Timer** (address 7005) has elapsed.

If the circuit breaker does not respond to the repeated trip, the adjacent circuit breakers, i.e. the breakers of the busbar or the busbar section affected, and where applicable also the breaker at the remote end, are tripped after the time delay **50BF-2 Delay** (Adresse 7008) has elapsed and the fault still exists.

The time delays to be set should be based on the maximum circuit breaker operating time plus the dropout time of the current flow monitoring element plus a safety margin which takes into consideration the tolerance of the time delay. In case of an external start, the set time delay is reduced automatically by 10 ms in order to compensate the residual time of the external start. [Figure 2-100](#) illustrates the time sequences in an example.

Fault Occurrence

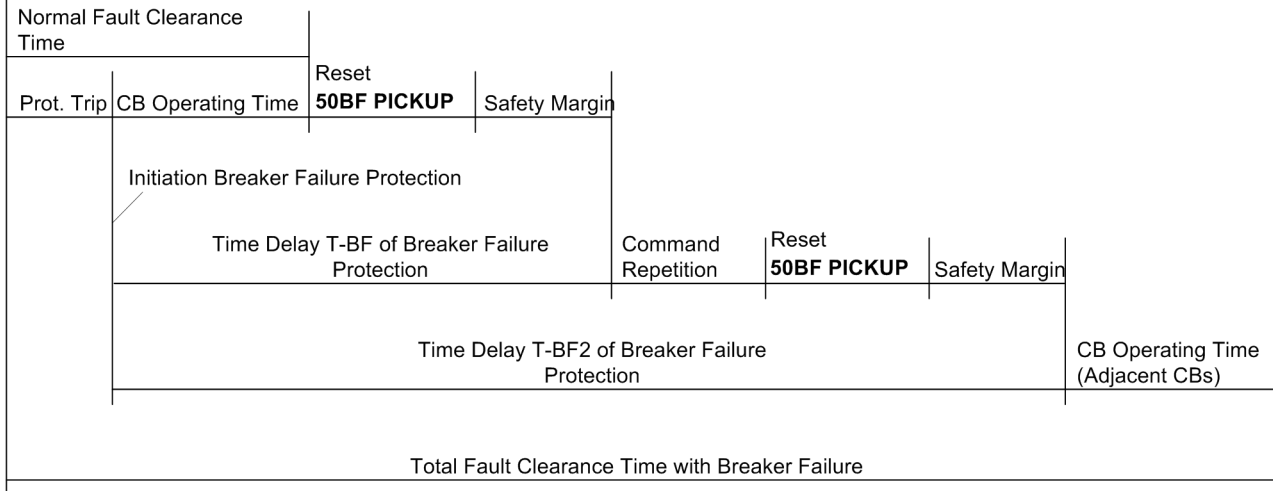

[abl-bei-norm-fehlerklaer-u-bei-lsvs-2stufig-090116, 1, en_US]

Figure 2-100 Time sequence example for normal clearance of a fault, and for circuit breaker failure with two-element breaker failure protection

Pickup Values

The pickup value of the current flow monitoring is set under address 7006 **50BF PICKUP**, and the pickup value of the ground current monitoring under address 7007 **50BF PICKUP IE>**. The threshold values must be set at a level below the minimum fault current for which the total current monitoring must operate. A setting of 10 % below the minimum fault current for which breaker failure protection must operate is recommended. The pickup value should not be set too low since otherwise there is a risk that transients in the current transformer secondary circuit may lead to extended dropout times if extremely high currents are switched off.

Via binary input 1404 *>50BFactiv.3IO>* you can activate the threshold value **50BF PICKUP IE>** also for checking the plausibility of the phase currents.

2.17.3 Settings

The table indicates region-specific presettings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
7001	FCT 50BF		OFF ON	OFF	50BF Breaker Failure Protection
7004	Chk BRK CONTACT		OFF ON	OFF	Check Breaker contacts
7005	TRIP-Timer		0.06 .. 60.00 sec; ∞	0.25 sec	TRIP-Timer
7006	50BF PICKUP	1A	0.05 .. 20.00 A	0.10 A	50BF Pickup current threshold
		5A	0.25 .. 100.00 A	0.50 A	
7007	50BF PICKUP IE>	1A	0.05 .. 20.00 A	0.10 A	50BF Pickup earth current threshold
		5A	0.25 .. 100.00 A	0.50 A	
7008	50BF-2 Delay		0.06 .. 60.00 sec; ∞	0.50 sec	Delay of 2nd stage for busbar trip

2.17.4 Information List

No.	Information	Type of Information	Comments
1403	>BLOCK 50BF	SP	>BLOCK 50BF
1404	>50BFactiv.3I0>	SP	>50BF Activate 3I0> threshold
1431	>50BF ext SRC	SP	>50BF initiated externally
1451	50BF OFF	OUT	50BF is switched OFF
1452	50BF BLOCK	OUT	50BF is BLOCKED
1453	50BF ACTIVE	OUT	50BF is ACTIVE
1456	50BF int Pickup	OUT	50BF (internal) PICKUP
1457	50BF ext Pickup	OUT	50BF (external) PICKUP
1471	50BF TRIP	OUT	50BF TRIP
1480	50BF int TRIP	OUT	50BF (internal) TRIP
1481	50BF ext TRIP	OUT	50BF (external) TRIP
1494	50BF TRIP 2	OUT	50BF TRIP 2

2.18 Flexible Protection Functions

The flexible protection function is applicable for a variety of protection principles. The user can create up to 20 flexible protection functions and configure them according to their function. Each function can be used either as an autonomous protection function, as an additional protective element of an existing protection function or as a universal logic, e.g. for monitoring tasks.

2.18.1 Functional Description

General

The function is a combination of a standard protection logic and a characteristic (measured quantity or derived quantity) that is adjustable via parameters. The characteristics listed in table 2-20 and the derived protection functions are available.

Please note that with voltage connection type **Vab**, **Vbc** or **Vab**, **Vbc**, **VSyn** or **Vab**, **Vbc**, **Vx** (address 213 **VT Connect. 3ph**) the power values are only available if you have symmetrical voltage conditions within the network and address 207 **Vol. Symmetry** is set to **YES** (Power System Data 1).

Table 2-15 Possible Protection Functions

Characteristic Group	Characteristic / Measured Quantity		Protective Function	ANSI-No.	Mode of Operation	
					3-phase	1-phase
Current	I	RMS value of fundamental component	Time overcurrent protection	50, 50G	X	X
	I_{rms}	True RMS (r.m.s. value)	Time overcurrent protection Thermal overload protection	50, 50G	X	X
	$3I_0$	Zero sequence system	Time overcurrent protection, ground	50N	X	
	I_1	Positive-sequence component			X	
	I_2	Negative-sequence component	Negative sequence protection	46	X	
	I_2/I_1	Positive/negative sequence component ratio			X	
Frequency	f	Frequency	Frequency protection	81U/O	without phase reference	
	df/dt	Frequency change	Frequency change protection	81R		
Voltage	V	RMS value of fundamental component	Voltage protection Displacement voltage	27, 59, 59G, 59N, 59NC	X	X
	V_{rms}	True RMS (r.m.s. value)	Voltage protection Displacement voltage	27, 59, 59G, 59N, 59NC	X	X
	$3V_0$	Zero sequence system	Displacement voltage	59N	X	
	V_1	Positive-sequence component	Voltage protection	27, 59	X	
	V_2	Negative-sequence component	Voltage asymmetry	47	X	
	dV/dt	Voltage change	Voltage change protection		X	

Characteristic Group	Characteristic / Measured Quantity		Protective Function	ANSI-No.	Mode of Operation	
					3-phase	1-phase
Power	P	Real power	Reverse power protection Power protection	32R, 32, 37	X	X
	Q	Reactive power	Power protection	32	X	X
	cos φ	Power factor	Power factor	55	X	X
Binary input	–	Binary input	Direct coupling		without phase reference	

Section [2.19 Reverse-Power Protection Application with Flexible Protection Function](#) gives an application example of the function “reverse power protection”.

The maximum 20 configurable protection functions operate independently of each other. The following description concerns one function; it can be applied accordingly to all other flexible functions. The logic diagram [Figure 2-101](#) illustrates the description.

Functional Logic

The function can be switched **OFF** and **ON** or, it can be set to **Alarm Only**. In this status, a pickup condition will neither initiate fault recording nor start the trip time delay. Tripping is thus not possible.

Changing the Power System Data 1 after flexible functions have been configured may cause these functions to be set incorrectly. Message (FNo.235.2128 *\$00 inva1.set*) reports this condition. The function is inactive in this case and function's setting has to be modified.

Blocking Functions

The function can be blocked via binary input (FNo. 235.2110 *>BLOCK \$00*) or via local operating terminal (“Control”->“Tagging”->“Set”). Blocking will reset the function's entire measurement logic as well as all running times and indications. Blocking via the local operating terminal may be useful if the function is in a status of permanent pickup which does not allow the function to be reset.

In context with voltage-based characteristics, the function can be blocked if one of the measuring voltages fails. Recognition of this status is either accomplished by the relay's internal „Fuse-Failure-Monitor“ (FNo. 170 *VT FuseFail*; see section [2.11.1 Measurement Supervision](#)) or via auxiliary contacts of the voltage transformer CB (FNo. 6509 *>FAIL:FEEDER VT* and FNo. 6510 *>FAIL: BUS VT*). This blocking mechanism can be enabled or disabled in the according parameters. The associated parameter **BLK.by Vol.Loss** is only available if the characteristic is based on a voltage measurement.

When using the flexible function for power protection or power monitoring, it will be blocked if currents fall below $0.03 \cdot I_{Nom}$.

Parameter **BLK f out of r** allows you to specify whether the protection function is blocked if the measured power frequency is outside the operating range of the function (25 Hz to 70 Hz).

Operating Mode, Measured Quantity, Measurement Method

The flexible function can be tailored to assume a specific protective function for a concrete application in parameters **OPERRAT. MODE**, **MEAS. QUANTITY**, **MEAS. METHOD** and **PICKUP WITH**. Parameter **OPERRAT. MODE** can be set to specify whether the function works **3-phase**, **1-phase** or **no reference**, i.e. without a fixed phase reference. The three-phase method evaluates all three phases in parallel. This implies that threshold evaluation, pickup indications and trip time delay are accomplished selectively for each phase and parallel to each other. This may be for example the typical operating principle of a three-phase time overcurrent protection.

When operating single-phase, the function employs either a phase's measured quantity, which must be stated explicitly, (e.g. evaluating only the current in phase **Ib**), or the measured ground current **In** or the measured displacement voltage **Vn**.

If the characteristic relates to the frequency or if external trip commands are used, the operating principle is without (fixed) phase reference. Additional parameters can be set to specify the used **MEAS. QUANTITY** and the **MEAS. METHOD**. The **MEAS. METHOD** determines for current and voltage measured values whether the function uses the RMS value of the fundamental component or the normal RMS value (true RMS) that evaluates also harmonics. All other characteristics use always the rms value of the fundamental component. Param-


eter **PICKUP WITH** moreover specifies whether the function picks up on exceeding the threshold (>-element) or on falling below the threshold (<-element).

Characteristic Curve

The function's characteristic curve is always "definite time"; this means that the time delay is not affected by the measured quantity.

Function Logic

The following figure shows the logic diagram of a three-phase function. If the function operates on one phase or without phase reference, phase selectivity and phase-specific indications are not relevant.

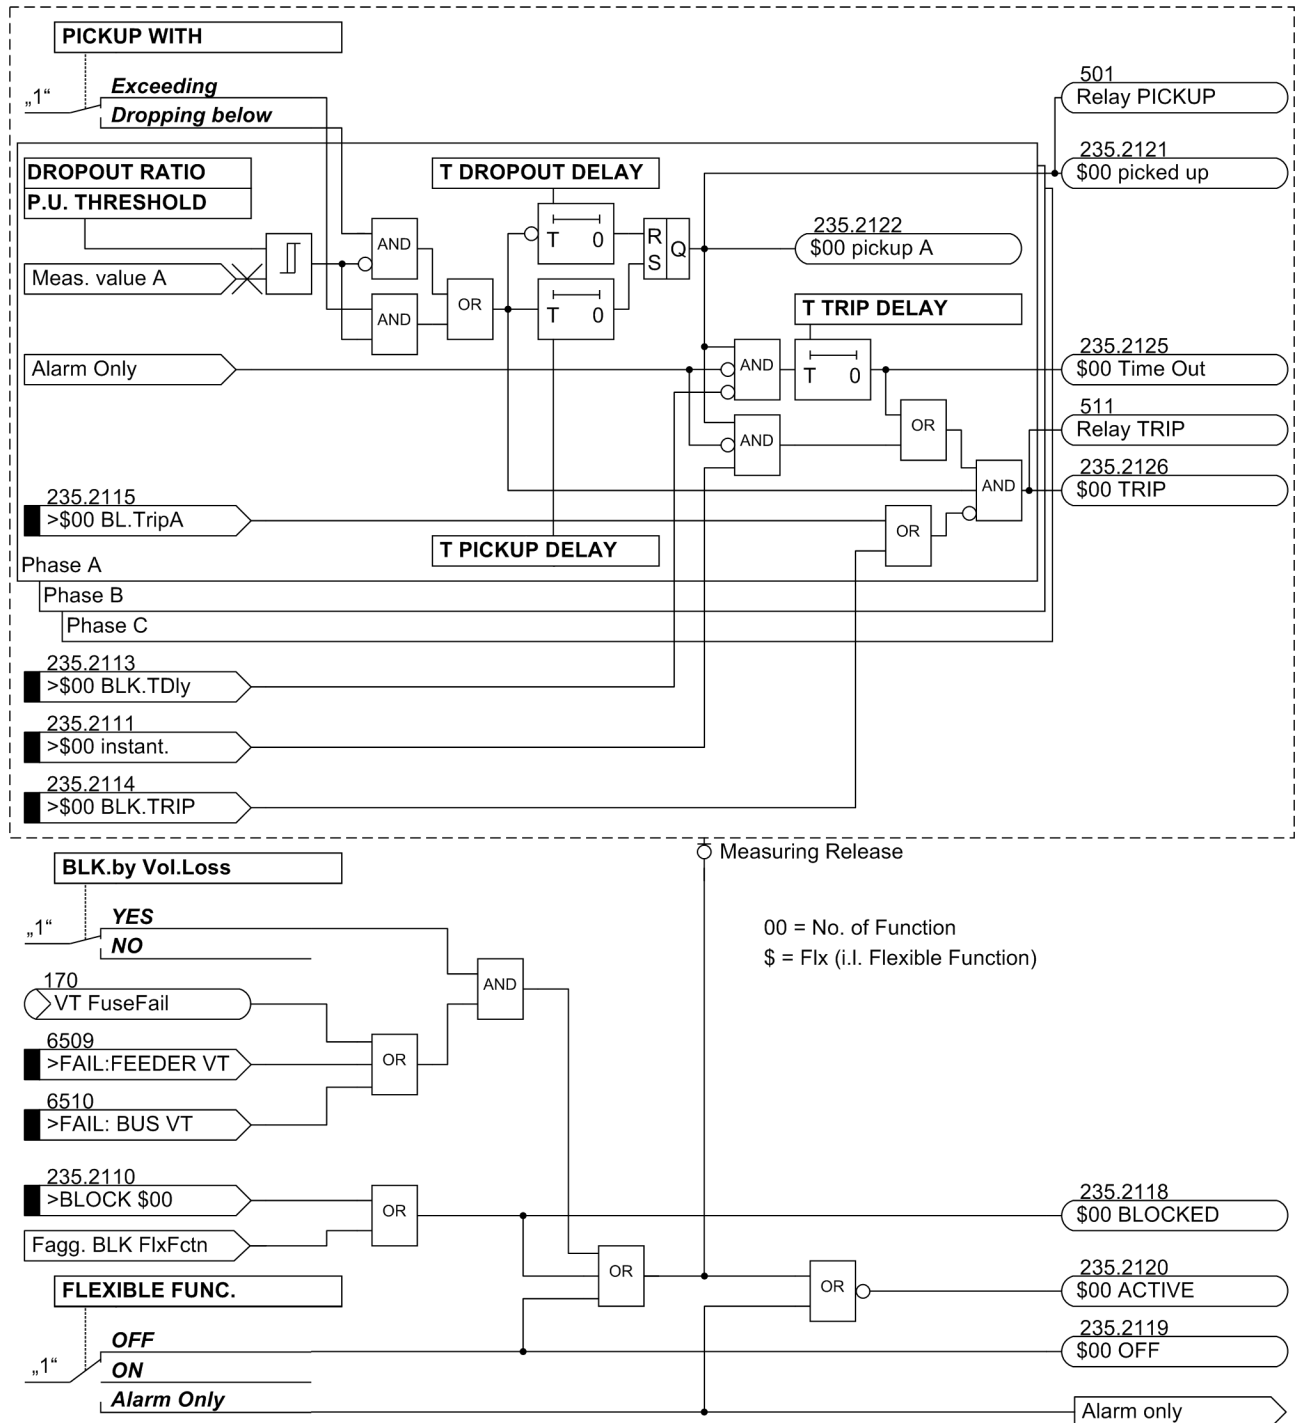

[logik-flexstz-100504-st, 1, en_US]

Figure 2-101 Logic diagram of the flexible protection functions

The parameters can be set to monitor either exceeding or dropping below of the threshold. The configurable pickup time delay will be started once the threshold (>-element) has been exceeded. When the time delay has elapsed and the threshold is still violated, the pickup of the phase (e.g. no. 235.2122 *\$00 pickup A*) and of the function (no. 235.2121 *\$00 picked up*) is reported. If the pickup delay is set to zero, the pickup will occur simultaneously with the detection of the threshold violation. If the function is enabled, the pickup will start the trip time delay and the fault log. This is not the case if set to "Alarm only". If the threshold violation persists after the trip time delay has elapsed, the trip will be initiated upon its expiration (no. 235.2126 *\$00 TRIP*). The timeout is reported via (no. 235.2125 *\$00 Time Out*). Expiry of the trip time delay can be

blocked via binary input (no. 235.2113 $> \$00 \text{ BLK. TDly}$). The time delay will not be started as long as the binary input is active; a trip can thus be initiated. The time delay is started after the binary input has dropped out and the pickup is still present. It is also possible to bypass the expiration of the time delay by activating binary input (no. 235.2111 $> \$00 \text{ instant.}$). The trip will be launched immediately when the pickup is present and the binary input has been activated. The trip command can be blocked via binary inputs (no. 235.2115 $> \$00 \text{ BL. TripA}$) and (no. 235.2114 $> \$00 \text{ BLK. TRIP}$). The phase-selective blocking of the trip command is required for interaction with the inrush restraint (see "Interaction with other functions"). The function's dropout ratio can be set. If the threshold ($>$ -element) is undershot after the pickup, the dropout time delay will be started. The pickup is maintained during that time, a started trip delay time continues to count down. If the trip time delay has elapsed while the dropout time delay is still during, the trip command will only be given if the current threshold is exceeded. The element will only drop out when the dropout time delay has elapsed. If the time is set to zero, the dropout will be initiated immediately once the threshold is undershot.

External Trip Commands

The logic diagram does not explicitly depict the external trip commands since their functionality is analogous. If the binary input is activated for external trip commands (no. 235.2112 $> \$00 \text{ Dir. TRIP}$), it will be logically treated as threshold overshooting, i.e. once it has been activated, the pickup time delay is started. If the pickup time delay is set to zero, the pickup condition will be reported immediately starting the trip time delay. Otherwise, the logic is the same as depicted in [Figure 2-101](#).

Interaction with Other Functions

The flexible protection functions interact with a number of other functions such as the

- Breaker failure protection:
The breaker failure protection is started automatically if the function initiates a trip. The trip will, however, only take place if the current criterion is met at this time, i.e. the set minimum current threshold 7006 **50BF PICKUP** (Power System Data 1) has been exceeded.
- Automatic reclosing (AR):
The AR cannot be started directly. In order to interact with the AR, the trip command of the flexible function needs be linked in CFC to binary input no. 2716 $> \text{Start } 79 \text{ Ph}$ or no. 2715 $> \text{Start } 79 \text{ Gnd}$. Using an operating time requires the pickup of the flexible function to be linked to binary input no. 2711 $> 79 \text{ Start}$.
- Fuse-Failure-Monitor (see description at "Blocking Functions").
- Inrush restraint:
Direct interaction with the inrush restraint is not possible. In order to block a flexible function by the inrush restraint, the blocking must be carried out in CFC. The flexible function provides three binary inputs for blocking trip commands selectively for each phase (no. 235.2115 to 235.2117). They have to be linked with the phase-selective indications for detecting the inrush (no. 1840 to 1842). Activating a crossblock function requires the phase-selective inrush indications to be logically combined with the binary input for blocking the function trip command (no. 235.2114 $> \$00 \text{ BLK. TRIP}$). The flexible function also needs to be delayed by at least 20 ms to make sure that the inrush restraint picks up before the flexible function.
- Entire relay logic:
The pickup signal of the flexible function is added to the general device pickup, the trip signal is added to the general device trip (see also [Section 2.22 Function Logic](#)). All functions associated with general device pickup and tripping are thus also applied to the flexible function.
After the picked up element has dropped out, the trip signals of the flexible protection functions are held up at least for the specified minimum trip command time 210 **TMin TRIP CMD**.

2.18.2 Setting Notes

The setting of the functional scope determines the number of flexible protection functions to be used (see [Section 2.1.1 Functional Scope](#)). If a flexible function in the functional scope is disabled (by removing the

checkmark), this will result in losing all settings and configurations of this function or its settings will be reset to their default settings.

General

In the DIGSI setting dialog „General“, parameter **FLEXIBLE FUNC.** can be set to **OFF**, **ON** or **Alarm Only**. If the function is enabled in operational mode Alarm Only, no faults are recorded, no „Effective“-indication is generated, no trip command issued and neither will the circuit-breaker protection be affected. Therefore, this operational mode is preferred when a flexible function is not required to operate as a protection function. Furthermore, the **OPERRAT. MODE** can be configured.

Three-phase – functions evaluate the three-phase measuring system, i.e. all three phases are processed simultaneously. A typical example is the three-phase operating time overcurrent protection.

Single-phase – functions evaluate only the individual measuring value. This can be an individual phase value (e.g. V_B) or V_x or a ground variable (V_N , I_N or I_{N2}).

Setting **no reference** determines the evaluation of measured variables irrespective of a single or three-phase connection of current and voltage. Table 2-20 provides an overview regarding which variables can be used in which mode of operation.

Parameter **BLK f out of r** allows you to specify whether the protection function is blocked if the measured power frequency is outside the operating range of the function (25 Hz to 70 Hz). SIEMENS recommends using the default setting (**YES**). A release beyond the normal operating range is only required for special applications.

Measured Variable

In the setting dialog „Measured Variable“ the measured variables to be evaluated by the flexible protection functions can be selected, which may be a calculated or a directly measured variable. The setting options that can be selected here are dependent on the mode of measured-value processing as predefined in parameter **OPERRAT. MODE** (see the following table).

Table 2-16 Parameter „Operating Mode“ and „Measured Quantity“

Parameter OPERRAT. MODE Setting	Parameter MEAS. QUANTITY Setting Options
Single-phase, Three-phase	Current Voltage P forward P reverse Q forward Q reverse Power factor
3-phase	dV/dt rising dV/dt falling
Without Reference	Frequency df/dt rising df/dt falling Binary Input

Please note that with voltage connection type **Vab**, **Vbc** or **Vab**, **Vbc**, **VSyn** or **Vab**, **Vbc**, **Vx** (address 213 **VT Connect. 3ph**) the power values are only available if you have symmetrical voltage conditions within the network and address 207 **Vol. Symmetry** is set to **YES** (Power System Data 1).

Measurement Procedures

The measurement procedures as set out in the following table can be configured for the measured variables - current, voltage and power. The dependencies of the available measurement procedures of configurable modes of operation and the measured variable are also indicated.

Table 2-17 Parameter in the Setting Dialog "Measurement Procedure", Mode of Operation 3-phase

Parameter OPERRAT. MODE = 3-phase	
Parameter MEAS. QUANTITY = Current or Voltage	
Parameter MEAS. METHOD	
Fundamental	Only the fundamental harmonic is evaluated, higher harmonics are suppressed. This is the standard measurement procedure of the protection functions. Important: The voltage threshold value is always parameterized as phase-to-phase voltage. If parameter VOLTAGE SYSTEM is selected as phase-to-ground, the voltage threshold will be divided by $\sqrt{3}$.
True RMS	The "true" RMS value is determined, i.e. higher harmonics are evaluated. This procedure is applied, for example, if an overload protection element must be realized on the basis of a current measurement, as the higher harmonics contribute to thermal heating. Important: The voltage threshold value is always parameterized as phase-to-phase voltage. If parameter VOLTAGE SYSTEM is selected as phase-to-ground, the voltage threshold will be divided by $\sqrt{3}$.
Positive seq., Negative seq., Zero sequence	In order to realize certain applications, the positive sequence system or negative sequence system can be configured as measurement procedure. Examples are: - I2 (tripping monitoring system) - U2 (voltage asymmetry) Via the selection zero sequence system, additional zero sequence current or zero sequence voltage functions can be realized that operate independent of the ground variables IN and VN, which are measured directly via transformers. Important: The voltage threshold is always parameterized according to the definition of the balanced components independently of parameter VOLTAGE SYSTEM.
Parameter MEAS. QUANTITY = Current	
Parameter MEAS. METHOD	
Ratio I2/I1	The ratio of the negative-sequence current to the positive-sequence current is evaluated. Please note that the function only operates if I2 or I1 has exceeded the threshold value $0.1 \cdot I_N$.
Parameter MEAS. QUANTITY = Voltage	
Parameter VOLTAGE SYSTEM	
Phase-Phase Phase-Ground	If you have configured address 213 VT Connect. 3ph to Van, Vbn, Vcn or Vab, Vbc, VGnd, you can select whether a threephase voltage function will evaluate the phase-to-ground voltage or the phase-to-phase voltages. When selecting phase-to-phase, these variables are derived from the phase-to-ground voltages. The selection is, for example, important for single-pole faults. If the faulty voltage drops to zero, the affected phase-to-ground voltage is thus zero, and the respective phase-to-phase voltages drop to the variable of a phase-to-ground voltage. With phase-to-phase voltage connection the parameter is hidden.



NOTE

With regard to the phase-selective pickup messages, a special behavior is observed in the three-phase voltage protection with phase-to-phase variables, because the phase-selective pickup message "Flx01 Pickup Lx" is allocated to the respective measured-value channel "Lx".

Single-phase faults:

If, for example, voltage V_A drops to such degree that voltages V_{AB} and V_A exceed their threshold values, the device indicates pickups "Flx01 Pickup A" and "Flx01 Pickup C", because the undershooting was detected in the first and third measured-value channel.

Two-phase faults:

If, for example, voltage V_{AB} drops to such degree that its threshold value is reached, the device then indicates pickup "Flx01 Pickup A", because the undershooting was detected in the first measured-value channel.

Table 2-18 Parameter in the Setting Dialog "Measurement Procedure", Mode of Operation 1-phase

Parameter OPERRAT. MODE = 1-phase	
Parameter MEAS. QUANTITY = Current or Voltage	
Parameter MEAS. METHOD	
Fundamental	Only the fundamental harmonic is evaluated, higher harmonics are suppressed. This is the standard measurement procedure of the protection functions.
True RMS	The "True" RMS value is determined, i.e. higher harmonics are evaluated. This procedure is applied, for example, if an overload protection element must be realized on the basis of a current measurement, as the higher harmonics contribute to thermal heating.
Parameter MEAS. QUANTITY = Current	
Parameter CURRENT	
Ia Ib Ic In In sensitive In2	It is determined which current-measuring channel must be evaluated by the function. Depending on the device version, either IN (normal-sensitive ground current input), INS (sensitive ground current input) or IN2 (second ground current connected to the device) can be selected. If parameter 251 is set to A, G2, C, G; G→B , the setting IN refers to the current at the second current (IN2). The setting INS refers to the sensitive ground current at the fourth current input. If parameter 251 is set to A, G2, C, G; G→B , the setting IN2 refers to the current at the second current (IN2). The setting INS or INS refers to the sensitive or highly sensitive ground current at the fourth current input.
Parameter MEAS. QUANTITY = Voltage	
Parameter VOLTAGE	
Va-n Vb-n Vc-n Va-b Vb-c Vc-a Vn Vx	It is determined which voltage-measuring channel must be evaluated by the function. When selecting phase-to-phase voltage, the threshold value must be set as a phase-to-phase value, when selecting a phase-to-ground variable as phase-to-ground voltage. The extent of the setting texts depends on the connection of the voltage transformer (see address 213 VT Connect. 3ph).

Parameter OPERRAT. MODE = 1-phase	
Parameter MEAS. QUANTITY = P forward or P reverse or Q forward or Q reverse	
Parameter POWER	
Ia Va-n Ib Vb-n Ic Vc-n	It is determined which power-measuring channel (current and voltage) must be evaluated by the function. With phase-to-phase voltage connections the parameter is hidden (see address 213 VT Connect. 3ph). When selecting Vab , Vbc , VGnd , the phase-to-ground voltages will be calculated if "phase-to-ground" is configured. When selecting "phase-to-phase", the connected phase-to-phase voltages are used and V_{CA} is calculated from V_{AB} and V_{BC} .

**NOTE****Warning!**

If the 3-phase voltage connection is established at a motor or generator feeder and the Ux input is operated at the busbar or at another voltage measuring point other than the feeder, you must select "True RMS" as the measurement procedure. Otherwise, there is a risk of overfunction or underfunction in a situation where the feeder voltage and the Ux voltage exhibit significantly different frequencies.

**NOTE**

If you have selected **Vph-g**, **VSyn** in **VT Connect. 3ph**, the connected phase-to-Ground voltage can be processed. If you select **VOLTAGE** as measured quantity, this connected voltage is used automatically.

The forward direction of power (P forward, Q reverse) is the direction of the line. Parameter (1108 **P,Q sign**) for sign inversion of the power display in the operating measured values is ignored by the flexible functions. Via parameter **PICKUP WITH** it is determined whether the function must be triggered on exceeding or under-shooting of the set threshold value.

Settings

The pickup thresholds, time delays and dropout ratios of the flexible protection function are set in the "Settings" dialog box in DIGSI.

The pickup threshold of the function is configured via parameter **P.U. THRESHOLD**. The OFF-command time delay is set via parameter **T TRIP DELAY**. Both setting values must be selected according to the required application.

The pickup can be delayed via parameter **T PICKUP DELAY**. This parameter is usually set to zero (default setting) in protection applications, because a protection function should pick up as quickly as possible. A setting deviating from zero may be appropriate if a trip log is not desired to be started upon each short-term exceeding of the pickup threshold, for example, with power protection or when a function is not used as a protection, but as a monitoring function.

When setting the power threshold values, it is important to take into consideration that a minimum current of $0.03 I_N$ is required for power calculation. The power calculation is blocked for lower currents.

The dropout of pickup can be delayed via parameter **T DROPOUT DELAY**. This setting is also set to zero by default (standard setting). A setting deviating from zero may be required if the device is utilized together with electro-magnetic devices with considerably longer dropout ratios than the digital protection device (see Section 2.2 for more information). When utilizing the dropout time delay, it is recommended to set it to a shorter time than the OFF-command time delay in order to avoid both times to "race".

The dropout ratio of the function can be selected in parameter **DROPOUT RATIO**. The standard dropout ratio of protection functions is 0.95 (default setting). If the function is used as power protection, a dropout ratio of at least 0.9 should be set. The same applies to the utilization of the symmetrical components of current and voltage. If the dropout ratio is decreased, it would be sensible to test the pickup of the function regarding possible "chatter".

The dropout difference of the frequency elements is set under parameter **DO differential**. Usually, the default setting of 0.02 Hz can be retained. A higher dropout difference should be set in weak systems with larger, short-term frequency fluctuations to avoid chattering of the message.

A fixed dropout difference of 0.1 Hz/s is used for the frequency change (df/dt) measurand. The same applies to the voltage change (dU/dt) measurand. The permanent dropout difference here is 3 V/s.

Parameter **BLK.by Vol.Loss** determines whether a function whose measured variable is based on a voltage measurement (measured quantities voltage, P forward, P reverse, Q forward, Q reverse and power factor), should be blocked in case of a measured voltage failure (set to **YES**) or not (set to **NO**).

Renaming Messages, Checking Configurations

After parameterization of a flexible function, the following steps should be noted:

- Open matrix in DIGSI
- Rename the neutral message texts in accordance with the application.
- Check configurations on contacts and in operation and fault buffer, or set them according to the requirements.

Further Information

The following instruction should be noted:

- As the power factor does not differentiate between capacitive and inductive, the sign of the reactive power may be used with CFC-help as an additional criterion.

2.18.3 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	C	Setting Options	Default Setting	Comments
0	FLEXIBLE FUNC.		OFF ON Alarm Only	OFF	Flexible Function
0	OPERRAT. MODE		3-phase 1-phase no reference	3-phase	Mode of Operation
0	BLK f out of r		YES NO	YES	Block while Freq. is out of range
0	MEAS. QUANTITY		Please select Current Voltage P forward P reverse Q forward Q reverse Power factor dV/dt rising dV/dt falling Frequency df/dt rising df/dt falling Binray Input	Please select	Selection of Measured Quantity

Addr.	Parameter	C	Setting Options	Default Setting	Comments
0	MEAS. METHOD		Fundamental True RMS Positive seq. Negative seq. Zero sequence Ratio I2/I1	Fundamental	Selection of Measurement Method
0	PICKUP WITH		Exceeding Dropping below	Exceeding	Pickup with
0	CURRENT		Ia Ib Ic In In sensitive In2	Ia	Current
0	VOLTAGE		Please select Va-n Vb-n Vc-n Va-b Vb-c Vc-a Vn Vx	Please select	Voltage
0	POWER		Ia Va-n Ib Vb-n Ic Vc-n	Ia Va-n	Power
0	VOLTAGE SYSTEM		Phase-Phase Phase-Ground	Phase-Phase	Voltage System
0	P.U. THRESHOLD		0.05 .. 40.00 A	2.00 A	Pickup Threshold
0	P.U. THRESHOLD	1A	0.05 .. 40.00 A	2.00 A	Pickup Threshold
		5A	0.25 .. 200.00 A	10.00 A	
0	P.U. THRESHOLD	1A	0.001 .. 1.500 A	0.100 A	Pickup Threshold
		5A	0.005 .. 7.500 A	0.500 A	
0	P.U. THRESHOLD		2.0 .. 260.0 V	110.0 V	Pickup Threshold
0	P.U. THRESHOLD		2.0 .. 200.0 V	110.0 V	Pickup Threshold
0	P.U. THRESHOLD		2.0 .. 260.0 V	110.0 V	Pickup Threshold
0	P.U. THRESHOLD		40.00 .. 60.00 Hz	51.00 Hz	Pickup Threshold
0	P.U. THRESHOLD		50.00 .. 70.00 Hz	61.00 Hz	Pickup Threshold
0	P.U. THRESHOLD		0.10 .. 20.00 Hz/s	5.00 Hz/s	Pickup Threshold
0	P.U. THRESHOLD	1A	2.0 .. 10000.0 W	200.0 W	Pickup Threshold
		5A	10.0 .. 50000.0 W	1000.0 W	
0	P.U. THRESHOLD	1A	2.0 .. 10000.0 VAR	200.0 VAR	Pickup Threshold
		5A	10.0 .. 50000.0 VAR	1000.0 VAR	
0	P.U. THRESHOLD		-0.99 .. 0.99	0.50	Pickup Threshold
0	P.U. THRESHOLD		15 .. 100 %	20 %	Pickup Threshold
0	P.U. THRESHOLD		4 .. 100 V/s	60 V/s	Pickup Threshold
0	T TRIP DELAY		0.00 .. 3600.00 sec	1.00 sec	Trip Time Delay
0A	T PICKUP DELAY		0.00 .. 60.00 sec	0.00 sec	Pickup Time Delay

Addr.	Parameter	C	Setting Options	Default Setting	Comments
0	T PICKUP DELAY		0.00 .. 28800.00 sec	0.00 sec	Pickup Time Delay
0A	T DROPOUT DELAY		0.00 .. 60.00 sec	0.00 sec	Dropout Time Delay
0A	BLK.by Vol.Loss		NO YES	YES	Block in case of Meas.- Voltage Loss
0A	DROPOUT RATIO		0.70 .. 0.99	0.95	Dropout Ratio
0A	DROPOUT RATIO		1.01 .. 3.00	1.05	Dropout Ratio
0	DO differential		0.02 .. 1.00 Hz	0.03 Hz	Dropout differential

2.18.4 Information List

No.	Information	Type of Information	Comments
235.2110	>BLOCK \$00	SP	>BLOCK Function \$00
235.2111	>\$00 instant.	SP	>Function \$00 instantaneous TRIP
235.2112	>\$00 Dir.TRIP	SP	>Function \$00 Direct TRIP
235.2113	>\$00 BLK.TDly	SP	>Function \$00 BLOCK TRIP Time Delay
235.2114	>\$00 BLK.TRIP	SP	>Function \$00 BLOCK TRIP
235.2115	>\$00 BL.TripA	SP	>Function \$00 BLOCK TRIP Phase A
235.2116	>\$00 BL.TripB	SP	>Function \$00 BLOCK TRIP Phase B
235.2117	>\$00 BL.TripC	SP	>Function \$00 BLOCK TRIP Phase C
235.2118	\$00 BLOCKED	OUT	Function \$00 is BLOCKED
235.2119	\$00 OFF	OUT	Function \$00 is switched OFF
235.2120	\$00 ACTIVE	OUT	Function \$00 is ACTIVE
235.2121	\$00 picked up	OUT	Function \$00 picked up
235.2122	\$00 pickup A	OUT	Function \$00 Pickup Phase A
235.2123	\$00 pickup B	OUT	Function \$00 Pickup Phase B
235.2124	\$00 pickup C	OUT	Function \$00 Pickup Phase C
235.2125	\$00 Time Out	OUT	Function \$00 TRIP Delay Time Out
235.2126	\$00 TRIP	OUT	Function \$00 TRIP
235.2128	\$00 inval.set	OUT	Function \$00 has invalid settings
236.2127	BLK. Flex.Fct.	IntSP	BLOCK Flexible Function

2.19 Reverse-Power Protection Application with Flexible Protection Function

2.19.1 Functional Description

General

General By means of the flexible protection functions a single-element or multi-element reverse power protection can be realized. Each reverse power element can be operated in single-phase or three-phase. Depending on the chosen option, the elements can evaluate active power forward, active power reverse, reactive power forward or reactive power reverse as measured value. The pickup by the protection elements can occur on exceeding or undershooting of the threshold. Possible applications for reverse power protection are set out in [Table 2-19](#).

Table 2-19 Overview of reverse power protection applications


	Direction	Type of Evaluation	
		Overshooting	Undershooting
P	forward	Monitoring of the forward power limits of operational equipment	Detection of idling motors
	reverse	Protection of a local industrial network against reversed feeding into the energy supply network Detection of reversed feeding by motors	
Q	forward	Monitoring of the reactive power limits of operational equipment (transformers, lines) Connection of a capacitor bank for reactive power compensation	
	reverse	Monitoring of the reactive power limits of operational equipment (transformers, lines) Connection of a capacitor bank	

The following example depicts a typical application where the flexible function acts as reverse power protection.

Disconnection Facility

The following figure gives an example of an industrial control system with internal supply by the illustrated generator. All illustrated lines and the busbar are indicated in three-phase (excluding the ground connections and the connection to the voltage measurement at the generator). Both feeders 1 and 2 supply the consumers of the customer. Usually the industrial customer receives his current from the energy supplier. The generator runs in synchronism, without feeding power. If the power supply company can no longer guarantee the required supply, the control system is separated from the system of the power supply company and the generator is taking over the internal supply. In this example the control system is disconnected from the system of the power supply company as soon as the frequency leaves the nominal range (e.g. 1 - 2% deviation from the nominal frequency), the voltage exceeds or undershoots a set value, or the generator's active power is fed to the system of the power supply company. Depending on the user's philosophy, some of these criteria may be combined. This would be realized via the CFC.

The example illustrates how a reverse power protection is implemented by means of the flexible protection functions. Frequency protection and voltage protection are described in [Sections 2.8 Frequency Protection 81 O/U](#) and [2.6 Voltage Protection 27, 59](#).

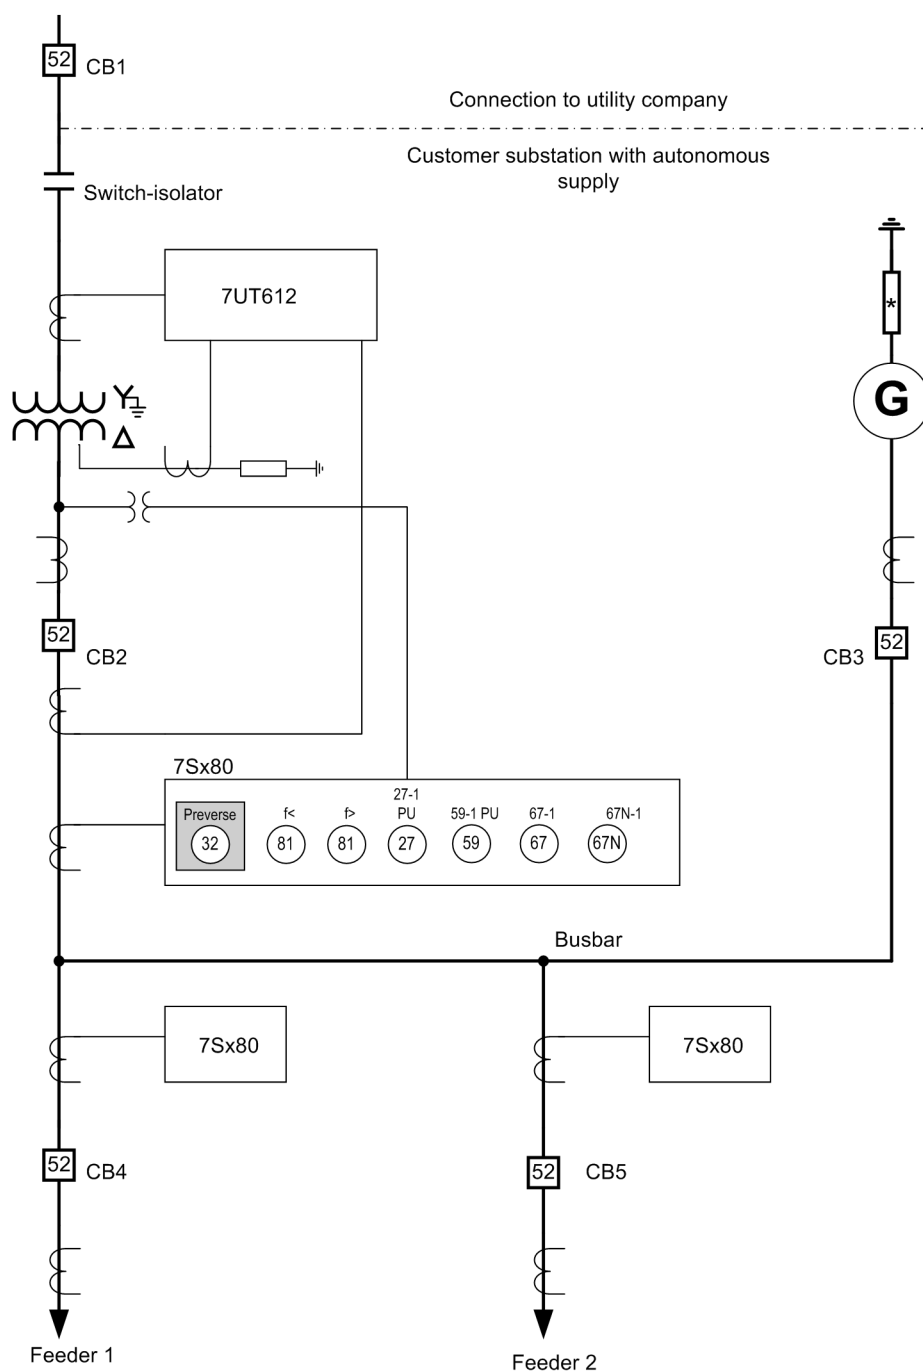

[bsb-schaltanl-gen-eigenvers-20061205, 1, en_US]

Figure 2-102 Example of a substation with autonomous generator supply

Substation Layout

The control system is on the high-voltage side linked via a 110 kV line to the power system of the power supply company. The circuit breaker CB1 is part of the power system of the power supply company. Disconnection from the control system of the power supply company's power system is effected by the load-isolator. The transformer with a transformation ratio of 10:1 transforms the voltage level to 11 kV. The transformer, the generator and the two feeders are linked via a busbar at the low-voltage side. Circuit breakers CB2 to CB5 separate consumer and operational equipment from the busbar.

Table 2-20 System data for the application example

Power System Data	
Generator nominal power	$S_{\text{Nom,Gen}} = 38.1 \text{ MVA}$
Transformer nominal power	$S_{\text{Nom,Trafo}} = 38.1 \text{ MVA}$
Nominal voltage of high-voltage side	$U_{\text{Nom}} = 110 \text{ kV}$
Nominal voltage of busbar side	$U_{\text{Nom}} = 11 \text{ kV}$
Nominal primary CT current on busbar side	$I_{\text{Nom,prim}} = 2000 \text{ A}$
Nominal secondary CT current on busbar side	$I_{\text{Nom,sek}} = 1 \text{ A}$
Nominal primary VT voltage on busbar side	$U_{\text{Nom,prim}} = 11 \text{ kV}$
Nominal secondary VT voltage on busbar side	$U_{\text{Nom,sek}} = 100 \text{ V}$

Protective Functionality

With protection device 7SJ80, the control system is disconnected from the generator upon the generator's reversed feeding into the power supply company's power system (protection function **P reverse**). This functionality is realized by means of a flexible protection function. Additionally, the disconnection is effected by fluctuations in frequency or voltage in the power supply company's power system (protection function **f<**, **f>**, **27-1 PICKUP**, **59-1 PICKUP**, **67-1 PICKUP**, **67N-1 PICKUP**).

The protection receives the measured values via a three-phase current and voltage transformer set.

In case of disconnection, the circuit breaker CB2 is triggered.

The transformer is protected by a differential protection and inverse or definite time overcurrent protection functions for the phase-to-phase currents. In the event of a fault, the circuit-breaker CB1 in the power supply company's system is activated via a remote link. In addition, the circuit breaker CB2 is activated.

Overcurrent protection functions protect the feeders 1 and 2 against short circuits and overload caused by the connected consumers. The phase-to-phase currents and the zero currents of the feeders can be protected by inverse and definite time overcurrent protection elements. In the event of a fault, the circuit breakers CB4 and CB5 are activated.

In addition, the busbar could be equipped with the 7UT635 differential protective relay for multiple ends. The current transformers required to this end are already included in the example above.

Wiring Diagram, Power Direction

The following figure shows the wiring of the device for reverse power protection. The power flow in positive or forward direction occurs from the high-voltage busbar (not shown) via the transformer to the lowvoltage busbar.




Figure 2-103 Wiring diagram for a 7SJ80 as reverse power protection

General

Determination of the Reverse Power

The reverse power protection evaluates the active power from the symmetrical components of the fundamental harmonics of the voltages and currents. The evaluation of the positive sequence systems causes reverse power determination to be independent of the asymmetries in currents and voltages and reflects the real load of the driving end. The calculated active power value corresponds to the total active power. The connection in the example illustrates positive measurement of power in the direction extending from the busbar to the transformer of the device.

The following logic diagram depicts the functional logic of the reverse power protection.

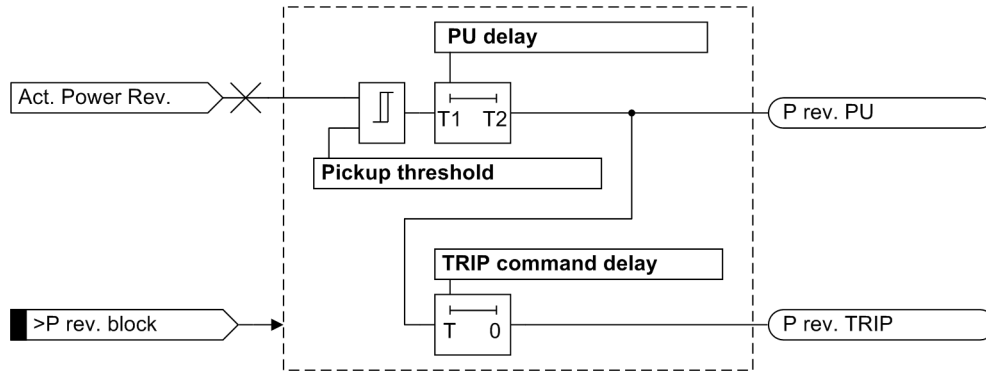

[flexfkn-p-rueckwaerts-040104-st, 1, en_US]

Figure 2-104 Logic diagram of the reverse power determination with flexible protection function

The reverse power protection picks up once the configured pickup threshold has been exceeded. If the pickup condition persists during the equally settable pickup delay, the pickup message **P.rev.PU** is generated and starts the trip delay time. If the pickup condition does not drop out while the trip delay time is counting down, the trip indication **P. rev. TRIP** and the timeout indication **P. rev. timeout** (not shown) are generated. The picked up element drops out when the value falls below the dropout threshold. The blocking input **>P rev. block** blocks the entire function, i.e. pickup, trip and running times are reset. After the blocking has been released, the reverse power must exceed the pickup threshold and both times must run out before the protection function trips.

Pickup Value, Dropout Ratio

The pickup value of the reverse power protection is set to 10% of the nominal generator output. In this example, the setting value is configured as secondary power in watts. The following relationship exists between the primary and the secondary power:

$$P_{\text{sec}} = P_{\text{prim}} \cdot \frac{U_{\text{Nom, sec}}}{U_{\text{Nom, prim}}} \cdot \frac{I_{\text{Nom, sec}}}{I_{\text{Nom, prim}}}$$

[fo_flexfkn-ansprechwert, 1, en_US]

On the basis of the indicated data, the pickup values are calculated considering $P_{\text{prim}} = 3.81 \text{ MW}$ (10% of 38.1 MW) on the primary level to

$$P_{\text{sec}} = 3.81 \text{ MW} \cdot \frac{100 \text{ V}}{11000 \text{ V}} \cdot \frac{1 \text{ A}}{2000 \text{ A}} = 17.3 \text{ W}$$

[fo_flexfkn-ansprechwert-numer, 1, en_US]

on the secondary level. The dropout ratio is set to 0.9. This yields a secondary dropout threshold of $P_{\text{sec, dropout}} = 15.6 \text{ W}$. If the pickup threshold is reduced to a value near the lower setting limit of 10 W, the dropout ratio should equally be reduced to approximately 0.7.


Delay for Pickup, Dropout and Trip

The reverse power protection does not require short tripping times as protection from undesired power feedback. In the present example, it is useful to delay pickup and dropout by about 0.5 s and the trip by approx. 1 s. Delaying the pickup will minimize the number of fault logs which are opened when the reverse power oscillates around the threshold.

When using the reverse power protection to disconnect the substation quickly from the power supply company's system if faults occur, it is useful to select a larger pickup value (e.g. 50% of nominal power) and shorter time delays.

2.19.3 Configuring the Reverse Power Protection in DIGSI

First create and open a 7SJ64x (e.g. 7SJ642) device in DIGSI Manager. Configure a flexible protection function (flexible function 01) for the present example in the Device Configuration.

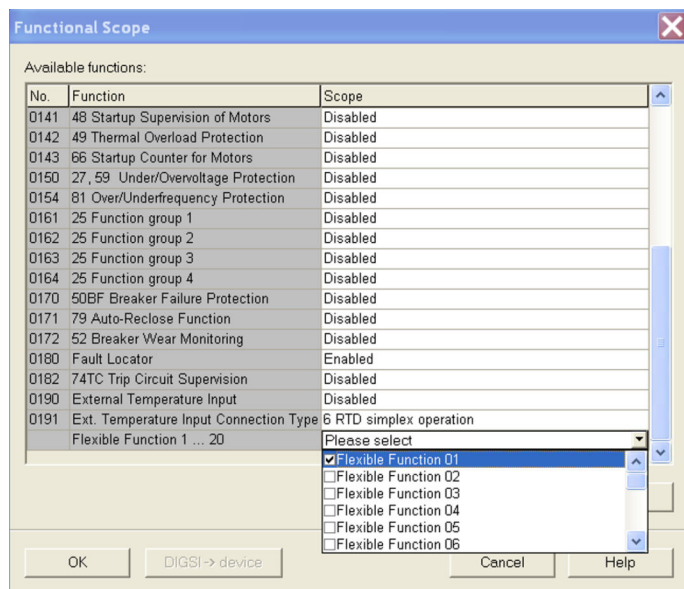


[funktionenumfang-flexfkn01-030204-he, 1, en_US]

Figure 2-105 Configuration of a flexible protection function

Select "Additional functions" in the „Parameters“ menu to view the flexible function


The parameter selection options for the flexible protection functions primarily depend on the settings made in the Power System Data 1 for the connection of the voltage and current transformers (Addresses 213 and 251).

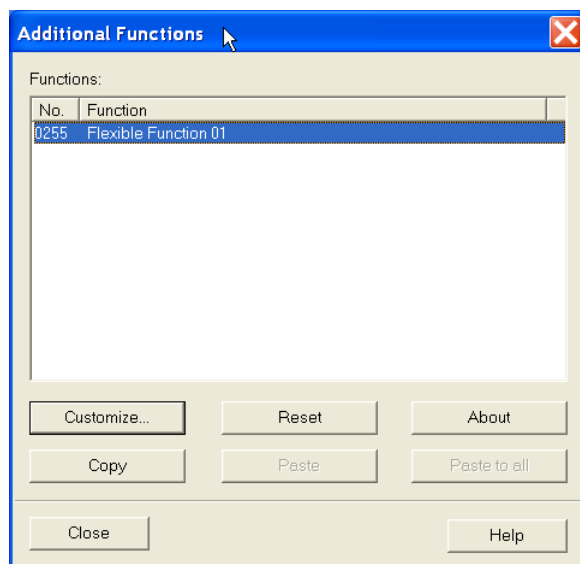

[flexfkn-weitere-funktionen-030204-he, 1, en_US]

Figure 2-106 The flexible function appears in the function selection.


First activate the function at "Settings --> General" and select the operating mode "3-phase"

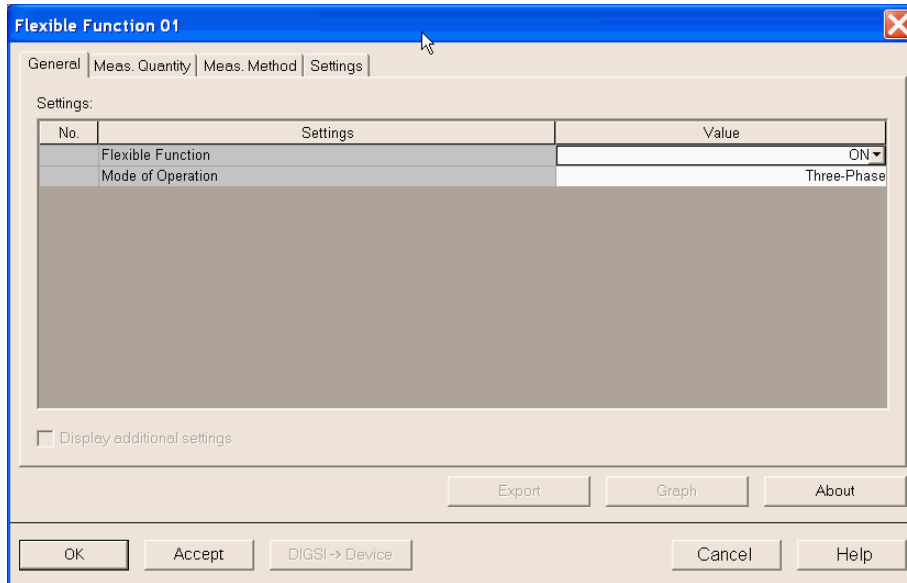

[flexfkn-einstellungen-allgemein-3phasig-030204-he, 1, en_US]

Figure 2-107 Selection of the three-phase operating mode

In menu items "Measured Value" and "Measurement Procedures" "Active Power reverse" or "Exceeding" must be set. If in menu item "Settings" the box "Additional Parameters display" is enabled, threshold value, pickup delay time and trip delay time can be configured. As the power direction cannot be determined in case of measured voltage failure, protection blocking would be sensible in this case.

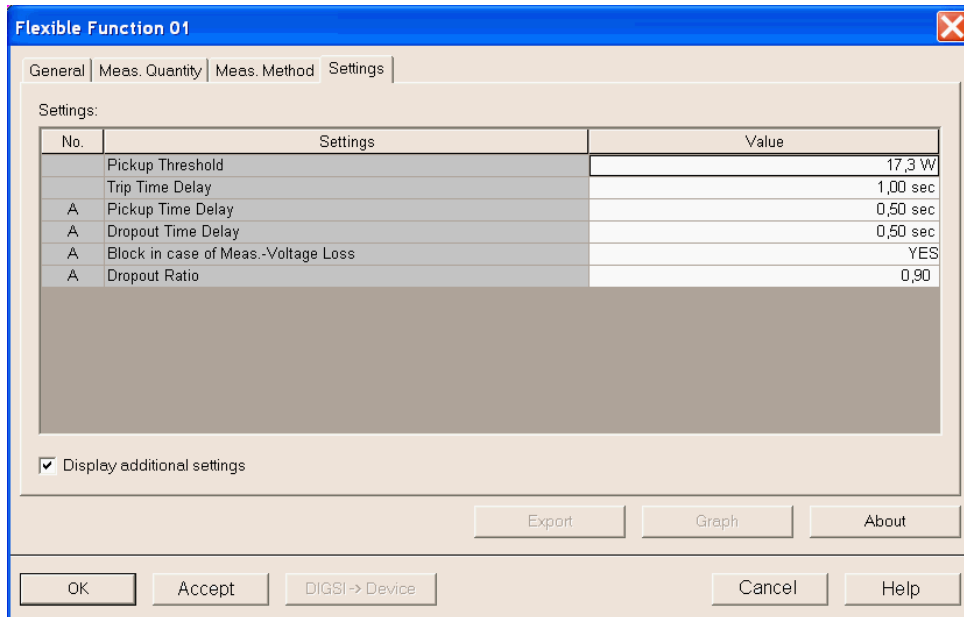

[flexfkn-einstellungen-5-watt-030204-he, 1, en_US]

Figure 2-108 Setting options of the flexible function

Allocating the Reverse-Power Protection in DIGSI Configuration Matrix

The DIGSI configuration matrix initially shows the following indications (after selecting "Indications and commands only" and "No filter").

Flx 01	235.2110.01	>BLOCK Flx01	>BLOCK Function Flx01	SP		
	235.2111.01	>Flx01 instant.	>Function Flx01 instantaneous TRIP	SP		
	235.2113.01	>Flx01 BLK.TDelay	>Function Flx01 BLOCK TRIP Time Delay	SP		
	235.2114.01	>Flx01 BLK. TRIP	>Function Flx01 BLOCK TRIP	SP		
	235.2118.01	Flx01 BLOCKED	Function Flx01 is BLOCKED	OUT		
	235.2119.01	Flx01 OFF	Function Flx01 is switched OFF	OUT		
	235.2120.01	Flx01 ACTIVE	Function Flx01 is ACTIVE	OUT		
	235.2121.01	Flx01 picked up	Function Flx01 picked up	OUT		
	235.2125.01	Flx01 Time Out	Function Flx01 TRIP Delay Time Out	OUT		
	235.2126.01	Flx01 TRIP	Function Flx01 TRIP	OUT		

[flexfkn-rangierung-vor-dem-editieren-030204-he, 1, en_US]

Figure 2-109 Indications prior to editing

Clicking the texts allows for editing short text and long text as required by the application.

Flx 01	235.2110.01	>P rev. block	>Active power reverse block	SP		
	235.2111.01	>P rev. instant	>Active pow. rev. OFF instantaneous trip	SP		
	235.2113.01	>P rev. BLK. T	>Active pow. rev. BLOCK TRIP Time Delay	SP		
	235.2114.01	>P rev.BLK.TRIP	>Active pow. rev. BLOCK TRIP	SP		
	235.2118.01	P rev. BLOCKED	Active pow. rev. is BLOCKED	OUT		
	235.2119.01	P rev. OFF	Active pow. rev. is switched OFF	OUT		
	235.2120.01	P rev. ACTIVE	Active pow. rev. is ACTIVE	OUT		
	235.2121.01	P rev.picked up	Active pow. rev. picked up	OUT		
	235.2125.01	P rev.Time Out	Active pow. rev. TRIP Delay Time Out	OUT		
	235.2126.01	P rev. TRIP	Active pow. rev. TRIP	OUT		

[flexfkn-rangierung-nach-dem-editieren-030204-he, 1, en_US]

Figure 2-110 Indications after editing

The indications are allocated in the same way as the indications of other protective functions.

2.20 Synchrocheck

When connecting two sections of a power system, the synchrocheck function verifies that the switching does not endanger the stability of the power system

Applications


- Typical applications are, for example, the synchronization of a feeder and a busbar or the synchronization of two busbars via tie-breaker.

2.20.1 General

Synchronous power systems exhibit small differences regarding frequency and voltage values. Before connection it is to be checked whether the conditions are synchronous or not. If the conditions are synchronous, the system is energized; if they are asynchronous, it is not. The circuit breaker operating time is not taken into consideration. The synchrocheck function is activated via address 161 **SYNCHROCHECK**.


For comparing the two voltages of the sections of the power system to be synchronized, the synchrocheck function uses the reference voltage V_1 and an additional voltage to be connected V_2 .

If a transformer is connected between the two voltage transformers as shown in the following example, its vector group can be adapted in the 7SJ80 relay so that there is no external adjustment required.

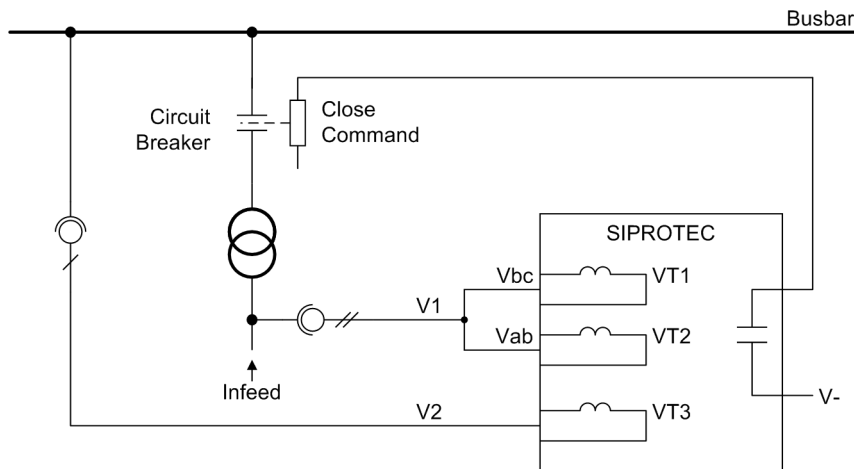

[synchro-fkt-einspeis-061115, 1, en_US]

Figure 2-111 Infeed

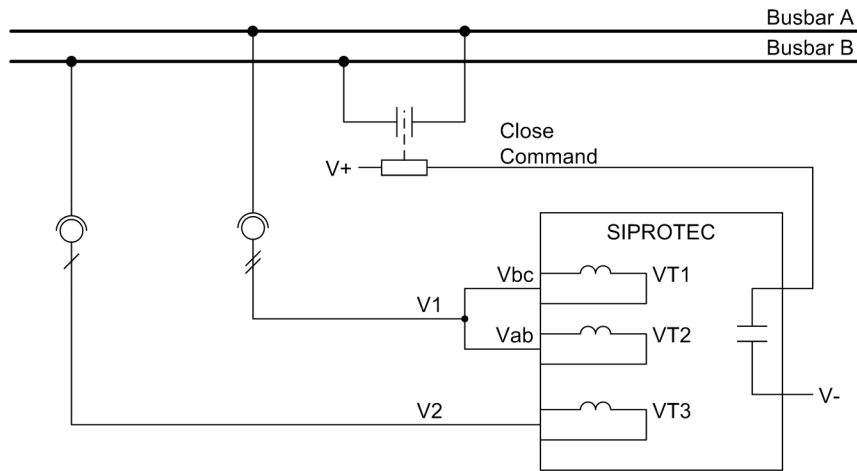

[synchro-fkt-querkuppl-061115, 1, en_US]

Figure 2-112 Cross coupling

The synchrocheck function of the 7SJ80 usually coordinates with the integrated automatic reclosing system and the control function. Nevertheless, it is also possible to employ an external automatic reclosing system. In such a case, the signal exchange between the devices is to be accomplished via binary inputs and outputs. The configuration determines whether the synchrocheck is to be carried out only in the case of automatic reclosing or only in the case of circuit breaker control or in both cases. It is also possible to configure different release criteria for automatic reclosing or control closing. Synchronous connection is always accomplished via the integrated control.

The release command for closing under satisfied synchronism conditions can be deactivated via parameter 6113 **25 Synchron**. For special applications, the deactivated closing release can, however, be activated via a binary input (**>25 synchr.**) (see "De-energized Switching").

Connection, Multi-phase

For comparing the two voltages, the synchrocheck function uses the reference voltage V_1 and an additional voltage to be connected V_2 . For the multi-phase connection, set the **P.System Data 1** at 213 **Vab**, **Vbc**, **VSyn**. With this setting, the device is connected as open-delta connection and the phase-to-phase voltages V_{AB} and V_{BC} are used as reference voltage V_1 . The voltage to be synchronized V_2 is assigned to the single-phase connection and may be any phase-to-phase voltage. The connected voltage is set at address 6123.

Furthermore, it should be noted that in the case of an open-delta connection, no zero voltage can be determined. In this case, the functions "Directional Ground Fault Detection" and "Fuse Failure Monitor (FFM)" must be hidden or disabled. The function „Directional Overcurrent Protection Ground" then works with the negative sequence system values. Notes on the effects of the current transformer connection can be found in Section [2.1.3.2 Setting Notes, Table 2-1](#).

Connection, Single-phase

If there is only one phase-to-ground voltage available for the reference voltage V_1 , the device can be informed of this fact via the **P.System Data 1**, address 213 **Vph-g**, **VSyn**. Also in this case the synchrocheck function can be fully applied. For the voltage to be synchronized V_2 , the same phase-to-ground voltage as for V_1 has to be connected.

Please note that some of the protection functions are restricted or do not work at all with this kind of connection. Notes on the effects of the current transformer connection can be found in Section [2.1.3.2 Setting Notes, Table 2-1](#).

2.20.2 Functional Sequence

Validity Check of the Configuration

Already during startup of the device, a validation check of the configuration is performed. If there is a fault, the message *25 Set-Error* is output. After a measurement request there is a condition which is not plausible, the message *25 Set-Error* is output. The measurement is then not started.

Concerning the configuration, it is also checked if the substation parameter 213 is set to **Vab**, **Vbc**, **VSyn** or **Vph-g**, **VSyn**. Furthermore, specific thresholds and settings of the function group are checked. If there is a condition which is not plausible, the error message *25 Set-Error* is output additionally. Please ensure in this case that address 6106 (threshold V_1 , V_2 energized) is smaller than address 6103 (lower voltage limit **Vmin**). The synchrocheck function cannot be controlled via a binary input.

SYNC Error

The synchronization is not started if a voltage transformer failure (m.c.b. tripping) is communicated to the device via the binary input 6509 *>FAIL:FEEDER VT* or 6510 *>FAIL:BUS VT*. The message *25 Sync. Error* is output. In this case, the synchronization can be controlled directly via a binary input. In case of a protection pickup, the complete synchronization process is reset instantaneously.

Release

The synchrocheck function only operates if it receives a measurement request. This request may be issued by the internal control function, the automatic reclosing function or externally via a binary input, e.g. from an external automatic reclosing system.

Before a release for closing is granted, the following conditions are checked:

- Is the reference voltage V_1 above the setting value **Vmin** but below the maximum voltage **Vmax**?
- Is the voltage V_2 to be synchronized above the setting value **Vmin**, but below the maximum voltage **Vmax**?
- Is the voltage difference $V_2 - V_1$ within the permissible limit **dV SYNCHK V2>V1**?
- Is the voltage difference $V_1 - V_2$ within the permissible limit **dV SYNCHK V2<V1**?
- Are the two frequencies f_1 and f_2 within the permissible operating range $f_{Nom} \pm 3 \text{ Hz}$?
- Is the frequency difference $f_2 - f_1$ within the permissible limit **df SYNCHK f2>f1**?
- Is the frequency difference $f_1 - f_2$ within the permissible limit **df SYNCHK f2<f1**?
- Is the angle difference $\alpha_2 - \alpha_1$ within the permissible limit **dα SYNCHK α2>α1**?
- Is the angle difference $\alpha_1 - \alpha_2$ within the permissible limit **dα SYNCHK α2<α1**?

If there is a condition which is not plausible, the message *25 Sync. Error* is output and the measurement is not started. If the conditions are plausible, the measurement is started (message *25-1 meas.*) and the configured release conditions are checked.

Each condition which is met is indicated explicitly (messages *25 vdiff ok*, *25 fdiff ok*, *25 αdiff ok*). Conditions which are not met are also indicated explicitly, e.g. when the voltage difference (messages *25 V2>V1*, *25 V2<V1*), frequency difference (messages *„25 f2>f1“*, *„25 f2<f1“*) or angle difference (messages *25 α2>α1*, *25 α2<α1*) is outside the limit values. The precondition for these messages is that both voltages are within the operating range of the synchrocheck function (see "Operating Range").

If the conditions are met, the synchrocheck function issues a release signal for closing the relay (*25 Close-release*). This release signal is only available for the configured duration of the CLOSE command and is processed by the device's function control as CLOSE command to the circuit breaker (see also margin heading "Interaction with Control"). However, the message *25 Synchron* is applied as long as the synchronous conditions are met.

The measurement of the the synchronism conditions can be confined to the a maximum monitoring time **T-SYN. DURATION**. If the conditions are not met within **T-SYN. DURATION**, the release is cancelled (message *25 MontimeExc*). A new synchronization can only be performed if a new measurement request is received.

Operating Range

The operating range of the synchrocheck function is defined by the configured voltage limits **Vmin** and **Vmax** as well as the fixed frequency band $f_{Nom} \pm 3 \text{ Hz}$

If the measurement is started and one of or both voltages are outside the operating range or one of the voltages leaves the operating range, this is indicated by corresponding messages (*25 f1>>*, *25 f1<<*, *25 v1>>*, *25 v1<<*).

Measured Values

The measured values of the synchrocheck function are displayed in separate windows for primary, secondary and percentaged measured values. The measured values are displayed and updated only while the synchrocheck function is requested.

The following is displayed:

- Value of the reference voltage V_1
- Value of the voltage to be synchronized V_2
- Frequency values f_1 and f_2
- Differences of voltage, frequency and angle.

2.20.3 De-energized Switching

Connecting two components of a power system is also possible if at least one of the components is de-energized and if the measured voltage is greater than the threshold 6106 **v>**. With a multi-phase connection on the side V_1 , all connected voltages must have a higher value than the threshold **v>** so that the side V_1 is considered as being energized. With a single-phase connection, of course, only the one voltage has to exceed the threshold value.

Besides the release under synchronous conditions, the following additional release conditions can be selected for the check:

SYNC v1>v2< =	Release on the condition that component V_1 is energized and component V_2 is de-energized.
SYNC v1<v2> =	Release on the condition that component V_1 is de-energized and component V_2 is energized.
SYNC v1<v2< =	Release on the condition that component V_1 and component V_2 are de-energized.

Each of these conditions can be enabled or disabled individually via parameters or binary inputs; combinations are thus also possible (e.g. release if **SYNC v1>v2<** or **SYNC v1<v2>** are fulfilled).

For that reason synchronization with the use of the additional parameter 6113 **25 Synchron** (configured to **NO**) can also be used for the connection of a ground electrode. In such a case, connection is only permissible when there is no voltage on the load side.

The threshold below which a power system component is considered as being de-energized is defined by parameter **v<**. If the measured voltage exceeds the threshold **v>**, a power system component is considered as being energized. With a multi-phase connection on the side V_1 , all connected voltages must have a higher value than the threshold **v>** so that the side V_1 is considered as being energized. With a single-phase connection, of course, only the one voltage has to exceed the threshold value.

Before granting a release for connecting the energized component V_1 and the de-energized component V_2 , the following conditions are checked:

- Is the reference voltage V_1 above the setting value V_{min} and $V >$ but below the maximum voltage V_{max} ?
- Is the voltage to be synchronized V_2 below the setting value $V <$?
- Is the frequency f_1 within the permissible operating range $f_{Nom} \pm 3 \text{ Hz}$?

After successful completion of the checks, the release is granted.

For connecting the de-energized component 1 to the energized component 2 or the de-energized component 1 to the de-energized component 2, the conditions to be fulfilled correspond to those stated above.

The associated messages indicating the release via the corresponding condition are as follows: *25 V1> V2<*, *25 V1< V2>* and *25 V1< V2<*.

Via the binary inputs *>25 V1>V2<*, *>25 V1<V2>* and *>25 V1<V2<*, the release conditions can also be issued externally, provided the synchronization is controlled externally.

The parameter **TSUP VOLTAGE** (address 6111) can be set to configure a monitoring time which requires the additional release conditions stated above to be present for de-energized connection before connection is allowed.

2.20.4 Direct Command / Blocking

Parameter 6110 **Direct CO** can be set to grant a release without performing any checks. In this case, connection is allowed immediately when initiating the synchrocheck function. It is obviously not reasonable to combine **Direct CO** with other release conditions.

If the synchrocheck function fails, a direct command may be issued or not, depending on the type of failure (also see "Plausibility Check" and "SYNC Error").

Via the binary input *>25direct CO*, this release can also be granted externally.


Blocking the entire synchrocheck function is possible via the binary input *>BLK 25-I*. The message signaling this condition is output via *25-I BLOCK*. With the blocking, the measurement is terminated and the entire function is reset. A new measurement can only be performed with a new measurement request.

Via the binary input *>BLK 25 CLOSE* it is possible to block only the release signal for closing (*25 CloseRelease*). When the blocking is active, measurement continues. The blocking is indicated by the message *25 CLOSE BLK*. When the blocking is reset and the release conditions are still fulfilled, the release signal for closing is issued.

2.20.5 Interaction with Control, Automatic Reclosing and External Control

With Control

Basically, the synchrocheck function interacts with the device control. The switchgear component to be synchronized is selected via a parameter. If a CLOSE command is issued, the control takes into account that the switchgear component requires synchronization. The control sends a measurement request (*25 Measur.req.*) to the synchrocheck function which is then started. Having completed the check, the synchrocheck function issues the release message (*25 CloseRelease*) to which the control responds by terminating the switching operation either positively or negatively.

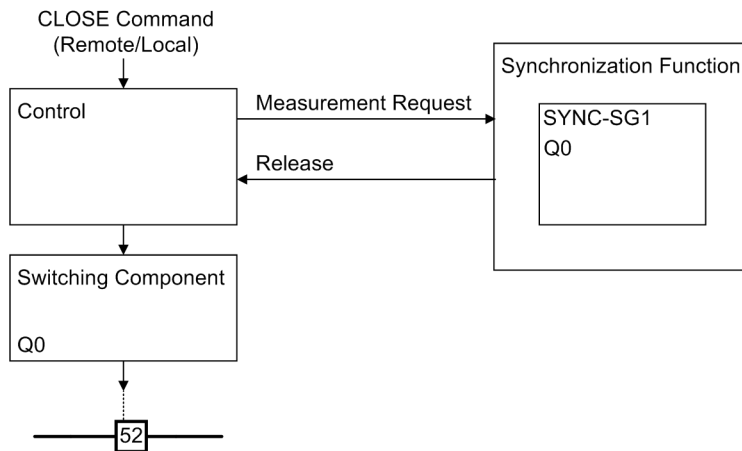


[zusam-wirk-steuer-synchro-fkt-061115, 1, en_US]

Figure 2-113 Interaction of control and synchrocheck function

With Automatic Reclosing

The automatic reclosing (AR) function can also interact with the synchrocheck function. They are linked via the device control. The selection is made via configuration in the automatic reclosing and synchrocheck function. The AR parameters (7138 **Internal SYNC**) determine whether working with SYNC function group 1 or - in the case of external synchronization - without SYNC function group. The switch to be used is defined in function group 1. The switchgear component indicated in the AR parameters (7137 **Cmd.via control**) and the SYNC function group must be identical. If no SYNC function group is entered in the AR parameters, the close command of the AR function is carried out asynchronously via the switchgear component indicated in the AR parameters. Equally, the CLOSE command **79 Close** (message 2851) allows only asynchronous switching. If, for example, circuit breaker Q0 is configured as object to be switched synchronously, a CLOSE command of the AR function will address this breaker and assign it a CLOSE command which will be processed by the control. As this breaker requires synchronization, the control launches the synchrocheck function and awaits release. If the configured conditions of the SYNC function group are fulfilled, the release is granted and the control issues the CLOSE command.

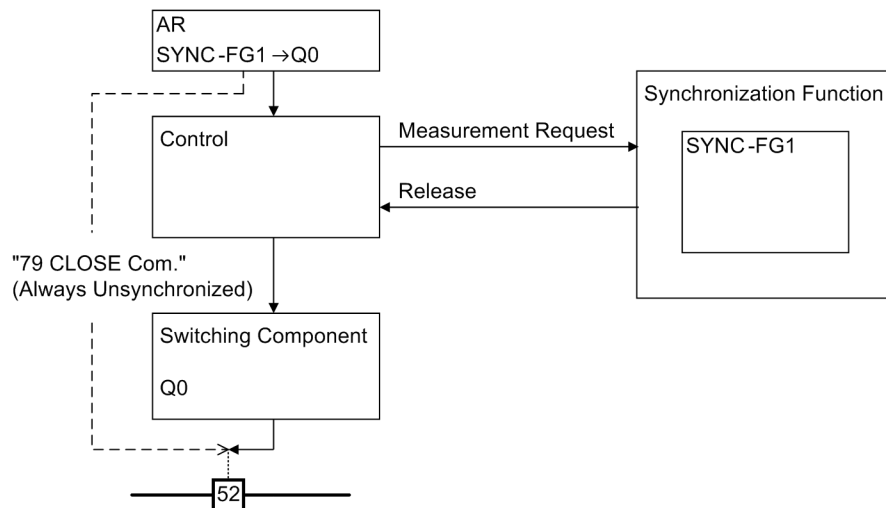


[anbind-awe-an-synchro-fkt-061115, 1, en_US]

Figure 2-114 Connection of the automatic reclosing function to the synchrocheck function

With External Control

As another option, the synchrocheck function can be activated via external measurement requests via binary inputs. If the start is effected via the pulse start signal **>25 Start**, the corresponding stop signal **>25 Stop** must always be generated, too. Having completed the check, the synchrocheck function issues the release message (see the following figure). Measurement is terminated as soon as the measurement request is reset via the binary input. In this case, there is no need to configure a control device to be synchronized.

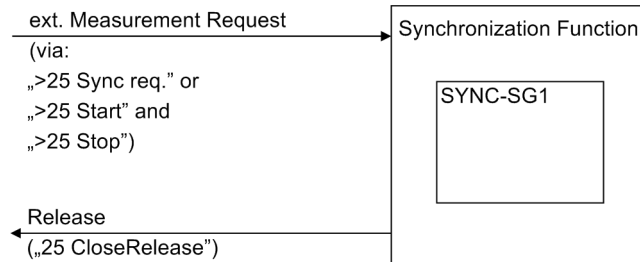

[zusam-wirk-synchro-fkt-mit-ext-anst-061115, 1, en_US]

Figure 2-115 Interaction of synchrocheck function and external control

2.20.6 Setting Notes

General

The synchronization function can only operate if **25 Function 1** with **SYNCHROCHECK** was enabled at address 161 during configuration of the functional scope (see Section 2.1.1.2 [Setting Notes](#)). If this function is not required, then **Disabled** is set.

While setting the Power System Data 1 (see Section [Voltage Connection \(Power System\), Page 40](#)) the device was already provided with data relevant for the measured values and the operating principle of the synchronization function. This concerns the following parameters:

202 **Vnom PRIMARY** primary nominal voltage of the voltage transformers V_1 (phase-to-phase) in kV;

203 **Vnom SECONDARY** secondary nominal voltage of the voltage transformers V_1 phase-to-phase) in V;

213 **VT Connect. 3ph** specifies how the voltage transformers are connected.

When using the synchronization function the setting **Vab**, **Vbc**, **VSyn** is used if two phase-to-phase voltages are open delta-connected to the device. You can use any phase-to-phase voltage as the reference voltage V_{SYN} .

Use the setting **Vph-g**, **VSyn** if only phase-to-ground voltages are available. One of these voltages is connected to the first voltage transformer; the reference voltage V_{SYN} is connected to the third voltage transformer. V_1 at the first voltage transformer and V_2 at the third voltage transformer must belong to the same voltage type (VAN or VBN or VCN).

Connection examples are given under side heading “Voltage Connections” and in the Appendix [C Connection Examples](#).

If you have set **Vab**, **Vbc**, **VSyn** or **Vph-g**, **VSyn**, the zero sequence voltage can not be determined. The functions “Directional Ground Fault Detection”, “Directional Time Overcurrent Protection Ground” and “Fuse Failure Monitor (FFM)” are disabled in this case. [Table 2-1](#) in the Section provides information about the consequences of the different voltage connection types.

The operating range of the synchronization function ($f_{Nom} \pm 3$ Hz) refers to the nominal frequency of the power system, address 214 **Rated Frequency**.

The corresponding messages of the SYNC function group are pre-allocated for IEC 60870–5–103 (VDEW).

Selecting the SYNC function group in DIGSI opens a dialog box with tabs in which the individual parameters for synchronization can be set.

General Settings

The general thresholds for the synchronizing function are set at addresses 6101 to 6112.

Address 6101 **Synchronizing** allows you to switch the entire SYNC function group **ON** or **OFF**. If switched off, the synchrocheck does not verify the synchronization conditions and release is not granted.

Parameter 6102 **SynCB** is used to select the switchgear component to which the synchronization settings are applied. Select the option **none** to use the function as external synchronizing feature. It will then be triggered via binary input messages.

Addresses 6103 **Vmin** and 6104 **Vmax** set the upper and lower limits for the operating voltage range for V_1 or V_2 and thus determine the operating range for the synchronization function. Values outside this range will be signaled.

Address 6105 **V<** indicates the voltage threshold below which the feeder or the busbar can safely be considered switched off (for checking a de-energized feeder or busbar).

Address 6106 **V>** indicates the voltage threshold above which the feeder or busbar can safely be considered energized (for checking an energized feeder or busbar). It must be set below the anticipated operational undervoltage.

The setting for the mentioned voltage values is made in secondary volts. When using DIGSI for configuration, these values can also be entered as primary values. Depending on the connection of the voltages these are phase-to-earth voltages or phase-to-phase voltages.

Addresses 6107 to 6110 are set to specify the release conditions for the voltage check: Where

6107 **SYNC V1<V2>** = component V_1 must be de-energized, component V_2 must be energized (connection when reference is de-energized, dead line);

6108 **SYNC V1>V2<** = component V_1 must be energized, component V_2 must be de-energized (connection when feeder is de-energized, dead bus);

6109 **SYNC V1<V2<** = component V_1 and component V_2 must both be de-energized (connection when reference and feeder are de-energized, dead bus / dead line);

6110 **Direct CO** = connection released without checks.

The possible release conditions are independent of each other and can be combined. It is not recommended to combine **Direct CO** with other release conditions.

Parameter **TSUP VOLTAGE** (address 6111) can be set to configure a monitoring time which requires above stated release conditions to be present for at least de-energized switching before connection is allowed. The preset value of 0.1 s accounts for transient responses and can be applied without modification.

Release via synchrocheck can be limited to a configurable synchronous monitoring time **SYN. DURATION** (address 6112). The configured conditions must be fulfilled within this time period. Otherwise release is not granted and the synchronizing function is terminated. If this time is set to ∞ , the conditions will be checked until they are fulfilled.

For special applications (e.g. connecting a ground switch) parameter 6113 **25 Synchron** allows enabling/disabling the connection release when the conditions for synchronism are satisfied.

Power System Data

The system related data for the synchronization function are set at addresses 6121 to 6125.

The parameter **Balancing V1/V2** (address 6121) can be set to account for different VT ratios of the two parts of the power system (see example in [Figure 2-116](#)).

If a transformer is located between the system parts to be synchronized, its vector group can be accounted for by angle adjustment so that no external adjusting measures are required. Parameter **ANGLE ADJUSTM.** (address 6122) is used to this end.

The phase angle from V_1 to V_2 is evaluated positively.

Example:


Busbar	400 kV primary; 100 V secondary
Feeder	220 kV primary; 110 V secondary
Transformer	400 kV/220 kV; vector group Dy(n)5

The transformer vector group is defined from the high side to the low side. In the example, the reference voltage transformers (V_1) are the ones of the transformer high side, i.e. the setting angle is $5 \times 30^\circ$ (according to vector group), that is 150° :

Address 6122 **ANGLE ADJUSTM.** = 150° .

The reference voltage transformers supply 100 V secondary for primary operation at nominal value while the feeder transformer supplies 110 V secondary. Therefore, this difference must be balanced:

Address 6121 **Balancing V1/V2** = $100 \text{ V}/110 \text{ V} = 0.91$.

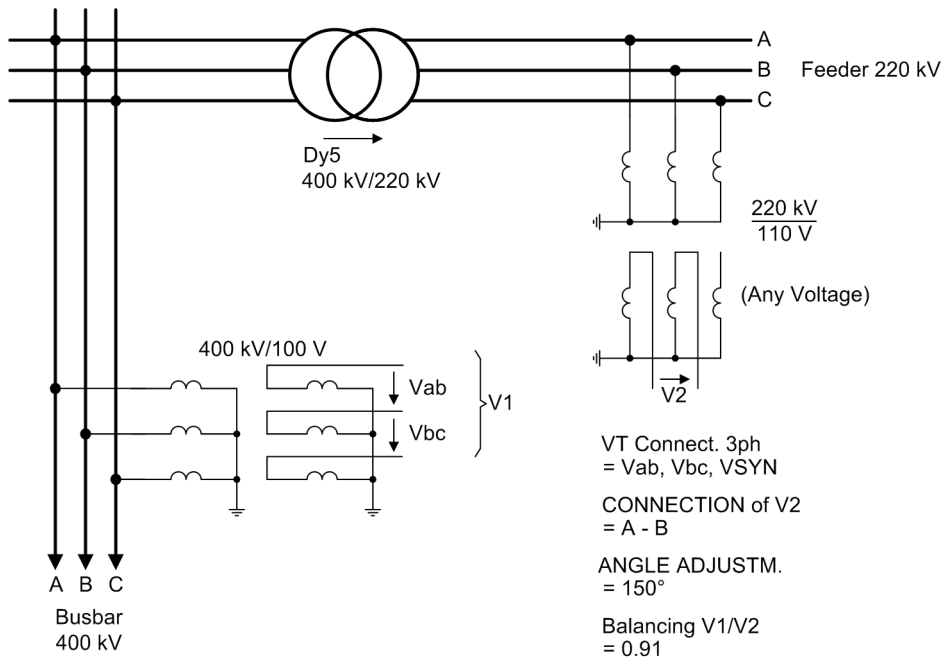

[ss-spg-ueber-trafo-gemess-061115, 1, en_US]

Figure 2-116 Busbar voltage measured across the transformer


Voltage Connections

The 7SJ80 provides **two** voltage inputs for connecting the voltage V_1 and **one** voltage input for connecting the voltage V_2 (see the following examples).

If two phase-to-phase voltages are open delta-connected to side V_1 as reference voltage, a phase-to-phase voltage must be connected and configured for the additional voltage V_2 to be synchronized.

To correctly compare the phase-to-phase reference voltage V_1 with the additional voltage V_2 , the device needs to know the connection type of voltage V_2 . That is the task of parameter **CONNECTION of V2** (parameter 6123).


For the device to perform the internal conversion to primary values, the primary rated transformer voltage of the measured quantity V_2 must be entered via parameter 6125 **VT vn2, primary**, primary if a transformer is located between the system parts to be synchronized.

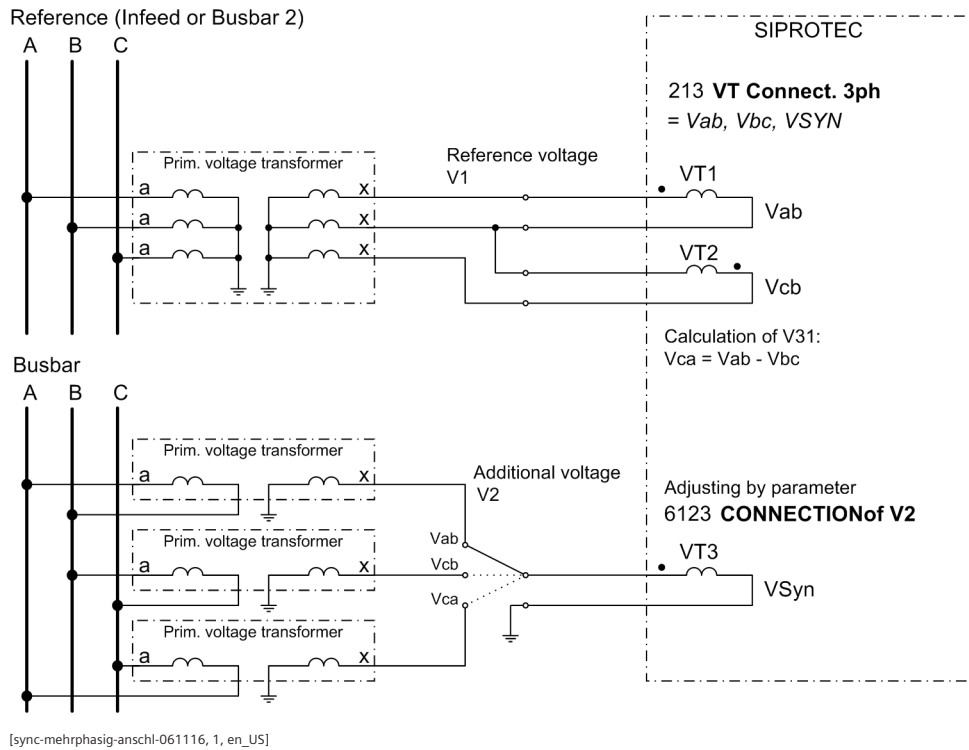

[sync-mehrphasig-anschl-061116, 1, en_US]

Figure 2-117 Phase-to-phase voltage connection (open-delta connection)

If only phase-to-ground voltages are available, the reference voltage V_1 is connected to the first voltage transformer and the additional voltage V_2 to the third voltage transformer.

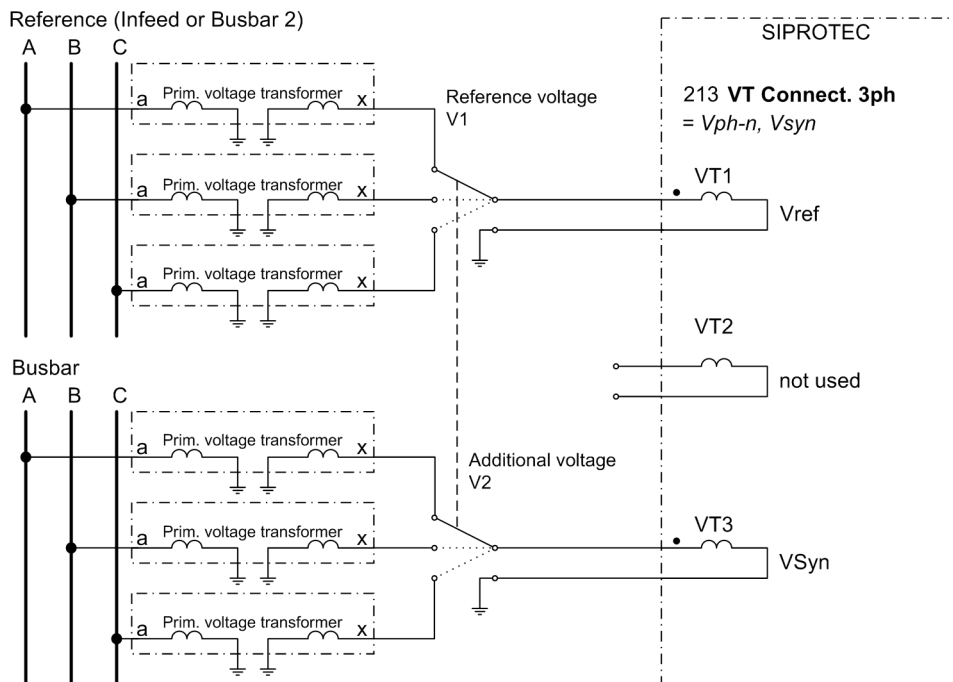

[sync-1phasig-anschl-le-061116, 1, en_US]

Figure 2-118 Phase-to-ground voltage connection

Voltage Difference

The parameters 6150 **dV SYNCHK V2>V1** and 6151 **dV SYNCHK V2<V1** can be set to adjust the permissible voltage differences asymmetrically. The availability of two parameters enables an asymmetrical release to be set.

2.20.7 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

Addr.	Parameter	Setting Options	Default Setting	Comments
6101	Synchronizing	ON OFF	OFF	Synchronizing Function
6102	SyncCB	(Setting options depend on configuration)	none	Synchronizable circuit breaker
6103	Vmin	20 .. 125 V	90 V	Minimum voltage limit: Vmin
6104	Vmax	20 .. 140 V	110 V	Maximum voltage limit: Vmax
6105	V<	1 .. 60 V	5 V	Threshold V1, V2 without voltage
6106	V>	20 .. 140 V	80 V	Threshold V1, V2 with voltage
6107	SYNC V1<V2>	YES NO	NO	ON-Command at V1< and V2>
6108	SYNC V1>V2<	YES NO	NO	ON-Command at V1> and V2<
6109	SYNC V1<V2<	YES NO	NO	ON-Command at V1< and V2<
6110A	Direct CO	YES NO	NO	Direct ON-Command
6111A	TSUP VOLTAGE	0.00 .. 60.00 sec	0.10 sec	Supervision time of V1>;V2> or V1<;V2<
6112	T-SYN. DURATION	0.01 .. 1200.00 sec; ∞	30.00 sec	Maximum duration of Synchronization
6113A	25 Synchron	YES NO	YES	Switching at synchronous condition
6121	Balancing V1/V2	0.50 .. 2.00	1.00	Balancing factor V1/V2
6122A	ANGLE ADJUSTM.	0 .. 360 °	0 °	Angle adjustment (transformer)
6123	CONNECTIONof V2	A-B B-C C-A	A-B	Connection of V2
6125	VT Vn2, primary	0.10 .. 800.00 kV	20.00 kV	VT nominal voltage V2, primary
6150	dV SYNCHK V2>V1	0.5 .. 50.0 V	5.0 V	Maximum voltage difference V2>V1
6151	dV SYNCHK V2<V1	0.5 .. 50.0 V	5.0 V	Maximum voltage difference V2<V1
6152	df SYNCHK f2>f1	0.01 .. 2.00 Hz	0.10 Hz	Maximum frequency difference f2>f1
6153	df SYNCHK f2<f1	0.01 .. 2.00 Hz	0.10 Hz	Maximum frequency difference f2<f1
6154	da SYNCHK α2>α1	2 .. 80 °	10 °	Maximum angle difference alpha2>alpha1
6155	da SYNCHK α2<α1	2 .. 80 °	10 °	Maximum angle difference alpha2<alpha1

2.20.8 Information List

No.	Information	Type of Information	Comments
170.0001	>25-1 act	SP	>25-group 1 activate
170.0043	>25 Sync requ.	SP	>25 Synchronization request
170.0049	25 CloseRelease	OUT	25 Sync. Release of CLOSE Command
170.0050	25 Sync. Error	OUT	25 Synchronization Error
170.0051	25-1 BLOCK	OUT	25-group 1 is BLOCKED
170.2007	25 Measu. req.	SP	25 Sync. Measuring request of Control
170.2008	>BLK 25-1	SP	>BLOCK 25-group 1
170.2009	>25direct CO	SP	>25 Direct Command output
170.2011	>25 Start	SP	>25 Start of synchronization
170.2012	>25 Stop	SP	>25 Stop of synchronization
170.2013	>25 V1>V2<	SP	>25 Switch to V1> and V2<
170.2014	>25 V1<V2>	SP	>25 Switch to V1< and V2>
170.2015	>25 V1<V2<	SP	>25 Switch to V1< and V2<
170.2016	>25 synchr.	SP	>25 Switch to Sync
170.2022	25-1 meas.	OUT	25-group 1: measurement in progress
170.2025	25 MonTimeExc	OUT	25 Monitoring time exceeded
170.2026	25 Synchron	OUT	25 Synchronization conditions okay
170.2027	25 V1> V2<	OUT	25 Condition V1>V2< fulfilled
170.2028	25 V1< V2>	OUT	25 Condition V1<V2> fulfilled
170.2029	25 V1< V2<	OUT	25 Condition V1<V2< fulfilled
170.2030	25 Vdiff ok	OUT	25 Voltage difference (Vdiff) okay
170.2031	25 fdiff ok	OUT	25 Frequency difference (fdiff) okay
170.2032	25 adiff ok	OUT	25 Angle difference (alphadiff) okay
170.2033	25 f1>>	OUT	25 Frequency f1 > fmax permissible
170.2034	25 f1<<	OUT	25 Frequency f1 < fmin permissible
170.2035	25 f2>>	OUT	25 Frequency f2 > fmax permissible
170.2036	25 f2<<	OUT	25 Frequency f2 < fmin permissible
170.2037	25 V1>>	OUT	25 Voltage V1 > Vmax permissible
170.2038	25 V1<<	OUT	25 Voltage V1 < Vmin permissible
170.2039	25 V2>>	OUT	25 Voltage V2 > Vmax permissible
170.2040	25 V2<<	OUT	25 Voltage V2 < Vmin permissible
170.2050	V1 =	MV	V1 =
170.2051	f1 =	MV	f1 =
170.2052	V2 =	MV	V2 =
170.2053	f2 =	MV	f2 =
170.2054	dV =	MV	dV =
170.2055	df =	MV	df =
170.2056	dα =	MV	dalpha =
170.2090	25 V2>V1	OUT	25 Vdiff too large (V2>V1)
170.2091	25 V2<V1	OUT	25 Vdiff too large (V2<V1)
170.2092	25 f2>f1	OUT	25 fdiff too large (f2>f1)
170.2093	25 f2<f1	OUT	25 fdiff too large (f2<f1)
170.2094	25 α2>α1	OUT	25 alphadiff too large (α2>α1)

No.	Information	Type of Information	Comments
170.2095	25 $\alpha_2 < \alpha_1$	OUT	25 alphadiff too large ($\alpha_2 < \alpha_1$)
170.2096	25 FG-Error	OUT	25 Multiple selection of func-groups
170.2097	25 Set-Error	OUT	25 Setting error
170.2101	25-1 OFF	OUT	Sync-group 1 is switched OFF
170.2102	>BLK 25 CLOSE	SP	>BLOCK 25 CLOSE command
170.2103	25 CLOSE BLK	OUT	25 CLOSE command is BLOCKED

2.21 Phase Rotation

A phase rotation function via binary input and parameter is implemented in 7SJ80 devices.

Applications

- Phase rotation ensures that all protective and monitoring functions operate correctly even with anti-clockwise rotation, without the need for two phases to be reversed.

2.21.1 Functional Description

General


Various functions of the 7SJ80 only operate correctly if the phase rotation of the voltages and currents is known. Among these functions are negative sequence protection, undervoltage protection (based only on positive sequence voltages), directional overcurrent protection (direction with cross-polarized voltages), and measured value monitors.

If an "acb" phase rotation is normal, the appropriate setting is made during configuration of the Power System Data.

If the phase rotation can change during operation (e.g. the direction of a motor must be routinely changed), then a changeover signal at the routed binary input for this purpose is sufficient to inform the protective relay of the phase rotation reversal.

Logic

Phase rotation is permanently established at address 209 **PHASE SEQ.** (Power System Data). Via the exclusive-OR gate the binary input **>Reverse Rot.** inverts the sense of the phase rotation applied with setting.

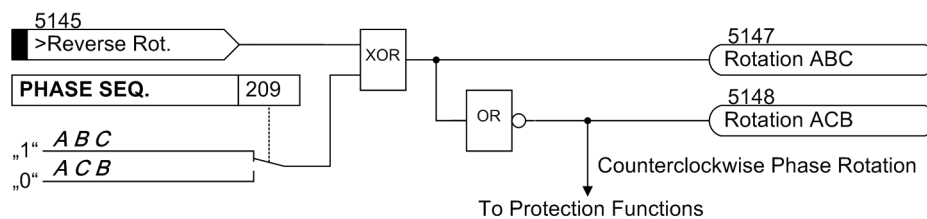

[melde-logik-drehfeldumschaltung-090902-kn, 1, en_US]

Figure 2-119 Message logic of the phase rotation reversal

Influence on Protective and Monitoring Functions

The swapping of phases directly impacts the calculation of positive and negative sequence quantities, as well as phase-to-phase voltages via the subtraction of one phase-to-ground voltage from another and vice versa. Therefore, this function is vital so that phase detection messages, fault values, and operating measurement values are not correct. As stated before, this function influences the negative sequence protection function, directional overcurrent protection function, voltage protection function, flexible protection functions and some of the monitoring functions that issue messages if the defined and calculated phase rotations do not match.

2.21.2 Setting Notes

Setting the Function Parameter

The normal phase sequence is set at 209 (see Section 2.1.3 *Power System Data 1*). If, on the system side, phase rotation is reversed temporarily, then this is communicated to the protection device using the binary input **>Reverse Rot.** (5145).

2.22 Function Logic

The function logic coordinates the execution of protection and auxiliary functions, it processes the resulting decisions and information received from the system. This includes in particular:

Fault Detection / Pickup Logic
Processing Tripping Logic

2.22.1 Pickup Logic of the Entire Device

General Device Pickup

The pickup signals for all protection functions in the device are connected via an OR logic and lead to the general device pickup. It is initiated by the first function to pick up and drop out when the last function drops out. As a consequence, the following message is reported: 501 *Relay PICKUP*.

The general pickup is a prerequisite for a number of internal and external consequential functions. The following are among the internal functions controlled by general device pickup:

- Start of a trip log: From general device pickup to general device dropout, all fault messages are entered in the trip log.
- Initialization of Oscillographic Records: The storage and maintenance of oscillographic values can also be made dependent on the general device pickup.

Exception: Apart from the settings **ON** or **OFF**, some protection functions can also be set to **Alarm Only**. With setting **Alarm Only** no trip command is given, no trip log is created, fault recording is not initiated and no spontaneous fault annunciations are shown on the display.

External functions may be controlled via an output contact. Examples are:

- Automatic reclosing devices,
- Starting of additional devices, or similar.

2.22.2 Tripping Logic of the Entire Device


General Tripping

The trip signals for all protective functions are connected by OR and generate the message 511 *Relay TRIP*. This message can be configured to an LED or binary output, just as the individual tripping messages can.

Terminating the Trip Signal

Once the trip command is output by the protection function, it is recorded as message *Relay TRIP* (see [Figure 2-120](#)). At the same time, the minimum trip command duration **TMin TRIP CMD** is started. This ensures that the command is transmitted to the circuit breaker for a sufficient amount of time, even if the function which issued the trip signal drops out quickly. The trip commands can be terminated first when the last protection function has dropped out (no function is in pickup mode) AND the minimum trip signal duration has expired.

Finally, it is possible to latch the trip signal until it is manually reset (lockout function). This allows the circuit-breaker to be locked against reclosing until the cause of the fault has been clarified and the lockout has been manually reset. The reset takes place either by pressing the LED reset key or by activating an appropriately allocated binary input (**>Reset LED**). A precondition, of course, is that the circuit-breaker close coil – as usual – remains blocked as long as the trip signal is present, and that the trip coil current is interrupted by the auxiliary contact of the circuit breaker.

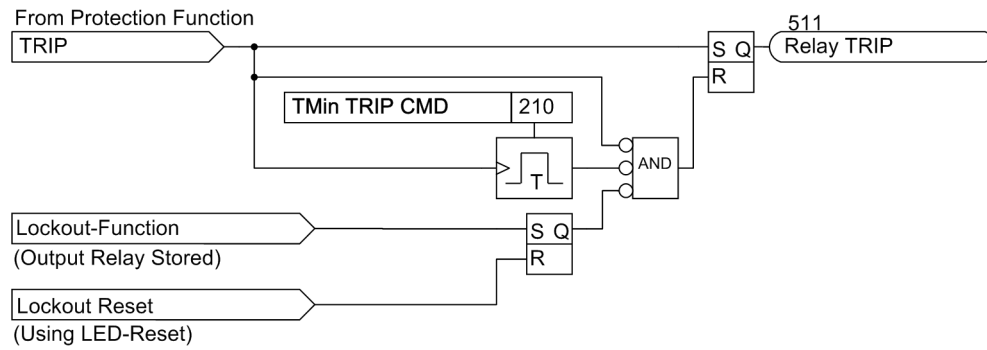

[7sj6x-abst-ausloesekommando-150502-kn, 1, en_US]

Figure 2-120 Terminating the Trip Signal

2.22.3 Setting Notes

Trip Signal Duration

The minimum trip command duration **TMin TRIP CMD** was described already in Section [2.1.3 Power System Data 1](#). This setting applies to all protective functions that initiate tripping.

2.23 Auxiliary Functions

The general functions of the device are described in chapter "Auxiliary Functions".

2.23.1 Message Processing

After the occurrence of a system fault, data regarding the response of the protective relay and the measured values are saved for future analysis. For this reason the device is designed to perform message processing.

Applications

- LED Display and Binary Outputs (Output Relays)
- Information via Display Field or Personal Computer
- Information to a Control Center

Prerequisites

The SIPROTEC 4 System Description provides a detailed description of the configuration procedure (see [/1/ SIPROTEC 4 System Description](#)).

2.23.1.1 LED Displays and Binary Outputs (Output Relays)

Important events and conditions are displayed, using LEDs at the front panel of the relay. The device furthermore has output relays for remote indication. All LEDs and binary outputs indicating specific messages can be freely configured. The relay is delivered with a default setting. The Appendix of this manual deals in detail with the delivery status and the allocation options.

The output relays and the LEDs may be operated in a latched or unlatched mode (each may be individually set).

The latched conditions are protected against loss of the auxiliary voltage. They are reset:

- On site by pressing the LED key on the relay,
- Remotely using a binary input configured for that purpose,
- Using one of the serial interfaces,
- Automatically at the beginning of a new pickup.

State indication messages should not be latched. Also, they cannot be reset until the criterion to be reported has reset. This applies to messages from monitoring functions, or similar.

A green LED displays operational readiness of the relay ("RUN"), and cannot be reset. It goes out if the self-check feature of the microprocessor recognizes an abnormal occurrence, or if the auxiliary voltage is lost.

When auxiliary voltage is present, but the relay has an internal malfunction, then the red LED ("ERROR") lights up and the processor blocks the relay.

2.23.1.2 Information on the Integrated Display (LCD) or Personal Computer

Events and conditions can be read out on the display at the front cover of the relay. Using the front PC interface or the port B at the bottom, a personal computer can be connected, to which the information can be sent. The relay is equipped with several event buffers, for operational messages, circuit breaker statistics, etc., which are protected against loss of the auxiliary voltage by a buffer battery. These messages can be displayed on the LCD at any time by selection via the keypad or transferred to a personal computer via the serial service or PC interface. Readout of messages during operation is described in detail in the SIPROTEC 4 System Description.

Classification of Messages

The messages are categorized as follows:

- Operational messages (event log); messages generated while the device is operating: Information regarding the status of device functions, measured data, power system data, control command logs etc.
- Fault indications; these are indications of the last 25 network faults that were processed by the device.
- Ground fault messages (when the device has sensitive ground fault detection).
- Messages of "statistics"; they include a counter for the trip commands initiated by the device and possibly reclose commands as well as values of interrupted currents and accumulated fault currents.

A complete list of all message and output functions that can be generated by the device with the maximum functional scope can be found in the appendix. All functions are associated with an information number (FNo). There is also an indication of where each message can be sent to. If functions are not present in a not fully equipped version of the device, or are configured to **Disabled**, then the associated indications cannot appear.

Operational Messages (Buffer: Event Log)

The operational messages contain information that the device generates during operation and about operational conditions. Up to 200 operational messages are recorded in chronological order in the device. New messages are appended at the end of the list. If the memory is used up, then the oldest message is scrolled out of the list by a new message.

Fault Messages (Buffer: Trip Log)

After a fault on the system, for example, important information about the progression of the fault can be retrieved, such as the pickup of a protective element or the initiation of a trip signal. The start of the fault is time stamped with the absolute time of the internal system clock. The progress of the disturbance is output with a relative time referred to the instant of fault detection, so that the duration of the fault until tripping and up to reset of the trip command can be ascertained. The resolution of the time information is 1 ms.

Spontaneous Displays on the Device Front

After occurrence of a fault, the most important fault data is output automatically on the device display, without any further operating actions. It is displayed after a general device pickup in the sequence shown in the following figure.

50-1 PU	Protective Function that Picked up First;
50-1 TRIP	Protective Function that Tripped Last;
T - Pickup	Operating Time from General Pickup to Dropout; (Mes.No.245)
T - TRIP	Operating Time from General Pickup to the First Trip Command; (Mes.No.246)
Fault locator	Fault Distance in km or Miles

[anzeige-spontanmeld-im-display-20070326, 1, en_US]

Figure 2-121 Display of spontaneous messages in the HMI

Retrievable Messages

The messages for the last eight network faults can be retrieved and read out. The definition of a network fault is such that the time period from fault detection up to final clearing of the disturbance is considered to be one network fault. If auto-reclosing occurs, then the network fault ends after the last reclosing shot, which means after a successful reclosing or lockout. Therefore the entire clearing process, including all reclosing shots, occupies only one trip log buffer. Within a network fault, several fault messages can occur (from the first pickup of a protective function to the last dropout of a protective function). Without auto-reclosing each fault event represents a network fault.

In total 600 indications can be recorded. Oldest data are erased for newest data when the buffer is full.

Ground Fault Messages

In devices with sensitive ground fault detection, separate ground fault logs are provided for ground fault recording. These logs are completed if the ground fault detection is not set to tripping but to **Alarm Only** (address 3101 = **Alarm Only**) or the setting **ON with GF log** has been selected. With setting **ON with GF log**, there is also a trip, apart from the opening of the ground fault log.

For $\cos\phi$ / $\sin\phi$ measurements, a criterion for the opening of the ground fault log is the pickup of the VN>-element. For "U0/I0- ϕ measurements" the ground fault log is opened as soon as a VN>-element has responded and the angle condition is fulfilled. (Detailed information is provided in the logic diagrams for ground fault detection, Section [2.12 Ground Fault Protection 64, 67N\(s\), 50N\(s\), 51N\(s\)](#)). As soon as the pickup drops out, the fault recording is terminated. The ground fault log is opened as soon as the message 1271 *Sens. Gnd Pickup* (appearing) is issued and terminated upon disappearing of such message.

Up to 45 ground fault messages can be recorded for the last 3 ground faults. If more ground fault messages are generated, the oldest are deleted consecutively.

General Interrogation

The general interrogation which can be retrieved via DIGSI enables the current status of the SIPROTEC 4 device to be read out. All messages requiring general interrogation are displayed with their present value.

Spontaneous Messages

The spontaneous messages displayed using DIGSI reflect the present status of incoming information. Each new incoming message appears immediately, i.e. the user does not have to wait for an update or initiate one.

2.23.1.3 Information to a Control Center

Stored information can additionally be transferred to a central control and storage device if the relay is connected to such a device via port B. Transmission is possible via various transmission protocols.

2.23.2 Statistics

The number of trips initiated by the 7SJ80, the number of close commands initiated by the AR and the operating hours under load are counted.

An additional counter allows the number of hours to be determined in which the circuit breaker is positioned in the "open" condition. Further statistical data can be gained to optimize the intervals for circuit breaker maintenance.

The counter and memory levels are secured against loss of auxiliary voltage.

During the first start of the protection device the statistical values are pre-defined to zero.

2.23.2.1 Functional Description

Number of Trips

In order to count the number of trips of 7SJ80, the 7SJ80 relay has to be informed of the position of the circuit breaker auxiliary contacts via binary inputs. Hereby, it is necessary that the internal pulse counter *#of TRIPS* is allocated in the matrix to a binary input that is controlled by the circuit breaker OPEN position. The pulse count value "Number of TRIPs CB" can be found in the "Statistics" group if the option "Measured and Metered Values Only" was enabled in the configuration matrix.

Number of Automatic Reclosing Commands

The number of reclosing commands initiated by the automatic reclosing function is summed up in separate counters for the 1st and $\geq$ 2nd cycle.

Operating Hours

The operating hours under load are also stored (= the current value in at least one phase is greater than the limit value **BkrClosed I MIN** set under address 212).

Hours Meter "CB open"

A meter can be realized as a CFC application if it adds up the number of hours in state "Circuit Breaker open" similarly to the operating hours meter. The universal hours meter is linked to a respective binary input and counts if the binary input is active. Alternatively, the undershooting of the parameter value 212 **BkrClosed**

I MIN may be used as a criterion for starting the meter. The meter can be set or reset. A CFC application example for such meter is available on the Internet (SIPROTEC Download Area).

2.23.2.2 Circuit Breaker Maintenance


General

The procedures aiding in CB maintenance allow maintenance intervals of the CB poles to be carried out when their actual degree of wear makes it necessary. Saving on maintenance and servicing costs is one of the main benefits this functionality offers.

The universal CB maintenance accumulates the tripping currents of the trips initiated by the protective functions and comprises the four following autonomous subfunctions:

- Summation tripping current (ΣI -procedure)
- Summation of tripping powers (ΣI^x -procedure)
- Two-point procedure for calculating the remaining lifetime (2P-procedure)
- Sum of all Squared Fault Current Integral (I^2t -procedure);

Measured value acquisition and preparation operates phase-selectively for all four subfunctions. The three results are each evaluated using a threshold which is specific for each procedure (see [Figure 2-122](#)).

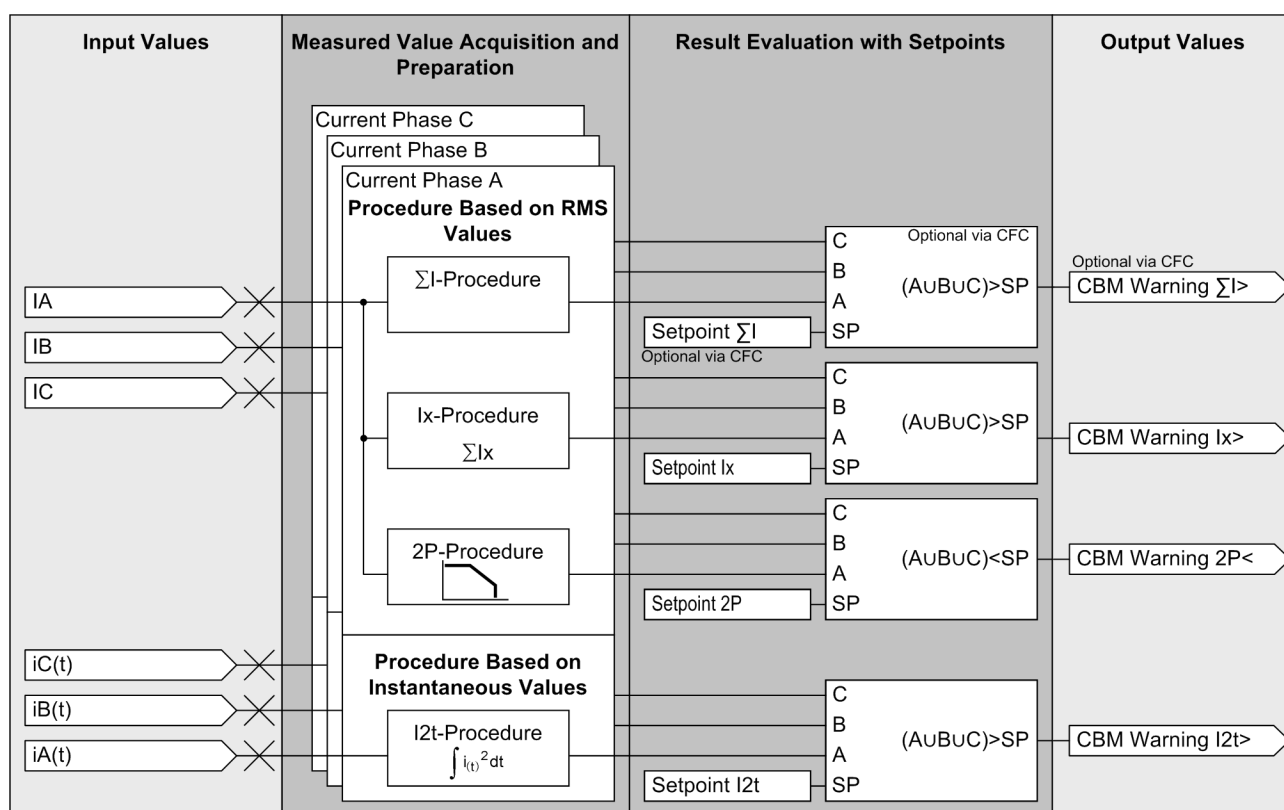

[schema-lsw-171103-kn, 1, en_US]

Figure 2-122 Diagram of CB maintenance procedures

The ΣI procedure is always present and active as a basic functionality. However, the other procedures (ΣI^x , 2P and I^2t) can be selected via a common configuration parameter.


As the load on the switch depends on the current amplitude and duration of the actual switching action, including arc deletion, determination of the start and end criteria is of great importance. The procedures ΣI^x , 2P and I^2t make use of the same criteria for that purpose. The logic of the start and end criterion is illustrated in [Figure 2-123](#).

The start criterion is fulfilled by an internal protective tripping initiated by the group indication "device TRIP". Trips initiated via the internal control function are taken into consideration for the circuit breaker maintenance if the respective command is indicated via the parameter 265 **Cmd.via control**. An externally initiated trip command can be taken into consideration if the message *>52 wear start* is sent simultaneously via a binary input. The edge of the sent message *>52-a* can also be used as a further criterion as this signals that the mechanism of the circuit breaker is put in motion in order to separate the contacts.

As soon as the start criterion has been fulfilled, the parameterized opening time of the circuit breaker is started. The time of commencement of separation of the circuit breaker contacts is thus determined. The end of the trip procedure, including arc deletion is determined via another given parameter (CB tripping time) supplied by the manufacturer of the circuit breaker.

In order to prevent an incorrect calculation procedure in case of circuit breaker failure, the current criterion 212 **BkrClosed I MIN** verifies whether the current actually returned to zero after two additional cycles. When the phase-selective logic release is fulfilled by the current criterion, the calculation and evaluation methods of the respective procedures are initiated. After these have been completed, the end criterion of the circuit breaker maintenance is fulfilled and ready for a new initiation.

Please note that CB maintenance will be blocked if parameter settings are made incorrectly. This condition is indicated by the message *52 wearSet.fail*, *52WL.b1k n PError* or *52WL.b1k I PErr* (see Section [2.1.6.2 Setting Notes](#), "Power System Data 2"). The latter two indications can only take effect if the 2P-procedure was configured.

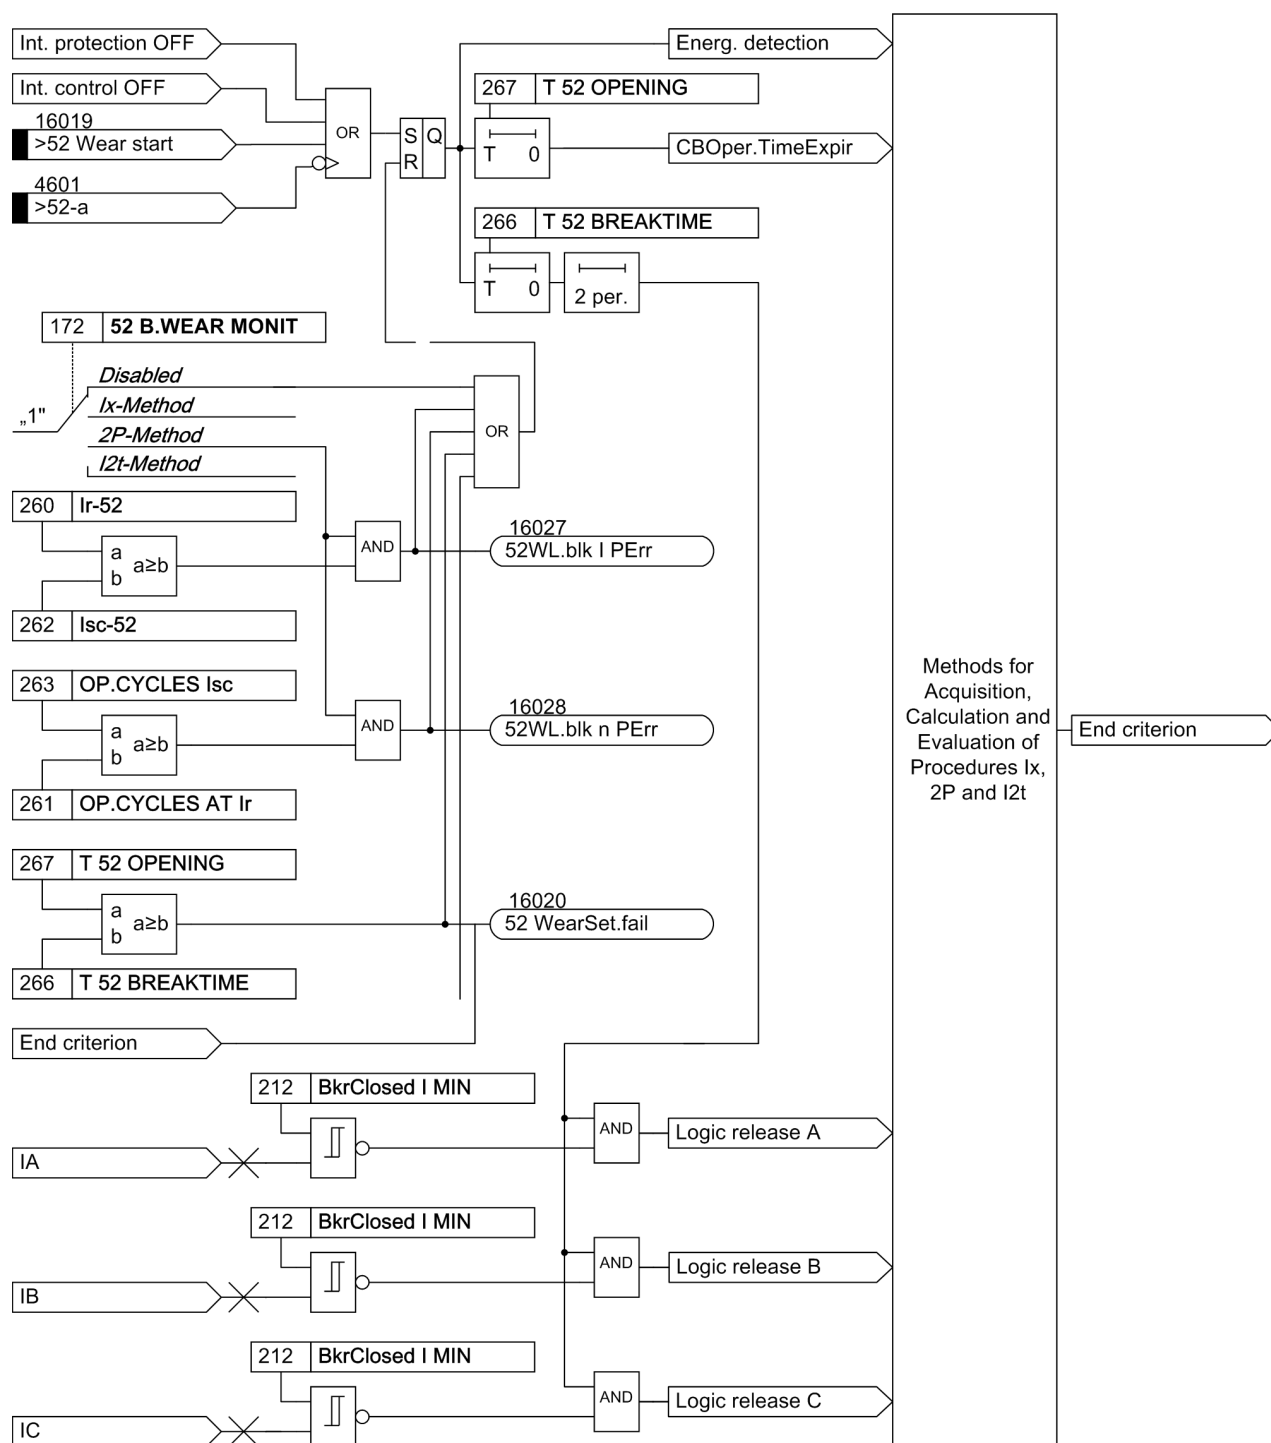

[logik-lsw-start-endeckriterium-170903-kn, 1, en_US]

Figure 2-123 Logic of the start and end criterion

ΣI-Procedure

Being a basic function, the ΣI-procedure is unaffected by the configuration and does not require any procedure-specific settings. All tripping currents occurring $1\frac{1}{2}$ periods after a protective trip, are summed up for each phase. These tripping currents are r.m.s. values of the fundamental harmonic.

The interrupted current in each pole is determined for each trip signal. The interrupted fault current is indicated in the fault messages and is added up with previously stored fault current values in the statistic-counters. Measured values are indicated in primary terms.

The ΣI method does not feature integrated threshold evaluation. But using CFC it is possible to implement a threshold, which logically combines and evaluates the three summation currents via an OR operation. Once the summation current exceeds the threshold, a corresponding message will be triggered.

ΣI^x -Procedure

While the ΣI -procedure is always enabled and active, use of the ΣI^x -procedure depends on the CB maintenance configuration. This procedure operates analogously to the ΣI -procedure. The differences relate to the involution of the tripping currents and their reference to the exponentiated rated operating current of the CB. Due to the reference to I_r^x , the result is an approximation to the number of make-break operations specified by the CB manufacturer. The displayed values can be interpreted as the number of trips at rated operational current of the CB. They are displayed in the statistics values without unit and with two decimal places.

The tripping currents used for calculation are a result of the rms values of the fundamental harmonic, which is recalculated each cycle.

If the start criterion is satisfied (as described in Section „General“), the r.m.s. values, which are relevant after expiration of the opening time, are checked for each phase as to whether they comply with the current criterion. If one of the values does not satisfy the criterion, its predecessor will be used instead for calculation. If no r.m.s. value satisfies the criterion up to the predecessor of the starting point, which is marked by the start criterion, a trip has taken place which only affects the mechanical lifetime of the breaker and is consequently not detected by this procedure.

If the current criterion grants the logic release after the opening time has elapsed, the recent primary tripping currents (I_b) are involuted and related to the exponentiated rated operating current of the CB. These values are then added to the existing statistic values of the ΣI^x -procedure. Subsequently, threshold comparison is started using threshold ΣI^x as well as the output of the new related summation tripping current powers. If one of the new statistic values lies above the threshold, the message *Threshold ΣI^x* is generated.


2P-Procedure

The application of the two-point procedure for the calculation of the remaining lifespan depends on the CMD configuration. The data supplied by the CB manufacturer is transformed in such manner that, by means of measuring the fault currents, a concrete statement can be made with regard to the still possible operating cycles. The CB manufacturer's double-log operating cycle diagrams form the basis of the measured fault currents at the time of contact separation. Determination of the fault currents is effected in accordance with the method as described in the above section of the ΣI^x -procedure.

The three results of the calculated remaining lifetime are represented as statistic value. The results represent the number of still possible trips, if the tripping takes place when the current reaches the rated operational current. They are displayed without unit and without decimals.

As with the other procedures, a threshold logically combines the three "remaining lifetime results" via an OR operation and evaluates them. It forms the "lower threshold", since the remaining lifetime is decremented with each trip by the corresponding number of operating cycles. If one of the three phase values drops below the threshold, a corresponding message will be triggered.

A double-logarithmic diagram provided by the CB manufacturer illustrates the relationship of operating cycles and tripping current (see example in [Figure 2-124](#)). This diagram allows the number of yet possible trips to be determined (for tripping with equal tripping current). According to the example, approximately 1000 trips can yet be carried out at a tripping current of 10 kA. The characteristic is determined by two vertices and their connecting line. Point P1 is determined by the number of permitted operating cycles at rated operating current I_r , point P2 by the maximum number of operating cycles at rated fault tripping current I_{sc} . The associated four values can be configured.

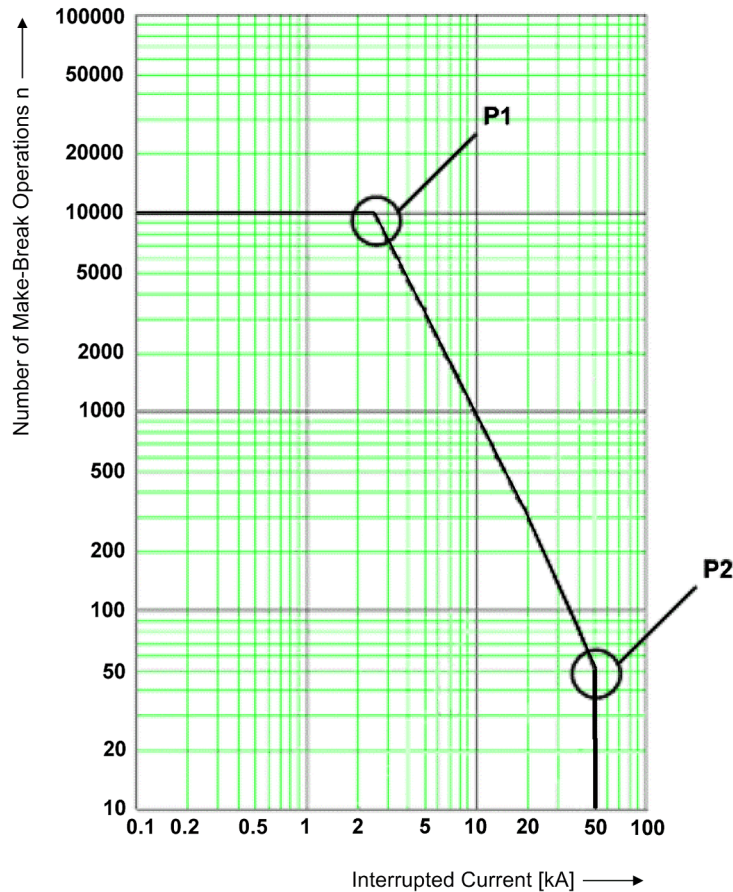

[lsw-2p-schaltspiel270404-he, 1, en_US]

Figure 2-124 Diagram of operating cycles for the 2P procedure

As [Figure 2-124](#) illustrates a double-log diagram, the straight line between P1 and P2 can be expressed by the following exponential function:

$$n = b \cdot I_b^m$$


where n is the number of operating cycles, b the operating cycles at $I_b = 1\text{A}$, I_b the tripping current, and m the directional coefficient.

The general line equation for the double-logarithmic representation can be derived from the exponential function and leads to the coefficients b and m .



NOTE

Since a directional coefficient of $m < -4$ is technically irrelevant, but could theoretically be the result of incorrect settings, it is limited to -4. If a coefficient is smaller than -4, the exponential function in the operating cycles diagram is deactivated. The maximum number of operating cycles with I_{sc} (263 **OP. CYCLES** **I_{sc}**) is used instead as the calculation result for the current number of operating cycles, see [Figure 2-125](#).

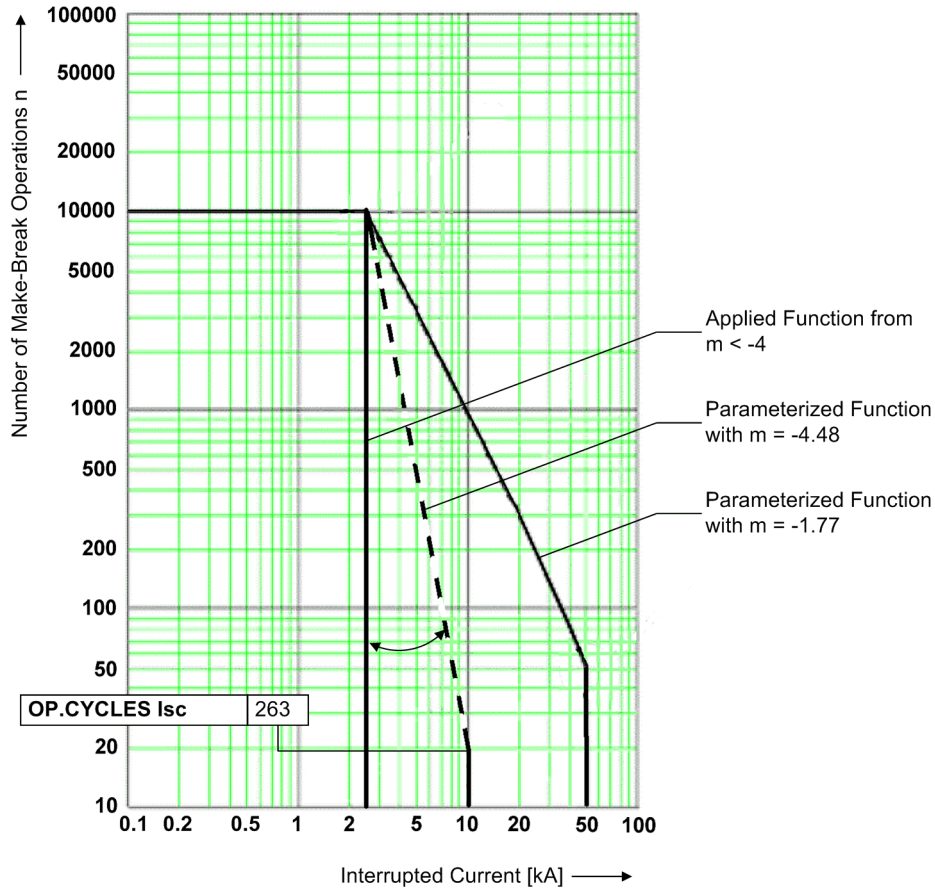

[dw_2p-richtungskoeffizient, 1, en_US]

Figure 2-125 Value limitation of directional coefficient

With the characteristics description, you can calculate the actual remaining lifetime after each tripping.

$$\text{Remaining lifetime}_i = \text{Remaining lifetime}_{i-1} - \frac{n/I_r}{n_i/I_b}$$

[fo_7sj_remaining-lifetime_01, 1, en_US]

The index i characterizes the actual tripping. With the ratio of the maximum number of switching cycles ($n_{\max}$ is n at I_r) to the actual calculated number of switching cycles, you get the ratio of these concerning the maximum number of possible switching cycles in case of a tripping with rated operating current (I_r).

In the following example, the circuit breaker has tripped 100 times with rated operating current, 2 times with rated short-circuit current, and 3 times with 10 kA.

The number of permissible trippings with rated operating current is calculated as following:

$$\text{RLT} = 10000_{\max} - \left(100 \cdot \frac{10000_{\max}}{10000_{2.5 \text{ kA}}}\right) - \left(2 \cdot \frac{10000_{\max}}{50_{50 \text{ kA}}}\right) - \left(3 \cdot \frac{10000_{\max}}{861_{10 \text{ kA}}}\right) = 9465$$

[fo_7sj_remaining-lifetime_03, 1, en_US]

RLT Remaining lifetime

In the example, 9465 more trippings with rated operating current are possible.

If the current criterion described in the Section "General" grants the phase-selective logic release, the present number of operating cycles is calculated based on the tripping currents determined when the CB operating time on tripping has elapsed. They are set off against the remaining lifetime allowing the present statistic

values to be displayed and the evaluation to be started using the specified threshold. If one of the new values lies above the threshold, the message *Thresh. R. Endu. <* is generated.

Three additional phase-selective statistic values are provided to determine the portion of purely mechanical trips among the results of the remaining lifetime (e.g. for phase A: *mechan. TRIP A*). They act as counters which count only the trips whose tripping currents are below the value of the current criterion.

I²t-Procedure

During the I²t-procedure the squared fault current integral occurring per trip is added up phase-selectively. The integral is derived from the squared instantaneous values of the currents occurring during arc time of the circuit breaker. This results in:

$T_{CB\ arc} = (\text{parameter } 266\ T\ 52\ \text{BREAKTIME}) - (\text{parameter } 267\ T\ 52\ \text{OPENING})$.

The three sums of the calculated integrals are represented as statistic values referred to the squared device nominal current (I_{nom}^2). As with the other procedures, a threshold logically combines the three sums via an OR operation and evaluates them.

The calculated squared tripping current integrals are added to the existing statistic values. Subsequently, threshold comparison is started using threshold $\Sigma I^2 t$, and the new statistic values are output. If one of the values lies above the threshold, the message *Thresh. $\Sigma I^2 t$* is generated.

Commissioning

Usually, no measures are required for commissioning. However, should the protection device be exchanged (e.g. old circuit breaker and a new protection device), the initial values of the respective limit or statistical values must be determined via the switching statistics of the respective circuit breaker.

2.23.2.3 Setting Notes

Reading/Setting/Resetting Counters

The SIPROTEC 4 System Description provides a description of how to read out the statistical counters via the device front panel or DIGSI. Setting or resetting of these statistical counters takes place under the menu item **MESSAGES** —> **STATISTICS** by overwriting the counter values displayed.

Circuit Breaker Maintenance


Under address 172 52 **B.WEAR MONIT** one of the alternatives ΣI^x procedure, 2P procedure, I²t procedure or **Disabled** can be set. All parameters relevant to this function are available at parameter block **P. System Data 1** (see Section [2.1.3 Power System Data 1](#)).

The following setting values are important input values the subfunctions require in order to operate correctly:

The CB Tripping Time is a characteristic value provided by the manufacturer. It covers the entire tripping process from the trip command (applying auxiliary power to the trip element of the circuit breaker) up to arc extinction in all poles. The time is set at address 266 **T 52 BREAKTIME**.

The CB Operating Time **T 52 OPENING** is equally a characteristic value of the circuit breaker. It covers the time span between the trip command (applying auxiliary power to the trip element of the circuit breaker) and separation of CB contacts in all poles. It is entered at address 267 **T 52 OPENING**.

The following diagram illustrates the relationship between these CB times.

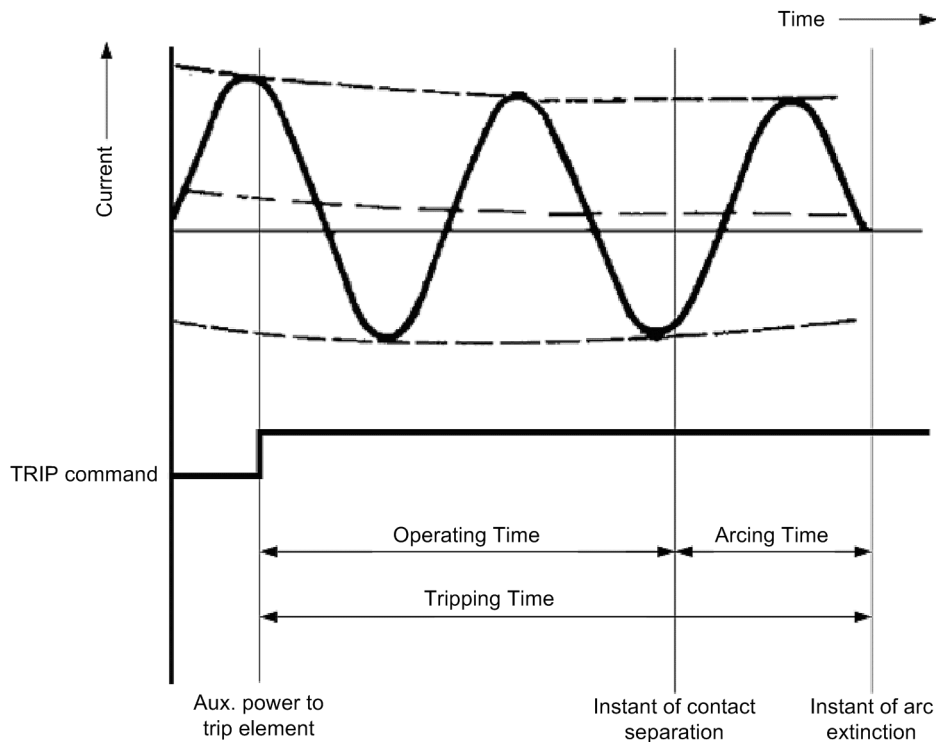

[ls-zeiten-120304-he, 1, en_US]

Figure 2-126 Illustration of the CB times

Current flow monitoring 212 **BkrClosed I MIN**, which some protective functions rely upon to detect a closed CB, is used as the current zero criterion. It should be set with respect to the actually used device functions (see also margin heading "Current Flow Monitoring (CB)" in Section 2.1.3.2 [Setting Notes](#)).

Σ I-Procedure

Being the basic function of summation current formation, the Σ I-procedure is always active and does not require any additional settings. This is irrespective of the configuration in address 172 52 **B.WEAR MONIT**. This method does not offer integrated threshold evaluation. The latter could, however, be implemented using CFC.

Σ I^x-Procedure

Parameter 172 52 **B.WEAR MONIT** can be set to activate the Σ I^x procedure. In order to facilitate evaluating the sum of all tripping current powers, the values are referred to the involuted CB rated operational current. This value is indicated in the CB data at address 260 **I_r-52** in the **P.System Data 1** and can be set as primary value. This reference allows the threshold of the Σ I^x procedure to correspond to the maximum number of make-break operations. For a circuit breaker, whose contacts have not yet been worn, the maximum number of make-break operations can be entered directly as threshold. The exponent for the involution of the rated operational current and of the tripping currents is set at address 264 **I_x EXPONENT**. To meet different customer requirements, this exponent 264 **I_x EXPONENT** can be increased from 1.0 (default setting = 2.0) to 3.0.

For the procedure to operate correctly, the time response of the circuit breaker must be specified in parameters 266 **T 52 BREAKTIME** and 267 **T 52 OPENING**.

The summated values can be interpreted as the number of tripping operations at rated operational current of the CB. They are displayed in the statistical values without unit and with two decimal places.

2P-Procedure

Parameter 172 52 **B.WEAR MONIT** can be set to activate the 2P procedure. An operating cycles diagram (see sample diagram in the functional description of the 2P procedure), provided by the manufacturer, shows the

relationship of make-break operations and tripping current. The two vertices of this characteristic in a double logarithmic scale are decisive for the setting of addresses 260 to 263:

Point P1 is determined by the number of permitted make-break operations (parameter 261 **OP.CYCLES AT Ir**) for rated operational current Ir (parameter 260 **Ir-52**)

Point P2 is determined by the maximum number of make-break operations (parameter 263 **OP.CYCLES Isc**) for rated fault tripping current Isc (parameter 262 **Isc-52**).

For the procedure to operate correctly, the time response of the circuit breaker must be specified in parameters 266 **T 52 BREAKTIME** and 267 **T 52 OPENING**.

I²t-Procedure

The I²t-procedure is activated via configuration parameter 172 **52 B.WEAR MONIT**. The square fault current integrals are referred to the squared device nominal current. For purposes of determining the arc time, the device must be informed of the CB tripping time **T 52 BREAKTIME** as well as the CB opening time **T 52 OPENING** of the circuit breaker. For recognition of the last zero crossing (arc deletion) of the currents after tripping, the "Current-zero" Criterion is required.

2.23.2.4 Information List

No.	Information	Type of Information	Comments
–	#of TRIPs=	PMV	Number of TRIPs=
409	>BLOCK Op Count	SP	>BLOCK Op Counter
1020	Op.Hours=	VI	Counter of operating hours
1021	$\Sigma I_a =$	VI	Accumulation of interrupted current Ph A
1022	$\Sigma I_b =$	VI	Accumulation of interrupted current Ph B
1023	$\Sigma I_c =$	VI	Accumulation of interrupted current Ph C
2896	79 #Close1./3p=	VI	No. of 1st AR-cycle CLOSE commands,3pole
2898	79 #Close2./3p=	VI	No. of higher AR-cycle CLOSE commands,3p
16001	$\Sigma I^x A=$	VI	Sum Current Exponentiation Ph A to I_r^x
16002	$\Sigma I^x B=$	VI	Sum Current Exponentiation Ph B to I_r^x
16003	$\Sigma I^x C=$	VI	Sum Current Exponentiation Ph C to I_r^x
16006	Resid.Endu. A=	VI	Residual Endurance Phase A
16007	Resid.Endu. B=	VI	Residual Endurance Phase B
16008	Resid.Endu. C=	VI	Residual Endurance Phase C
16011	mechan.TRIP A=	VI	Number of mechanical Trips Phase A
16012	mechan.TRIP B=	VI	Number of mechanical Trips Phase B
16013	mechan.TRIP C=	VI	Number of mechanical Trips Phase C
16014	$\Sigma I^2 t A=$	VI	Sum Squared Current Integral Phase A
16015	$\Sigma I^2 t B=$	VI	Sum Squared Current Integral Phase B
16016	$\Sigma I^2 t C=$	VI	Sum Squared Current Integral Phase C

2.23.3 Measurement

A series of measured values and the values derived from them are constantly available for call up on site, or for data transfer.

Applications

- Information on the actual status of the system
- Conversion of secondary values to primary values and percentages

Prerequisites

Except for secondary values, the device is able to indicate the primary values and percentages of the measured values.

A precondition correct display of the primary and percentage values is the complete and correct entry of the nominal values for the instrument transformers and the protected equipment as well as current and voltage transformer ratios in the ground paths when configuring the device. The following table shows the formulas which are the basis for the conversion of secondary values to primary values and percentages.

When using the connection types **Vab**, **Vbc** or **Vab**, **Vbc**, **Vx** of the voltage transformers (address 213 **VT Connect. 3ph**), the measured values for power P, Q, S, power factor, energy and the derived values, such as mean values etc. are not available.

Measured values which cannot be calculated due to the selected voltage connection are shown as dots.

2.23.3.1 Display of Measured Values

Table 2-21 Conversion formulae between secondary values and primary/percentage values

Measured Values	sekun-dary	primary	%
$I_A, I_B, I_C,$ I_1, I_2	$I_{sec.}$	$\frac{CT PRIM}{CT SEC} \cdot I_{sec}$	$\frac{I_{prim}}{FullScaleCurr.}$
$I_E = 3 \cdot I_0$ (calculated)	$I_{e sec.}$	$\frac{CT PRIM}{CT SEC} \cdot I_{n sec}$	$\frac{I_{Nom prim}}{FullScaleCurr.}$
$I_N =$ measured value of I_N -input	$I_{N sec.}$	$\frac{IN CT PRIM}{IN CT SEC} \cdot I_{N sec}$	$\frac{I_{Nom prim}}{FullScaleCurr.}$
I_{Ns} (I_{Ns} , $I_{3I0real}$, $I_{3I0reaktiv}$)	$I_{Ns sec.}$	$\frac{IN CT PRIM}{IN CT SEC} \cdot I_{Ns sec}$	$\frac{I_{Ns prim}}{FullScaleCurr.}$
$I_{N2} =$ measured value from the I_{E2} input	$I_{N2 sec.}$	$\frac{IB-CT PRIM}{IB-CT SEC} \cdot I_{e sec}$	$\frac{I_{Nom prim}}{FullScaleCurr.}$
$V_A, V_B, V_C,$ $V_0, V_1, V_2,$ V_{syn}	$V_{Ph-N sec.}$	$\frac{Vnom PRIMARY}{Vnom SECONDARY} \cdot U_{PhNsec}$	$\frac{V_{prim}}{FullScaleVolt. / (\sqrt{3})}$
$V_{A-B}, V_{B-C}, V_{C-A}$	$V_{Ph-Ph sec.}$	$\frac{Vnom PRIMARY}{Vnom SECONDARY} \cdot V_{Ph-Ph sec}$	$\frac{V_{prim}}{FullScaleVolt.}$
V_N	$V_{N sec.}$	$V_{ph/Vdelta} \cdot \frac{Vnom PRIM}{Vnom SEC} \cdot V_{N sec}$	$\frac{V_{prim}}{\sqrt{3} \cdot FullScaleVolt.}$
V_x	$V_{x sec.}$	$\frac{VXnom PRIMARY}{VXnom SECONDARY} \cdot V_x$	$\frac{V_{prim}}{V REF 100\% PRIM}$
P, Q, S (P and Q phase-segre-gated)	No secondary measured values		$\frac{Power_{prim}}{\sqrt{3} \cdot (Full.Scal.Volt.) \cdot (Full.Scal.Curr.)}$
Power Factor (phase-segre-gated)	$\cos \varphi$	$\cos \varphi$	$\cos \varphi \cdot 100$ in %
Frequency Protection	f in Hz	f in Hz	$\frac{f \text{ in Hz}}{f_{Nom}} \cdot 100$

Table 2-22 Legend for the conversion formulae

Parameter	Address	Parameter	Address
CT PRIMARY	204	I _{gnd-CT PRIM}	217
CT SECONDARY	205	I _{gnd-CT SEC}	218
V _{nom} PRIMARY	202	V _{ph} / V _{delta}	206
V _{nom} SECONDARY	203	FullScaleVolt.	1101
		FullScaleCurr.	1102
VX _{nom} PRIMARY	232	I _{gnd2-CT PRIM.}	238
VX _{nom} SECONDARY	233	I _{gnd2-CT SEC.}	239

Depending on the type of device ordered and the device connections, some of the operational measured values listed below may not be available.

The phase-to-ground voltages are either measured directly, if the voltage inputs are connected phase-to-ground, or they are calculated from the phase-to-phase voltages V_{A-B} and V_{B-C} and the displacement voltage V_N .

The displacement voltage V_N is either measured directly or calculated from the phase-to-ground voltages:

$$V_N = \frac{3 \cdot V_0}{V_{ph} / V_{delta}} \quad \text{with} \quad \begin{aligned} 3V_0 &= (V_{A-G} + V_{B-G} + V_{C-G}) \\ V_{ph} / V_{delta} &= \text{Transformation adjustment for ground input voltage (setting 0206A)} \end{aligned}$$

[verlagerungsspannunguen-020315-wlk, 1, en_US]

Please note that value V_0 is indicated in the operational measured values.

The ground current I_N is either measured directly or calculated from the conductor currents.

$$I_N = \frac{3 \cdot I_0}{I_{gnd-CT} / (CT)} \quad \text{with} \quad \begin{aligned} 3I_0 &= (I_A + I_B + I_C) \\ I_{gnd-CT} &= \text{setting 0217 or 0218} \\ CT &= \text{setting 0204 or 0205} \end{aligned}$$

[erdstrom-020315-wlk, 1, en_US]

Upon delivery, the power and operating values are set in such manner that power in line direction is positive. Active components in line direction and inductive reactive components in line direction are also positive. The same applies to the power factor $\cos\phi$. It is occasionally desired to define the power drawn from the line (e.g. as seen from the consumer) positively. Using parameter 1108 **P,Q sign** the signs for these components can be inverted.

The calculation of the operational measured values is also performed during a fault. The values are updated in intervals of > 0.3 s and < 1 s.

2.23.3.2 Transfer of Measured Values

Measured values can be transferred via the interfaces to a central control and storage unit.

The measuring range in which these values are transmitted depend on the protocol and, if necessary, additional settings.

Protocol	Transmittable measuring range, format
IEC 60870-5-103	0 to 240 % of the measured value.
IEC 61850	The primary operational measured values are transmitted. The measured values as well as their unit format are set out in detail in manual PIXIT 7SJ. The measured values are transmitted in "Float" format. The transmitted measuring range is not limited and corresponds to the operational measurement.
PROFIBUS, Modbus, DNP 3.0 DNP3 TCP PROFINET	The unit format of the measured values on the device side is at first automatically generated by means of the selected nominal values of current and voltage within the system data. The current unit format can be determined in DIGSI or at the device via Menu Operational Values. The user can select via DIGSI which operational measured values (primary, secondary or percentage) must be transmitted. The measured values are always transmitted as 16-bit values including sign (range ± 32768). The user can define the scaling of the operational measured value to be transmitted. This will result in the respective transmittable measuring range. For further details, please refer to the descriptions and protocol profiles.

2.23.3.3 Information List

No.	Information	Type of Information	Comments
601	Ia =	MV	Ia
602	Ib =	MV	Ib
603	Ic =	MV	Ic
604	In =	MV	In
605	I1 =	MV	I1 (positive sequence)
606	I2 =	MV	I2 (negative sequence)
621	Va =	MV	Va
622	Vb =	MV	Vb
623	Vc =	MV	Vc
624	Va-b=	MV	Va-b
625	Vb-c=	MV	Vb-c
626	Vc-a=	MV	Vc-a
627	VN =	MV	VN
629	V1 =	MV	V1 (positive sequence)
630	V2 =	MV	V2 (negative sequence)
632	Vsync =	MV	Vsync (synchronism)
641	P =	MV	P (active power)
642	Q =	MV	Q (reactive power)
644	Freq=	MV	Frequency
645	S =	MV	S (apparent power)
680	Phi A =	MV	Angle Va-Ia
681	Phi B =	MV	Angle Vb-Ib
682	Phi C =	MV	Angle Vc-Ic
701	INs Real	MV	Resistive ground current in isol systems
702	INs Reac	MV	Reactive ground current in isol systems
807	Θ/Θ_{trip} =	MV	Thermal Overload
830	INs =	MV	INs Sensitive Ground Fault Current

No.	Information	Type of Information	Comments
831	3I ₀ =	MV	3I ₀ (zero sequence)
832	V ₀ =	MV	V ₀ (zero sequence)
901	PF =	MV	Power Factor
16031	φ(3V ₀ , I _{Ns}) =	MV	Angle between 3V ₀ and I _{Ns} .
18473	V _{a-b} RMS=	MV	V _{a-b} RMS(10 minute RMS value)
18474	V _{b-c} RMS=	MV	V _{b-c} RMS(10 minute RMS value)
18475	V _{c-a} RMS=	MV	V _{c-a} RMS(10 minute RMS value)
30701	P _a =	MV	P _a (active power, phase A)
30702	P _b =	MV	P _b (active power, phase B)
30703	P _c =	MV	P _c (active power, phase C)
30704	Q _a =	MV	Q _a (reactive power, phase A)
30705	Q _b =	MV	Q _b (reactive power, phase B)
30706	Q _c =	MV	Q _c (reactive power, phase C)
30707	PF _a =	MV	Power Factor, phase A
30708	PF _b =	MV	Power Factor, phase B
30709	PF _c =	MV	Power Factor, phase C
30800	V _X =	MV	Voltage V _X
30801	V _{ph-n} =	MV	Voltage phase-neutral

2.23.4 Average Measurements

The long-term averages are calculated and output by the 7SJ80.

2.23.4.1 Functional Description

Long-Term Averages

The long-term averages of the three phase currents I_x , the positive sequence components I_1 for the three phase currents, and the real power P, reactive power Q, and apparent power S are calculated within a set period of time and indicated in primary values.

For the long-term averages mentioned above, the length of the time window for averaging and the frequency with which it is updated can be set.

2.23.4.2 Setting Notes

Average Calculation

The selection of the time period for measured value averaging is set with parameter 8301 **DMD Interval** in the corresponding setting group from A to D under **MEASUREMENT**. The first number specifies the averaging time window in minutes while the second number gives the frequency of updates within the time window. **15 Min., 3 Subs**, for example, means: Time average is generated for all measured values with a window of 15 minutes. The output is updated every $15/3 = 5$ minutes.

With address 8302 **DMD Sync. Time**, the starting time for the averaging window set under address 8301 is determined. This setting specifies if the window should start on the hour (**On The Hour**) or 15 minutes later (**15 After Hour**) or 30 minutes / 45 minutes after the hour (**30 After Hour** or **45 After Hour**).

If the settings for averaging are changed, then the measured values stored in the buffer are deleted, and new results for the average calculation are only available after the set time period has passed.

2.23.4.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
8301	DMD Interval	15 Min., 1 Sub 15 Min., 3 Subs 15 Min., 15 Subs 30 Min., 1 Sub 60 Min., 1 Sub 60 Min., 10 Subs 5 Min., 5 Subs	60 Min., 1 Sub	Demand Calculation Intervals
8302	DMD Sync.Time	On The Hour 15 After Hour 30 After Hour 45 After Hour	On The Hour	Demand Synchronization Time

2.23.4.4 Information List

No.	Information	Type of Information	Comments
833	I1 dmd=	MV	I1 (positive sequence) Demand
834	P dmd =	MV	Active Power Demand
835	Q dmd =	MV	Reactive Power Demand
836	S dmd =	MV	Apparent Power Demand
963	Ia dmd=	MV	I A demand
964	Ib dmd=	MV	I B demand
965	Ic dmd=	MV	I C demand

2.23.5 Min/Max Measurement Setup

Minimum and maximum values are calculated by the 7SJ80. Time and date of the last update of the values can also be read out.

2.23.5.1 Functional Description**Minimum and Maximum Values**

The minimum and maximum values for the three phase currents I_x , the three phase-to-ground voltages V_{x-N} , the three phase-to-phase voltages V_{xy} , the positive sequence components I_1 and V_1 , the displacement voltage V_0 , the real power P , reactive power Q , and apparent power S , the frequency; and the power factor $\cos \phi$ are calculated as primary values (including the date and time they were last updated).

The minimum and maximum values of the long-term averages listed in the previous section are also calculated.

The minimum and maximum values can be reset at any time via binary inputs or by using the integrated control panel or the DIGSI software. Additionally, the reset can be carried out cyclically, starting at a preset point of time.

2.23.5.2 Setting Notes**Minimum and Maximum Values**

The tracking of minimum and maximum values can be reset automatically at a programmable point in time. To select this feature, address 8311 **MinMax cycRESET** should be set to **YES**. The point in time when reset is to take place (the minute of the day in which reset will take place) is set at address 8312 **MiMa RESET TIME**.

The reset cycle in days is entered at address 8313 **MiMa RESETCYCLE**, and the beginning date of the cyclical process, from the time of the setting procedure (in days), is entered at address 8314 **MinMaxRES . START**.

2.23.5.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
8311	MinMax cycRESET	NO YES	YES	Automatic Cyclic Reset Function
8312	MiMa RESET TIME	0 .. 1439 min	0 min	MinMax Reset Timer
8313	MiMa RESETCYCLE	1 .. 365 Days	7 Days	MinMax Reset Cycle Period
8314	MinMaxRES.START	1 .. 365 Days	1 Days	MinMax Start Reset Cycle in

2.23.5.4 Information List

No.	Information	Type of Information	Comments
–	ResMinMax	IntSP_Ev	Reset Minimum and Maximum counter
395	>I MinMax Reset	SP	>I MIN/MAX Buffer Reset
396	>I1 MiMaReset	SP	>I1 MIN/MAX Buffer Reset
397	>V MiMaReset	SP	>V MIN/MAX Buffer Reset
398	>VphphMiMaRes	SP	>Vphph MIN/MAX Buffer Reset
399	>V1 MiMa Reset	SP	>V1 MIN/MAX Buffer Reset
400	>P MiMa Reset	SP	>P MIN/MAX Buffer Reset
401	>S MiMa Reset	SP	>S MIN/MAX Buffer Reset
402	>Q MiMa Reset	SP	>Q MIN/MAX Buffer Reset
403	>Idmd MiMaReset	SP	>Idmd MIN/MAX Buffer Reset
404	>Pdmd MiMaReset	SP	>Pdmd MIN/MAX Buffer Reset
405	>Qdmd MiMaReset	SP	>Qdmd MIN/MAX Buffer Reset
406	>Sdmd MiMaReset	SP	>Sdmd MIN/MAX Buffer Reset
407	>Frq MiMa Reset	SP	>Frq. MIN/MAX Buffer Reset
408	>PF MiMaReset	SP	>Power Factor MIN/MAX Buffer Reset
412	>Θ MiMa Reset	SP	>Theta MIN/MAX Buffer Reset
837	IAdmdMin	MVT	I A Demand Minimum
838	IAdmdMax	MVT	I A Demand Maximum
839	IBdmdMin	MVT	I B Demand Minimum
840	IBdmdMax	MVT	I B Demand Maximum
841	ICdmdMin	MVT	I C Demand Minimum
842	ICdmdMax	MVT	I C Demand Maximum
843	I1dmdMin	MVT	I1 (positive sequence) Demand Minimum
844	I1dmdMax	MVT	I1 (positive sequence) Demand Maximum
845	PdMin=	MVT	Active Power Demand Minimum
846	PdMax=	MVT	Active Power Demand Maximum
847	QdMin=	MVT	Reactive Power Minimum
848	QdMax=	MVT	Reactive Power Maximum
849	SdMin=	MVT	Apparent Power Minimum
850	SdMax=	MVT	Apparent Power Maximum
851	Ia Min=	MVT	Ia Min
852	Ia Max=	MVT	Ia Max
853	Ib Min=	MVT	Ib Min

No.	Information	Type of Information	Comments
854	Ib Max=	MVT	Ib Max
855	Ic Min=	MVT	Ic Min
856	Ic Max=	MVT	Ic Max
857	I1 Min=	MVT	I1 (positive sequence) Minimum
858	I1 Max=	MVT	I1 (positive sequence) Maximum
859	Va-nMin=	MVT	Va-n Min
860	Va-nMax=	MVT	Va-n Max
861	Vb-nMin=	MVT	Vb-n Min
862	Vb-nMax=	MVT	Vb-n Max
863	Vc-nMin=	MVT	Vc-n Min
864	Vc-nMax=	MVT	Vc-n Max
865	Va-bMin=	MVT	Va-b Min
867	Va-bMax=	MVT	Va-b Max
868	Vb-cMin=	MVT	Vb-c Min
869	Vb-cMax=	MVT	Vb-c Max
870	Vc-aMin=	MVT	Vc-a Min
871	Vc-aMax=	MVT	Vc-a Max
872	Vn Min =	MVT	V neutral Min
873	Vn Max =	MVT	V neutral Max
874	V1 Min =	MVT	V1 (positive sequence) Voltage Minimum
875	V1 Max =	MVT	V1 (positive sequence) Voltage Maximum
876	Pmin=	MVT	Active Power Minimum
877	Pmax=	MVT	Active Power Maximum
878	Qmin=	MVT	Reactive Power Minimum
879	Qmax=	MVT	Reactive Power Maximum
880	Smin=	MVT	Apparent Power Minimum
881	Smax=	MVT	Apparent Power Maximum
882	fmin=	MVT	Frequency Minimum
883	fmax=	MVT	Frequency Maximum
884	PF Max=	MVT	Power Factor Maximum
885	PF Min=	MVT	Power Factor Minimum
1058	Θ/ΘTrpMax=	MVT	Overload Meter Max
1059	Θ/ΘTrpMin=	MVT	Overload Meter Min

2.23.6 Set Points for Measured Values

SIPROTEC devices facilitate the setting of limit values for some measured and metered values. If any of these limit values is reached, exceeded or fallen below during operation, the device issues an alarm which is indicated in the form of an operational message. This can be allocated to LEDs and/or binary outputs, transferred via the interfaces and linked in DIGSI CFC. The limit values can be configured via DIGSI CFC and allocated via the DIGSI device matrix.

Applications

- This monitoring program works with multiple measurement repetitions and a lower priority than the protection functions. Therefore, it may not pick up if measured values are changed spontaneously in the event of a fault, before a pickup or tripping of the protection function occurs. This monitoring program is therefore absolutely unsuitable for blocking protection functions.

2.23.6.1 Setting Notes

Setpoints for Measured Values

Setting is performed in the DIGSI configuration Matrix under **Settings, Masking I/O (Configuration Matrix)**. Apply the filter "Measured and Metered Values Only" and select the configuration group "Set Points (MV)".

Here you can insert new limit values via the Information Catalog which are subsequently linked to the measured value to be monitored using CFC.

This view also allows you to change the default settings of the limit values under **Properties**.

The settings for limit values must be in percent and usually refer to nominal values of the device.

For more details, see the SIPROTEC 4 System Description and the DIGSI CFC Manual.

2.23.7 Set Points for Statistic

2.23.7.1 Functional Description

For the statistical counters, setpoints may be entered and a message is generated as soon as they are reached. The message can be allocated to both output relays and LEDs.

2.23.7.2 Setting Notes

Setpoints for the Statistical Counter

The setting of threshold values for the statistical counters takes place in DIGSI under **Messages → Statistics** in the sub-menu **Threshold Values for Statistics**. Double-click to display the corresponding contents in another window. By overwriting the previous value the settings can be changed (please refer to the SIPROTEC 4 System Description).

2.23.7.3 Information List

No.	Information	Type of Information	Comments
–	OpHour>	LV	Operating hours greater than
272	SP. Op Hours>	OUT	Set Point Operating Hours
16004	ΣI^x >	LV	Threshold Sum Current Exponentiation
16005	Threshold ΣI^x >	OUT	Threshold Sum Curr. Exponent. exceeded
16009	Resid.Endu. <	LV	Lower Threshold of CB Residual Endurance
16010	Thresh.R.Endu.<	OUT	Dropped below Threshold CB Res.Endurance
16017	$\Sigma I^2 t$ >	LV	Threshold Sum Squared Current Integral
16018	Thresh. $\Sigma I^2 t$ >	OUT	Threshold Sum Squa. Curr. Int. exceeded

2.23.8 Energy Metering

Metered values for active and reactive energy are determined by the device. They can be output via the display of the device, read out with DIGSI via the operator interface or transmitted to a control center via port B.

2.23.8.1 Functional Description

Metered Values for Active and Reactive Energy

Metered values of the real power W_p and reactive power (W_q) are acquired in kilowatt, megawatt or gigawatt hours primary or in kVARh, MVARh or GVARh primary, separately according to the input (+) and output (–), or capacitive and inductive. The measured-value resolution can be configured. The signs of the measured values appear as configured in address 1108 **P,Q sign** (see Section “Display of Measured Values”).

2.23.8.2 Setting Notes

Setting of parameter for meter resolution

Parameter 8315 **MeterResolution** allows increasing the resolution of the energy metered values by the **Factor 10** or **Factor 100** compared to the **Standard** setting.

2.23.8.3 Settings

Addr.	Parameter	Setting Options	Default Setting	Comments
8315	MeterResolution	Standard Factor 10 Factor 100	Standard	Meter resolution

2.23.8.4 Information List

No.	Information	Type of Information	Comments
–	Meter res	IntSP_Ev	Reset meter
888	Wp(puls)	PMV	Pulsed Energy Wp (active)
889	Wq(puls)	PMV	Pulsed Energy Wq (reactive)
916	WpΔ=	-	Increment of active energy
917	WqΔ=	-	Increment of reactive energy
924	WpForward	MVMV	Wp Forward
925	WqForward	MVMV	Wq Forward
928	WpReverse	MVMV	Wp Reverse
929	WqReverse	MVMV	Wq Reverse

2.23.9 Commissioning Aids

In test mode or during commissioning, the device information transmitted to a central or storage device can be influenced. There are tools available for testing the system interface (port B) and the binary inputs and outputs of the device.

Applications

- Test Mode
- Commissioning

Prerequisites

In order to be able to use the commissioning aids described in the following, the device must be connected to a control center via port B.

2.23.9.1 Functional Description

Influencing Information to the Control Center During Test Mode

Some of the available protocols allow for identifying all messages and measured values transmitted to the control center with "Test Mode" as the message cause while the device is tested on site. This identification prevents the message from being incorrectly interpreted as resulting from an actual fault. Moreover, a transmission block can be set during the test so that no messages are transferred to the control center.

This can be implemented via binary inputs, using the interface on the device front and a PC.

The SIPROTEC 4 System Description states in detail how to activate and deactivate test mode and blocked data transmission.

Testing the Connection to a Control Center

Via the DIGSI device control it can be tested whether messages are transmitted correctly.

A dialog box shows the display texts of all messages which were allocated to the system interface (port B) in the DIGSI matrix. In another column of the dialog box, a value for the messages to be tested can be defined (e.g. message ON / message OFF). After having entered password no. 6 (for hardware test menus), the corresponding message is issued and can be read out in the event log of the SIPROTEC 4 device and in the substation control center.

The procedure is described in detail in Chapter "Mounting and Commissioning".

Checking the Binary Inputs and Outputs

The binary inputs, outputs, and LEDs of a SIPROTEC 4 device can be individually and precisely controlled in DIGSI. This feature can be used, for example, to verify control wiring from the device to substation equipment (operational checks), during start-up.

A dialog box shows all binary inputs and outputs as well as LEDs of the device with their present status. The operating equipment, commands, or messages that are configured (masked) to the hardware components are also displayed. After having entered password no. 6 (for hardware test menus), it is possible to switch to the opposite status in another column of the dialog box. Thus, you can energize every single output relay to check the wiring between protected device and the system without having to create the alarm allocated to it.

The procedure is described in detail in Chapter "Mounting and Commissioning".

Creating Oscillographic Recordings for Tests

During commissioning, energization sequences should be carried out to check the stability of the protection also during closing operations. Oscillographic event recordings contain the maximum information on the behavior of the protection.

Along with the capability of storing fault recordings via pickup of the protection function, the 7SJ80 also has the capability of capturing the same data when commands are given to the device via the service program DIGSI, the serial interface, or a binary input. For the latter, event *>Trig.Wave.Cap.* must be allocated to a binary input. Triggering for the oscillographic recording then occurs, for instance, via the binary input when the protection object is energized.

An oscillographic recording that is triggered externally (that is, without a protective element pickup) are processed by the device as a normal oscillographic record. For each oscillographic record a fault record is created which is given its individual number to ensure that assignment can be made properly. However, these oscillographic recordings are not displayed in the fault log buffer in the display as they are no network fault events.

The procedure is described in detail in Chapter "Mounting and Commissioning".

2.24 Breaker Control

A control command function is integrated in the SIPROTEC 4 7SJ80 to coordinate the operation of circuit breakers and other equipment in the power system.

Control commands can originate from four command sources:

- Local control at the device's operator panel
- Operation using DIGSI
- Remote control via network control center or substation controller (e.g. SICAM)
- Automatic functions (e.g., via binary input)

Switchgear with single and multiple busbars are supported. The number of switchgear devices to be controlled is limited only by the number of binary inputs and outputs. Interlocking checks ensure high security against maloperation and a multitude of switchgear types and operating modes are available.

2.24.1 Control Device

Switchgear can also be controlled via the device's operator panel, DIGSI or a connection to the substation control equipment.

Applications

- Switchgear with single and double busbars

Prerequisites

The number of switchgear devices to be controlled is limited by the

- existing binary inputs
- existing binary outputs.

2.24.1.1 Functional Description

Operation Using the Device's Operator Panel

For controlling the device, there are two independent colored keys located below the graphic display. If you are somewhere in the menu system outside the control submenu, you can return to the control mode via one of these keys.

Then, select the switchgear to be operated with the help of the navigation keys. The switching direction is determined by operating the **I** or **O** pushbutton. The selected switching direction is displayed flashing in the bottom line of the following security prompt.

Password and security prompts prevent unintended switching operations. With **ENTER** the entries are confirmed.

Cancellation is possible at any time before the control command is issued or during switch selection via the **ESC** key.

Command end, feedback or any violation of the interlocking conditions are indicated.

For further information on the device operation, please refer to Section [2.25 Notes on Device Operation](#).

Operation using DIGSI

Switchgear can be controlled via the operator control interface with a PC using the DIGSI software. The procedure to do so is described in the SIPROTEC 4 System Description (Control of Switchgear).

Operation Using the System Interface

Switchgear can be controlled via the serial system interface and a connection to the substation control equipment. For that it is necessary that the required periphery is physically existing in the device as well as in the

substation. Furthermore, certain settings for the serial interface need to be made in the device (see SIPROTEC 4 System Description).

2.24.1.2 Information List

No.	Information	Type of Information	Comments
–	52Breaker	CF_D12	52 Breaker
–	52Breaker	DP	52 Breaker
–	Disc.Swit.	CF_D2	Disconnect Switch
–	Disc.Swit.	DP	Disconnect Switch
–	GndSwit.	CF_D2	Ground Switch
–	GndSwit.	DP	Ground Switch
31000	Q0 OpCnt=	VI	Q0 operationcounter=
31001	Q1 OpCnt=	VI	Q1 operationcounter=
31008	Q8 OpCnt=	VI	Q8 operationcounter=

2.24.2 Types of Commands

In conjunction with the power system control several command types can be distinguished for the device:

2.24.2.1 Functional Description

Commands to the Process

These are all commands that are directly output to the switchgear to change their process state:

- Switching commands for controlling the circuit breakers (not synchronized), disconnectors and ground electrodes
- Step commands, e.g. raising and lowering transformer LTCs
- Set-point commands with configurable time settings, e.g. to control Petersen coils

Internal / Pseudo Commands

They do not directly operate binary outputs. They serve to initiate internal functions, simulate changes of state, or to acknowledge changes of state.

- Manual overriding commands to manually update information on process-dependent objects such as annunciations and switching states, e.g. if the communication with the process is interrupted. Manually overridden objects are flagged as such in the information status and can be displayed accordingly.
- Tagging commands (for "setting") of the information value of internal objects, for example switching authority (remote/local), settings group switching, data transmission block and deleting/presetting metered values.
- Acknowledgment and resetting commands for setting and resetting internal buffers or data states.
- Information status command to set/reset the additional information "information status" of a process object, such as:
 - Input blocking
 - Output blocking

2.24.3 Command Sequence

Safety mechanisms in the command sequence ensure that a command can only be released after a thorough check of preset criteria has been successfully concluded. Standard Interlocking checks are provided for each individual control command. Additionally, user-defined interlocking conditions can be programmed separately for each command. The actual execution of the command is also monitored afterwards. The overall command task procedure is described in brief in the following list:

2.24.3.1 Functional Description

Check Sequence

Please observe the following:

- Command Entry, e.g. using the keypad on the local user interface of the device
 - Check Password → Access Rights
 - Check Switching Mode (interlocking activated/deactivated) → Selection of Deactivated interlocking Recognition.
- User configurable interlocking checks
 - Switching Authority
 - Device Position Check (set vs. actual comparison)
 - Interlocking, Zone Controlled (logic using CFC)
 - System Interlocking (centrally, using SCADA system or substation controller)
 - Double Operation (interlocking against parallel switching operation)
 - Protection Blocking (blocking of switching operations by protective functions).
- Fixed Command Checks
 - Internal Process Time (software watch dog which checks the time for processing the control action between initiation of the control and final close of the relay contact)
 - Setting Modification in Process (if setting modification is in process, commands are denied or delayed)
 - Operating equipment enabled as output (if an operating equipment component was configured, but not configured to a binary input, the command is denied)
 - Output Block (if an output block has been programmed for the circuit breaker, and is active at the moment the command is processed, then the command is denied)
 - Board Hardware Error
 - Command in Progress (only one command can be processed at a time for one operating equipment, object-related Double Operation Block)
 - 1-of-n-check (for schemes with multiple assignments, such as relays contact sharing a common terminal a check is made if a command is already active for this set of output relays).

Monitoring the Command Execution

The following is monitored:

- Interruption of a command because of a Cancel Command
- Runtime Monitor (feedback message monitoring time)

2.24.4 Switchgear Interlocking

System interlocking is executed by the user-defined logic (CFC).

2.24.4.1 Functional Description

Interlocking checks in a SICAM / SIPROTEC 4 system are normally divided in the following groups:

- System interlocking relies on the system data base in the substation or central control system.
- Bay interlocking relies on the object data base (feedbacks) of the bay unit.
- Cross-bay interlocking via GOOSE messages directly between bay units and protection relays (with IEC61850: The inter-relay communication with GOOSE is performed via the EN100 module)

The extent of the interlocking checks is determined by the configuration of the relay. To obtain more information about GOOSE, please refer to the SIPROTEC 4 System Description.

Switching objects that require system interlocking in a central control system are assigned to a specific parameter inside the bay unit (via configuration matrix).

For all commands, operation with interlocking (normal mode) or without interlocking (Interlocking OFF) can be selected:

- For local commands, by activation of "Normal/Test"-key switch,
- For automatic commands, via command processing. by CFC and deactivated interlocking recognition,
- For local / remote commands, using an additional interlocking disable command, via Profibus.

Interlocked / Non-Interlocked Switching

The configurable command checks in the SIPROTEC 4 devices are also called "standard interlocking". These checks can be activated via DIGSI (interlocked switching/tagging) or deactivated (non-interlocked).

Deactivated interlock switching means the configured interlocking conditions are not checked in the relay.

Interlocked switching means that all configured interlocking conditions are checked within the command processing. If a condition is not fulfilled, the command will be rejected by a message with a minus added to it (e.g. "CO-"), immediately followed by a message.

The following table shows the possible types of commands in a switching device and their corresponding annunciations. For the device the messages designated with *) are displayed in the event logs, for DIGSI they appear in spontaneous messages.

Type of Command	Command	Cause	Message
Control issued	Switching	CO	CO +/-
Manual tagging (positive / negative)	Manual tagging	MT	MT +/-
Information state command, input blocking	Input blocking	ST	ST +/- *)
Information state command, output blocking	Output blocking	ST	ST +/- *)
Cancel command	Cancel	CA	CA +/-

The "plus" appearing in the message is a confirmation of the command execution. The command execution was as expected, in other words positive. The minus sign means a negative confirmation, the command was rejected. Possible command feedbacks and their causes are dealt with in the SIPROTEC 4 System Description. The following figure shows operational indications relating to command execution and operation response information for successful switching of the circuit breaker.

The check of interlocking can be programmed separately for all switching devices and tags that were set with a tagging command. Other internal commands such as manual entry or abort are not checked, i.e. carried out independent of the interlocking.

EVENT LOG	
19.06.01 11:52:05,625	Q0 CO+ Close
19.06.01 11:52:06,134	Q0 FB+ Close

[dw_display_LS-betriebsmeldung, 1, en_US]

Figure 2-127 Example of an operational annunciation for switching circuit breaker 52 (Q0)

Standard Interlocking (default)

The standard interlockings contain the following fixed programmed tests for each switching device, which can be individually enabled or disabled using parameters:

- **Device Status Check (set = actual):** The switching command is rejected, and an error indication is displayed if the circuit breaker is already in the set position. (If this check is enabled, then it works whether interlocking, e.g. zone controlled, is activated or deactivated.) This condition is checked in both interlocked and non-interlocked status modes.
- **System Interlocking:** To check the power system interlocking, a local command is transmitted to the central unit with Switching Authority = LOCAL. A switching device that is subject to system interlocking cannot be switched by DIGSI.
- **Zone Controlled / Bay Interlocking:** Logic links in the device which were created via CFC are interrogated and considered during interlocked switching.
- **Blocking by Protection:** Switch-ON commands are rejected with interlocked switches, as soon as one of the protection functions of the unit has opened a fault case. The OPEN-command, by contrast, can always be executed. Please be aware, activation of thermal overload protection elements or sensitive ground fault detection can create and maintain a fault condition status, and can therefore block CLOSE commands.
- **Double Operation Block:** Parallel switching operations are interlocked against one another; while one command is processed, a second cannot be carried out.
- **Switching Authority LOCAL:** A control command from the user interface of the device (command with command source LOCAL) is only allowed if the Key Switch (by configuration) is set to LOCAL.
- **Switching Authority DIGSI:** Switching commands that are issued locally or remotely via DIGSI (command with command source DIGSI) are only allowed if remote control is admissible for the device (by configuration). If a DIGSI-PC communicates with the device, it deposits here its virtual device number (VD). Only commands with this VD (when Switching Authority = REMOTE) will be accepted by the device. Remote switching commands will be rejected.
- **Switching authority REMOTE:** A remote switch command (command with source REMOTE) is only allowed if remote control is enabled at the device (by configuration).




Figure 2-128 Standard interlockings

The following figure shows the configuration of the interlocking conditions using DIGSI.

[sc_objekteigenschaft_verriegelungsbeding, 1, en_US]

Figure 2-129 DIGSI dialog box for setting the interlocking conditions

On devices with operator panel, the display shows the configured interlocking reasons. They are marked with letters explained in the following table.

Table 2-23 Command types and corresponding messages

Interlocking Commands	Abbrev.	Display
Switching Authority	L	L
System interlocking	S	A
Zone controlled	Z	Z
SET = ACTUAL (switch direction check)	P	P
Protection blocking	B	B

Control Logic using CFC

For bay interlocking, a release logic can be created using CFC. Via specific release conditions the information "released" or "bay interlocked" are available (e.g. object "52 Close" and "52 Open" with the data values: ON/OFF).

Switching Authority

The interlocking condition "Switching Authority" serves for determining the switching authority. It enables the user to select the authorized command source. For devices with operator panel, the following switching authority ranges are defined in the following priority sequence:

- LOCAL
- DIGSI
- REMOTE

The "Switching authority" object serves for interlocking or enabling LOCAL control but not REMOTE or DIGSI commands. With a 7SJ80, the switching authority can be changed between "REMOTE" and "LOCAL" on the operator panel after having entered the password or by means of CFC also via binary inputs and a function key.

The "Switching authority DIGSI" is used for interlocking and allows commands to be initiated using DIGSI. Commands are allowed for both a remote and a local DIGSI connection. When a (local or remote) DIGSI PC logs on to the device, it enters its Virtual Device Number (VD). The device only accepts commands having that VD (with switching authority = OFF or REMOTE). When the DIGSI PC logs off, the VD is cancelled.

Commands are checked for their source SC and the device settings, and compared to the information set in the objects "Switching authority" and "Switching authority DIGSI".

Configuration

Switching authority available	y/n (create appropriate object)
Switching authority available DIGSI	y/n (create appropriate object)
Specific device (e.g. switching device)	Switching authority LOCAL (check for Local status): y/n
Specific device (e.g. switching device)	Switching authority REMOTE (check for LOCAL, REMOTE, or DIGSI commands): y/n

Table 2-24 Interlocking logic

Current Switching Authority Status	Switching	Command Issued with SC ³⁾ =LOCAL	Command Issued from SC=LOCAL or REMOTE	Command issued from SC=DIGSI
LOCAL	not registered	Allowed	Interlocked ²⁾ - "switching authority LOCAL"	Interlocked "DIGSI not registered"
LOCAL	Checked	Allowed	Interlocked ²⁾ - "switching authority LOCAL"	Interlocked ²⁾ - "switching authority LOCAL" „verriegelt, da VORORT-Steuerung“
REMOTE	Not checked	Interlocked ¹⁾ - "switching authority REMOTE"	Allowed	Interlocked "DIGSI not registered"
REMOTE	Checked	Interlocked ¹⁾ - "switching authority DIGSI"	Interlocked ²⁾ - "switching authority DIGSI"	Allowed

¹⁾ also "Allowed" for: "switching authority LOCAL (check for Local status): is not marked"

²⁾ also "Allowed" for: "Switching authority REMOTE (check for LOCAL, REMOTE, or DIGSI status): is not marked"

³⁾ SC = Source of command

SC = Auto SICAM:

Commands that are initiated internally (command processing in the CFC) are not subject to switching authority and are therefore always "allowed".

Switching Mode

The switching mode determines whether selected interlocking conditions will be activated or deactivated at the time of the switching operation.

The following switching modes (local) are defined:

- Local commands (SC = LOCAL)
 - interlocked (normal), or
 - non-interlocked switching.

With a 7SJ80, the switching mode can be changed between "locked" and "unlocked" on the operator panel after having entered the password or by means of CFC also via binary inputs and a function key.

The following switching modes (remote) are defined:

- Remote or DIGSI commands (SC = LOCAL, REMOTE, or DIGSI)
 - interlocked, or
 - non-interlocked switching. Here, deactivation of interlocking is accomplished via a separate command.
 - For commands from CFC (SC = AUTO SICAM), please observe the notes in the CFC manual (component: BOOL to command).

Zone Controlled / Field Interlocking

Zone controlled / field interlocking (e.g. via CFC) includes the verification that predetermined switchgear position conditions are satisfied to prevent switching errors (e.g. disconnecter vs. ground switch, ground switch only if no voltage applied) as well as verification of the state of other mechanical interlocking in the switchgear bay (e.g. High Voltage compartment doors).

Interlocking conditions can be programmed separately, for each switching device, for device control CLOSE and/or OPEN.

The enable information with the data "switching device is interlocked (OFF/NV/FLT) or enabled (ON)" can be set up,

- directly, using a single point or double point indication, key-switch, or internal indication (marking), or
- by means of a control logic via CFC.

When a switching command is initiated, the actual status is scanned cyclically. The assignment is done via "Release object CLOSE/OPEN".

System Interlocking

Substation Controller (System interlocking) involves switchgear conditions of other bays evaluated by a central control system.

Double Activation Blockage

Parallel switching operations are interlocked. As soon as the command has arrived all command objects subject to the interlocking are checked to know whether a command is being processed. While the command is being executed, interlocking is enabled for other commands.

Blocking by Protection

The pickup of protective elements blocks switching operations. Protective elements are configured, separately for each switching component, to block specific switching commands sent in CLOSE and TRIP direction.

When enabled, "Block CLOSE commands" blocks CLOSE commands, whereas "Block TRIP commands" blocks TRIP signals. Switching operations in progress will immediately be aborted by the pickup of a protective element.

Device Status Check (set = actual)

For switching commands, a check takes place whether the selected switching device is already in the set/ desired position (set/actual comparison). This means, if a circuit breaker is already in the CLOSED position and an attempt is made to issue a closing command, the command will be refused, with the operating message "set condition equals actual condition". If the circuit breaker / switchgear device is in the intermediate position, then this check is not performed.

Bypassing Interlockings

Bypassing configured interlockings at the time of the switching action happens device-internal via interlocking recognition in the command job or globally via so-called switching modes.

- SC=LOCAL
 - The user can switch between the modes "interlocked" or "non-interlocked" (bypassed) in the operator panel after entering the password or using CFC via binary input and function key.

- REMOTE and DIGSI
 - Commands issued by SICAM or DIGSI are unlocked via a global switching mode REMOTE. A separate request must be sent for the unlocking. The unlocking applies only for one switching operation and for commands caused by the same source.
 - Job order: command to object "Switching mode REMOTE", ON
 - Job order: switching command to "switching device"
- Command via CFC (automatic command, SC=Auto SICAM):
 - Behavior configured in the CFC block ("BOOL to command").

2.24.5 Command Logging

During the processing of the commands, independent of the further message routing and processing, command and process feedback information are sent to the message processing center. These messages contain information on the cause. With the corresponding allocation (configuration) these messages are entered in the event list, thus serving as a report.

Prerequisites

A listing of possible operating messages and their meaning as well as the command types needed for tripping and closing of the switchgear or for raising and lowering of transformer taps are described in the SIPROTEC 4 System Description.

2.24.5.1 Functional Description

Acknowledgment of Commands to the Device Front

All messages with the source of command LOCAL are transformed into a corresponding response and shown in the display of the device.

Acknowledgment of commands to Local / Remote / DIGSI

The acknowledgment of messages with source of command Local/ Remote/DIGSI are sent back to the initiating point independent of the routing (configuration on the serial digital interface).

The acknowledgment of commands is therefore not executed by a response indication as it is done with the local command but by ordinary command and feedback information recording.

Monitoring of Feedback Information

The processing of commands monitors the command execution and timing of feedback information for all commands. At the same time the command is sent, the monitoring time is started (monitoring of the command execution). This time controls whether the device achieves the required final result within the monitoring time. The monitoring time is stopped as soon as the feedback information arrives. If no feedback information arrives, a response **Timeout command monitoring time** appears and the process is terminated.

Commands and information feedback are also recorded in the event list. Normally the execution of a command is terminated as soon as the feedback information (**FB+**) of the relevant switchgear arrives or, in case of commands without process feedback information, the command output resets and a message is output.

The "plus" sign appearing in a feedback information confirms that the command was successful. The command was as expected, in other words positive. The "minus" is a negative confirmation and means that the command was not executed as expected.

Command Output and Switching Relays

The command types needed for tripping and closing of the switchgear or for raising and lowering of transformer taps are described in the configuration section of the SIPROTEC 4 System Description [/1/ SIPROTEC 4 System Description](#).

2.25 Notes on Device Operation

The operation of the 7SJ80 slightly differs from the other SIPROTEC 4 devices. These differences are described in the following. General information regarding the operation and configuration of SIPROTEC 4 devices is set out in the SIPROTEC 4 System Description.

2.25.1 Different operation

Pushbuttons of the Control Panels

Pushbutton	Funktion/Bedeutung
	Confirming entries and navigating forward in the menus
	Navigating to the main menu (where necessary, press repeatedly), navigating backwards in the menus, discarding entries
	Testing the LEDs Resetting the LED memory and binary outputs
	Function key Fn for displaying the assignment of the function keys. If several function keys have been assigned, a second page is displayed for the assignment when leaving through, if required. Combined pushbutton with numeric keys for a faster navigation (e.g. Fn + 1 operational messages) Navigation to the main menu with Fn in combination with the numeric key 0.
	For setting the contrast, keep the pushbutton pressed for about 5 seconds. Set the contrast in the menu with the scrolling keys (downward: less contrast, upward: more contrast).

Entry of Negative Signs

Only a few parameters can reach a negative value, i.e. a negative sign can only be entered for these.

If a negative sign is permissible, the prompt -/+ --> v/^ appears in the bottom line when changing the parameter. The sign can be determined via the scrolling keys: downward = negative sign, upward = positive sign.

Display

The SIPROTEC 4 System Description applies to devices with a 4-line ASCII display. Apart from that there are devices with a graphical display and a size of 30 lines. The 7SJ80 uses the outputs of the graphical display, but with 6 lines. Therefore, the representation might differ from the representations in the System Description.

The basic differences of the device with regard to the representation are the following:

The current selection is indicated by inverse representation (not by the prefix >)

MAIN MENU	04/05

Annunciation	-> 1
Measurement	-> 2
Control	-> 3
Parameter	-> 4

[grundbild-hauptmenue-20070404, 1, en_US]

Figure 2-130 Inverse representation of the current selection

In part, the sixth line is used for representing e.g. the active parameter group.

PARAMETER	01/08
Functional Scope	-> 01
Allocation	-> 02
active Setting Group	A

[grundbild-parameter-20070404, 1, en_US]

Figure 2-131 Representation of the active parameter group (line 6)

3 Mounting and Commissioning

This chapter is intended for experienced commissioning staff. He must be familiar with the commissioning of protection and control systems, the management of power systems and the safety rules and regulations. Hardware adjustments to the power system data might be necessary. The primary tests require the protected object (line, transformer, etc.) to carry load.

3.1	Mounting and Connections	312
3.2	Checking Connections	329
3.3	Commissioning	333
3.4	Final Preparation of the Device	353

3.1 Mounting and Connections

General



WARNING

Warning of improper transport, storage, installation or assembly of the device.

Failure to observe these precautions can result in death, personal injury, or serious material damage.

- ✧ Trouble-free and safe use of this device depends on proper transport, storage, installation, and assembly of the device according to the warnings in this device manual.
 - ✧ Of particular importance are the general installation and safety regulations for work in a high-voltage environment (for example, ANSI, IEC, EN, DIN, or other national and international regulations). These regulations must be observed.
-

3.1.1 Configuration Information

Prerequisites

For installation and connections the following conditions must be met:

The rated device data have been checked as recommended in the SIPROTEC 4 System Description. It has been verified that these data comply with the power system data.

General Diagrams

Block diagrams for the terminal assignment of the 7SJ80 are shown in Appendix [B Terminal Assignments](#). Connection examples for the current and voltage transformer circuits are provided in Appendix [C Connection Examples](#).

Voltage Connection Examples

Connection examples for voltage transformers are provided in Appendix [C Connection Examples](#). It must be checked that the configuration of the **Power System Data 1** (Section [Voltage Connection \(Power System\)](#), [Page 40](#)) corresponds with the connections.

The normal connection is set at address 213 **VT Connect**. $3ph = Van, Vbn, Vcn$.

When connecting an open delta winding of the voltage transformer set, address 213 **VT Connect**. $3ph$ must be set to **Vab, Vbc, VGnd**.

For the synchrocheck function, address 213 must be set to **Vab, Vbc, VSyn** or **Vph-g, VSyn**.

Another example shows the connection mode $213 = Vab, Vbc, Vx$. The voltage connected to the third transformer Vx is only used by the flexible protection functions.

Moreover, there are examples for the connection modes **Vab, Vbc** and **Vph-g, VSyn**.

Binary Inputs and Outputs

The configuration options of the binary in- and outputs, i.e. the procedure for the individual adaptation to the plant conditions, are described in the SIPROTEC 4 System Description. The connections to the plant are dependent on this configuration. The presettings of the device are listed in Appendix [E Default Settings and Protocol-dependent Functions](#). Please also check that the labeling strips on the front panel correspond to the configured message functions.

Setting Group Change

If binary inputs are used to switch setting groups, please observe the following:

- Two binary inputs must be dedicated to the purpose of changing setting groups when four groups are to be switched. One binary input must be set for **>Set Group Bit0**, the other input for **>Set Group Bit1**. If either of these input functions is not assigned, then it is considered as not controlled.
- For the control of 2 setting groups one binary input is sufficient, namely **>Set Group Bit0**, since the non-assigned binary input **>Set Group Bit1** is then regarded as not connected.
- The control signals must be permanently active so that the selected setting group is and remains active.


The following table shows the allocation of the binary inputs to the setting groups A to D and a simplified connection diagram for the two binary inputs is illustrated in the following figure. The figure illustrates an example in which both Set Group Bits 0 and 1 are configured to be controlled (actuated) when the associated binary input is energized (high).

Where:

no = not energized or not connected
yes = energized

Table 3-1 Changing setting groups using binary inputs

Binary Input		Active Group
>Param.Wahl1	>Param. Wahl2	
no	no	Group A
yes	no	Group B
no	yes	Group C
yes	yes	Group D

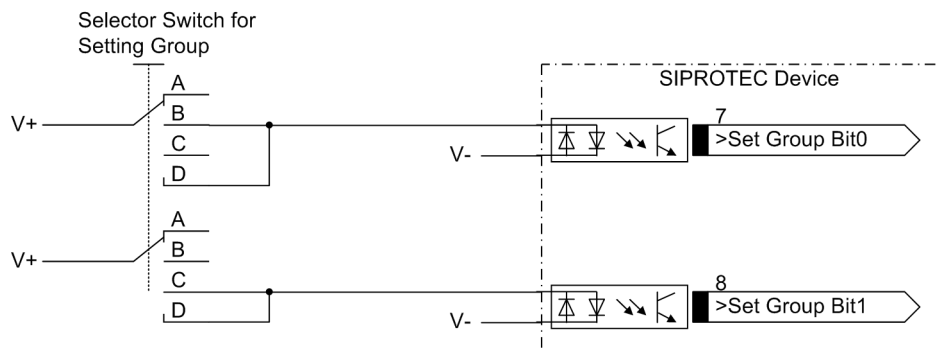

[dw_einstellgruppenumschaltung-ueber-binaere, 1, en_US]

Figure 3-1 Connection diagram (example) for setting group switching using binary inputs

Trip Circuit Supervision 74TC

It must be noted that two binary inputs or one binary input and one bypass resistor R must be connected in series. The pick-up threshold of the binary inputs must therefore be substantially below half the rated control DC voltage.

If **one** binary input is used, a bypass resistor R must be used (see following figure). The resistor R is inserted into the circuit of the 52b circuit breaker auxiliary contact to facilitate the detection of a malfunction also when the 52a circuit breaker auxiliary contact is open and the trip contact has dropped out. The value of this resistor must be such that in the circuit breaker open condition (therefore 52a is open and 52b is closed), the circuit breaker trip coil (52TC) is no longer energized and binary input (BI1) is still energized if the command relay contact is open.




Figure 3-2 Trip circuit supervision with one binary input

This results in an upper limit for the resistance dimension, $R_{\max}$ and a lower limit $R_{\min}$, from which the optimal value of the arithmetic mean R should be selected:

[formel-mittelwert-r-260602-kn, 1, en_US]

In order that the minimum voltage for controlling the binary input is ensured, $R_{\max}$ is derived as:

[formel-rmax-260602-kn, 1, en US]

So the circuit breaker trip coil does not remain energized in the above case, $R_{\min}$ is derived as:

[formel-rmin-260602-kn, 1, en_US]

I_{BI} (HIGH)	Constant current with activated BI (= 0.4 mA)
$V_{BI \min}$	Minimum control voltage for BI (= 19 V at delivery setting for nominal voltages of 24 V/ 48 V; 88 V at delivery setting for nominal voltages of 60 V/ 110 V/ 125 V/ 220 V/ 250 V)
V_{CTR}	Control voltage for trip circuit
R_{CBTC}	Ohmic resistance of the circuit breaker coil
$V_{CBTC(LOW)}$	Maximum voltage on the circuit breaker coil that does not lead to tripping

If the calculation has the result $\max < R_{\min}$, the calculation has to be repeated with the next smaller threshold $V_{BI \min}$. This threshold is determined via the parameters 220 **Threshold BI 1** to 226 **Threshold BI 7**. The settings **Thresh. BI 176V**, **Thresh. BI 88V**, **Thresh. BI 19V** are possible.

For the power consumption of the resistance:

$$P_R = I^2 \cdot R = \left(\frac{V_{CTR}}{R + R_{CBTC}} \right)^2 \cdot R$$

[formel-leistungvon-r-260602-ken, 1, en_US]

Example

I_{BI} (HIGH)	0.4 mA (SIPROTEC 4 7SJ80)
$V_{BI \min}$	19 V at delivery setting for nominal voltages of 24 V/ 48 V; 88 V at delivery setting for nominal voltages of 60 V/ 110 V/ 125 V/ 220 V/ 250 V
V_{CTR}	110 V (from the system / trip circuit)
R_{CBTC}	500 Ω (from the system / trip circuit)
V_{CBTC} (LOW)	2 V (from the system / trip circuit)

$$R_{\max} = \left(\frac{110 \text{ V} - 19 \text{ V}}{0.4 \text{ mA}} \right) - 500 \Omega = 227 \text{ k}\Omega$$

[fo_r-max-bsp, 1, en_US]

$$R_{\min} = \left(\frac{110 \text{ V} - 2 \text{ V}}{2 \text{ V}} \right) \cdot 500 \Omega = 27 \text{ k}\Omega$$

[beispiel-rmin-20061211, 1, en_US]

$$R = \frac{R_{\max} + R_{\min}}{2} = 127 \text{ k}\Omega$$

[fo_r-mittelwertbsp, 1, en_US]

$$P_R = \left(\frac{110 \text{ V}}{127 \text{ k}\Omega + 0.5 \text{ k}\Omega} \right)^2 - 127 \text{ k}\Omega \geq 95 \text{ mW}$$

[fo_leistung-r, 1, en_US]

3.1.2 Hardware Modifications

3.1.2.1 Environmental Protection Hints

Disposal of Old Equipment and Batteries (Applicable only for European Union and Countries with a Recycling System)

The disposal of our products and possible recycling of their components after decommissioning has to be carried out by an accredited recycling company, or the products/components must be taken to applicable collection points. Such disposal activities must comply with all local laws, guidelines and environmental specifications of the country in which the disposal is done. For the European Union the sustainable disposal of electronic scrap is defined in the respective regulation for "waste electrical and electronic equipment" (WEEE).



The crossed-out wheellie bin on the products, packaging and/or accompanying documents means that used electrical and electronic products and batteries must not be mixed with normal household waste.

According to national legislation, penalties may be charged for incorrect disposal of such waste.

By disposing of these products correctly you will help to save valuable resources and prevent any potential negative effects on human health and the environment.



NOTE

Our products and batteries must not be disposed of as household waste. For disposing batteries it is necessary to observe the local national/international directives.

REACH/RoHS Declaration

You can find our current **REACH/RoHS** declarations at:

<https://www.siemens.com/global/en/home/products/energy/ecotransparency/ecotransparency-downloads.html>



NOTE

You can find more information about activities and programs to protect the climate at the EcoTransparency website:

<https://www.siemens.com/global/en/home/products/energy/ecotransparency.html>

3.1.2.2 Disassembly

Work on the Printed Circuit Boards



NOTE

Before carrying out the following steps, make sure that the device is not operative.



NOTE

Apart from the communication modules and the fuse, there are no further components that can be configured or operated by the user inside the device. Any service activities exceeding the installation or exchange of communication modules must only be carried out by Siemens personnel

For preparing the workplace, a pad suitable for electrostatic sensitive devices (ESD) is required. Additionally, the following tools are required:

- a screwdriver with a 5 mm to 6 mm (0.20 – 0.24 in) wide blade,
- a Philips screwdriver size 1,
- a 5 mm (0.20 in) socket or nut driver

In order to disassemble the device, first remove it from the substation installation. To do so, perform the steps stated in Sections Panel Flush Mounting, Panel Surface Mounting or Cubicle Mounting in reverse order.



NOTE

The following must absolutely be observed:

Disconnect the communication connections at the device bottom (ports A and B). If this is not observed, the communication lines and/or the device might be destroyed.



NOTE

To use the device, all terminal blocks must be plugged in.



CAUTION

Mind electrostatic discharges

Failure to observe these precautions can result in personal injury or material damage.

- ✧ Any electrostatic discharges while working at the electronics block are to be avoided. We recommend ESD protective equipment (grounding strap, conductive grounded shoes, ESD-suitable clothing, etc.). Alternatively, an electrostatic charge is to be discharged by touching grounded metal parts.
-



NOTE

In order to minimize the expenditure for reconnecting the device, remove the completely wired terminal blocks from the device. Use a screwdriver (DIN 4 x 0.8) to carefully bend the left and right spring clips outwards. Then carefully pull out the terminal block. When reinstalling the device, carefully insert the terminal block into the spring clips. Both spring clips must engage clearly audible. (Sections Panel Flush Mounting, Panel Surface Mounting or Cubicle Mounting).

In order to install or exchange communication modules or to replace the fuse, proceed as follows:


Remove the two covers at the top and bottom. Thus, 1 housing screw each at the top and bottom becomes accessible. First, only unscrew the bottom housing screw so far that its tip no longer looks out of the thread of the mounting bracket (the housing screws are captive, they remain in the front cover even when unscrewed). Unscrew all screws that fasten any existing communication modules in the module cover on the bottom side of the device. Also unscrew the 4 countersunk screws that fasten the module cover on the bottom side of the device. Carefully pull the entire module cover out of the device.

Only now completely unscrew the two housing screws at the top and bottom in the cover and carefully remove the complete electronics block from the housing ([Figure 3-3](#)).



NOTE

If you have not removed the terminal blocks from the rear panel, much more force is required for removing and reinstalling the electronics block, which might lead to the damaging of the device. Therefore, we absolutely recommend to remove the terminal blocks before removing the electronics block.

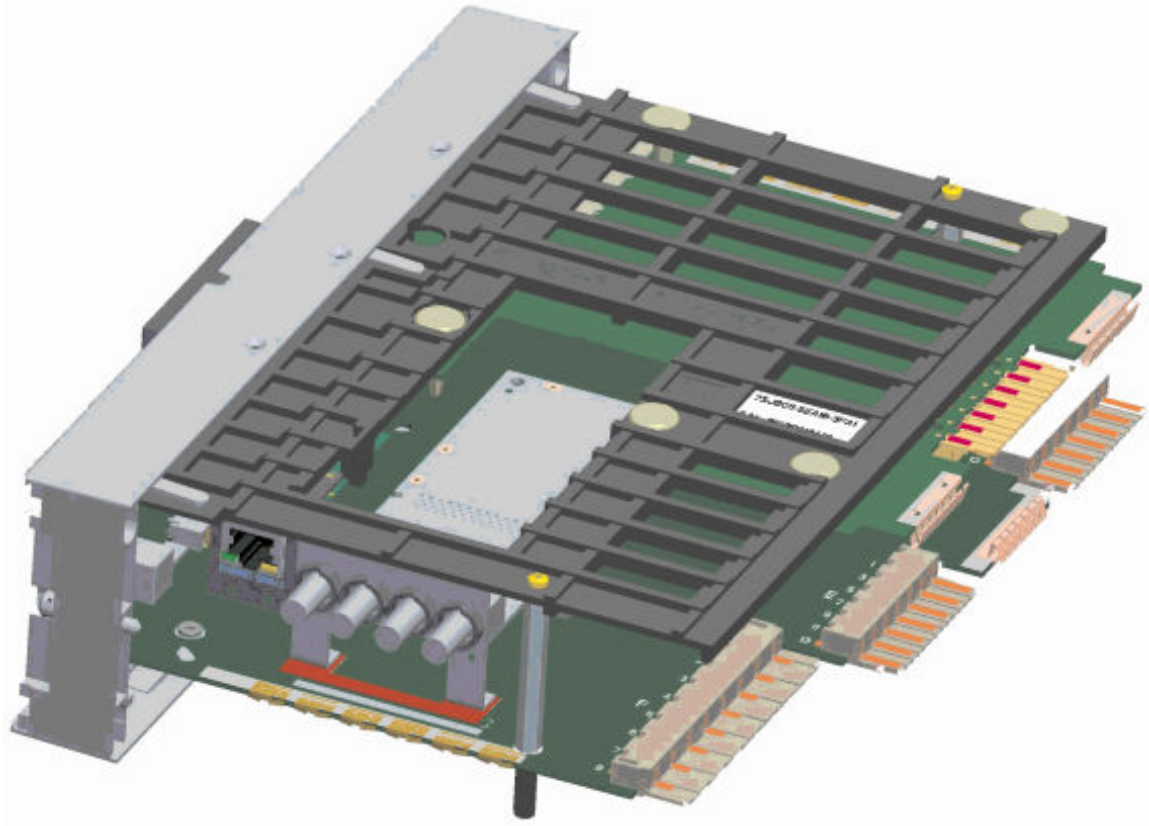


[einschub-7sj80-20071107, 1, --]

Figure 3-3 Electronics block without housing

Replacing the Fuse

The fuse holder is located at the edge of the basic I/O board close to the power supply connection.

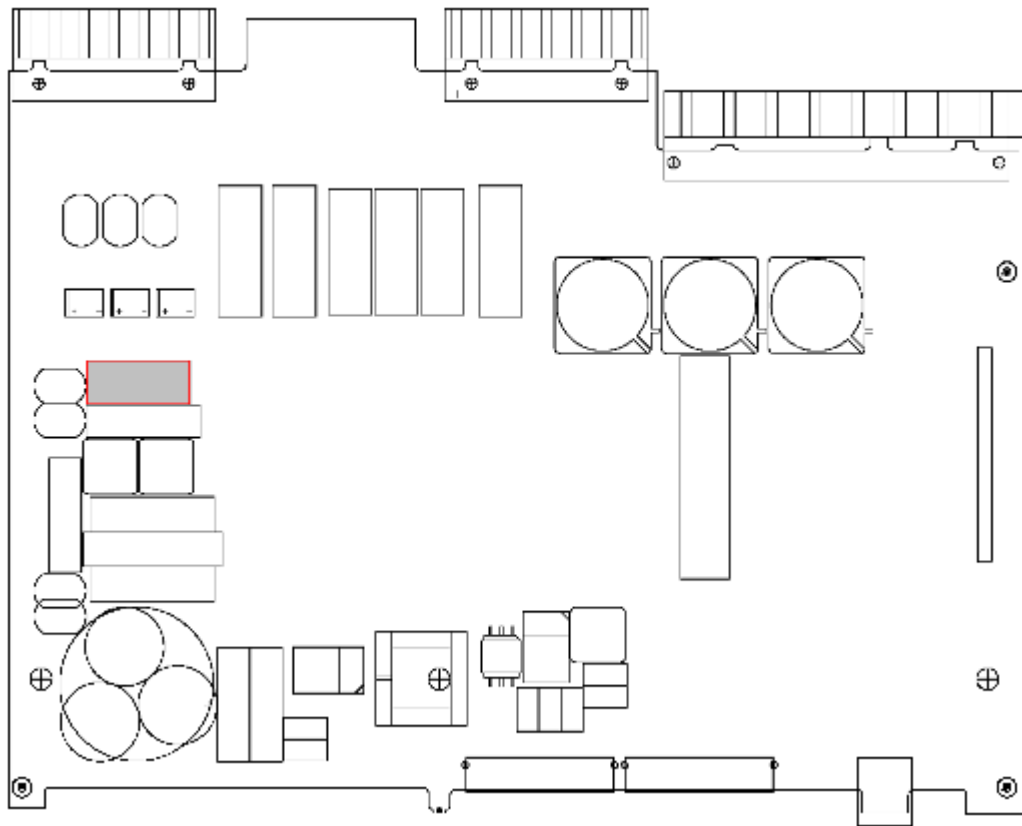

[7sx80-fuse-basic-io-080408, 1, en_US]

Figure 3-4 Placing the fuse

Remove the defective fuse. Insert the new fuse with the following technical data into the fuse holder:

5 mm x 20 mm (0.20 * 0.79 in) safety fuse

T characteristic

2.0 A nominal current

250 V nominal voltage

Switching capability 1500 VA/ DC 300 V

Only UL-approved fuses may be used.

This data applies to all device types (24 V/48 V and 60 V – 250 V).

Make sure that the defective fuse has not left any obvious damage on the device. If the fuse trips again after reconnection of the device, refrain from any further repairs and send the device to Siemens for repair.

The device can now be reassembled again (see Section Reassembly).

3.1.2.3 Connections of the Current Terminals


Fixing Elements

The fixing elements for the transformer connection are part of the current terminal (housing side). They have a stress-crack- and corrosion-resistant alloy. The head shape of the terminal screw allows for using a flat screwdriver (5.0 x 1.0 mm) or a crosstip screwdriver (PZ2). We recommend PZ2.

Cable Lugs and Wire Cross-sections

There are two connection options: the connection of single wires and the connection with a ring lug. Only copper wires may be used.

We recommend ring lugs with the following dimensions:

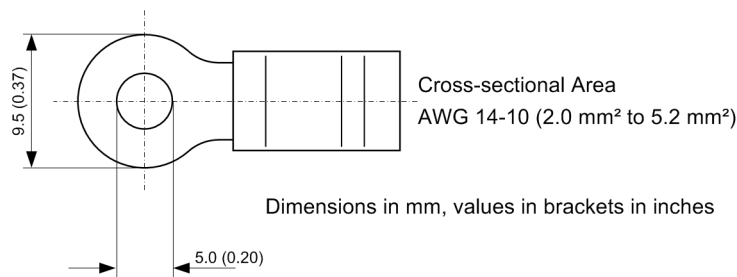


[ringkabelschuh-20070710, 1, en_US]

Figure 3-5 Ring lug

For complying with the required insulation clearances, insulated ring lugs have to be used. Otherwise, the crimp zone has to be insulated with corresponding means (e.g. by pulling a shrink-on sleeve over).

We recommend ring lugs of the PIDG range from Tyco Electronics.

Two ring lugs can be mounted per connection.

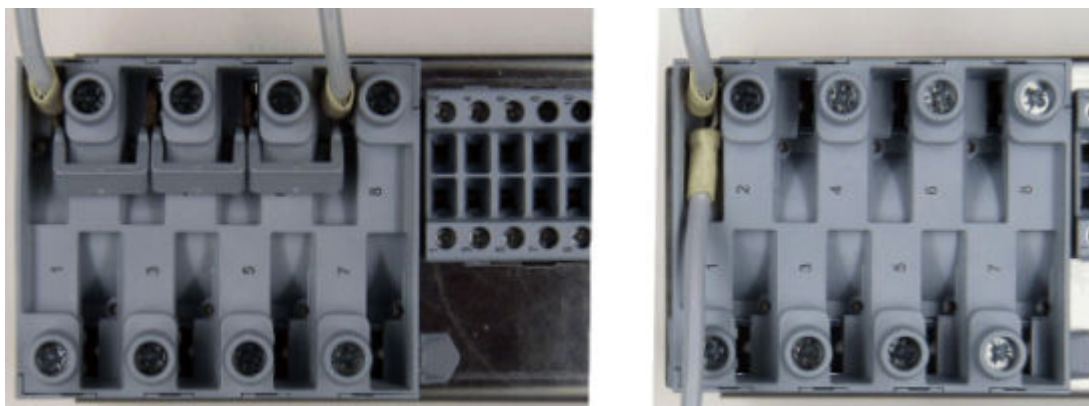

[stromwandler-anklemmen-20080530, 1, en_US]

Figure 3-6 Current transformer connection

As single wires, solid conductors as well as stranded conductors with conductor sleeves can be used. Up to two single wires with identical cross-sections can be used per connection.

Alternatively jumpers (Order No. C53207-A406-D193-1) can be used with terminal points in a stacked arrangement. When using jumpers, only ring lugs are allowed.

When connecting single wires, the following cross-sections are allowed:

Cable cross-section:	AWG 14-10 (2.0 mm ² to 5.2 mm ²)
Connector sleeve with plastic collar	L = 10 mm (0.39 in) or L = 12 mm (0.47 in)
Stripping length: (when used without conductor sleeve)	15 mm (0.59 in) Use exclusively solid copper conductors.

Mechanical Requirements

The fixing elements and the connected components are designed for the following mechanical requirements:

Permissible tightening torque at the terminal screw	2.7 Nm (23.9 lb.in) With solid conductors the allowed maximum tightening torque is 2 Nm
Permissible traction per connected conductor	80 N based on IEC 60947-1 (VDE 660, Part 100)

3.1.2.4 Connections of the Voltage Terminals

Fixing Elements

The fixing elements for the voltage transformer connection are part of the voltage terminal (housing side). They have a stress-crack- and corrosion-resistant alloy. The head shape of the terminal screw allows for using a flat screwdriver (4.0 mm x 0.8 mm / 0.16 in x 0.031 in) or a crosstip screwdriver (PZ1). PZ1 is recommended.

Cable Lugs and Wire Cross-sections

The connection mode available is the connection as single cable. As single cables, solid conductors as well as stranded conductors with or without conductor sleeves can be used. We recommend using twin cable end sleeves when connecting two single cables. We recommend the twin cable end sleeves of the series PN 966 144 from Tyco Electronics.

When connecting single cables, the following cross-sections are allowed:

Cable cross-sections:	AWG 20-14 (0.5 mm ² to 2.0 mm ² (0.0008 in ² to 0.0031 in ²))
Connector sleeve with plastic collar	L = 12 mm (0.47 in)
Stripping length: (when used without conductor sleeve)	12 mm (0.47 in) Only copper cables may be used.

With terminal points lying one below the other you may connect single conductors and jumpers (Order No. C53207-A406-D194-1) together. Please make sure that neighboring jumpers are built in/connected alternately.

Mechanical Requirements

The fixing elements and the connected components are designed for the following mechanical requirements:

Permissible tightening torque at the terminal screw	1.0 Nm (8.85 lb.in)
Permissible traction per connected conductor	50 N based on IEC 60947-1 (VDE 660, Part 100)

3.1.2.5 Interface Modules

General

The 7SJ80 relay is supplied with preconfigured interfaces according to the ordering version. You do not have to make any adaptations to the hardware (e.g. plugging in jumpers) yourself, except for the installation or replacement of communication modules.


The use of the interface modules RS232, RS485 and optical can be defined via the parameter 617 **ServiProt (CM)**. This parameter is only visible if the 11th digit of the ordering number was selected to be 1 for RS232, 2 for RS485 or 3 for optical.

Installation or Replacement of the Ethernet Interface Module

The following requirement must be fulfilled:


There is no SIPROTEC 4 communication module mounted yet. Otherwise, this has to be removed before actually installing the Ethernet interface module (see below).

The Ethernet interface module is inserted in the respective slot, most suitably from the open bottom, i.e. above the back of the battery case. A supporting frame is placed over the modular plug. The narrow spacer lies at edge of the printed circuit board. The module is attached to the 50-pole plug connector of the CPU module slightly inclined to the basic I/O board. The supporting plate is slightly pulled outwards in this area. The module can now be inserted vertically up to the stop. Then, the supporting plate is pressed against in the area of the locking latch until the upper edge of the printed circuit board of the Ethernet interface module snaps into the locking latch.

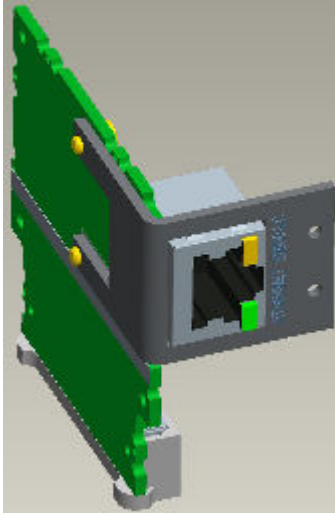

[com-modul-mit-stuetz-20100716, 1, --, --]

Figure 3-7 Ethernet interface with support frame

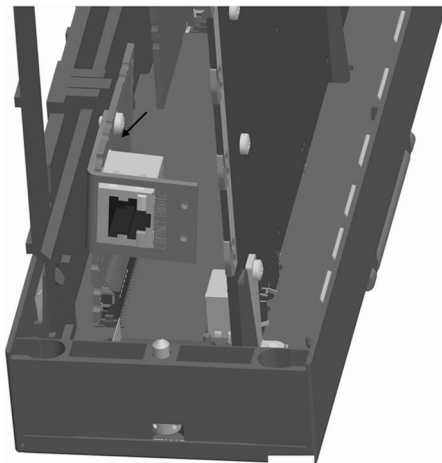

[en100-lc_schraeg-20071107, 1, --, --]

Figure 3-8 Installation of the Ethernet interface

Now, a SIPROTEC 4 communication module can be installed (see Section Installation or Replacement of a SIPROTEC 4 Communication Module). Otherwise, the device can be reassembled again (see Section Reassembly).

Installation or Replacement of a SIPROTEC 4 Communication Module

The following description assumes the normal case that a SIPROTEC 4 communication module which has not yet been existing is retrofitted.

If a SIPROTEC 4 communication module has to be removed or replaced, the steps are to be performed in reverse order.




NOTE

The installation can only be performed alone or after the installation of the Ethernet module.

The SIPROTEC 4 communication module is inserted via the large window in the plastic supporting plate. The direction of insertion is not arbitrary. The module is held at its mounting bracket. The opposite end of the module is inserted with the same orientation in the window opening, under the supporting plate and any existing extension I/O. The module bracket is turned towards the Ethernet module locking latch at the

supporting plate. Thus, even the longest connection elements of the communication module can be moved in this space between the lower supporting plate reinforcement and the locking latch in the direction of the transformer module. The mounting bracket of the module is now drawn up to the stop in the direction of the lower supporting plate reinforcement. Thus, the 60-pin plug connector on the module and the basic I/O board are aligned on top of each other. The alignment has to be checked via the opening at the bottom of the rack. Attach the module's mounting rail from the back side of the basic I/O using 2 M 2.5 screws.

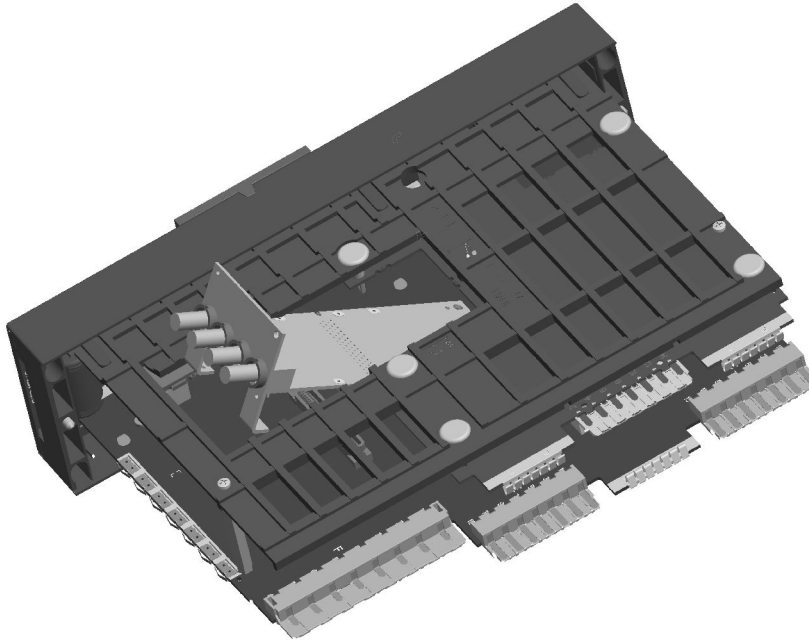

[com-modul-20071107, 1, --]

Figure 3-9 Installation of a SIPROTEC 4 communication module

The device can now be reassembled again (see Section Reassembly).


3.1.2.6 Reassembly

The reassembly of the device is performed in the following steps:

Carefully insert the complete electronics block into the housing. Please observe the following:

The connections of the communication modules point at the bottom of the housing. If there is no communication module, orient yourself to the connections for the current terminal. These connections are located on the side of the printed circuit board pointing at the device bottom.

Insert the electronics block into the housing, until the supporting part rests against the front edge of the housing. Press the left housing wall slightly out and insert the electronics block carefully further into the housing. When the front edge of the housing and the inside of the front plate touch, center the front plate by careful lateral movements. This makes sure that the front plate encloses/surrounds the housing. The electronics block can only be inserted centered up to the end stop.

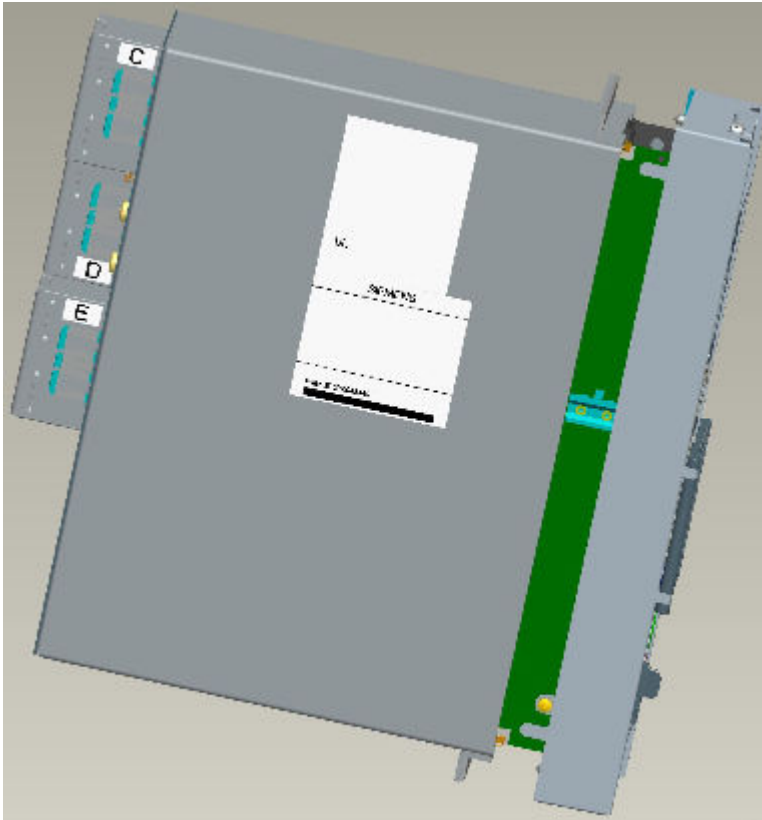

[einschub-mit-stuetz-20100716, 1, --, --]

Figure 3-10 Reassembly of Device

Fix the front cover to the housing with the two medium screws at the top and bottom of the front cover. The two covers can be inserted again either now or after the reinstallation of the device. Now install the device in accordance with the Sections Panel Flush Mounting, Panel Surface Mounting or Cubicle Mounting.




NOTE

Insert the current and voltage terminal blocks again and lock them in place!

3.1.3 Installation

3.1.3.1 General

The 7SJ80 relay has a housing size 1/6. The housing has 2 covers and 4 fixing holes each at the top and bottom (see [Figure 3-11](#) and [Figure 3-12](#)).

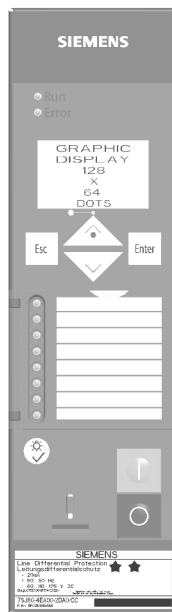

[front-7sj80-mit-abdeckungen-20071107, 1, --_]

Figure 3-11 Housing with covers



[front-7sj80-ohne-abdeckungen-20071107, 1, --_]


Figure 3-12 Housing with fixing holes (without covers)

3.1.3.2 Panel Flush Mounting

The housing (housing size $\frac{1}{6}$) has 2 covers and 4 fixing holes.

- Remove the 2 covers at the top and bottom of the front cover. Thus, 4 elongated holes are revealed in the mounting bracket and can be accessed.
- Insert the device into the panel cut-out and fasten it with four screws. For dimensional drawings, refer to Section [4.25 Dimensions](#).
- Mount the 2 covers again.

- Connect a solid low-ohmic protective and operational ground to the grounding terminal of the device. The cross-section of the cable used must correspond to the maximum connected cross-section but must be at least 2.5 mm² (Grounding area > M4, grounding area to be lacquer-free).
- Connections are to be established via the screw terminals on the rear panel of the device in accordance with the circuit diagram. The details on the connection technique for the communication modules at the bottom of the device (port A and port B) in accordance with the SIPROTEC 4 System Description and the details on the connection technique for the current and voltage terminals on the rear of the device in the Sections "Connections of the Current Terminals" and "Connections of the Voltage Terminals" must be strictly observed.

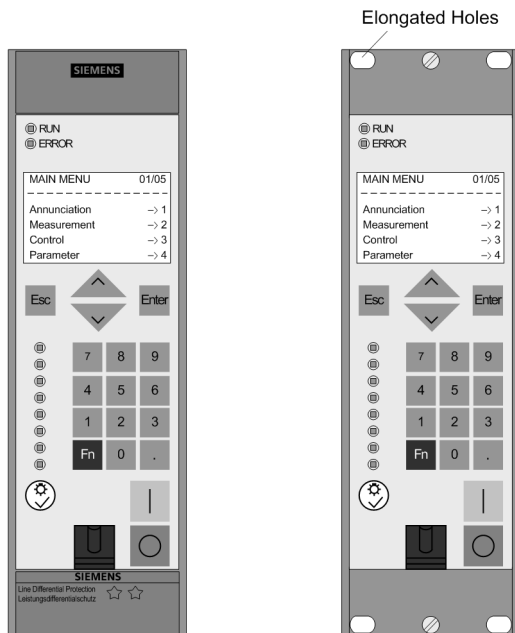

[schalttafelbau-7sj80-1-6tel-gehaeuse-20070107, 1, en_US]


Figure 3-13 Panel flush mounting of a 7SJ80

3.1.3.3 Cubicle Mounting

To install the device in a rack or cubicle, two mounting brackets are required. The ordering codes are stated in Appendix, Section [A Ordering Information and Accessories](#).

The housing (housing size 1₆) has 2 covers and 4 fixing holes.

- Loosely screw the two angle rails into the rack or cubicle with 4 screws each.
- Remove the 2 covers at the top and bottom of the front cover. Thus, 4 elongated holes are revealed in the mounting bracket and can be accessed.
- Secure the device to the angle rails with 4 screws.
- Mount the 2 covers again.
- Tighten the 8 screws of the the angle rails in the rack or cubicle.
- Connect a solid low-ohmic protective and operational ground to the grounding terminal of the device. The cross-section of the cable used must correspond to the maximum connected cross-section but must be at least 2.5 mm² (Grounding area > M4, grounding area to be lacquer-free).
- Connections are to be established via the screw terminals at the rear panel of the device in accordance with the circuit diagram. The details on the connection technique for the communication modules on the bottom of the device (port A and port B) in accordance with the SIPROTEC 4 System Description and the details on the connection technique for the current and voltage terminals at the rear of the device in the Sections "Connections of the Current Terminals" and "Connections of the Voltage Terminals" must be strictly observed.

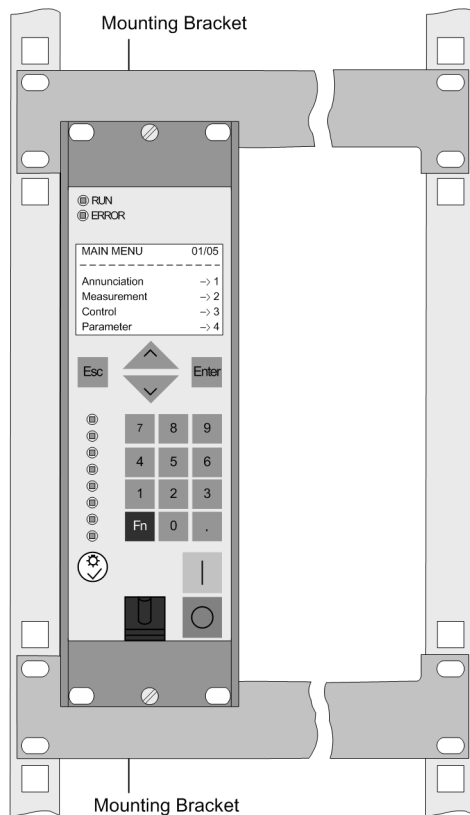

[montage-7sj8x-einsechstel-gehaeuse-20070117, 1, en_US]


Figure 3-14 Example installation of a 7SJ80 in a rack or cubicle

3.1.3.4 Panel Surface Mounting

When ordering the device as surface-mounting case (9th digit of the ordering number= B), the mounting frame shown below is part of the scope of delivery.

For installation, proceed as follows:

- Drill the holes for the mounting frame into the control panel.
- Fasten the mounting frame with 4 screws to the control panel (the continuously open side of the mounting frame is intended for the cable harnesses and can point at the top or bottom according to customer specification).
- Loosen the terminal blocks for the wiring, wire the terminal blocks and then click them in again.
- Connect a solid low-ohmic protective and operational ground to the grounding terminal of the device. The cross-section of the cable used must correspond to the maximum connected cross-section but must be at least 2.5 mm² (Grounding area > M4, grounding area to be lacquer-free).
- Connections are to be established via the screw terminals on the rear panel of the device in accordance with the circuit diagram. The details on the connection technique for the communication modules at the bottom of the device (port A and port B) in accordance with the SIPROTEC 4 System Description and the details on the connection technique for the current and voltage terminals on the rear of the device in the Sections "Connections of the Current Terminals" and "Connections of the Voltage Terminals" must be strictly observed.
- Insert the device into the mounting frame (make sure that no cables are jammed).
- Secure the device to the mounting frame with 4 screws. For dimensional drawings, refer to the Technical Data, Section [4.25 Dimensions](#).

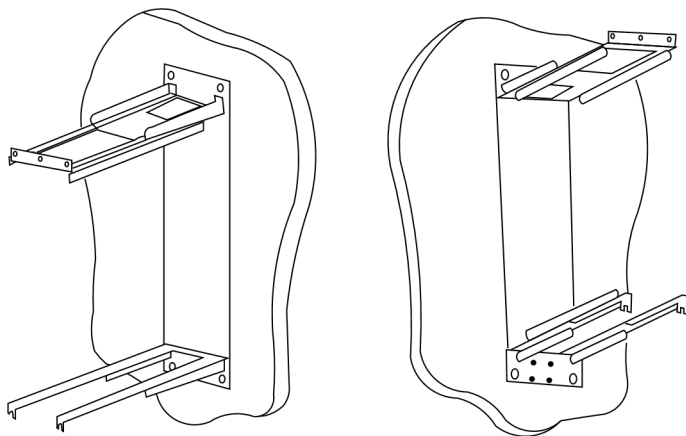

[montagehalterung-20070116, 1, en_US]


Figure 3-15 Mounting rails for panel surface mounting

3.2 Checking Connections

3.2.1 Checking the Data Connections of the Interfaces


Pin Assignment

The following tables show the pin assignment of the various interfaces. The position of the connections can be seen in the following figures.

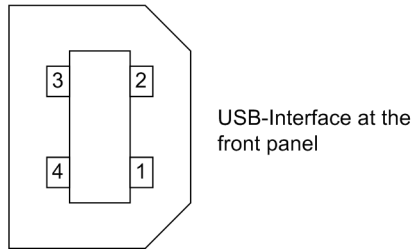


[usb-schnittst-auf-geraetefrontseite-20070111, 1, en_US]

Figure 3-16 USB interface

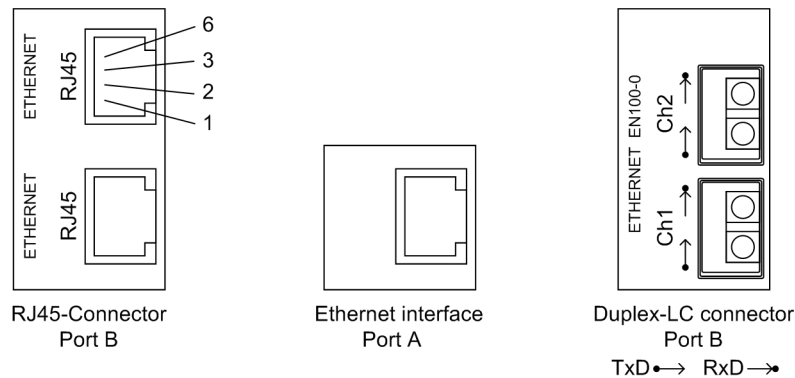

[ethernet-anschlussbuchsen-101103-kn, 1, en_US]

Figure 3-17 Ethernet connections at the device bottom

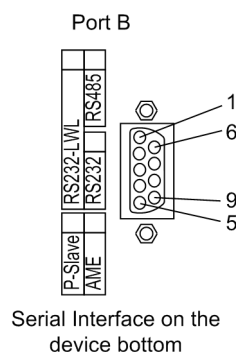

[dsub-buchsen-20070111, 1, en_US]

Figure 3-18 Serial interface at the device bottom

USB Interface

The USB interface can be used to establish a connection between the protection device and your PC. For the communication, the Microsoft Windows USB driver is used which is installed together with DIGSI (as of version V4.82). The interface is installed as a virtual serial COM port. We recommend the use of standard USB cables with a maximum length of 5 m/16 ft.

Table 3-2 Assignment of the USB socket

Pin-No.	1	2	3	4	Housing
USB	VBUS (unused)	D-	D+	GND	Shield

Connections at port A

If the interface is used for communication with the device, the data connection is to be checked.

Table 3-3 Assignment of the port A socket

Pin-No.	Ethernet interface
1	Tx+
2	Tx-
3	Rx+
4	—
5	—
6	Rx-
7	—
8	—

Connections at port B

When a serial interface of the device is connected to a control center, the data connection must be checked. A visual check of the assignment of the transmit and receive channels is important. With RS232 and fiber optic interfaces, each connection is dedicated to one transmission direction. For that reason the data output of one device must be connected to the data input of the other device and vice versa.

Table 3-4 Belegung der Buchsen Port B

Pin-No.	RS232	RS485	Profibus DP, RS485	Modbus RS485	Ethernet EN 100	IEC 60870-5-103 redundant	
				DNP3.0 RS485			
1	Shield (electrically connected with shield shroud)					Tx+	B/B' (RxD/TxD-P)
2	RxD	—	—	—	Tx—	A/A' (RxD/TxD-N)	
3	TxD	A/A' (RxD/TxD-N)	B/B' (RxD/TxD-P)	A	Rx+	—	
4	—	—	CNTR-A (TTL)	RTS (TTL level)	—	—	
5	GND	C/C' (GND)	C/C' (GND)	GND1	—	—	
6	—	—	+5 V ((max. load <100 mA)	VCC1	Rx—	—	
7	RTS	— ¹⁾	—	—	—	—	
8	CTS	B/B' (RxD/TxD-P)	A/A' (RxD/TxD-N)	B	—	—	
9	—	—	—	—	not available	not available	

¹⁾ Pin 7 also carries the RTS signal with RS232 level when operated as RS485 interface. Pin 7 must therefore not be connected!

¹⁾ Pin 7 also carries the RTS signal with RS232 level when operated as RS485 interface. Pin 7 must therefore not be connected!

With data cables, the connections are designated according to DIN 66020 and ISO 2110:

- TxD = Data output
- RxD = Data input
- $\overline{\text{RTS}}$ = Request to send
- $\overline{\text{CTS}}$ = Clear to send
- GND = Signal/Chassis Ground

The cable shield is to be grounded at **both ends**. For extremely EMC-prone environments, the GND may be connected via a separate individually shielded wire pair to improve immunity to interference.

Fiber-optic Cables



WARNING

Laser Radiation! Class 1

- ✧ Do not look directly into the fiber-optic elements!

Signals transmitted via optical fibers are unaffected by interference. The fibers guarantee electrical isolation between the connections. Transmit and receive connections are represented by symbols.

The standard setting of the character idle state for the optical fiber interface is "Light off". If the character idle state is to be changed, use the operating program DIGSI as described in the SIPROTEC 4 System Description.

3.2.2 Checking the System Connections



WARNING

Warning of dangerous voltages

Non-observance of the following measures can result in death, personal injury or substantial property damage.

- ✧ Therefore, only qualified people who are familiar with and adhere to the safety procedures and precautionary measures should perform the inspection steps.



CAUTION

Take care when operating the device without a battery on a battery charger.

Non-observance of the following measures can lead to unusually high voltages and consequently, the destruction of the device.

- ✧ Do not operate the device on a battery charger without a connected battery. (For limit values see also Technical Data, Section [4.1 General Device Data](#)).

If undervoltage protection is configured and enabled in the device and if, at the same time, the current criterion is disabled, the device picks up right after auxiliary voltage has been connected, since no measuring voltage is available. To make the device configurable, pickup is to be stopped, i.e. the measuring voltage is connected or voltage protection is blocked. This can be performed by operation.

Before the device is energized for the first time, it should be in the final operating environment for at least 2 hours to equalize the temperature, to minimize humidity and to avoid condensation. Connections are checked with the device at its final location. The plant must first be switched off and grounded.

Proceed as follows for checking the system connections:

- Circuit breakers for the auxiliary power supply and the measuring voltage must be opened.
- Check the continuity of all current and voltage transformer connections against the system and connection diagrams:
 - Are the current transformers grounded properly?
 - Are the polarities of the current transformer connections the same?
 - Is the phase assignment of the current transformers correct?
 - Are the voltage transformers grounded properly?
 - Are the polarities of the voltage transformer connections the same and correct?
 - Is the phase assignment of the voltage transformers correct?
 - Is the polarity for the current input I_N , I_{Ns} (if used)?
 - Is the polarity for the voltage input V_3 correct (if used e.g. for broken delta winding or busbar voltage)?
- If test switches are used for the secondary testing of the device, their functions must also be checked, in particular that in the "Check" position the current transformer secondary lines are automatically short-circuited
- Connect an ammeter in the supply circuit of the power supply. A range of about 2.5 A to 5 A for the meter is appropriate.
- Switch on m.c.b. for auxiliary voltage (supply protection), check the voltage level and, if applicable, the polarity of the voltage at the device terminals or at the connection modules.
- The current input should correspond to the power input in neutral position of the device. The measured steady state current should be insignificant. Transient movement of the ammeter merely indicates the charging current of capacitors
- Remove the voltage from the power supply by opening the protective switches.
- Disconnect the measuring test equipment; restore the normal power supply connections.
- Apply voltage to the power supply
- Close the protective switches for the voltage transformers.
- Verify that the voltage phase rotation at the device terminals is correct.
- Open the protective switches for the voltage transformers and the power supply.
- Check the trip and close circuits to the power system circuit breakers.
- Verify that the control wiring to and from other devices is correct.
- Check the signaling connections.
- Switch the mcb back on.

3.3 Commissioning



WARNING

Warning of dangerous voltages when operating an electrical device

Non-observance of the following measures can result in death, personal injury or substantial property damage.

- ✧ Only qualified people shall work on and around this device. They must be thoroughly familiar with all warnings and safety notices in this instruction manual as well as with the applicable safety steps, safety regulations, and precautionary measures.
- ✧ Before making any connections, the device must be grounded at the protective conductor terminal.
- ✧ Hazardous voltages can exist in all switchgear components connected to the power supply and to measurement and test circuits.
- ✧ Hazardous voltages can be present in the device even after the power supply voltage has been removed (capacitors can still be charged).
- ✧ After switching off the auxiliary voltage, wait a minimum of 10 seconds before reconnecting this voltage so that steady conditions can be established.
- ✧ The limit values given in Technical Data (Chapter 4) must not be exceeded, neither during testing nor during commissioning.

When testing the device with secondary test equipment, make sure that no other measurement quantities are connected and that the trip and close circuits to the circuit breakers and other primary switches are disconnected from the device.



DANGER

Hazardous voltages during interruptions in secondary circuits of current transformers

Non-observance of the following measure will result in death, severe personal injury or substantial property damage.

- ✧ Short-circuit the current transformer secondary circuits before current connections to the device are opened.

Switching operations have to be carried out during commissioning. A prerequisite for the prescribed tests is that these switching operations can be executed without danger. They are accordingly not intended for operational checks.



WARNING

Warning of dangers evolving from improper primary tests

Non-observance of the following measures can result in death, personal injury or substantial property damage.

- ✧ Primary tests are only allowed to be carried out by qualified personnel, who are familiar with the commissioning of protection systems, the operation of the plant and the safety rules and regulations (switching, grounding, etc.).

3.3.1 Test Mode and Transmission Block

Activation and Deactivation

If the device is connected to a central or main computer system via the SCADA interface, then the information that is transmitted can be influenced. This is only possible with some of the protocols available (see Table "Protocol- dependent functions" in the Appendix [E.6 Protocol-dependent Functions](#)).

If the **test mode** is switched on, the messages sent by a SIPROTEC 4 device to the main system has an additional test bit. This bit allows the messages to be recognized as not resulting from actual faults. Furthermore, it can be determined by activating the **transmission block** that no annunciations are transmitted via the system interface during test mode.

The SIPROTEC 4 System Manual describes in detail how to activate and deactivate the test mode and blocked data transmission. Please note that when DIGSI is being used for device editing, the program must be in the **online** operating mode for the test features to be used.

3.3.2 Testing the System Interface (at Port B)

Prefacing Remarks

If the device features a system interface and this is used to communicate with the control center, the DIGSI device operation can be used to test if messages are transmitted correctly. This test option should however definitely not be used while the device is in "real" operation.



DANGER

Danger evolving from operating the equipment (e.g. circuit breakers, disconnectors) by means of the test function

Non-observance of the following measure will result in death, severe personal injury or substantial property damage.

- ✧ Equipment used to allow switching such as circuit breakers or disconnectors is to be checked only during commissioning. Do not under any circumstances check them by means of the test function during "real" operation by transmitting or receiving messages via the system interface.



NOTE


After termination of the system interface test the device will reboot. Thereby, all annunciation buffers are erased. If required, these buffers should be extracted with DIGSI prior to the test.

The interface test is carried out using DIGSI in the Online operating mode:

- Open the **Online** directory by double-clicking; the operating functions for the device appear.
- Click on **Test**; the function selection appears in the right half of the screen.
- Double-click **Generate Indications** in the list view. The **Generate Indications** dialog box opens (see following figure).

Structure of the Test Dialog Box

In the column **Indication** the display texts of all indications are displayed which were allocated to the system interface in the matrix. In the column **SETPOINT Status** the user has to define the value for the messages to be tested. Depending on annunciation type, several input fields are offered (e.g. message **ON** / message **OFF**). By clicking on one of the fields you can select the desired value from the pull-down menu.

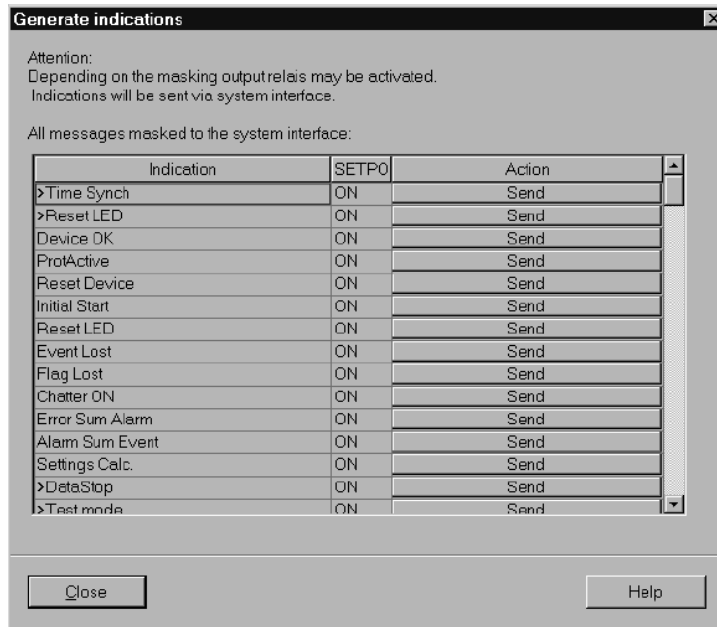

[sc_schnittstelle-testen, 1, en_US]

Figure 3-19 System interface test with the dialog box: Creating messages - example

Changing the Operating State

When clicking one of the buttons in the column **Action** for the first time, you will be prompted for the password no. 6 (for hardware test menus). After correct entry of the password, individual annunciations can be initiated. To do so, click on the button **Send** on the corresponding line. The corresponding message is issued and can be read out either from the event log of the SIPROTEC 4 device or from the substation control system. As long as the window is open, further tests can be performed.

Test in Message Direction

For all information that is transmitted to the central station, test the options in the list which appears in **SETP0INT Status**:

- Make sure that each checking process is carried out carefully without causing any danger (see above and refer to DANGER!)
- Click on Send in the function to be tested and check whether the transmitted information reaches the central station and shows the desired reaction. Data which are normally linked via binary inputs (first character ">") are likewise indicated to the central power system with this procedure. The function of the binary inputs itself is tested separately.

Exiting the Test Mode

To end the System Interface Test, click on **Close**. The device is briefly out of service while the start-up routine is executed. The dialog box closes.

Test in Command Direction

The information transmitted in command direction must be indicated by the central station. Check whether the reaction is correct.

3.3.3 Configuring Communication Modules

Required Settings in DIGSI 4

The following applies in general:

In the case of a first-time installation or replacement of a communication module, the ordering number (MLFB) does not need to be changed. The ordering number can be retained. Thus, all previously created parameter sets remain valid for the device.


Changes in the DIGSI Manager

In order that the protection device can access the new communication module, a change has to be made in the parameter set within the DIGSI Manager.

Select the SIPROTEC device in **DIGSI 4 Manager project** and choose the menu entry **Edit > Object Properties** to open the dialog **Properties – SIPROTEC 4 Device** (see the following figure).

Select an Interface for **11. Port B (on back of device bottom)** and for **12. Port A (on front of device bottom)** in the properties box **Communications modules**. For Profibus DP, Modbus or DNP3.0, the entry **additional Protocols, see MLFB Ext L** has to be selected.

For port B, click **L...** and select the type of communication protocol in the dialog **Additional information**

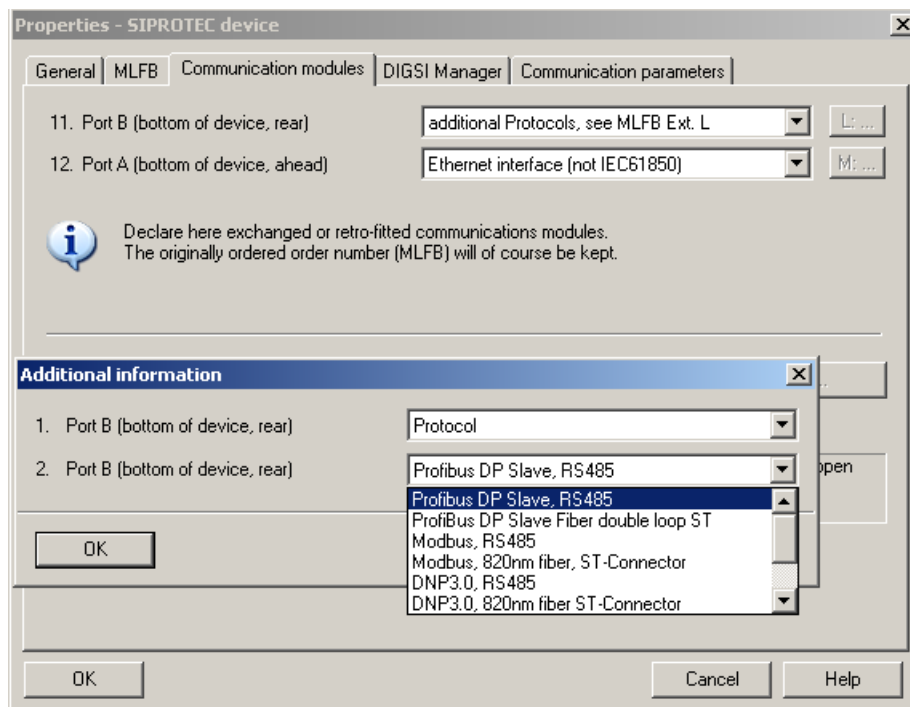

[sx80-komm-prot-l-071112, 1, en_US]

Figure 3-20 DIGSI 4.3: Profibus DP protocol selection (example)


Mapping File

For Profibus DP, Modbus, DNP3.0 and VDEW Redundant, a matching bus mapping has to be selected.

For the selection of the mapping file please open the SIPROTEC device in DIGSI and choose **Settings > Interfaces** (see [Figure 3-21](#)).

The dialog **Interface Settings** shows under **Additional protocols at device** the following:

- Display of the selected communication module
- Selection **Mapping file**, listing all Profibus DP, Modbus, DNP3.0 and VDEW Redundant mapping files available for the respective device type, with their names and reference to the corresponding bus mapping document
- Edit field **Module-specific settings** for changing the bus-specific parameters

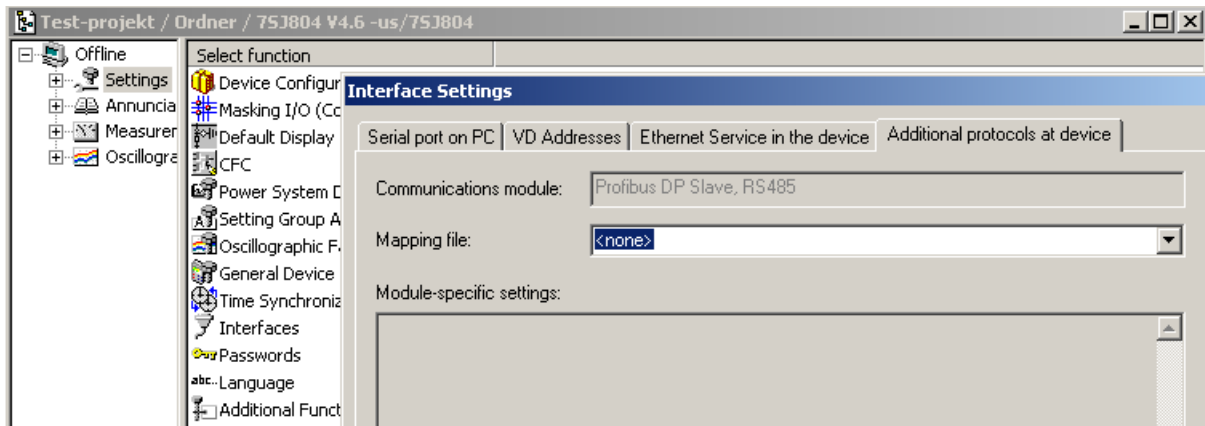

[auswahl-mapping-071122, 1, en_US]

Figure 3-21 DIGSI 4.3: Selection of a mapping file and setting of bus-specific parameters



NOTE

If the mapping file assignment for a SIPROTEC device has been changed, this is usually connected with a change of the allocations of the SIPROTEC objects to the system interface.

After having selected a new mapping file, please check the allocations to "Target system interface" or "Source system interface" in the **DIGSI allocation matrix**.


Edit Field "Module-specific settings"

Change only the numbers in the lines not starting with "/" and observe the semicolon at the end of the lines in the field **Module-specific settings**.

Further changes in the field might lead to an error message when closing the dialog box **Interface settings**.

Select the bus mapping corresponding to your requirements. The documentation of the individual bus mappings is available on the Internet (www.siprotec.com in the download area).


After having selected the bus mapping, the area of the mapping file in which you can make device-specific settings appears in the window (see [Figure 3-22](#)). The type of this setting depends of the protocol used and is described in the protocol documentation. Please only perform the described changes in the settings window and confirm your entries with "OK".

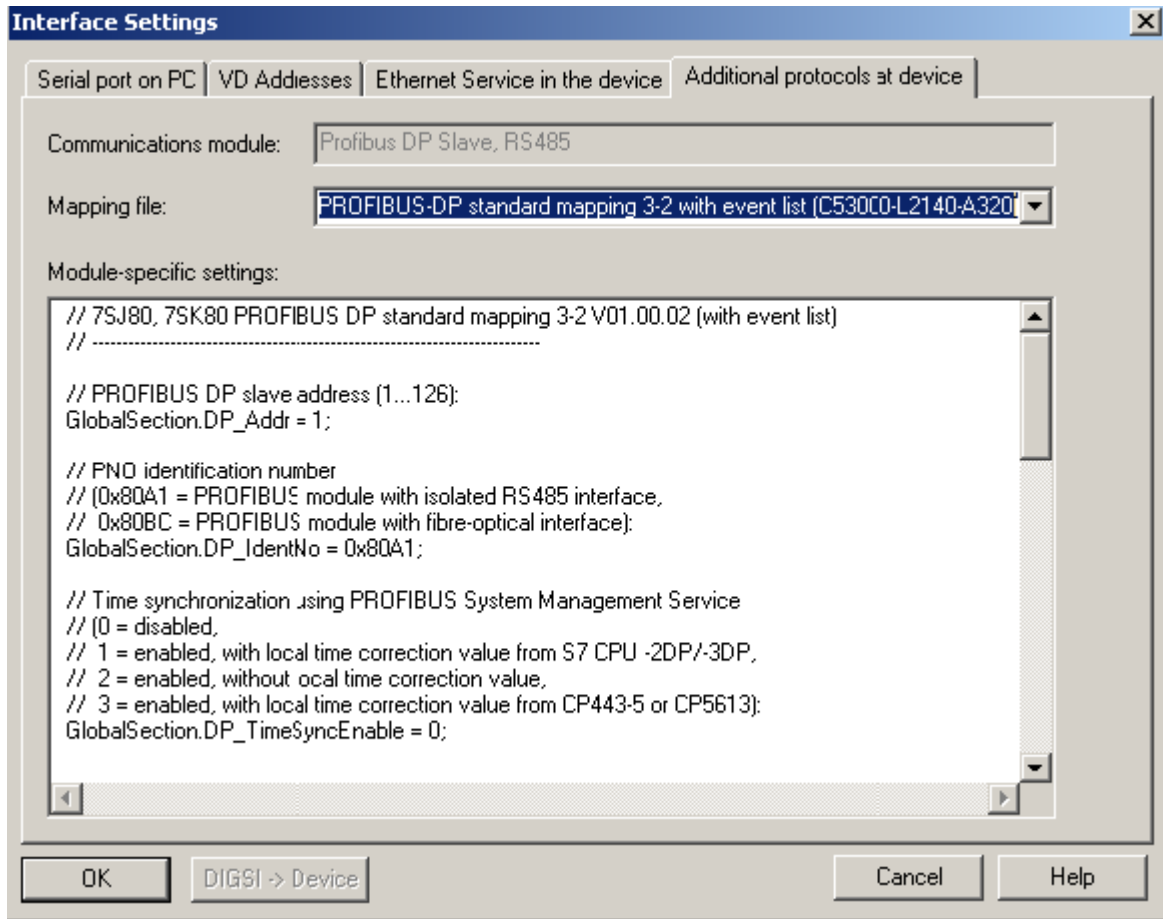

[modulspez-071122, 1, en_US]

Figure 3-22 Module-specific settings

Transfer the data to the protection device (see the following figure).

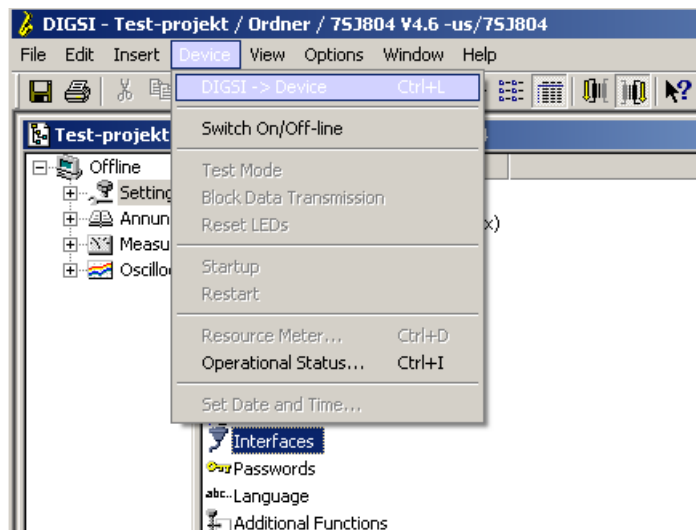

[daten-uebertragen-071122, 1, en_US]

Figure 3-23 Transmitting data

Terminal Test

The system interface (EN 100) is preassigned with the default value zero and the module is thus set to DHCP mode. The IP address can be set in the DIGSI Manager (Object properties... / Communication parameters / System interface [Ethernet]).

The Ethernet interface is preassigned with the following IP address and can be changed on the device at any time (DIGSI device processing / Parameters / Interfaces / Ethernet service):

IP address: 192.168.100.10

Network mask: 255.255.255.0

The following restrictions must be observed:

For subnet mask: 255.255.255.0 the IP bandwidth 192.168.64.xx is not available

For subnet mask 255.255.255.0, the IP-Band 192.168.1.xx is not available

For subnet mask: 255.255.0.0 the IP bandwidth 192.168.xx.xx is not available

For subnet mask: 255.0.0.0 the IP band 192.xx.xx.xx is not available.

3.3.4 Checking the Status of Binary Inputs and Outputs

Prefacing Remarks

The binary inputs, outputs, and LEDs of a SIPROTEC 4 device can be individually and precisely controlled in DIGSI. This feature is used to verify control wiring from the device to plant equipment (operational checks) during commissioning. This test option should however definitely not be used while the device is in "real" operation.



DANGER

Danger evolving from operating the equipment (e.g. circuit breakers, disconnectors) by means of the test function

Non-observance of the following measure will result in death, severe personal injury or substantial property damage.

- ✧ Equipment used to allow switching such as circuit breakers or disconnectors is to be checked only during commissioning. Do not under any circumstances check them by means of the test function during real operation by transmitting or receiving messages via the system interface.



NOTE

After finishing the hardware tests, the device will reboot. Thereby, all annunciation buffers are erased. If required, these buffers should be read out with DIGSI and saved prior to the test.

The hardware test can be carried out using DIGSI in the Online operating mode:


- Open the **Online** directory by double-clicking; the operating functions for the device appear.
- Click on **Test**; the function selection appears in the right half of the screen.
- Double-click in the list view on **Hardware Test**. The dialog box of the same name opens (see the following figure).

Structure of the Test Dialog Box

The dialog box is classified into three groups: **BI** for binary inputs, **REL** for output relays, and **LED** for lightemitting diodes. On the left of each of these groups is an accordingly labeled button. By double-clicking a button, information regarding the associated group can be shown or hidden.

In the column **Status** the present (physical) state of the hardware component is displayed. Indication is made by symbols. The physical actual states of the binary inputs and outputs are indicated by an open or closed switch symbol, the LEDs by a dark or illuminated LED symbol.

The opposite state of each element is displayed in the column **Scheduled**. The display is made in plain text. The right-most column indicates the commands or messages that are configured (masked) to the hardware components.

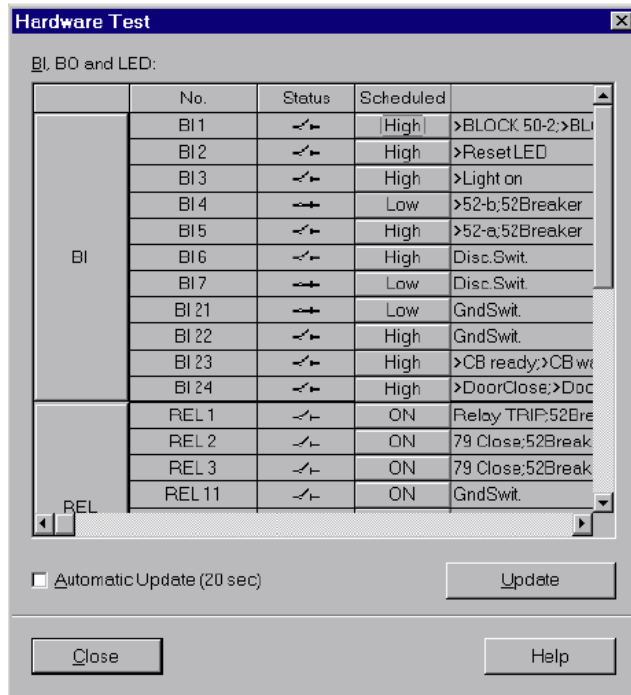

[ein-ausgabe-testen-110402-wlk, 1, en_US]

Figure 3-24 Test of the binary inputs/outputs — example

Changing the Operating State

To change the status of a hardware component, click on the associated button in the **Scheduled** column. Password No. 6 (if activated during configuration) will be requested before the first hardware modification is allowed. After entry of the correct password a status change will be executed. Further status changes remain possible while the dialog box is open.

Test of the Output Relays

Each individual output relay can be energized allowing to check the wiring between the output relay of the 7SJ80 and the system, without having to generate the message that is assigned to the relay. As soon as the first status change for any one of the output relays is initiated, all output relays are separated from the internal device functions, and can only be operated by the hardware test function. This for example means that a switching command coming from a protection function or a control command from the operator panel to an output relay cannot be executed.

Proceed as follows in order to check the output relay:

- Ensure that the switching of the output relay can be executed without danger (see above under DANGER!).
- Each output relay must be tested via the corresponding **Scheduled**-cell in the dialog box.
- Finish the testing (see margin title below "Exiting the Test Mode"), so that during further testings no unwanted switchings are initiated.

Test of the Binary Inputs

To test the wiring between the plant and the binary inputs of the 7SJ80 the condition in the plant which initiates the binary input must be generated and the response of the device checked.

To do so, the dialog box **Hardware Test** must be opened again to view the physical state of the binary inputs. The password is not yet required.

Proceed as follows in order to check the binary inputs:

- Activate each of function in the system which causes a binary input to pick up.
- Check the reaction in the **Status** column of the dialog box. To do so, the dialog box must be updated. The options may be found below under the margin heading "Updating the Display".
- Finish the testing (see margin heading below "Exiting the Test Mode").

If ,however, the effect of a binary input must be checked without carrying out any switching in the plant, it is possible to trigger individual binary inputs with the hardware test function. As soon as the first state change of any binary input is triggered and the password No. 6 has been entered, all binary inputs are separated from the plant and can only be activated via the hardware test function.

Test of the LEDs

The LEDs may be tested in a similar manner to the other input/output components. As soon as the first state change of any LED has been triggered, all LEDs are separated from the internal device functionality and can only be controlled via the hardware test function. This means e.g. that no LED is illuminated anymore by a protection function or by pressing the LED reset button.

Updating the Display

As the **Hardware Test** dialog opens, the operating states of the hardware components which are current at this time are read in and displayed.

An update is made:

- for each hardware component, if a command to change the condition is successfully performed,
- for all hardware components if the **Update** button is clicked,
- for all hardware components with cyclical updating (cycle time is 20 seconds) if the **Automatic Update (20sec)** field is marked.

Exiting the Test Mode

To end the hardware test, click on **Close**. The dialog box is closed. The device becomes unavailable for a brief start-up period immediately after this. Then all hardware components are returned to the operating conditions determined by the plant settings.

3.3.5 Tests for Breaker Failure Protection

General

If the device provides a breaker failure protection and if this is used, the integration of this protection function in the system must be tested under practical conditions.

Due to the variety of application options and the available system configurations, it is not possible to make a detailed description of the necessary tests. It is important to observe local conditions and protection and system drawings.

Before starting the circuit breaker tests it is recommended to isolate the circuit breaker of the tested feeder at both ends, i.e. line isolators and busbar isolators should be open so that the breaker can be operated without risk.



CAUTION

Also for tests on the local circuit breaker of the feeder a trip command to the surrounding circuit breakers can be issued for the busbar.

Non-observance of the following measure can result in minor personal injury or property damage.

- ✧ Therefore, primarily it is recommended to interrupt the tripping commands to the adjacent (busbar) breakers, e.g. by interrupting the corresponding pickup voltages.

Before the breaker is finally closed for normal operation, the trip command of the feeder protection routed to the circuit breaker must be disconnected so that the trip command can only be initiated by the breaker failure protection.

Although the following lists do not claim to be complete, they may also contain points which are to be ignored in the current application.

Auxiliary Contacts of the CB

The circuit breaker auxiliary contact(s) form an essential part of the breaker failure protection system in case they have been connected to the device. Make sure the correct assignment has been checked.

External Initiation Conditions

If the breaker failure protection can be started by external protection devices, the external start conditions must be checked.

In order for the breaker failure protection to be started, a current must flow at least via the monitored phase. This may be a secondary injected current.

- Start by trip command of the external protection: binary input functions *>50BF ext SRC* (FNo 1431) (in spontaneous or fault annunciations).
- After every start, the message *50BF ext Pickup* (FNo 1457) must appear in the spontaneous or fault annunciations.
- After time expiration **TRIP-Timer** (address 7005) tripping command of the breaker failure protection.

Switch off test current.

If start is possible without current flow:

- Closing the circuit breaker to be monitored to both sides with the disconnecter switches open.
- Start by trip command of the external protection: Binary input functions *>50BF ext SRC* (FNo 1431) (in spontaneous or fault annunciations).
- After every start, the message *50BF ext Pickup* (FNo 1457) must appear in the spontaneous or fault annunciations.
- After time expiration **TRIP-Timer** (address 7005) tripping command of the breaker failure protection.

Open the circuit breaker again.

Busbar Tripping

For testing the distribution of the trip commands in the substation in the case of breaker failures it is important to check that the trip commands to the adjacent circuit breakers are correct.

The adjacent circuit breakers are those of all feeders which must be tripped in order to ensure interruption of the fault current should the local breaker fail. These are therefore the circuit breakers of all feeders which feed the busbar or busbar section to which the feeder with the fault is connected.

A general detailed test guide cannot be specified because the layout of the adjacent circuit breakers largely depends on the system topology.

In particular with multiple busbars, the trip distribution logic for the adjacent circuit breakers must be checked. Here it should be checked for every busbar section that all circuit breakers which are connected to the same busbar section as the feeder circuit breaker under observation are tripped, and no other breakers.

Termination

All temporary measures taken for testing must be undone, e.g. especially switching states, interrupted trip commands, changes to setting values or individually switched off protection functions.

3.3.6 Testing User-Defined Functions

CFC Logic

The device has a vast capability for allowing functions to be defined by the user, especially with the CFC logic. Any special function or logic added to the device must be checked.

Of course, general test procedures cannot be given. Configuration of these functions and the target conditions must be actually known beforehand and tested. Possible interlocking conditions of switching devices (circuit breakers, disconnectors, ground switch) are of particular importance. They must be observed and tested.

3.3.7 Current, Voltage, and Phase Rotation Testing

Preliminary Remark



NOTE

The voltage and phase rotation test is only relevant for devices with voltage transformers.

≥ 10 % of Load Current

The connections of the current and voltage transformers are tested using primary quantities. Secondary load current of at least 10 % of the nominal current of the device is necessary. The line is energized and will remain in this state during the measurements.

With proper connections of the measuring circuits, none of the measured-values supervision elements in the device should pick up. If an element detects a problem, the causes which provoked it may be viewed in the Event Log. If current or voltage summation errors occur, then check the matching factors.

Messages from the symmetry monitoring could occur because there actually are asymmetrical conditions in the network. If these asymmetrical conditions are normal service conditions, the corresponding monitoring functions should be made less sensitive.

Current and Voltage Values

Currents and voltages can be seen in the display field on the front of the device or the operator interface via a PC. They can be compared to the quantities measured by an independent source, as primary and secondary quantities.

If the measured values are not plausible, the connection must be checked and corrected after the line has been isolated and the current transformer circuits have been short-circuited. The measurements must then be repeated.

Phase Rotation

The phase rotation must correspond to the configured phase rotation, in general a clockwise phase rotation. If the system has an anti-clockwise phase rotation, this must have been considered when the power system data was set (address 209 **PHASE SEQ.**). If the phase rotation is incorrect, the alarm *Fai1 Ph. Seq.* (FNo 171) is generated. The measured value phase allocation must be checked and corrected, if required, after the line has been isolated and current transformers have been short-circuited. The measurement must then be repeated.

Voltage Transformer Miniature Circuit Breaker (VT mcb)

The VT mcb of the feeder (if used) must be opened. The measured voltages in the operational measured values appear with a value close to zero (small measured voltages are of no consequence).

Check in the spontaneous annunciations that the VT mcb trip was entered (annunciation **>FAIL : FEEDER VT "ON"** in the spontaneous annunciations). Beforehand it has to be assured that the position of the VT mcb is connected to the device via a binary input.

Close the VT mcb again: The above messages appear under the spontaneous messages as "OFF", i.e. **>FAIL : FEEDER VT "OFF"**.

If one of the events does not appear, the connection and allocation of these signals must be checked.

If the **ON**-state and **OFF**-state are swapped, the contact type (H-active or L-active) must be checked and remedied.

3.3.8 Test for High Impedance Protection

Polarity of Transformers

When the device is used for high-impedance protection, the current at I_N or I_{N5} is equivalent to the fault current in the protected object. It is essential in this case that all current transformers feeding the resistor whose current is measured at $I_{N(S)}$ have the same polarity. The test currents used for this are through currents. Each CT must be included in a measurement. The current at $I_{N(S)}$ may never exceed half the pickup value of the single-phase time overcurrent protection.

3.3.9 Testing the Reverse Interlocking Scheme

(only if used)

Testing reverse interlocking is available if at least one of the binary inputs available is configured for this purpose (e.g. presetting of binary input BI1 **>BLOCK 50-2** and **>BLOCK 50N-2** to open circuit system). Tests can be performed with phase currents or ground current. For ground current the corresponding ground current settings apply.

Please note that the blocking function can either be configured for the pickup current connected (open circuit system) or the pickup current missing (closed circuit system). For open circuit system the following tests are to be proceeded:

The feeder protection relays of all associated feeders must be in operation. At the beginning no auxiliary voltage is fed to the reverse interlocking system.

A test current higher than the pickup values of **50-2 PICKUP** and **50-1 PICKUP** or **51 PICKUP** is set. As a result of the missing blocking signal, the protection function trips after (short) time delay **50-2 DELAY**.



CAUTION

Tests with currents that exceed more than 4 times the nominal device current **cause an overload of the input circuits.**

- ✧ Perform test only for a short time (see Technical Data, Section [4.1 General Device Data](#)). Afterwards the device has to cool off !

The direct voltage for reverse interlocking is now switched on to the line. The precedent test is repeated, the result will be the same.

Subsequently, at each of the protection devices of the feeders, a pickup is simulated. Meanwhile, another fault is simulated for the protection function of the infeed, as described before. Tripping is performed within time **50-1 DELAY** (longer time period) (with definite time overcurrent protection) or according to characteristic (with inverse time overcurrent protection).

These tests also check the proper functioning of the wiring for reverse interlocking.

3.3.10 Direction Check with Load Current

Preliminary Remark



NOTE

The direction check is only relevant for devices with voltage transformers.

$\geq 10\%$ of Load Current

The correct connection of the current and voltage transformers is tested via the protected line using the load current. For this purpose, connect the line. The load current the line carries must be at least $0.1 \cdot I_{\text{Nom}}$. The load current should be in-phase or lagging the voltage (resistive or resistive-inductive load). The direction of the load current must be known. If there is any doubt, network or ring loops should be opened. The line remains energized during the test.


The direction can be derived directly from the operational measured values. Initially the correlation of the measured load direction with the actual direction of load flow is checked. In this case the normal situation is assumed whereby the forward direction (measuring direction) extends from the busbar towards the line

P positive, if active power flows into the line,

P negative, if active power flows towards the busbar,

Q positive, if reactive power flows into the line,

Q negative, if reactive power flows toward the busbar.

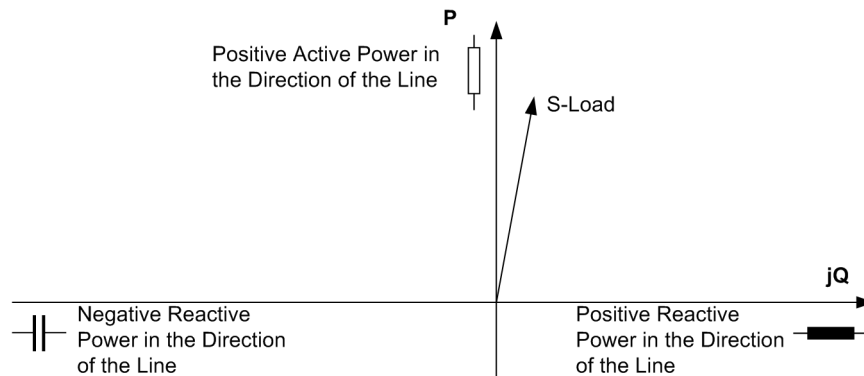

[lastscheinleistung-110402-wlk, 1, en_US]

Figure 3-25 Apparent Load Power

All signs of powers may be inverted deliberately. Check whether polarity is inverted in address 1108 **P,Q sign** in the **P.System Data 2**. In that case the signs for active and reactive power are inverse as well.

The power measurement provides an initial indication as to whether the measured values have the correct polarity. If both the active power and the reactive power have the wrong sign and 1108 **P,Q sign** is set to **not reversed**, the polarity according to address 201 **CT Starpoint** must be checked and corrected.

However, power measurement itself is not able to detect all connection errors. For this reason, directional messages should be generated by means of the directional overcurrent protection. Therefore, pickup thresholds must be reduced so that the available load current causes a continuous pickup of the element. The direction reported in the messages, such as *Phase A forward* or *Phase A reverse* must correspond to the actual power flow. Be careful that the "Forward" direction of the protective element is in the direction of the line (or object to be protected). This is not necessarily identical with the direction of the normal the power flow. For all three phases, the directional messages to the power flow must be reported properly.

If all directions differ from each other, individual phases in current or voltage transformer connections are interchanged, not connected properly or phase assignment is incorrect. After isolation of the line and short-circuiting of the current transformers the connections must be checked and corrected. The measurements must then be repeated.

Finally, switch off the protected power line.



NOTE

Reset the pickup values changed for the check to valid values.

3.3.11 Polarity Check for Voltage Input V_3

Depending on the application of the voltage measuring input V_3 of a 7SJ80, a polarity check may be necessary. If no measuring voltage is connected to this input, this section is irrelevant.

If input V_3 is used for the measurement of the **displacement voltage** V_N (Power System Data 1 address 213 **VT Connect**. **3ph** = **Vab**, **Vbc**, **VGnd**), the polarity is checked together with the current input I_N/I_{Ns} (see further below).

If the input V_3 is used for measuring a voltage for **synchrocheck** (Power System Data 1, address 213 **VT Connect**. **3ph** = **Vab**, **Vbc**, **VSyn** or **Vph-g**, **VSyn**), the following is to be observed:

- The single-phase voltage V_2 to be synchronized must be connected to input V_3 .
- The correct polarity is to be checked as follows using the synchrocheck function:

The device must provide the synchrocheck function which is to be configured in address 161 = **25 Function 1** = **SYNCHROCHECK**.

The voltage V_2 to be synchronized must be set correctly in address 6123 **CONNECTION of V2**.

If a transformer is located between the measuring points of the reference voltage V_1 and the voltage to be synchronized V_2 , its phase rotation must be taken into consideration. For this purpose, a corresponding angle is entered in address 6122 **ANGLE ADJUSTM.**, in the direction of the busbar seen from the feeder. An example is shown in Section [2.20 Synchrocheck](#).

If necessary different transformation ratios of the transformers on the busbar and the feeder may have to be considered under address **Balancing V1/V2**.


The synchrocheck function must be activated at address 6101 **Synchronizing** = **ON**.

A further aid for checking the connections are the messages 170.2090 **25 V2>V1**, 170.2091 **25 V2<V1**, 170.2094 **25 $\alpha 2 > \alpha 1$** and 170.2095 **25 $\alpha 2 < \alpha 1$** in the spontaneous messages.

- Circuit breaker is open. The feeder is de-energized. The circuit breakers of both voltage transformer circuits must be closed.
- For the synchrocheck, the program **Direct CO** is set to **YES** (address 6110); the other programs (addresses 6107 to 6109) are set to **NO**.
- Via a binary input (170.0043 **>25 Sync requ.**) a measurement request is entered. The synchrocheck must release closing (message 170.0049 **25 CloseRelease**). If not, check all relevant parameters again (synchrocheck configured and enabled correctly, see Sections [2.1.1 Functional Scope](#) and [2.20 Synchrocheck](#)).
- Set address 6110 **Direct CO** to **NO**.
- Then the circuit breaker is closed while the line isolator is open (see [Figure 3-26](#)). Thus, both voltage transformers receive the same voltage.
- For the synchrocheck, the program **25 Function 1** is set to **SYNCHROCHECK** (address 161)
- Via a binary input (170.0043 **>25 Sync requ.**) a measurement request is entered. The synchrocheck must release closing (message 170.0049 **25 CloseRelease**).

- If not, first check whether one of the aforesaid messages 170.2090 25 $V2 > V1$ or 170.2091 25 $V2 < V1$ or 170.2094 25 $\alpha2 > \alpha1$ or 170.2095 25 $\alpha2 < \alpha1$ is available in the spontaneous messages.
The message 25 $V2 > V1$ or 25 $V2 < V1$ indicates that the magnitude adaption is incorrect. Check address 6121 **Balancing V1/V2** and recalculate the adaptation factor.
The message 25 $\alpha2 > \alpha1$ or 25 $\alpha2 < \alpha1$ indicates that the phase relation of the busbar voltage does not match the setting under address **CONNECTION of V2** (see Section 2.20 [Synchrocheck](#)). When measuring via a transformer, address 6122 **ANGLE ADJUSTM.** must also be checked; this must adapt the vector group. If these are correct, there is probably a reverse polarity of the voltage transformer terminals for V1.
- For the synchrocheck, the program **SYNC V1>V2<** is set to **YES** (address 6108)
- Open the VT mcb of the busbar voltage.
- Via a binary input (170.0043 >25 *sync requ.*) a measurement request is entered. There is no close release. If there is, the VT mcb for the busbar voltage is not allocated. Check whether this is the required state, alternatively check the binary input >*FAIL: BUS VT* (6510).
- Close the VT mcb of the busbar voltage again.
- Open the circuit breaker.
- For the synchrocheck, the program **SYNC V1<V2>** is set to **YES** (address 6107) and **SYNC V1>V2<** is set to **NO** (address 6108).
- Via a binary input (170.0043 >25 *sync requ.*) a measurement request is entered. The synchrocheck must release closing (message 170.0049 25 *closeRelease*). Otherwise check all voltage connections and the corresponding parameters again thoroughly as described in Section 2.20 [Synchrocheck](#).
- Open the VT mcb of the feeder voltage.
- Via a binary input (170.0043 >25 *sync requ.*) a measurement request is entered. No close release is given.
- Close the VT mcb of the busbar voltage again.

Addresses 6107 to 6110 must be restored as they were changed for the test. If the allocation of the LEDs or signal relays was changed for the test, this must also be restored.

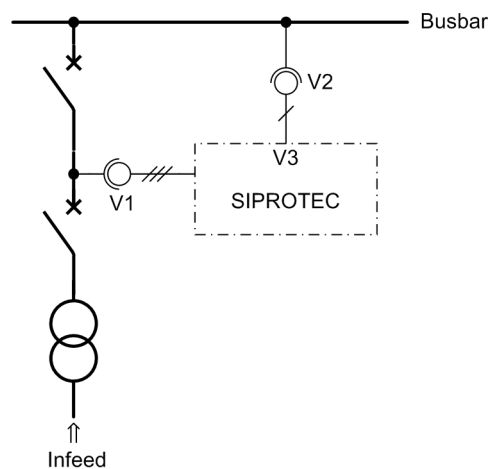

[messspan-synch-kontr-20070716, 1, en_US]

Figure 3-26 Measuring voltages for synchrocheck

3.3.12 Ground Fault Check

Ungrounded Systems

The ground fault check is only necessary if the device is connected to an isolated or resonant-grounded system and the ground fault detection is applied. The device must thus have been preset during configuration of the device functions to **Sens. Gnd Fault = Enabled** (address 131). In all other cases, this section is irrelevant. Ground fault direction detection only works with devices in which the 15th digit of the is B or C.

If none of this is the case, this section is not relevant.

Determination of the ground fault direction only works in devices that have an B or C in the 15th position of their MLFB number.

The primary check serves to find out the correct polarity of the transformer connections for the determination of the ground fault direction.



DANGER

Energized equipment of the power system ! Capacitive coupled voltages at disconnected equipment of the power system !

Non-observance of the following measure will result in death, severe personal injury or substantial property damage.

- ✧ Primary measurements must only be carried out on disconnected and grounded equipment of the power system !

Using the primary ground fault method a most reliable test result is guaranteed. Therefore please proceed as follows:

- Isolate the line and ground it on both ends. During the whole testing procedure the line must be open at the remote end.
- Make a test connection between a single phase and ground. On overhead lines it can be connected anywhere, however, it must be located behind the current transformers (looking from the busbar of the feeder to be checked). Cables are grounded on the remote end (sealing end).
- Remove the protective grounding of the line.
- Connect a circuit breaker to the line end that is to be tested.
- Check the direction indication (LED if allocated)
- The faulty phase (FNo 1272 for A or 1273 for B or 1274 for C) and the direction of the line, i.e. *SensGnd Forward* (FNo 1276) must be indicated in the ground fault protocol.
- The active and reactive components of the ground current are also indicated (*INS Reac*, FNo. 702). The reactive current *INS Rea1*, FNo. 701) is the most relevant for isolated systems. If the display shows the message *SensGnd Reverse* (FNo. 1277), either the current or voltage transformer terminals are swapped in the neutral path. If message *SensGnd undef.* (FNo 1278) appears, the ground current may be too low.
- Deenergize and ground the line.

The test is then finished.

3.3.13 Polarity Check for Current Input I_E

General

If the standard connection of the device is used with current input I_N connected in the neutral point of the set of current transformers (see also connection circuit diagram in Appendix C [Connection Examples](#)), then the correct polarity of the ground current path usually occurs automatically.

If, however, current I_N is derived from a separate summation CT (see e.g. a connection circuit diagram in the Appendix C [Connection Examples](#)), an additional direction check with this current is necessary.

If the device features the sensitive current input for I_N and if it is used in an isolated or resonant-grounded system, the polarity check for I_N was already carried out with the ground fault check according to the previous section. Then this section is not relevant.

Otherwise the test is done with a disconnected trip circuit and primary load current. It must be noted that during all simulations that do not exactly correspond with situations that may occur in practice, the non-symmetry of measured values may cause the measured value monitoring to pick up. This must therefore be ignored during such tests.



DANGER

Hazardous voltages during interruptions in secondary circuits of current transformers

Non-observance of the following measure will result in death, severe personal injury or substantial property damage.

- ✧ Short-circuit the current transformer secondary circuits before current connections to the device are opened.

Directional Testing for Grounded Systems

The check can either be carried out with function "directional ground fault protection" (address 116) or with the function "ground fault detection" (address 131), which can be operated as additional fault protection.

In the following the check is described using the "directional ground fault protection" function (address 116) as an example.


To generate a displacement voltage, the e–n winding of one phase in the voltage transformer set (e.g. A) is bypassed (see [Figure 3-27](#)). If no connection on the e–n windings of the voltage transformer is provided, the corresponding phase is disconnected on the secondary side (see [Figure 3-28](#)). Only the current of the transformer which is not provided with voltage in its voltage path is fed into the current path. If the line carries resistive- inductive load, the protection is subject to the same conditions as exist during a ground fault in line direction.

The directional ground fault protection must be configured to enabled and activated (address 116 or 131). Its pickup threshold must be below the load current of the line; if necessary the pickup threshold must be reduced. The parameters that have been changed, must be noted.

After switching the line on and off again, the direction indication must be checked: In the fault log the messages *67N picked up* and *Ground forward* must at least be present. If the directional pickup is not present, either the ground current connection or the displacement voltage connection is incorrect. If the wrong direction is indicated, either the direction of load flow is from the line toward the busbar or the ground current path has a swapped polarity. In the latter case, the connection must be rectified after the line has been isolated and the current transformers short-circuited.


If the pickup message is missing, the measured ground (residual) current or the displacement voltage emerged may be too small. This can be checked via operational measured values.

Important! If parameters were changed for this test, they must be returned to their original state after completion of the test !

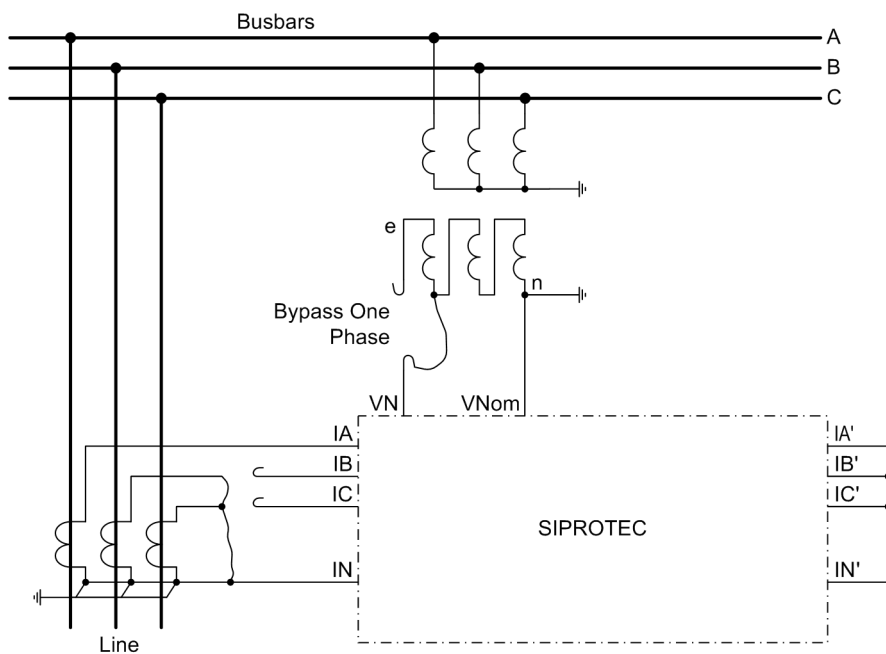

[polaritaetspruefung-ie-mituen-gemessen, 1, en_US]

Figure 3-27 Polarity testing for I_N , example with current transformers configured in a Holmgreen-connection (VTs with broken delta connection -- e-n winding)

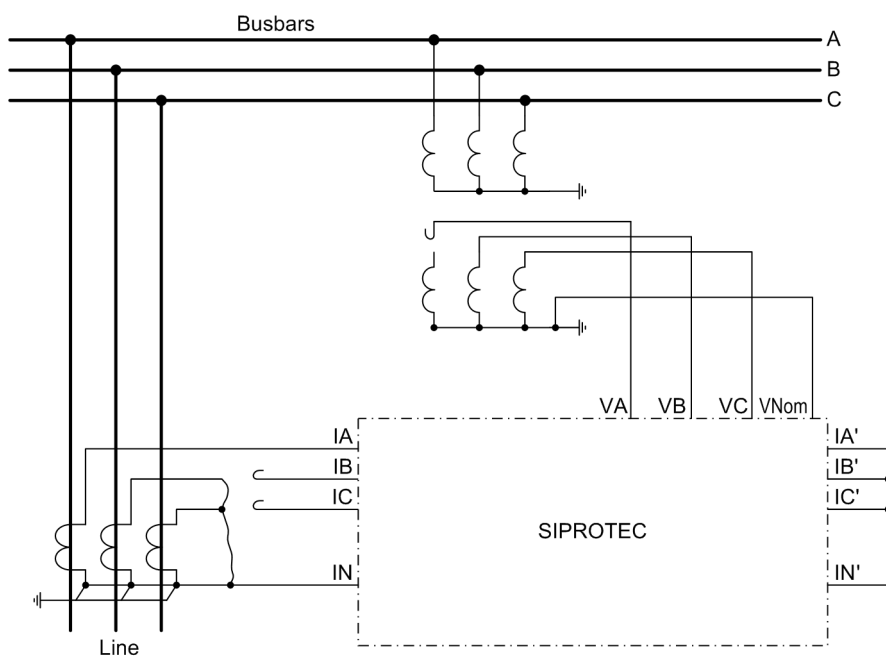

[polaritaetspruefung-ie-mituen-berechnet-211002-kn, 1, en_US]

Figure 3-28 Polarity testing for I_N , example with current transformers configured in a Holmgreen-connection (VTs Wye-connected)

3.3.14 Trip/Close Tests for the Configured Operating Devices

Control by Local Command

If the configured operating devices were not switched sufficiently in the hardware test already described, all configured switching devices must be switched on and off from the device via the integrated control element. The feedback information of the circuit breaker position injected via binary inputs is read out at the device and compared with the actual breaker position.

For devices with graphic display this is easy to do with the control display.

The switching procedure is described in the SIPROTEC 4 System Description. The switching authority must be set according to the command source used. The switching mode can be selected from interlocked and non-interlocked switching. Please note that non-interlocked switching can be a safety hazard.

Control by Protective Functions

For OPEN-commands sent to the circuit breaker please take into consideration that if the internal or external automatic reclosure function is used a TRIP-CLOSE test cycle is initiated.



DANGER

A test cycle successfully started by the automatic reclosure function can lead to the closing of the circuit breaker !

Non-observance of the following statement will result in death, severe personal injury or substantial property damage.

- ✧ Be fully aware that OPEN-commands sent to the circuit breaker can result in a trip-close-trip event of the circuit breaker by an external reclosing device.

Control from a Remote Control Center

If the device is connected to a remote substation via a system interface, the corresponding switching tests may also be checked from the substation. Please also take into consideration that the switching authority is set in correspondence with the source of commands used.

3.3.15 Creating Oscillographic Recordings for Tests

General

In order to be able to test the stability of the protection during switchon procedures also, switchon trials can also be carried out at the end. Oscillographic records obtain the maximum information about the behaviour of the protection.


Requirements

To be able to trip an oscillographic recording, parameter **Osc Fault Rec.** must be configured to Enabled in the **Functional Scope**. Apart from the capability of storing fault recordings via pickup of the protection function, the 7SJ80 also has the capability of initiating a measured value recording via the operator program DIGSI, the serial interface or binary input. In the latter case, the information **>Trig.Wave.Cap.** must be allocated to a binary input. Triggering for the oscillographic recording then occurs, for instance, via the binary input when the protection object is energized.

Those that are externally triggered (that is, without a protective element pickup) are processed by the device as a normal oscillographic record. For each oscillographic record a fault record is created which is given its individual number to ensure that assignment can be made properly. However, these recordings are not displayed in the fault indication buffer, as they are not fault events.

Triggering Oscillographic Recording

To trigger test measurement recording with DIGSI, click on **Test** in the left part of the window. Double click the entry **Test Wave Form** in the list of the window.

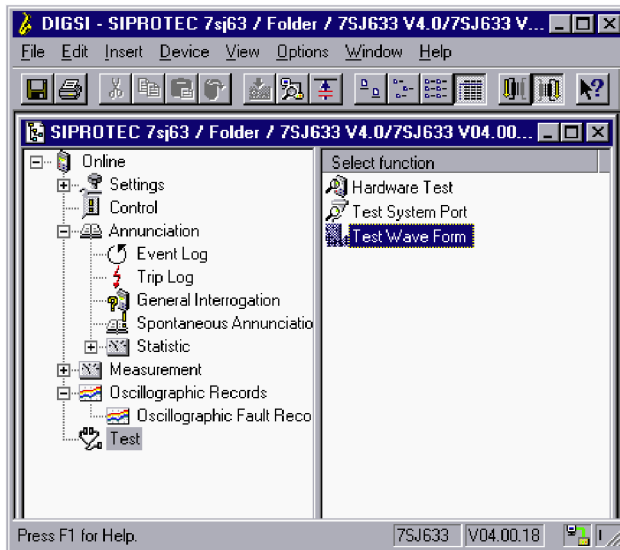

[digsifenster-testmessschrieb-starten-260602-ko, 1, en_US]

Figure 3-29 Start oscillographic recording with DIGSI

Oscillographic recording is started immediately. During recording, a report is given in the left part of the status bar. Bar segments additionally indicate the progress of the procedure.

The SIGRA or the Comtrade Viewer program is required to view and analyse the oscillographic data.

3.4 Final Preparation of the Device

Firmly tighten all screws. Tighten all terminal screws, including those that are not used.



CAUTION

Inadmissible Tightening Torques

Non-observance of the following measure can result in minor personal injury or property damage.

- ✧ The tightening torques must not be exceeded as the threads and terminal chambers may otherwise be damaged!

The settings should be checked again, if they were changed during the tests. Check if all protection, control and auxiliary functions to be found with the configuration parameters are set correctly (Section [2.1.1 Functional Scope](#), Functional Scope) and all desired functions are set to **ON**. Keep a copy of all setting values on a PC.

The device-internal clock should be checked and set, if necessary.

The annunciation buffers are deleted under **MAIN MENU → Annunciations → Set/Reset**, so that future information will only apply to actual events and states (see also SIPROTEC 4 System Description). The counters in the switching statistics should be reset to the values that were existing prior to the testing (see also SIPROTEC 4 System Description).

Reset the counter of the operational measured values (e.g. operation counter, if available) under **MAIN MENU → Measured Values → Reset** (also see SIPROTEC 4 System Description).

Press the **ESC** key (several times if necessary), to return to the default display. The default display appears in the display box (e.g. the display of operational measured values).

Clear the LEDs on the front panel of the device by pressing the **LED** key, so that they show only real events and states in the future. In this context, also output relays probably memorized are reset. Pressing the LED key also serves as a test for the LEDs on the front panel because they should all light when the button is pushed. Any LEDs that are lit after the clearing attempt are displaying actual conditions.

The green "RUN" LED must light up, whereas the red "ERROR" must not light up.

Close the protective switches. If test switches are available, then these must be in the operating position.

The device is now ready for operation.

4 Technical Data

This chapter provides the technical data of the device SIPROTEC 7SJ80 and its individual functions, including the limit values that may not be exceeded under any circumstances. The electrical and functional data for the maximum functional scope are followed by the mechanical specifications with dimensioned drawings.

4.1	General Device Data	356
4.2	Definite-time Overcurrent Protection	365
4.3	Inverse-time Overcurrent Protection	367
4.4	Directional Overcurrent Protection	378
4.5	Inrush Restraint	380
4.6	Dynamic Cold Load Pickup	381
4.7	1-phase Overcurrent Protection	382
4.8	Voltage Protection	383
4.9	Negative Sequence Protection (definite-time characteristic)	385
4.10	Negative Sequence Protection (inverse-time characteristics)	386
4.11	Frequency Protection 81 O/U	392
4.12	Undervoltage-controlled reactive power protection (27/Q)	393
4.13	Thermal Overload Protection	395
4.14	Ground Fault Detection (Sensitive/Insensitive)	397
4.15	Intermittent Ground Fault Protection	403
4.16	Directional intermittent ground fault protection	404
4.17	Automatic Reclosing	405
4.18	Fault Locator	406
4.19	Breaker Failure Protection 50BF	407
4.20	Flexible Protection Functions	408
4.21	Synchrocheck 25	411
4.22	User-defined Functions (CFC)	413
4.23	Auxiliary Functions	418
4.24	Switching Device Control	423
4.25	Dimensions	424

4.1 General Device Data

4.1.1 Analog Inputs

Current Inputs

Nominal Frequency	f_{Nom}	50 Hz or 60 Hz	(adjustable)
Operating range frequency (not dependent on the nominal frequency)		25 Hz to 70 Hz	
Nominal current	I_{Nom}	1 A or 5 A	
Ground current, sensitive	I_{Ns}	$\leq 1.6 \cdot I_{\text{Nom}}$ linear range ¹⁾	
Burden per phase and ground path - at $I_{\text{N}} = 1 \text{ A}$ - at $I_{\text{N}} = 5 \text{ A}$ - for sensitive ground fault detection at 1 A - for sensitive ground fault detection at 5 A		$\leq 0.05 \text{ VA}$ $\leq 0.3 \text{ VA}$ $\leq 0.05 \text{ VA}$ $\leq 0.3 \text{ VA}$	
Load capacity current path - thermal (rms) - dynamic (peak value)		500 A for 1 s 150 A for 10 s 20 A continuous 1250 A (half-cycle)	
Load capacity input for sensitive ground fault detection I_{Ns} ¹⁾			
- thermal (rms) - dynamic (peak value)		300 A for 1 s 100 A for 10 s 15 A continuous 750 A (half-cycle)	

¹⁾ only in models with input for sensitive ground fault detection (see ordering data in the Appendix)

Voltage Inputs

Nominal voltage		34 V – 225 V (adjustable) for connection of phase-to-ground voltages 34 V – 200 V (adjustable) for connection of phase-to-phase voltages
Measuring Range		0 V to 200 V
Burden	at 100 V	approx. 0.005 VA
Overload capacity in the voltage path		
– thermal (rms)		230 V continuous

4.1.2 Auxiliary voltage

Direct Voltage

Voltage supply via an integrated converter		
Nominal auxiliary DC voltage V_{Aux}	DC 24 V to 48 V	DC 60 V to 250 V
Permissible voltage ranges	DC 19 V to 60 V	DC 48 V to 300 V
Overvoltage category, IEC 60255-27	III	
AC ripple voltage peak to peak, IEC 60255-11	15 % of auxiliary voltage	

Power input	Quiescent	Energized
7SJ80	approx. 5 W	approx. 12 W
Bridging time for failure/short-circuit, IEC 60255-11	≥ 50 ms at V ≥ 110 V	
	≥ 10 ms at V < 110 V	

Alternating Voltage

Voltage supply via an integrated converter		
Nominal auxiliary AC voltage V _{Aux}	AC 115 V	AC 230 V
Permissible voltage ranges	AC 92 V to 132 V	AC 184 V to 265 V
Overvoltage category, IEC 60255-27	III	
Power input (at AC 115 V/230 V)	< 15 VA	
Bridging time for failure/short-circuit	≥ 10 ms at V = 115 V/230 V	

4.1.3 Binary Inputs and Outputs

Binary Input

Variant	Quantity	
7SJ801/803	3 (configurable)	
7SJ802/804	7 (configurable)	
7SJ807/808	11 (configurable)	
Nominal direct voltage range	24 V to 250 V	
Current input, energized (independent of the control voltage)	approx. 0.4 mA	
Pickup time	approx. 3 ms	
Response Time of the binary output after trigger signal via binary input	approx. 9 ms	
Dropout time	approx. 4 ms	
Response Time of the binary output after trigger signal via binary input	approx. 5 ms	
Secured switching thresholds	(adjustable)	
for nominal voltages	DC 24 V to 125 V	V high > DC 19 V V low < DC 10 V
for nominal voltages	DC 110 V to 250 V	V high > DC 88 V V low < DC 44 V
for nominal voltages	DC 220 V and 250 V	V high > DC 176 V V low < DC 88 V
Maximum permissible voltage	DC 300 V	
Input interference suppression	DC 220 V across 220 nF	

Output Relays

Signal/command Relay, Alarm Relay		
Quantity and data	depending on the order variant (allocatable)	
Order variant	NO contact	NO/NC selectable
7SJ801/803/807/808	3	2 (+ 1 life contact not allocatable)
7SJ802/804	6	2 (+ 1 life contact not allocatable)

Switching Capability MAKE	1000 W / 1000 VA	
Switching capability BREAK	40 W or 30 VA at $L/R \leq 40$ ms	
Switching voltage AC and DC	250 V	
Admissible current per contact (continuous)	5 A	
Permissible current per contact (close and hold)	30 A for 1 s (NO contact)	
Interference suppression capacitor at the relay outputs 2.2 nF, 250 V, ceramic	Frequency	Impedance
	50 Hz	$1.4 \cdot 10^6 \Omega \pm 20 \%$
	60 Hz	$1.2 \cdot 10^6 \Omega \pm 20 \%$

4.1.4 Communication Interfaces

User Interface

Terminal	Front side, non-isolated, USB type B socket for connecting a personal computer Operation from DIGSI V4.82 via USB 2.0 full speed (PELV)
Operation	with DIGSI
Transmission speed	up to 12 Mbit/s max.
Bridgeable distance	5 m

Port A

Ethernet electrical for DIGSI or SICAM I/O Unit 7XV5673	
Operation	with DIGSI
Terminal	Front case bottom, mounting location "A", RJ45 socket 100BaseT according to IEEE802.3 LED yellow: 10-/100 MBit/s (on/off) LED green: connection/no connection (on/off)
Test voltage (PELV)	500 V; 50 Hz
Transmission speed	10/100 MBit/s
Bridgeable distance	20 m

Port B

IEC 60870-5-103 single	
RS232/RS485/FO depending on the order variant	Isolated interface for data transfer to a control center
RS232	
Terminal	Back case bottom, mounting location "B", 9- pin DSUB socket
Test voltage (PELV)	500 V; 50 Hz
Transmission speed	min. 1,200 Bd, max. 115,000 Bd; factory setting 9,600 Bd
Bridgeable distance	15 m
RS485	
Terminal	Back case bottom, mounting location "B", 9- pin DSUB socket
Test voltage (PELV)	500 V; 50 Hz

Transmission speed	min. 1,200 Bd, max. 115,000 Bd; factory setting 9,600 Bd
Bridgeable distance	max. 1 km
Fiber optic cable (FO)	
FO connector type	ST connector
Terminal	Back case bottom, mounting location "B"
Optical wavelength	$\lambda = 820 \text{ nm}$
Laser Class 1 according to EN 60825-1/-2	When using glass fiber 50 μm /125 μm or glass fiber 62.5 μm /125 μm
Permissible optical signal attenuation	max. 8 dB, with glass fiber 62.5/125 μm
Bridgeable distance	max. 1.5 km
Character idle state	Configurable; factory setting "Light off"
IEC 60870-5-103 redundant, RS485	
Isolated interface for data transfer to a control center	
Terminal	Back case bottom, mounting location "B", RJ45 socket
Test voltage (PELV)	500 V; 50 Hz
Transmission speed	min. 2,400 Bd, max. 57,600 Bd; factory setting 19,200 Bd
Bridgeable distance	max. 1 km
Profibus RS485 (DP)	
Terminal	Back case bottom, mounting location "B", 9-pin DSUB socket
Test voltage (PELV)	500 V; 50 Hz
Transmission speed	Up to 1.5 MBd
Bridgeable distance	1 000 m (3 300 ft) at $\leq 93.75 \text{ kBd}$ 500 m (1 600 ft) at $\leq 187.5 \text{ kBd}$ 200 m (660 ft) at $\leq 1.5 \text{ MBd}$
Profibus FO (DP)	
FO connector type	ST connector Double ring
Terminal	Back case bottom, mounting location "B"
Transmission speed	up to 1.5 MBd
Recommended:	> 500 kBd with normal casing
Optical wavelength	$\lambda = 820 \text{ nm}$
Laser Class 1 according to EN 60825-1/-2	When using glass fiber 50/125 μm or glass fiber 62.5/125 μm
Permissible optical signal attenuation	max. 8 dB, with glass fiber 62.5/125 μm
Bridgeable distance	max. 1.5 km
DNP3.0 /MODBUS RS485	
Terminal	Back case bottom, mounting location "B", 9-pin DSUB socket
Test voltage (PELV)	500 V; 50 Hz
Transmission speed	up to 19,200 Bd
Bridgeable distance	max. 1 km

DNP3.0 /MODBUS FO	
FO connector type	ST connector transmitter/receiver
Terminal	Back case bottom, mounting location "B"
Transmission speed	up to 19,200 Bd
Optical wavelength	$\lambda = 820 \text{ nm}$
Laser Class 1 according to EN 60825-1/-2	When using glass fiber 50 μm /125 μm or glass fiber 62.5/125 μm
Permissible optical signal attenuation	max. 8 dB, with glass fiber 62.5/125 μm
Bridgeable distance	max. 1.5 km
Ethernet electrical (EN 100) for DIGSI, IEC61850, DNP3 TCP, Modbus TCP, IEC60870-5-104, PROFINET, SICAM I/O Unit 7XV5673	
Terminal	Back case bottom, mounting location "B", 2 x RJ45 socket 100BaseT according to IEEE802.3
Test voltage (with regard to the socket) (PELV)	500 V; 50 Hz
Transmission speed	100 MBit/s
Bridgeable distance	20 m
Ethernet optical (EN 100) for DIGSI, IEC61850, DNP3 TCP, Modbus TCP, IEC60870-5-104, PROFINET, SICAM I/O Unit 7XV5673	
Terminal	Back case bottom, mounting location "B", Duplex-LC, 100BaseF according to IEEE802.3
Transmission speed	100 MBit/s
Optical wavelength	1300 nm
Bridgeable distance	max. 2 km (1.24 mi)

4.1.5 Electrical Tests

Regulations

Standards:	IEC 60255 IEEE Std C37.90, see individual functions VDE 0435 for more standards see also individual functions

Insulation Test

Standards:	IEC 60255-27 and IEC 60870-2-1
Voltage test (routine test) of all circuits except auxiliary voltage, binary inputs and communication ports	2.5 kV, 50 Hz
Voltage test (routine test) of auxiliary voltage and binary inputs	DC 3.5 kV
Voltage test (routine test) of isolated communication ports only (A and B)	500 V, 50 Hz

Impulse voltage test (type test) of all process circuits (except for communication ports) against the internal electronics	6 kV (peak value); 1.2 μ s/50 μ s; 0.5 J; 3 positive and 3 negative impulses at intervals of 1 s
Impulse voltage test (type test) of all process circuits against each other (except for communication ports) and against the PE terminal of class III	5 kV (peak value); 1.2 μ s/50 μ s; 0.5 J; 3 positive and 3 negative impulses at intervals of 1 s

EMC Tests for Immunity (Type Tests)

Standards:		IEC 60255-26, (product standard) IEC/EN 61000-6-2 VDE 0435 For more standards see also individual functions
Immunity to damped oscillatory waves IEC 60255-22-1 IEC 61000-4-18		2.5 kV (Peak); 100 kHz and 1 MHz; τ = 15 ms; 400 Surges per s; Test duration 2 s; R_i = 200 Ω
Electrostatic discharge, Class IV EN 61000-6-2, IEC 60255-22-2		8 kV contact discharge; 15 kV air discharge, both polarities; 150 pF; R_i = 330 Ω , rating criteria B
Radio frequency electromagnetic field, amplitude-modulated, Class III EN 61000-6-2, IEC 60255-22-3		10 V/m; 80 MHz to 2.7 GHz 80 % AM; 1 kHz
Fast transient bursts, Class IV EN 61000-6-2, IEC 60255-22-4		4 kV; 5 ns/50 ns; 5 kHz; 1 min. test length, rating criteria B
High energy surge voltages (SURGE), Installation Class III, EN 61000-6-2, IEC 60255-22-5		Impulse: 1.2 μ s/50 μ s, rating criteria B
	Auxiliary voltage	common mode: 4 kV; 12 Ω ; 9 μ F diff. mode: 1 kV; 2 Ω ; 18 μ F
	Measuring inputs, binary inputs and relay outputs	common mode: 4 kV; 42 Ω ; 0.5 μ F diff. mode: 1 kV; 42 Ω ; 0.5 μ F
Immunity to Conducted Disturbance by RF fields, injected Current EN 61000-6-2, IEC 60255-22-6		10 V; 150 kHz to 80 MHz; 80 % AM; 1 kHz; 27 Mhz and 68 MHz spot freq. Dwell time > 10 sec.
Power system frequency magnetic field EN 61000-6-2, IEC 61000-4-8		30 A/m continuous; 300 A/m and 1000 V/m for 3 s;
Radiated Electromagnetic Interference IEEE Std C37.90.2		20 V/m; 80 MHz to 1 GHz; 80 % AM; 1 kHz 35 V/m pulsed, 50% duty cycle 1 Hz rep. rate
Power frequency on binary input ports IEC 60255-26, IEC 61000-4-16		Common mode Zone A and B: 300 Veff (220 Ω , 0.47 μ F) Differential Mode Zone B: 100 Veff (100 Ω , 0.047 μ F) testet with 3.9 K Ω termination resistor
Ripple on d.c. input power port immunity test, IEC 61000-4-17		15 % of nominal auxiliary voltage
Gradual shutdown / start-up for d.c. power supply IEC 60255-26		Shut-down ramp: 60 s Power off: 5 min. Start-up ramp: 60 s

EMC Tests for Noise Emission (Type Test)

Standard:	EN 61000-6-4 /01.07 + A1 EN 55011 /11.2009 + A1 class A
Radio noise voltage to lines, only auxiliary voltage IEC/CISPR 16-2-1	150 kHz to 30 MHz Limit Class A
Interference field strength IEC/CISPR 16-2-3	30 MHz to 1000 MHz Limit Class A 1 GHz to 6 GHz Limit Class A
Harmonic currents on the network lead at AC 230 V IEC 61000-3-2	Device is to be assigned Class D (applies only to devices with > 50 VA power consumption)
Voltage dips, interruptions and fluctuations IEC 60255-11, IEC 61000-4-29	Tolerate Voltage interruptions < 60 ms for the nominal auxiliary voltage.

4.1.6 Mechanical Tests**Vibration and Shock Stress during Steady-State Operation**

Standards:	IEC 60255-21 and IEC 60068
Oscillation IEC 60255-21-1, Class 2; IEC 60068-2-6	Sinusoidal 10 Hz to 60 Hz: $\pm 0,075$ mm amplitude; 60 Hz to 150 Hz: 1g acceleration frequency sweep rate 1 octave/min 20 cycles in 3 orthogonal axes.
Shock IEC 60255-21-2, Class 1; IEC 60068-2-27	Semi-sinusoidal acceleration, duration 11 ms, each 3 shocks in both directions of the 3 axes
Seismic Vibration IEC 60255-21-3, Class 2; IEC 60068-3-3	Sinusoidal 1 Hz to 8 Hz: $\pm 7,5$ mm amplitude (horizontal axis) 1 Hz to 8 Hz: $\pm 3,5$ mm amplitude (vertical axis) 8 Hz to 35 Hz: 2 g acceleration (horizontal axis) 8 Hz to 35 Hz: 1 g acceleration (vertical axis) Frequency sweep 1 octave/min 1 cycle in 3 orthogonal axes

Vibration and Shock Stress during Transport

Standards:	IEC 60255-21 and IEC 60068
Oscillation IEC 60255-21-1, Class 2; IEC 60068-2-6	Sinusoidal 5 Hz to 8 Hz: ± 7.5 mm amplitude; 8 Hz to 150 Hz: 2 g acceleration frequency sweep 1 octave/min 20 cycles in 3 orthogonal axes
Shock IEC 60255-21-2, Class 1; IEC 60068-2-27	Semi-sinusoidal 15 g acceleration, duration 11 ms, each 3 shocks (in both directions of the 3 axes)
Continuous Shock IEC 60255-21-2, Class 1; IEC 60068-2-29	Semi-sinusoidal 10 g acceleration, duration 16 ms, each 1000 shocks (in both directions of the 3 axes)

4.1.7 Climatic Stress Tests

Temperatures

Standards:	IEC 60255-1, IEC 60068-2-1/2, IEC 60068-2-78, IEC 60068-2-30
Type test (in acc. with IEC 60068-2-1 and -2, Test Bd for 16 h)	–25 °C to +85 °C or –13 °F to +185 °F
Damp heat, steady state - Test Cab IEC 60255-1 and IEC 60068-2-78.	40 °C, 93 % RH, 56 days
Damp heat, cyclic - Test Db IEC 60255-1 and IEC 60068-2-30	25 °C to/down 40 °C in 3 hr., > 93 % RH, dwell time 9 hr. 6 cycles
Permissible temporary operating temperature (tested for 96 h)	–20 °C to +70 °C or –4 °F to +158 °F (clearness of the display may be impaired from +55 °C or +131 °F)
Recommended for permanent operation (in acc. with IEC 60255-6)	–5 °C to +55 °C or +23 °F to +131 °F
Limit temperatures for storage	–25 °C to +55 °C or –13 °F to +131 °F
Limit temperatures for transport	–25 °C to +70 °C or –13 °F to +158 °F
Storage and transport with factory packaging	

Humidity

Permissible humidity	Mean value per year ≤ 75 % relative humidity; on 56 days of the year up to 93 % relative humidity; condensation must be avoided!
Siemens recommends that all devices be installed such that they are not exposed to direct sunlight, nor subject to large fluctuations in temperature that may cause condensation to occur.	

4.1.8 Service Conditions

The protective device is designed for use in an industrial environment and an electrical utility environment. Proper installation procedures should be followed to ensure electromagnetic compatibility (EMC).

In addition, the following is recommended:

- All contacts and relays that operate in the same cubicle, cabinet, or relay panel as the numerical protective device should, as a rule, be equipped with suitable surge suppression components.
- For substations with operating voltages of 100 kV and above, all external cables should be shielded with a conductive shield grounded at both ends. For substations with lower operating voltages, no special measures are normally required.
- Do not withdraw or insert individual modules or boards while the protective device is energized. In withdrawn condition, some components are electrostatically endangered; during handling the ESD standards (for **Electrostatic Sensitive Devices**) must be observed. They are not endangered when inserted into the case.

4.1.9 Constructive Design

Case	7XP20
Dimensions	see dimensional drawings, Section 4.25 Dimensions

Device	Case	Size	Weight
7SJ80**-*B	for panel surface mounting	1/6	4.5 kg (9.9 lb)
7SJ80**-*E	for panel flush mounting	1/6	4 kg (8.8 lb)

Protection type acc. to IEC 60529	
For equipment in the surface-mounting case	IP 50
For equipment in flush mounting case	Front IP 51 Rear IP 50
For operator protection	IP 2x for current terminal IP 2x for voltage terminal
Degree of pollution, IEC 60255-27	2

4.1.10 UL certification conditions

Output Relays	DC 24 V	5 A General Purpose
	DC 48 V	0,8 A General Purpose
	DC 240 V	0,1 A General Purpose
	AC 240 V	5 A General Purpose
	AC 120 V	1/3 hp
	AC 250 V	1/2 hp
	B300, R300	
Voltage Inputs	Input voltage range	300 V
Battery	Servicing of the circuitry involving the batteries and replacement of the lithium batteries shall be done by a trained technician. Replace Battery with VARTA or Panasonic Cat. Nos. CR 1/2 AA or BR 1/2 AA only. Use of another Battery may present a risk of fire or explosion. See manual for safety instructions. Caution: The battery used in this device may present a fire or chemical burn hazard if mistreated. Do not recharge, disassemble, heat above 100 °C (212 °F) or incinerate. Dispose of used battery promptly. Keep away from children.	
Climatic Stress Tests	Surrounding air temperature	tsurr: max. 70 °C (158 °F), normal operation
Design	Field Wires of Control Circuits shall be separated from other circuits with respect to the end use requirements!	
	Type 1 if mounted into a door or front cover of an enclosure.	

4.2 Definite-time Overcurrent Protection

Operating Modes

Three-phase	Standard
Two-phase	Phases A and C

Measuring Method

All elements	First harmonic, rms value (true rms)
50-3, 50N-3	Instantaneous values

Setting Ranges / Increments

Pickup current 50-1, 50-2 (phases)	for $I_{Nom} = 1\text{ A}$	0.10 A to 35.00 A or ∞ (disabled)	Increments 0.01 A
	for $I_{Nom} = 5\text{ A}$	0.50 A to 175.00 A or ∞ (disabled)	
Pickup current 50-3 (phases)	for $I_{Nom} = 1\text{ A}$	1.0 A to 35.00 A or ∞ (disabled)	
	for $I_{Nom} = 5\text{ A}$	5.0 A to 175.00 A or ∞ (disabled)	
Pickup Current 50N-1, 50N-2 (ground)	for $I_{Nom} = 1\text{ A}$	0.05 A to 35.00 A or ∞ (disabled)	Increments 0.01 A
	for $I_{Nom} = 5\text{ A}$	0.25 A to 175.00 A or ∞ (disabled)	
Pickup Current 50N-3 (ground)	for $I_{Nom} = 1\text{ A}$	0.25 A to 35.00 A or ∞ (disabled)	
	for $I_{Nom} = 5\text{ A}$	1.25 A to 175.00 A or ∞ (disabled)	
Time delays T		0.00 s to 60.00 s or ∞ (disabled)	Increments 0.01 s
Dropout time delays 50 T DROP-OUT , 50N T DROP-OUT		0.00 s to 60.00 s	Increments 0.01 s

Times

Pickup times (without inrush restraint, with restraint + 1 period)	
First harmonic, rms value	
for 2 x setting value	approx. 30 ms
- for 10 x setting value	approx. 20 ms
Instantaneous value	
- for 2 x setting value	approx. 16 ms
- for 10 x setting value	approx. 16 ms
Dropout Times	
First harmonic, rms value	approx. 30 ms
Instantaneous value	approx. 40 ms

Dropout Ratio

Dropout ratio for	
- first harmonic, rms value	approx. 0.95 for $I/I_{Nom} \geq 0.3$
- instantaneous value	approx. 0.90 for $I/I_{Nom} \geq 0.3$

Tolerances

Pickup times	for $I_{Nom} = 1\text{ A}$	3 % of setting value or 15 mA
	for $I_{Nom} = 5\text{ A}$	3 % of setting value or 75 mA
Time delays T		1 % or 10 ms

Influencing Variables for Pickup and Dropout

Auxiliary DC voltage in range $0.8 \leq V_{\text{Aux}}/V_{\text{AuxNom}} \leq 1,15$	1 %
Temperature in range $-5\text{ °C (23 °F)} \leq \Theta_{\text{amb}} \leq 55\text{ °C (131 °F)}$	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{\text{Nom}} \leq 1.05$ ($f_{\text{Nom}} = 50\text{ Hz or }60\text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{\text{Nom}} \leq 1.05$	Increased tolerances
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %
at instantaneous value of 50-3/50N-3 elements	Increased tolerances
Transient overreaction for $\tau > 100\text{ ms}$ (with full displacement)	<5 %

4.3 Inverse-time Overcurrent Protection

Operating Modes

Three-phase	Standard
Two-phase	Phases A and C
voltage-independent, voltage-controlled, voltage-dependent	

Measuring Method

All elements	First harmonic, rms value (true rms)

Setting Ranges / Increments

Pickup current 51 (phases) (Phasen)	for $I_N = 1 \text{ A}$	0.10 A to 4.00 A	Increments 0.01 A
	for $I_N = 5 \text{ A}$	0.50 A to 20.00 A	
Pickup current 51N ground	for $I_N = 1 \text{ A}$	0.05 A to 4.00 A	Increments 0.01 A
	for $I_N = 5 \text{ A}$	0.25 A to 20.00 A	
Time multiplier T for 51, 51N for IEC-Kennlinien		0.05 s to 3.20 s or ∞ (disabled)	Increments 0.01 s
Time multiplier D for 51, 51N for ANSI-Kennlinien		0.50 s to 15.00 s or ∞ (disabled)	Increments 0.01 s
Undervoltage threshold 51V V< for for release of 51		10.0 V to 125.0 V	Increments 0.1V

Trip Time Curves acc. to IEC

Acc. to IEC 60255-151 or BS 142, Section 3.5.2 (see also Figure 4-1 and Figure 4-2)	
INVERSE (Type A)	$t = \frac{0.14}{(I/I_p)^{0.02} - 1} \cdot T_p \quad [\text{s}]$
VERY INVERSE (Type B)	$t = \frac{13.5}{(I/I_p)^1 - 1} \cdot T_p \quad [\text{s}]$
EXTREMELY INV. (Type C)	$t = \frac{80}{(I/I_p)^2 - 1} \cdot T_p \quad [\text{s}]$
LONG INVERSE (Type D)	$t = \frac{120}{(I/I_p)^1 - 1} \cdot T_p \quad [\text{s}]$
Where: t Trip time in seconds T_p Setting Value of the Time Multiplier I Fault Current I_p Setting Value of the Pickup Current	
The tripping times for $I/I_p \geq 20$ are identical with those for $I/I_p = 20$	
For zero sequence current, read $3I_{0p}$ instead of I_p and $T_{3I_{0p}}$ instead of T_p for ground fault, read I_{Ep} instead of I_p and T_{IEp} instead of T_p	
Pickup threshold	approx. $1.10 \cdot I_p$

Dropout Time Characteristics with Disk Emulation acc. to IEC

Acc. to IEC 60255-151 or BS 142, Section 3.5.2 (see also Figure 4-1 and Figure 4-2)		
INVERSE (Type A)	$t_{\text{Reset}} = \frac{9.7}{1 - (I/I_p)^2} \cdot T_p \quad [\text{s}]$	
VERY INV. (Type B)	$t_{\text{Reset}} = \frac{43.2}{1 - (I/I_p)^2} \cdot T_p \quad [\text{s}]$	
EXTREMELY INV. (Type C)	$t_{\text{Reset}} = \frac{58.2}{1 - (I/I_p)^2} \cdot T_p \quad [\text{s}]$	
LONG INVERSE (Type D)	$t_{\text{Reset}} = \frac{80}{1 - (I/I_p)^2} \cdot T_p \quad [\text{s}]$	
Where:		
	t_{Reset}	Reset Time
	T_p	Setting Value of the Time Multiplier
	I	Fault Current
	I_p	Setting Value of the Pickup Current
The dropout time curves apply to $(I/I_p) \leq 0.90$		
For zero sequence current, read I_{3I0p} instead of I_p and T_{3I0p} instead of T_p ;		
for ground fault, read I_{Ep} instead of I_p and T_{IEp} instead of T_p		

Dropout Setting

IEC without Disk Emulation	approx. $1.05 \cdot$ setting value I_p for $I_p/I_N \geq 0.3$, this corresponds to approx. $0.95 \cdot$ pickup value

Reset of the Integration Timer

IEC with Disk Emulation	approx. $0.90 \cdot$ setting value I_p


Tolerances

Pickup/dropout thresholds I_p , I_{Ep}	for $I_{\text{Nom}} = 1 \text{ A}$	3 % of setting value or 15 mA
	for $I_{\text{Nom}} = 5 \text{ A}$	3 % of setting value or 75 mA
Trip time for $2 \leq I/I_p \leq 20$		5 % of reference (calculated) value + 2 % current tolerance, or 30 ms
Dropout time for $I/I_p \leq 0.90$		5 % of reference (calculated) value + 2 % current tolerance, or 30 ms

Influencing Variables for Pickup and Dropout


Auxiliary DC voltage in range $0.8 \leq V_{\text{Aux}}/V_{\text{AuxNom}} \leq 1.15$	1 %
Temperature in range $-5 \text{ °C (23 °F)} \leq \Theta_{\text{amb}} \leq 55 \text{ °C (131 °F)}$	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{\text{Nom}} \leq 1.05$ ($f_{\text{Nom}} = 50 \text{ Hz or } 60 \text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{\text{Nom}} \leq 1.05$	Increased tolerances

Harmonics - up to 10 % 3rd harmonic - up to 10 % 5th harmonic at instantaneous value of 50-3/50N-3 elements	1 % 1 % Increased tolerances
Transient overreaction for $\tau > 100$ ms (with full displacement)	<5 %

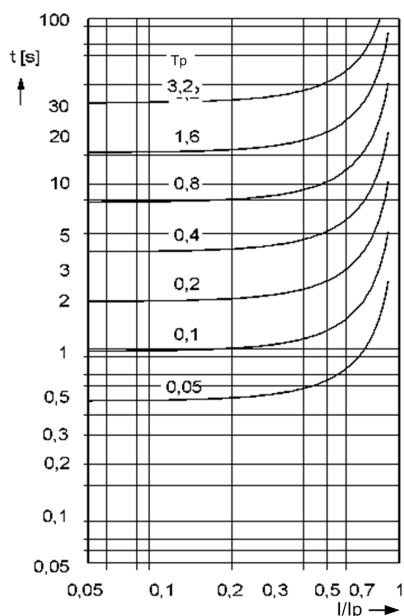


Dropout normal inverse:
$$t = \frac{9.7}{1 - (I/I_p)^2} \cdot T_p \text{ [s]}$$

Type A

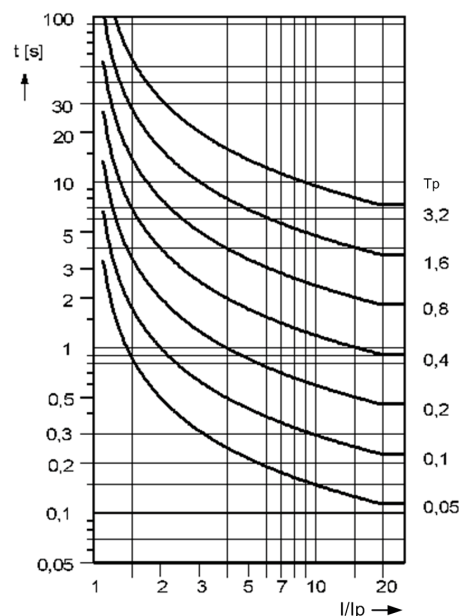


Normal Inverse:
$$t = \frac{0.14}{(I/I_p)^{0.02} - 1} \cdot T_p \text{ [s]}$$

Type A

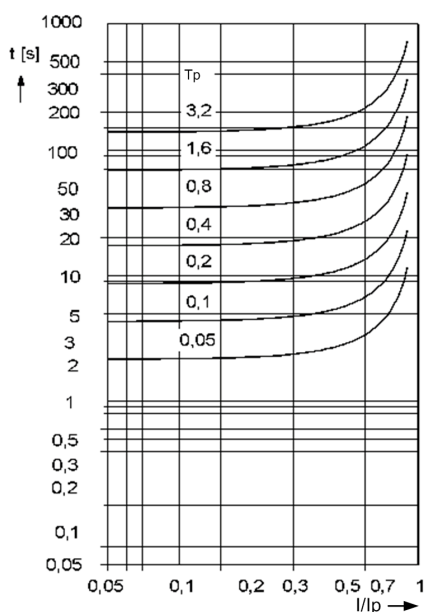

Reset Very Inverse:
$$t = \frac{43.2}{1 - (I/I_p)^2} \cdot T_p \text{ [s]}$$

Type B

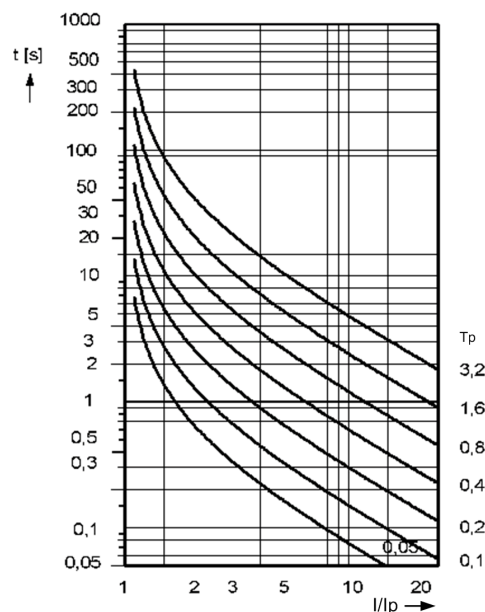


VERY INVERSE:
$$t = \frac{13.5}{(I/I_p)^{-1} - 1} \cdot T_p \text{ [s]}$$

Type B

[ausloese-rueckfall-kennli-amz-iec-norm-stark-170502-wlk, 1, en_US]


Figure 4-1 Dropout time and trip time curves of the inverse time overcurrent protection, acc. to IEC

4.3 Inverse-time Overcurrent Protection

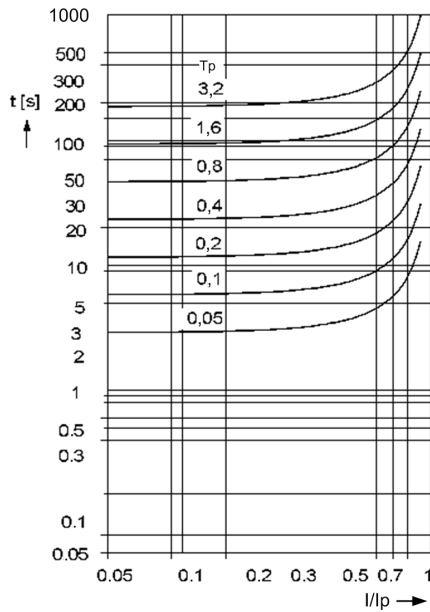


Reset Extremely Inverse:
Type C

$$t = \frac{58.2}{1 - (I/I_p)^2} \cdot T_p \text{ [s]}$$

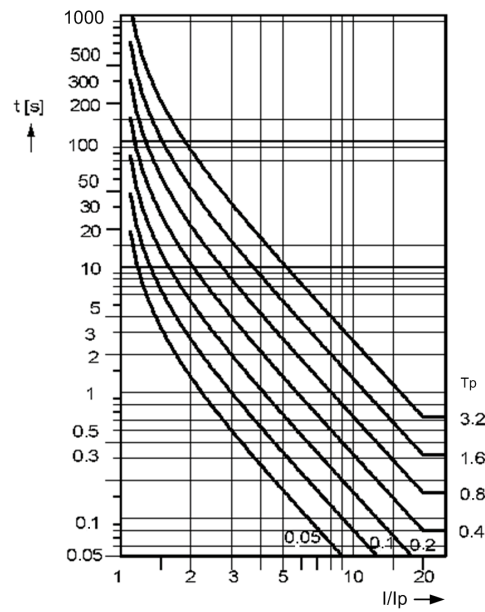


Extremely Inverse:
Type C

$$t = \frac{80}{(I/I_p)^2 - 1} \cdot T_p \text{ [s]}$$

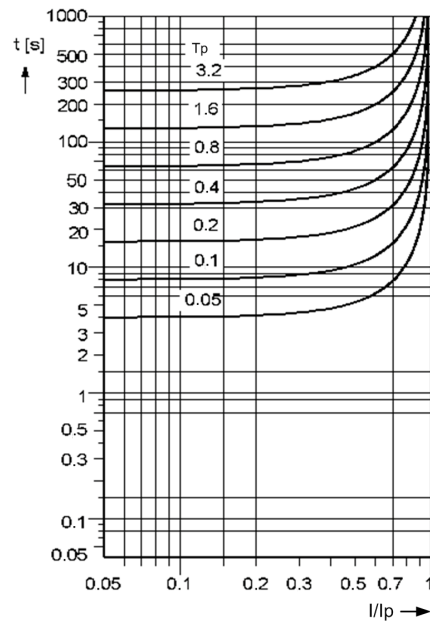

Reset long inverse:
Type B

$$t = \frac{80}{1 - (I/I_p)^2} \cdot T_p \text{ [s]}$$

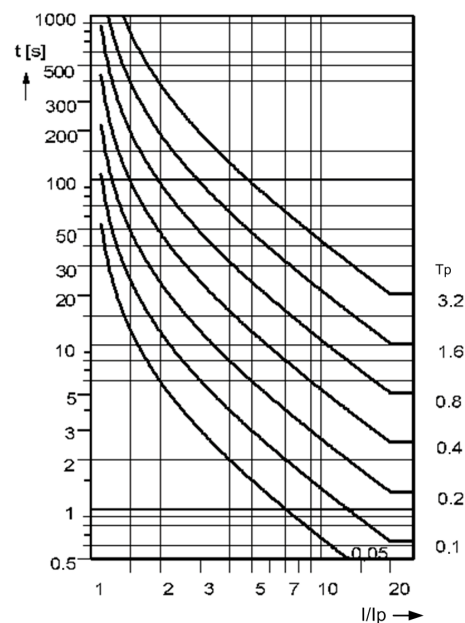

Long time Inverse:
Type B

$$t = \frac{120}{(I/I_p)^1 - 1} \cdot T_p \text{ [s]}$$

[ausl-rueckfall-kennl-amz-iec-extrem-langzeit-170502-wlk, 1, en_US]

Figure 4-2 Dropout time and trip time curves of the inverse time overcurrent protection, acc. to IEC

Trip Time Curves acc. to ANSI

Acc. to ANSI/IEEE (see also Figure 4-3 to Figure 4-6)	
INVERSE	$t = \left(\frac{8.9341}{(I/I_p)^{2.0938}} + 0.17966 \right) \cdot D \quad [s]$
SHORT INVERSE	$t = \left(\frac{0.2663}{(I/I_p)^{1.2969}} + 0.03393 \right) \cdot D \quad [s]$
LONG INVERSE	$t = \left(\frac{5.6143}{(I/I_p) - 1} + 2.18592 \right) \cdot D \quad [s]$
MODERATELY INV.	$t = \left(\frac{0.0103}{(I/I_p)^{0.02}} + 0.0228 \right) \cdot D \quad [s]$
VERY INVERSE	$t = \left(\frac{3.922}{(I/I_p)^2 - 1} + 0.0982 \right) \cdot D \quad [s]$
EXTREMELY INV.	$t = \left(\frac{5.64}{(I/I_p)^2 - 1} + 0.02434 \right) \cdot D \quad [s]$
DEFINITE INV.	$t = \left(\frac{0.4797}{(I/I_p)^{1.5625}} + 0.21359 \right) \cdot D \quad [s]$
Where:	
t	Trip Time
D	Setting Value of the Time Multiplier
I	Fault Current
I _p	Setting Value of the Pickup Current
The tripping times for $I/I_p \geq 20$ are identical with those for $I/I_p = 20$	
For zero sequence current read $3I_{0p}$ instead of I_p and $T_{3I_{0p}}$ instead of T_p ; for ground fault read I_{Ep} instead of I_p and T_{IEp} instead of T_p	
Pickup threshold	ca. $1.10 \cdot I_p$

Dropout Time Characteristics with Disk Emulation acc. to ANSI/IEEE

Acc. to ANSI/IEEE (see also Figure 4-3 to Figure 4-6)		
INVERSE	$t_{\text{Reset}} = \left(\frac{8.8}{1 - (I/I_p)^{2.0938}} \right) \cdot D \quad [\text{s}]$	
SHORT INVERSE	$t_{\text{Reset}} = \left(\frac{0.831}{1 - (I/I_p)^{1.2969}} \right) \cdot D \quad [\text{s}]$	
LONG INVERSE	$t_{\text{Reset}} = \left(\frac{12.9}{1 - (I/I_p)^1} \right) \cdot D \quad [\text{s}]$	
MODERATELY INV.	$t_{\text{Reset}} = \left(\frac{0.97}{1 - (I/I_p)^2} \right) \cdot D \quad [\text{s}]$	
VERY INVERSE	$t_{\text{Reset}} = \left(\frac{4.32}{1 - (I/I_p)^2} \right) \cdot D \quad [\text{s}]$	
EXTREMELY INV.	$t_{\text{Reset}} = \left(\frac{5.82}{1 - (I/I_p)^2} \right) \cdot D \quad [\text{s}]$	
DEFINITE INV.	$t_{\text{Reset}} = \left(\frac{1.03940}{1 - (I/I_p)^{1.5625}} \right) \cdot D \quad [\text{s}]$	
Where: t_{Reset} Reset time D Setting value of the multiplier I Fault Current I_p Setting value of the pickup current		
for $0.5 < (I/I_p) \leq 0.90$		
The dropout time curves apply to $(I/I_p) \leq 0.90$		
For zero sequence current read $3I_{0p}$ instead of I_p and $T_{3I_{0p}}$ instead of T_p ;		
for ground fault read I_{Ep} instead of I_p and T_{IEp} instead of T_p		

Dropout Setting

ANSI without Disk Emulation	approx. $1.05 \cdot$ setting value I_p for $I_p/I_N \geq 0.3$; corresponds to approx. $0.95 \cdot$ pickup value

Reset of the Integration Timer

ANSI with Disk Emulation	approx. $0.90 \cdot$ setting value I_p


Tolerances

Pickup and Dropout Thresholds I_p , I_{Ep}	for $I_{\text{Nom}} = 1 \text{ A}$	3 % of setting value or 15 mA
	for $I_{\text{Nom}} = 5 \text{ A}$	3 % of setting value or 75 mA
Trip Time for $2 \leq I/I_p \leq 20$		5 % of reference (calculated) value + 2 % current tolerance, or 30 ms
Dropout Time for $I/I_p \leq 0.90$		5 % of reference (calculated) value + 2 % current tolerance, or 30 ms

Influencing Variables for Pickup and Dropout


Auxiliary DC voltage in range $0.8 \leq V_{Aux}/V_{AuxNom} \leq 1,15$	1 %
Temperature in range $-5\text{ °C (23 °F)} \leq \Theta_{amb} \leq 55\text{ °C (131 °F)}$	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{Nom} \leq 1.05$ ($f_{Nom} = 50\text{ Hz or }60\text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{Nom} \leq 1.05$	Increased tolerances
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %
at instantaneous value of 50-3/50N-3 elements	Increased tolerances
Transient overreaction for $\tau > 100\text{ ms}$ (with full displacement)	<5 %

4.3 Inverse-time Overcurrent Protection

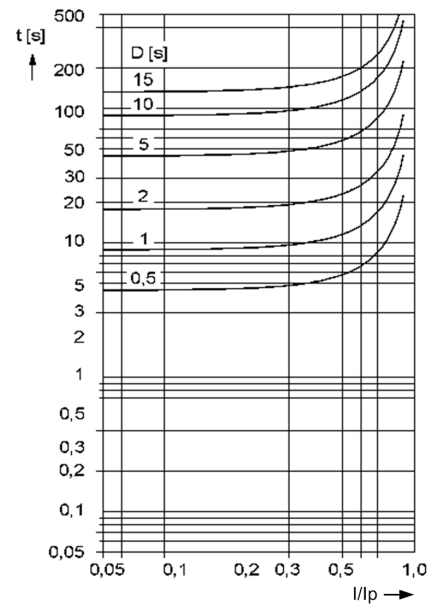


RESET INVERSE

$$t = \frac{8.8}{1 - (I/I_p)^{2.0938}} \cdot D \text{ [s]}$$

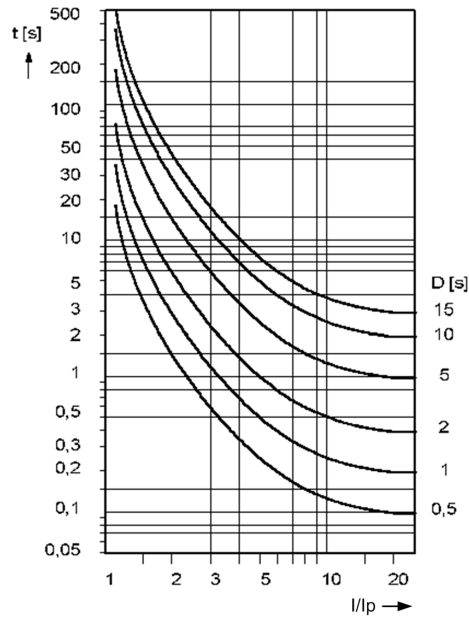


INVERSE

$$t = \left(\frac{8.9341}{(I/I_p)^{2.0938} - 1} + 0.17966 \right) \cdot D \text{ [s]}$$

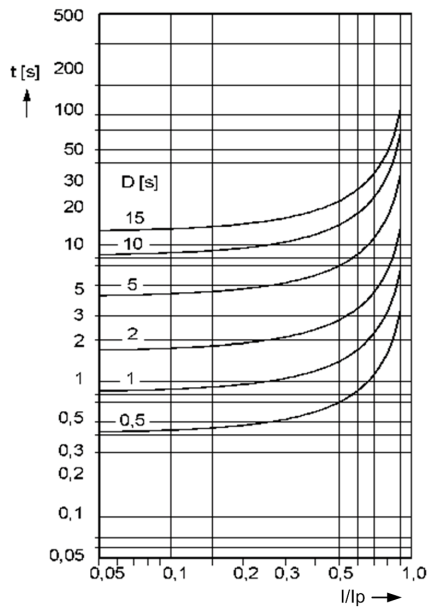

RESET SHORT INVERSE

$$t = \frac{0.831}{1 - (I/I_p)^{1.2969}} \cdot D \text{ [s]}$$

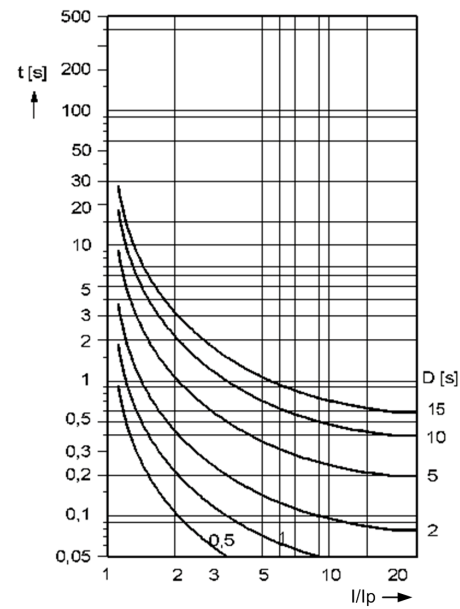


SHORT INVERSE

$$t = \left(\frac{0.2663}{(I/I_p)^{1.2969} - 1} + 0.03393 \right) \cdot D \text{ [s]}$$

[ausl-rueckfallkennl-amz-ansi-inv-short-170502-wlk, 1, en_US]


Figure 4-3 Dropout time and trip time curves of the inverse time overcurrent protection, acc. to ANSI/IEEE

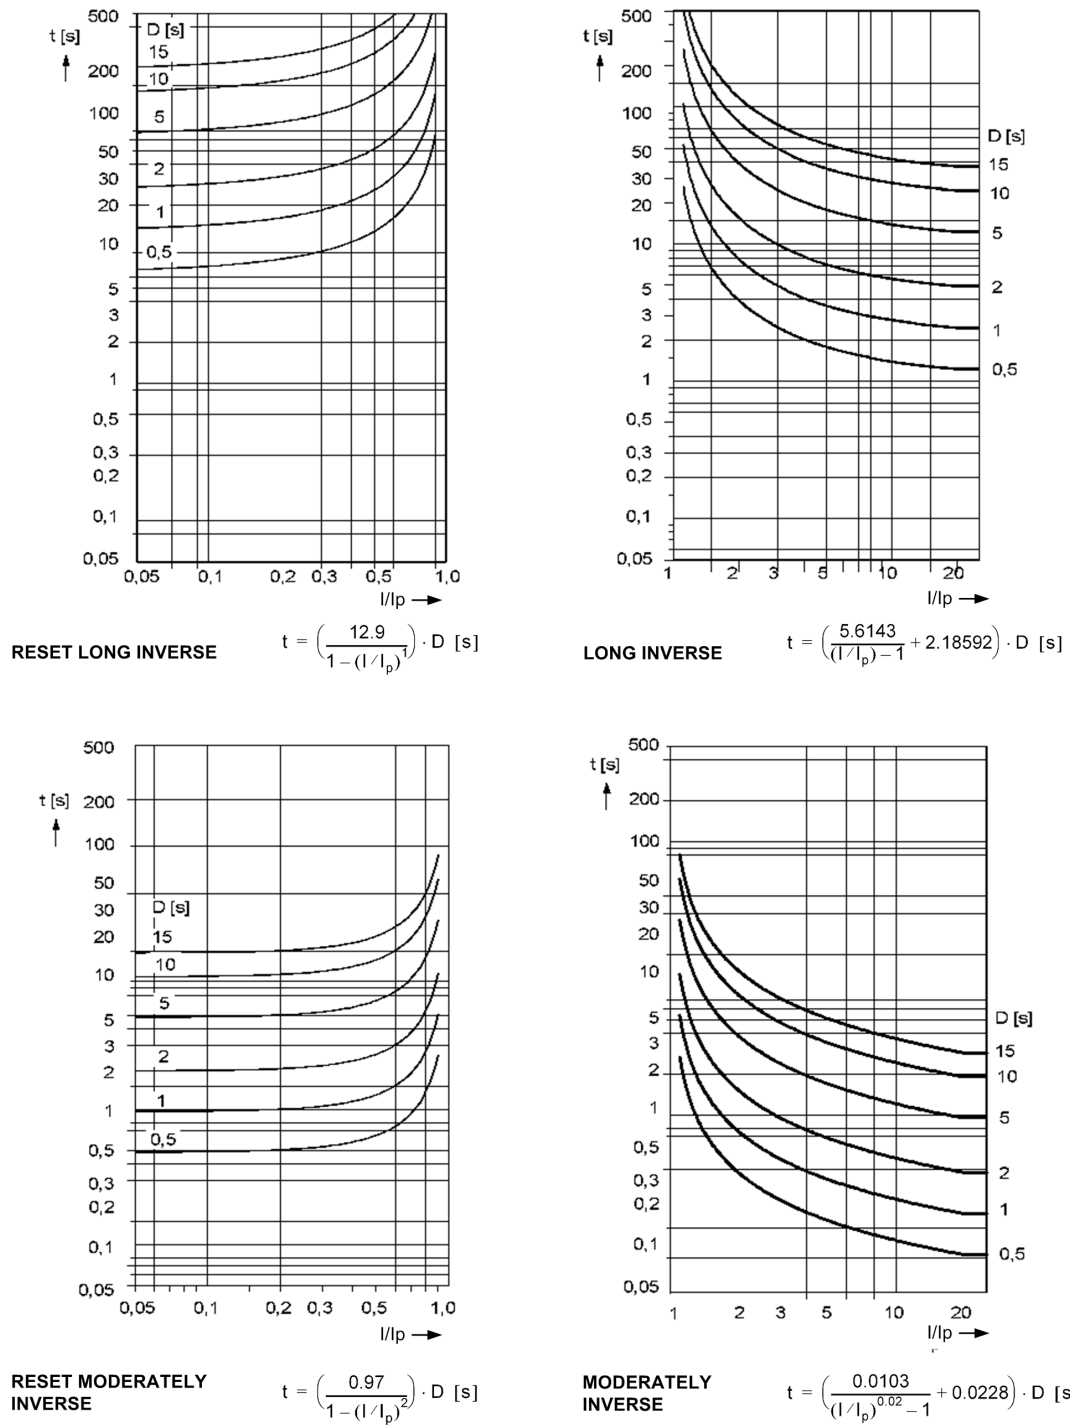

[ausl-rueckfallkennl-amz-ansi-lang-maessig-170502-wlk, 1, en_US]


Figure 4-4 Dropout time and trip time curves of the inverse time overcurrent protection, acc. to ANSI/IEEE

4.3 Inverse-time Overcurrent Protection

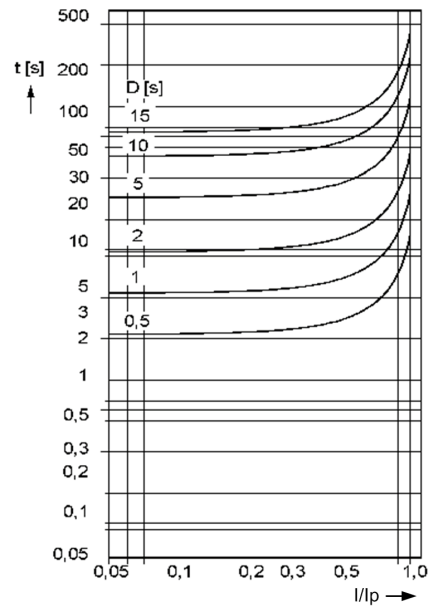


RESET VERY INVERSE

$$t = \left(\frac{4.32}{1 - (I/I_p)^2} \right) \cdot D \text{ [s]}$$

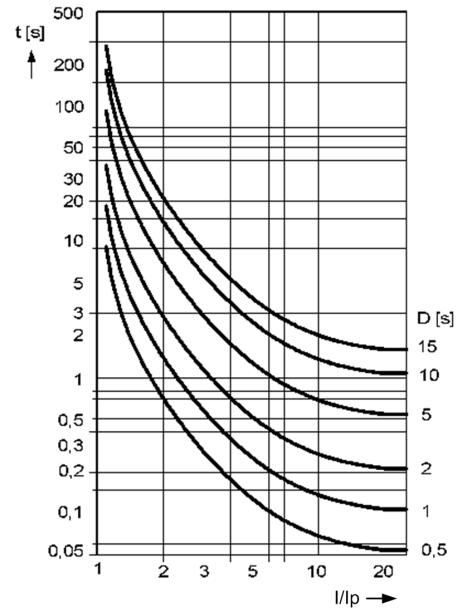


VERY INVERSE:

$$t = \left(\frac{3.922}{(I/I_p)^2 - 1} + 0.0982 \right) \cdot D \text{ [s]}$$

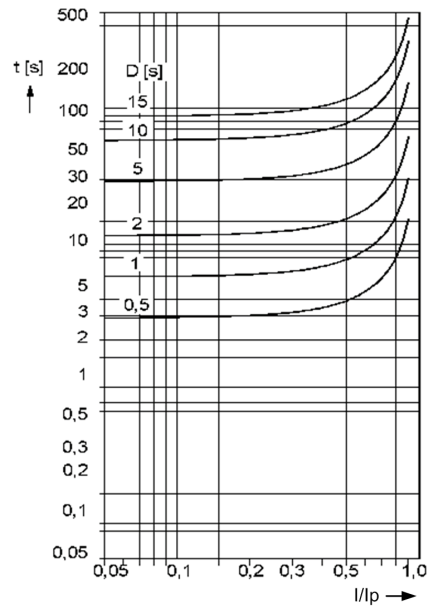

RESET EXTREMELY INVERSE

$$t = \left(\frac{5.82}{1 - (I/I_p)^2} \right) \cdot D \text{ [s]}$$

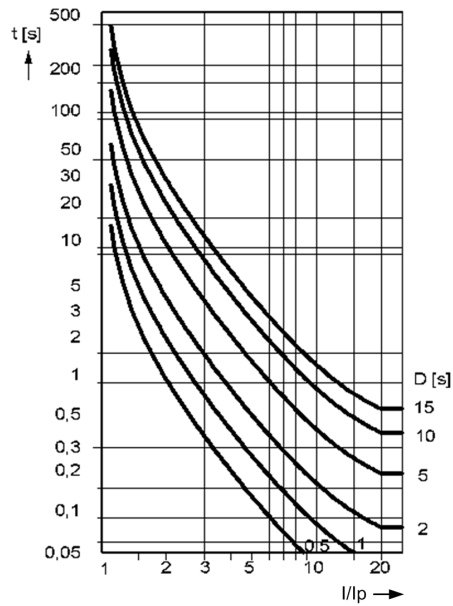


EXTREMELY INVERSE


$$t = \left(\frac{5.64}{(I/I_p)^2 - 1} + 0.02434 \right) \cdot D \text{ [s]}$$

[ausloese-rueckfallkennl-ansi-amz-stark-extrem-170502-wlk, 1, en_US]

Figure 4-5 Dropout time and trip time curves of the inverse time overcurrent protection, acc. to ANSI/IEEE

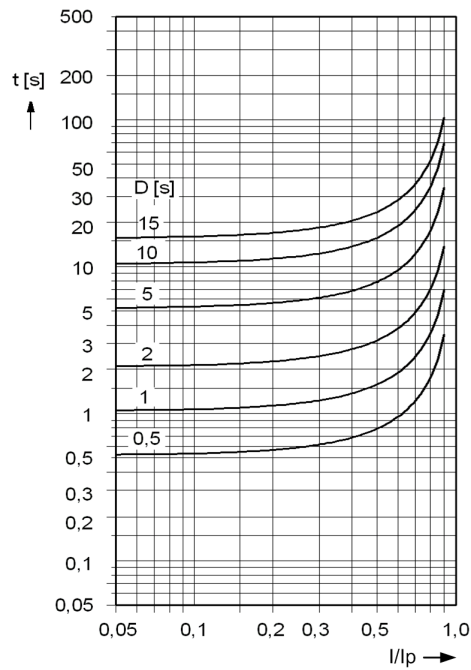
RESET DEFINITE INVERSE

$$t = \left(\frac{1.0394}{1 - (I/I_p)^{1.5625}} \right) \cdot D \text{ [s]}$$

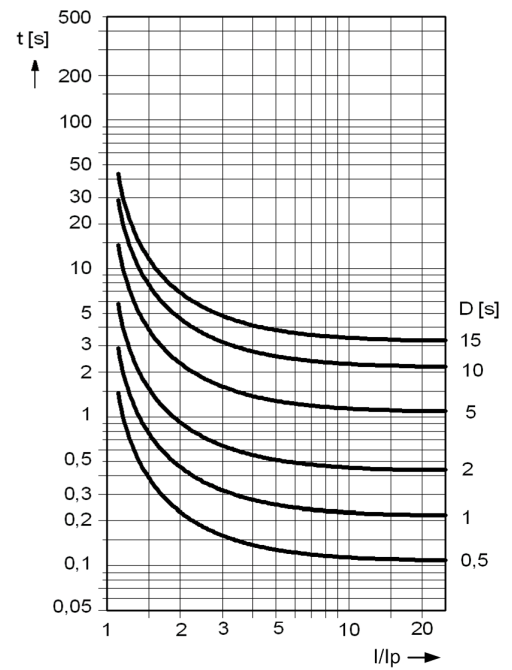
DEFINITE INVERSE

$$t = \left(\frac{0.4797}{(I/I_p)^{1.5625} - 1} + 0.21359 \right) \cdot D \text{ [s]}$$

Note:

For earth fault read IEP instead of Ip and DIEp instead of DIp.

[ausloese-rueckfall-amz-ansi-gleichmaessig-170502-wlk, 1, en_US]

Figure 4-6 Dropout time and trip time curves of the inverse time overcurrent protection, acc. to ANSI/IEEE

4.4 Directional Overcurrent Protection

Time Overcurrent Elements

The same specifications and characteristics apply as for non-directional time overcurrent protection (see previous Sections).

Determination of Direction

Moreover, the following data apply to direction determination:

For Phase Faults

Polarization	With cross-polarized voltages; with voltage memory 2 s
Forward Range	$V_{\text{ref,rot}} \pm 86^\circ$
Rotation of the reference voltage $V_{\text{ref,rot}}$	-180° to $+180^\circ$ Increments 1°
Dropout difference	3°
Directional sensitivity	Unlimited for single and two phase faults For three phase faults, dynamically unlimited, steady-state approx. 7V phase-to-phase

For Ground Faults

Polarization	with zero sequence quantities $3V_0$, $3I_0$
Forward Range	$V_{\text{ref,rot}} \pm 86^\circ$
Rotation of the reference voltage $V_{\text{ref,ot}}$	-180° to $+180^\circ$ Increments 1°
Dropout difference	3°
Directional Sensitivity	$V_N \approx 2.5$ V displacement voltage, measured $3V_0 \approx 5$ V displacement voltage, calculated

Polarization	with negative sequence quantities $3V_2$, $3I_2$
Forward Range	$V_{\text{ref,rot}} \pm 86^\circ$
Rotation of the reference voltage $V_{\text{ref,rot}}$	-180° to $+180^\circ$ Increments 1°
Dropout difference	3°
Directional Sensitivity	$3V_2 \approx 5$ V negative sequence voltage $3I_2 \approx 45$ mA negative sequence current with $I_{\text{Nom}} = 1$ A $3I_2 \approx 225$ mA negative sequence current with $I_{\text{Nom}} = 5$ A

Times

Pickup times (without inrush restraint, with restraint + 1 period)	
67-1, 67-2, 67-3, 67N-1, 67N-2, 67N-3	
- for 2 x setting value	approx. 45 ms
- for 10 x setting value	approx. 40 ms
Dropout Times	
67-1, 67-2, 67-3, 67N-1, 67N-2, 67N-3	approx. 40 ms

Tolerances

Angle faults for phase and ground faults	$\pm 1^\circ$ electrical

Influencing Variables

Frequency Influence	
– With no memory voltage	approx 1° in range 25 Hz to 50 Hz

4.5 Inrush Restraint

Controlled Elements

Time Overcurrent Elements	50-1, 50N-1, 51, 51N, 67-1, 67N-1

Setting Ranges / Increments

Stabilization factor I_{2f}/I	10 % to 45 %	Increments 1 %

Functional Limits

Lower Function Limit Phases	for $I_{Nom} = 1 \text{ A}$	at least one phase current (50 Hz and 100 Hz) $\geq 50 \text{ mA}$	
	for $I_{Nom} = 5 \text{ A}$	at least one phase current (50 Hz and 100 Hz) $\geq 125 \text{ mA}$	
Lower Function Limit ground	for $I_{Nom} = 1 \text{ A}$	Ground current (50 Hz and 100 Hz) $\geq 50 \text{ mA}$	
	for $I_{Nom} = 5 \text{ A}$	Ground current (50 Hz and 100 Hz) $\geq 125 \text{ mA}$	
Upper Function Limit, configurable	for $I_{Nom} = 1 \text{ A}$	0.30 A to 25.00 A	Increments 0.01 A
	for $I_{Nom} = 5 \text{ A}$	1.50 A to 125.00 A	Increments 0.01 A

Crossblock

Crossblock I_A, I_B, I_C	ON/OFF

4.6 Dynamic Cold Load Pickup

Timed Changeover of Settings

Controlled functions	Directional and non-directional time overcurrent protection (separated acc. to phases and ground)
Initiation criteria	Current Criteria "BkrClosed I MIN"
	Interrogation of the circuit breaker position
	Automatic reclosing function ready
	3 time elements
Time control	3 time elements ($T_{CB\ Open}$, T_{Active} , T_{Stop})
Current control	Current threshold "BkrClosed I MIN" (reset on current falling below threshold: monitoring with timer)

Setting Ranges / Increments

Current Control	for $I_N = 1\ A$	0.04 A to 1.00 A	Increments 0.01 A
	for $I_N = 5\ A$	0.20 A to 5.00 A	
Time Until Changeover To Dynamic Settings $T_{CB\ Open}$		0 s to 21600 s (= 6 h)	Increments 1 s
Period Dynamic Settings are Effective After a Reclosure T_{Active}		1 s to 21600 s (= 6 h)	Increments 1 s
Fast Reset Time T_{Stop}		1 s to 600 s (= 10 min) or ∞ (fast reset inactive)	Increments 1 s
Dynamic Settings of Pickup Currents and Time Delays or Time Multipliers		Adjustable within the same ranges and with the same increments as the directional and non-directional time overcurrent protection	

4.7 1-phase Overcurrent Protection

Current Elements

High-set current elements 50-2	for $I_{Nom} = 1\text{ A}$	0.001 A to 1.6 A or ∞ (element disabled)	Increments 0.001 A
	for $I_{Nom} = 5\text{ A}$	0.005 A to 8 A or ∞ (element disabled)	
T_{50-2}		0.00 s to 60.00 s or ∞ (no trip)	Increments 0.01 s
Definite time current element 50-1	for $I_{Nom} = 1\text{ A}$	0.001 A to 1.6 A or ∞ (element disabled)	Increments 0.001 A
	for $I_{Nom} = 5\text{ A}$	0.005 A to 8 A or ∞ (element disabled)	
T_{50-1}		0.00 s to 60.00 s or ∞ (no trip)	Increments 0.01 s

Operating Times

Pickup/Dropout Times		
Frequency Pickup Time	50 Hz	60 Hz
minimum	14 ms	13 ms
maximum	$\leq 35\text{ ms}$	$\leq 35\text{ ms}$
Dropout time approx.	25 ms	22 ms

Dropout Ratios

Current Elements	approx 0.95 for $I/I_{Nom} \geq 0.5$

Tolerances

Currents	5 % of setting value or 1 mA
Times	1 % of setting value or 10 ms

Influencing Variables for Pickup Values

Auxiliary DC voltage in range $0.8 \leq V_{Aux}/V_{AuxNom} \leq 1.15$	1 %
Temperature in range $-5\text{ °C (23 °F)} \leq \Theta_{amb} \leq 55\text{ °C (131 °F)}$	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{Nom} \leq 1.05$ ($f_{Nom} = 50\text{ Hz or }60\text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{Nom} \leq 1.05$	Increased tolerances
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %

4.8 Voltage Protection

Setting Ranges / Increments

Undervoltages 27-1, 27-2		
Measured quantity used with three-phase connection	- Positive sequence system of voltages - Smallest phase-to-phase voltages - Smallest phase-to-ground voltage	
Measured quantity used with single-phase connection	Single-phase phase-to-ground or phase-to-phase voltage	
Connection of phase-to-ground voltages		
- Evaluation of phase-to-ground voltages	10 V to 120 V	Increment 1 V
- Evaluation of phase-to-phase voltages	10 V to 210 V	Increment 1 V
- Evaluation of positive-sequence system	10 V to 210 V	Increment 1 V
Connection of phase-to-phase voltages	10 V to 120 V	Increment 1 V
Connection: single-phase	10 V to 120 V	Increment 1 V
Dropout ratio r for 27-1, 27-2 ¹⁾	1.01 to 3.00	Increment 0.01
Dropout threshold for $(r \cdot 27-1)$ or $(r \cdot 27-2)$	max. 130 V for phase-to-phase voltage max. 225 V for phase-to-ground voltage Minimum hysteresis 0.6 V	
Time delays 27-1 DELAY, 27-2 DELAY	0.00 s to 200.00 s or ∞ (disabled)	Increment 0.01 s
Current criterion BkrClosed I MIN	for $I_N = 1$ A	0.04 A to 1.00 A
	for $I_N = 5$ A	0.20 A to 5.00 A
Overvoltages 59-1, 59-2		
Measured quantity used with three-phase connection	- Positive sequence system of the voltages - Negative sequence system of the voltages - Largest phase-to-phase voltage - Largest phase-to-ground voltage	
Measured quantity used with single-phase connection	Connected single-phase phase-to-ground voltage or phase-to-phase voltage	
Connection of phase-to-ground voltages		
- Evaluation of phase-to-ground voltages	20 V to 150 V	Increment 1 V
- Evaluation of phase-to-phase voltages	20 V to 260 V	Increment 1 V
- Evaluation of positive-sequence system	20 V to 150 V	Increment 1 V
- Evaluation of negative-sequence system	2 V to 150 V	Increment 1 V
Connection of phase-to-phase voltages		
- Evaluation of phase-to-phase voltages	20 V to 150 V	Increment 1 V
- Evaluation of positive-sequence system	20 V to 150 V	Increment 1 V
- Evaluation of negative-sequence system	2 V to 150 V	Increment 1 V
Connection: single-phase	20 V to 150 V	Increment 1 V
Dropout ratio r for 59-1, 59-2 ¹⁾	0.90 to 0.99	Increment 0.01 V
Dropout threshold for $(r \cdot 59-1)$ or $(r \cdot 59-2)$	max. 150 V for phase-to-phase voltage max. 260 V for phase-to-ground voltage Minimum hysteresis 0.6 V	

Time delays 59-1 DELAY, 59-2 DELAY	0.00 s to 200.00 s or ∞ (disabled)	Increment 0.01 s
1) $r = V_{\text{dropout}} / V_{\text{pickup}}$		

Times

Pickup Times		
Undervoltage 27-1, 27-2, 27-1 V_1 , 27-2 V_1		approx. 50 ms
- Overvoltage 59-1, 59-2		approx. 50 ms
- Overvoltage 59-1 V_1 , 59-2 V_1 , 59-1 V_2 , 59-2 V_2		approx. 60 ms
Dropout Times		
- Undervoltage 27-1, 27-2, 27-1 V_1 , 27-2 V_1		approx. 50 ms
- Overvoltage 59-1, 59-2		approx. 50 ms
- Overvoltage 59-1 V_1 , 59-2 V_1 , 59-1 V_2 , 59-2 V_2		approx. 60 ms

Tolerances

Pickup Voltage Limits	1 % of setting value or 1 V
Delay times T	1 % of setting value or 10 ms

Influencing Variables

Auxiliary DC voltage in range $0.8 \leq V_{\text{Aux}} / V_{\text{AuxNom}} \leq 1.15$	1 %
Temperature in range $-5^\circ\text{C} (23^\circ\text{F}) \leq \Theta_{\text{amb}} \leq 55^\circ\text{C} (131^\circ\text{F})$	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{\text{Nom}} \leq 1.05$ ($f_{\text{Nom}} = 50 \text{ Hz or } 60 \text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{\text{Nom}} \leq 1.05$	Increased tolerances
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %

4.9 Negative Sequence Protection (definite-time characteristic)

Setting Ranges / Increments

Unbalanced load tripping element 46-1, 46-2	for $I_N = 1 \text{ A}$	0.05 A to 3.00 A or ∞ (disabled)	Increments 0.01 A
	for $I_N = 5 \text{ A}$	0.25 A to 15.00 A or ∞ (disabled)	
Delay Times 46-1, 46-2		0.00 s to 60.00 s or ∞ (disabled)	Increments 0.01 s
Dropout Delay Times 46 T DROP-OUT		0.00 s to 60.00 s	Increments 0.01 s

Functional Limit

Functional Limit	for $I_{Nom} = 1 \text{ A}$	all phase currents $\leq 10 \text{ A}$
	for $I_{Nom} = 5 \text{ A}$	all phase currents $\leq 50 \text{ A}$
	for $I_{Nom} = 1 \text{ A}$	one phase current $\geq 0.1 \text{ A}$
	for $I_{Nom} = 5 \text{ A}$	one phase current $\geq 0.5 \text{ A}$

Times

Pickup Times	approx. 35 ms
Dropout Times	approx. 35 ms

Dropout Ratio

Characteristic 46-1, 46-2	approx. 0.95 for $I_2/I_{Nom} \geq 0,3$

Tolerances

Pickup values 46-1, 46-2	$I_{Nom} = 1 \text{ A}$	3 % of setting value or 10 mA
	$I_{Nom} = 5 \text{ A}$	3 % of setting value or 50 mA
Time Delays		5 % of reference (calculated) value + 2 % current tolerance, or 30 ms

Influencing Variables for Pickup Values

Auxiliary DC voltage in range $0.8 \leq V_{Aux}/V_{AuxNom} \leq 1,15$	1 %
Temperature in range $-5 \text{ °C (23 °F)} \leq \Theta_{amb} \leq 55 \text{ °C (131 °F)}$	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{Nom} \leq 1.05$ ($f_{Nom} = 50 \text{ Hz or } 60 \text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{Nom} \leq 1.05$	Increased tolerances
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %
Transient overreaction for $\tau > 100 \text{ ms}$ (with full displacement)	<5 %

4.10 Negative Sequence Protection (inverse-time characteristics)

Setting Ranges / Increments

Pickup value 46-TOC (I_{2p})	for $I_{Nom} = 1 \text{ A}$	0.05 A to 2.00 A	Increments 0.01 A
	for $I_{Nom} = 5 \text{ A}$	0.25 A to 10.00 A	
Time Multiplier T_{I2p} (IEC)		0.05 s to 3.20 s or ∞ (disabled)	Increments 0.01 s
Time Multiplier D_{I2p} (ANSI)		0.50 s to 15.00 s or ∞ (disabled)	Increments 0.01 s

Functional Limit

Functional Limit	for $I_{Nom} = 1 \text{ A}$	all phase currents $\leq 10 \text{ A}$
	for $I_{Nom} = 5 \text{ A}$	all phase currents $\leq 50 \text{ A}$

Trip Time Curves acc. to IEC

See also Figure 4-7		
INVERSE	$t_{TRIP} = \frac{0.14}{(I_2/I_{2p})^{0.02} - 1} \cdot T_{I2p} \quad [s]$	
VERY INVERSE	$t_{TRIP} = \frac{13.5}{(I_2/I_{2p})^1 - 1} \cdot T_{I2p} \quad [s]$	
EXTREMELY INVERSE	$t_{TRIP} = \frac{80}{(I_2/I_{2p})^2 - 1} \cdot T_{I2p} \quad [s]$	
Where		
t_{TRIP}		Trip Time
T_{I2p}		Setting Value of the Time Multiplier
I_2		Negative Sequence Currents
I_{2p}		Setting Value of the Pickup Current
The trip times for $I_2/I_{2p} \geq 20$ are identical to those for $I_2/I_{2p} = 20$		
Pickup Threshold		approx. $1.10 \cdot I_{2p}$

Trip Time Curves acc. to ANSI

It can be selected one of the represented trip time characteristic curves in [Figure 4-8](#) and [Figure 4-9](#) each on the right side of the figure.

INVERSE	$t_{\text{TRIP}} = \left(\frac{8.9341}{(I_2/I_{2p})} + 0.17966 \right) \cdot D_{I_{2p}} \quad [\text{s}]$
MODERATELY INVERSE	$t_{\text{TRIP}} = \left(\frac{0.0103}{(I_2/I_{2p})} + 0.0228 \right) \cdot D_{I_{2p}} \quad [\text{s}]$
VERY INVERSE	$t_{\text{TRIP}} = \left(\frac{3.922}{(I_2/I_{2p})} + 0.0982 \right) \cdot D_{I_{2p}} \quad [\text{s}]$
EXTREMELY INVERSE	$t_{\text{TRIP}} = \left(\frac{5.64}{(I_2/I_{2p})} + 0.02434 \right) \cdot D_{I_{2p}} \quad [\text{s}]$

Where

t_{TRIP}	Trip Time
$D_{I_{2p}}$	Setting Value of the Time Multiplier
I_2	Negative Sequence Currents
I_{2p}	Setting Value of the Pickup Current

The trip times for $I_2/I_{2p} \geq 20$ are identical to those for $I_2/I_{2p} = 20$

Pickup Threshold approx. $1.10 \cdot I_{2p}$

Toleranzen

Pickup threshold I_{2p}	$I_{\text{Nom}} = 1 \text{ A}$	3 % of setting value or 15 mA
	$I_{\text{Nom}} = 5 \text{ A}$	3 % of setting value or 75 mA
Time for $2 \leq I/I_{2p} \leq 20$		5 % of reference (calculated) value + 2 % current tolerance, or 30 ms

Dropout Time Curves with Disk Emulation acc. to ANSI

Representation of the possible dropout time curves, see [Figure 4-8](#) and [Figure 4-9](#) each on the left side of the figure

INVERSE	$t_{\text{Reset}} = \left(\frac{8.8}{1 - (I_2/I_{2p})^{2.0938}} \right) \cdot D_{I_{2p}} \quad [\text{s}]$
MODERATELY INVERSE	$t_{\text{Reset}} = \left(\frac{0.97}{1 - (I_2/I_{2p})^2} \right) \cdot D_{I_{2p}} \quad [\text{s}]$
VERY INVERSE	$t_{\text{Reset}} = \left(\frac{4.32}{1 - (I_2/I_{2p})^2} \right) \cdot D_{I_{2p}} \quad [\text{s}]$
EXTREMELY INVERS	$t_{\text{Reset}} = \left(\frac{5.82}{1 - (I_2/I_{2p})^2} \right) \cdot D_{I_{2p}} \quad [\text{s}]$

Where:

t_{Reset}	Reset Time
$D_{I_{2p}}$	Setting Value of the Time Multiplier
I_2	Negative Sequence Currents
I_{2p}	Setting Value of the Pickup Current

The dropout time constants apply to $(I_2/I_{2p}) \leq 0.90$

Dropout Value


IEC and ANSI (without Disk Emulation)	approx. $1.05 I_{2p}$, setting value, which is approx. $0.95 \cdot$ pickup threshold I_2
ANSI with Disk Emulation	approx. $0.90 I_{2p}$ setting value

Tolerances


Dropout value I_{2p}	$I_{Nom} = 1 \text{ A}$	3 % of setting value or 15 mA
	$I_{Nom} = 5 \text{ A}$	3 % of setting value or 75 mA
Time for $2 \leq I/I_{2p} \leq 0.90$		5 % of reference (calculated) value + 2 % current tolerance, or 30 ms

Influencing Variables for Pickup Values


Auxiliary DC voltage in range $0.8 \leq V_{Aux}/V_{AuxNom} \leq 1.15$	1 %
Temperature in range $-5 \text{ °C (23 °F)} \leq \Theta_{amb} \leq 55 \text{ °C (131 °F)}$	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{Nom} \leq 1.05$ ($f_{Nom} = 50 \text{ Hz or } 60 \text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{Nom} \leq 1.05$	Increased tolerances
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %
Transient overreaction for $\tau > 100 \text{ ms}$ (with full displacement)	<5 %

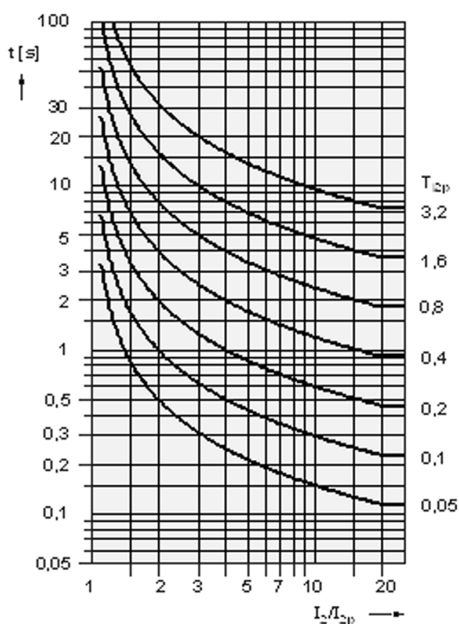

IEC INVERSE:
$$t = \frac{0,14}{(I_2/I_{2p})^{0,02} - 1} \cdot T_{I2p} \text{ [s]}$$

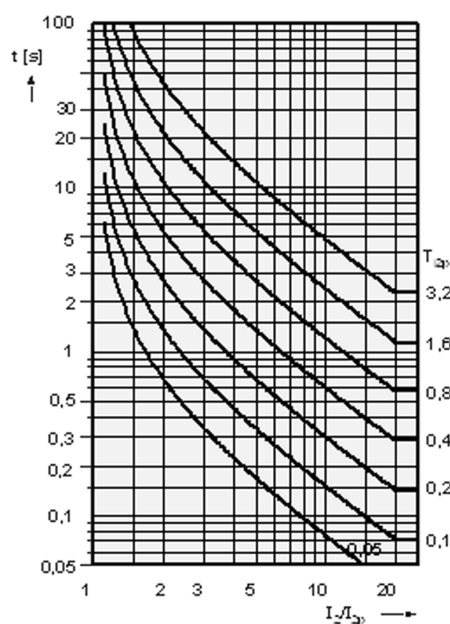

IEC VERY INVERSE:
$$t = \frac{13,5}{(I_2/I_{2p})^1 - 1} \cdot T_{I2p} \text{ [s]}$$

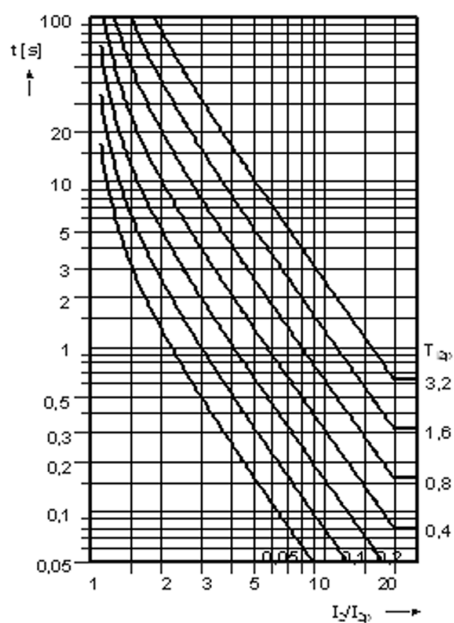


IEC EXTREMELY INVERSE:
$$t = \frac{80}{(I_2/I_{2p})^2 - 1} \cdot T_{I2p} \text{ [s]}$$

t Tripping Time
 T_{I2p} Setting Value of the Time Factor
 I_2 Inverse current
 I_{2p} Pickup current of unbalanced load protection

[ausloese-iec-schieflast-inv-stark-extr-170502-wlk, 1, en_US]


Figure 4-7 Trip time characteristics of the inverse time negative sequence element 46-TOC, acc. to IEC

4.10 Negative Sequence Protection (inverse-time characteristics)

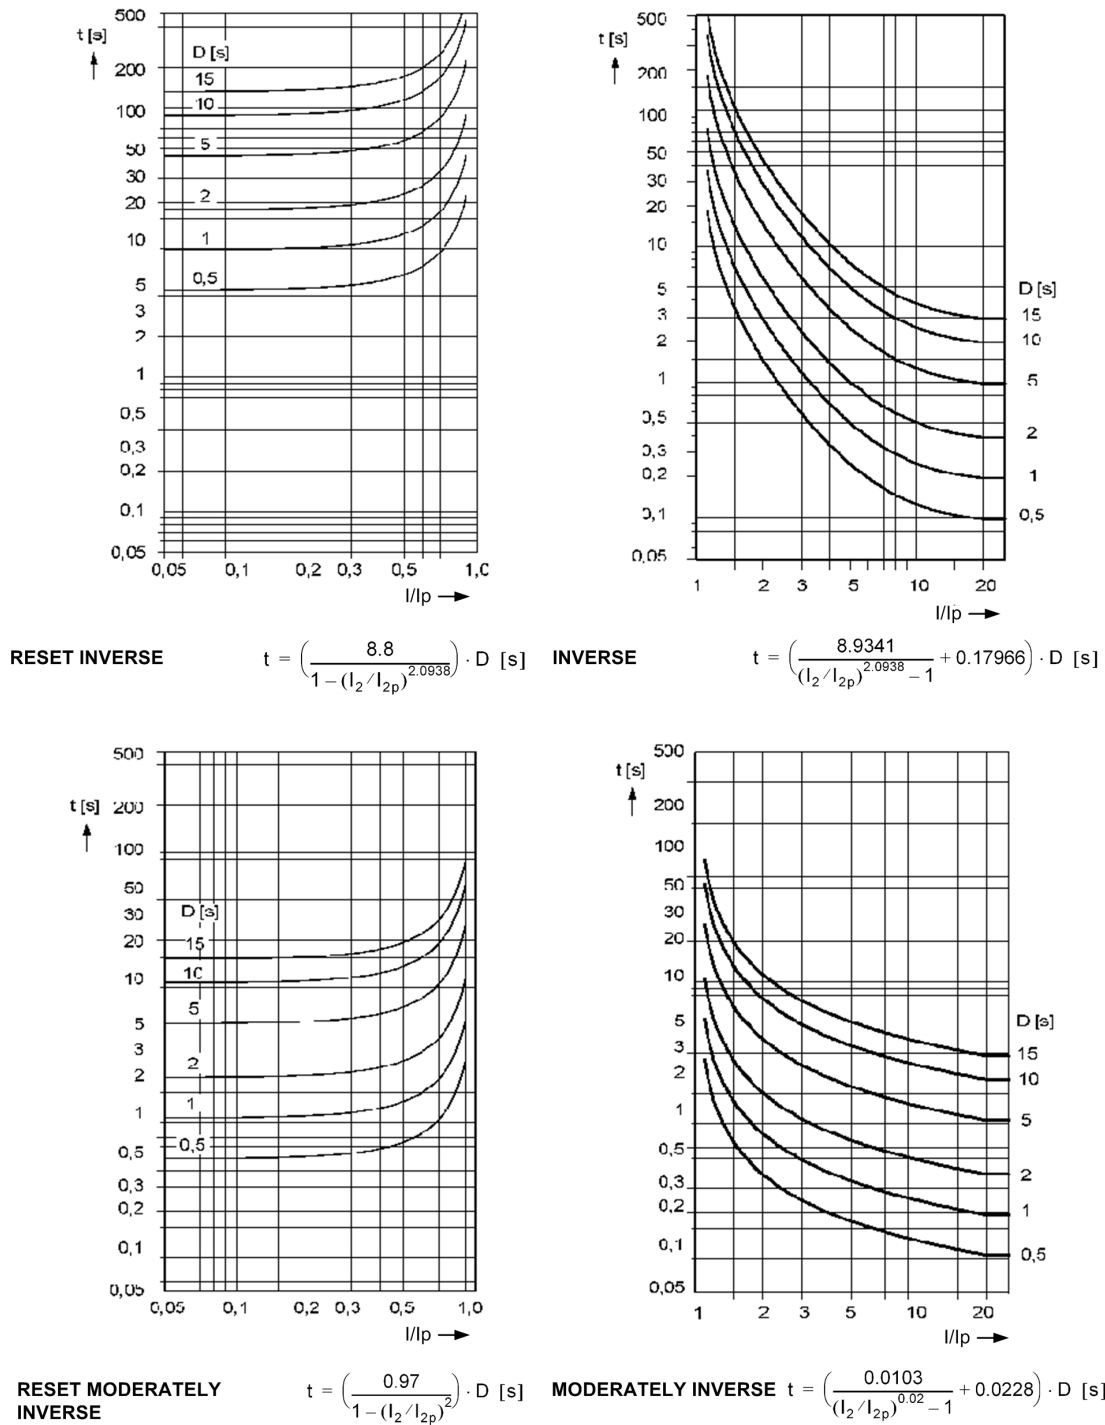


[ausloese-rueckfall-ansi-schiefast-inv-mod-170502-wlk, 1, en_US]

Figure 4-8 Dropout time and trip time characteristics of the inverse time unbalanced load stage, acc. to ANSI

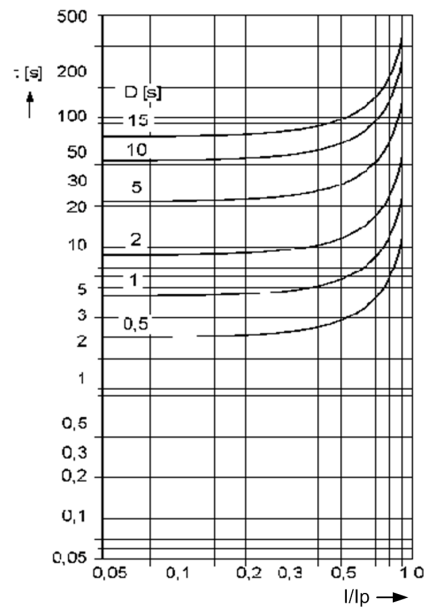


RESET VERY INVERSE

$$t = \left(\frac{4.32}{1 - (I_2/I_{2p})^2} \right) \cdot D \text{ [s]}$$

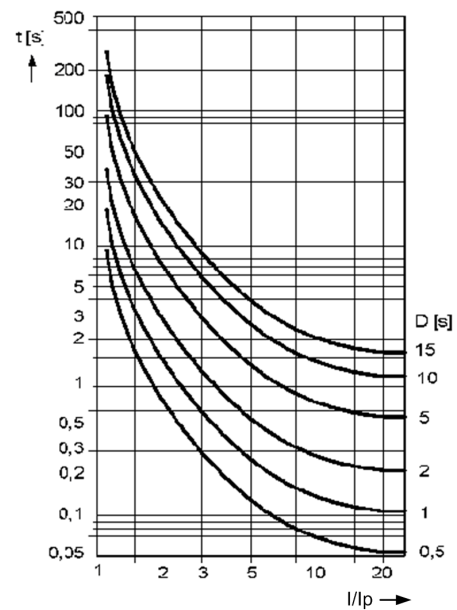


VERY INVERSE:

$$t = \left(\frac{3.922}{(I_2/I_{2p})^2 - 1} + 0.0982 \right) \cdot D \text{ [s]}$$

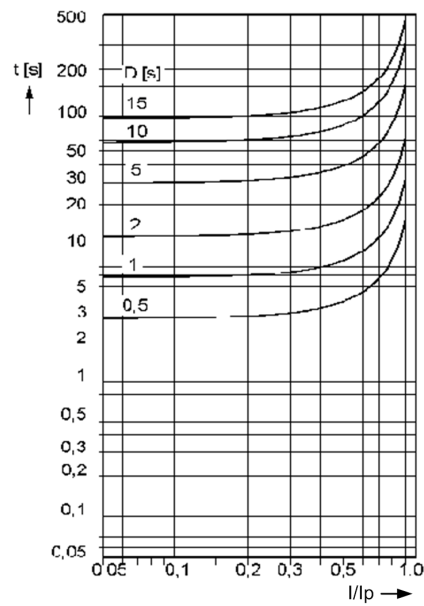

RESET EXTREMELY INVERSE

$$t = \left(\frac{5.82}{1 - (I_2/I_{2p})^2} \right) \cdot D \text{ [s]}$$

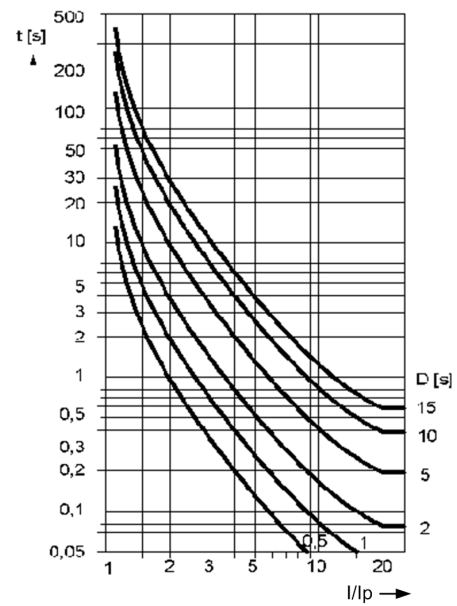

EXTREMELY INVERSE

$$t = \left(\frac{5.64}{(I_2/I_{2p})^2 - 1} + 0.02434 \right) \cdot D \text{ [s]}$$

[ausl-rueckfall-schieflast-ansi-stark-extrem-170502-wlk, 1, en_US]

Figure 4-9 Dropout time and trip time characteristics of the inverse time unbalanced load stage, acc. to ANSI

4.11 Frequency Protection 81 O/U

Setting Ranges / Increments

Setting Ranges / Increments	4; each can be set to $f >$ or $f <$	
Pickup values $f >$ or $f <$ for $f_{Nom} = 50$ Hz	40.00 Hz to 60.00 Hz	Increments 0.01 Hz
Pickup values $f >$ or $f <$ for $f_{Nom} = 60$ Hz	50.00 Hz to 70.00 Hz	Increments 0.01 Hz
Dropout threshold = pickup threshold - dropout threshold	0.02 Hz to 1.00 Hz	Increments 0.01 Hz
Time delays T	0.00 s to 100.00 s or ∞ (disabled)	Increments 0.01 s
Undervoltage blocking with three-phase connection: Positive sequence component V_1 with single-phase connection ("Vphn, Vsyn"): single-phase Phase-to-ground voltage	10 V to 150 V	Increments 1 V

Times

Pickup times $f >$, $f <$	approx. 100 ms at $f_{Nom} = 50$ Hz approx. 80 ms at $f_{Nom} = 60$ Hz
Dropout times $f >$, $f <$	approx. 100 ms at $f_{Nom} = 50$ Hz approx. 80 ms at $f_{Nom} = 60$ Hz

Dropout Difference

$\Delta f = I$ pickup value - dropout value I	0.02 Hz to 1 Hz

Dropout Ratio

Dropout Ratio for Undervoltage Blocking	approx. 1.05

Tolerances

Pickup frequencies 81/O or 81/U	≤ 5 mHz Tolerance (at $V = V_{Nom}$, $f_{Nom} - 0.5$ Hz $< f < f_{Nom} + 0.5$ Hz) < 15 mHz Tolerance (at $V = V_{Nom}$, $f_{Nom} - 5$ Hz $< f < f_N - 0.5$ Hz) < 15 mHz Tolerance (at $V = V_{Nom}$, $f_{Nom} + 0.5$ Hz $< f < f_{Nom} + 5$ Hz)
Undervoltage blocking	3 % of setting value or 1 V
Time delays 81/O or 81/U	1 % of setting value or 10 ms

Influencing Variables

Power supply direct voltage in range $0.8 \leq V_{PS}/V_{PSNom} \leq 1.15$	1 %
Temperature in range $23^\circ\text{F} (-5^\circ\text{C}) \leq \Theta_{amb} \leq 131^\circ\text{F} (55^\circ\text{C})$	0,5 %/10 K
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %

4.12 Undervoltage-controlled reactive power protection (27/Q)

Measured Values / Modes of Operation

3-phase	I1, V, Q,
Measuring method for I, V	Fundamental wave
Pickup when	Exceeding threshold value or falling below threshold value

Setting Ranges / Increments

Pickup thresholds:			
Current I_1	for $I_{Nom} = 1\text{ A}$	0.02 to 0.20 A	Increments 0.01 A
	for $I_{Nom} = 5\text{ A}$	0.10 to 1.00 A	
Voltage V		10.0 to 210.00 V	Increments 0.1 V
Power Q	for $I_{Nom} = 1\text{ A}$	1.0 to 100 VAR	Increments 0.01 VAR
	for $I_{Nom} = 5\text{ A}$	5.0 to 500 VAR	
Tripping delay time		0.00 to 60.00 s	Increments 0.01 s
Release delay time		0.00 to 3600.00 s	Increments 0.01 s
Dropout delay		0.00 to 60.00 s	Increments 0.01 s

Function Limits

Power measurement 3-phase	for $I_{Nom} = 1\text{ A}$	Positive sequence system current > 0.03 A
	for $I_{Nom} = 5\text{ A}$	Positive sequence system current > 0.15 A

Times

Pickup times:	
QU protection typical maximum (small signals and thresholds)	approx. 120 ms approx. 350 ms
Binary input	approx. 20 ms
Dropout times:	
QU protection typical maximum	< 50 ms < 350 ms
Binary input	< 10 ms

Tolerances

Pickup thresholds:		
Current	for $I_{Nom} = 1\text{ A}$	1% of set value or 10 mA at $I_{Nom} \geq 0.03\text{ A}$ 2% of set value or 20 mA bei $I_{Nom} < 0.03\text{ A}$
	for $I_{Nom} = 5\text{ A}$	1% of set value or 50 mA at $I_{Nom} \geq 0.25\text{ A}$ 2% of set value or 100 mA at $I_{Nom} < 0.25\text{ A}$
Current (symmetrical components)	for $I_{Nom} = 1\text{ A}$	2% of set value or 20 mA
	for $I_{Nom} = 5\text{ A}$	2% of set value or 100 mA
Voltage		1% of set value or 0.1 V

Voltage (symmetrical components)	2% of set value or 0.2 V
Power	1% of set value or 0.3 VAR
Times	1% of set value or 10 ms

Influencing Variables for Pickup Values

Auxiliary direct voltage in the range from $0.8 \leq V_{PS}/V_{PSNom} \leq 1.15$	1 %
Temperature in the range from $23.00\text{ °F } (-5\text{ °C}) \leq \Theta_{amb} \leq 131.00\text{ °F } (55\text{ °C})$	0.5 %/10 K
Frequency in the range from 25 Hz to 70 Hz	1 %
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %

4.13 Thermal Overload Protection

Setting ranges / increments

Factor k according to IEC 60255-8		0.10 to 4.00	Increments 0.01
Time constant τ_{th}		1.0 min to 999.9 min	Increments 0.1 min
Current alarm element I_{Alarm}	for $I_{Nom} = 1\text{ A}$	0.10 A to 4.00 A	Increments 0.01 A
	for $I_{Nom} = 5\text{ A}$	0.50 A to 20.00 A	
Extension with machine at rest $k\tau$ factor		1.0 to 10.0 relative to the time constant for the machine running	Increments 0.1
Dropout time (emergency start) $T_{Emergency}$		10 s to 15000 s	Increments 1 s

Trip Characteristic

Formula for primary values:	
Trip Characteristic curve for $I / (k \cdot I_{Nom}) \leq 8$	
$t = \tau_{th} \cdot \ln \frac{\left(\frac{I}{k \cdot I_{Nom}}\right)^2 - \left(\frac{I_{pre}}{k \cdot I_{Nom}}\right)^2}{\left(\frac{I}{k \cdot I_{Nom}}\right)^2 - 1}$	
with	
t	Trip time in minutes
τ_{th}	Heating-up time constant
I	Actual load current
I_{pre}	Preload current
k	Setting factor per IEC 60255-8
I_{Nom}	Nominal current for the protected object

Dropout Ratios

Θ/Θ_{Trip}	Drops out with Θ_{Alarm} approx. 0.99 approx. 0.97
Θ/Θ_{Alarm}	
I/I_{Alarm}	


Tolerances

Referring to $k \cdot I_{Nom}$	2 % or 10 mA for $I_{Nom} = 1\text{ A}$, or 50 mA für $I_{Nom} = 5\text{ A}$, 2 % class according to IEC 60255-8
Referring to Trip Time	3 % or 1 s for $I/(k \cdot I_{Nom}) > 1,25$; 3 % class according to IEC 60255-8

Influencing Variables Referring to $k \cdot I_{Nom}$


Auxiliary DC voltage in range $0.8 \leq V_{Aux}/V_{AuxNom} \leq 1,15$	1 %
Temperature in range $-5\text{ °C (23 °F)} \leq \Theta_{amb} \leq 55\text{ °C (131 °F)}$	0.5 %/10 K

Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{\text{Nom}} \leq 1.05$ ($f_{\text{Nom}} = 50 \text{ Hz or } 60 \text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{\text{Nom}} \leq 1.05$	Increased tolerances

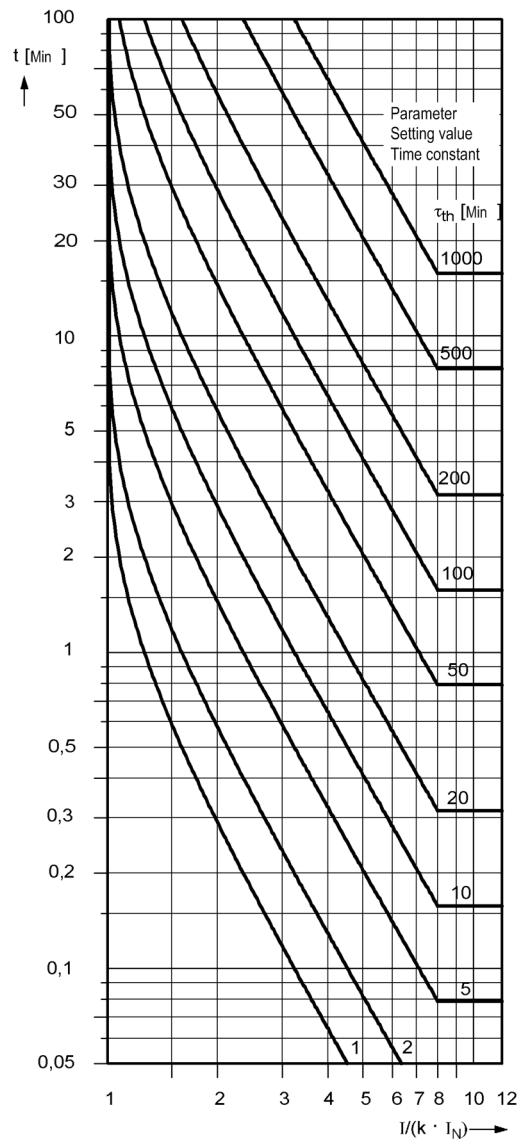

without pre-load:

$$t = \tau_{\text{th}} \cdot \ln \frac{\left(\frac{I}{k \cdot I_N}\right)^2}{\left(\frac{I}{k \cdot I_N}\right)^2 - 1} [\text{Min}]$$

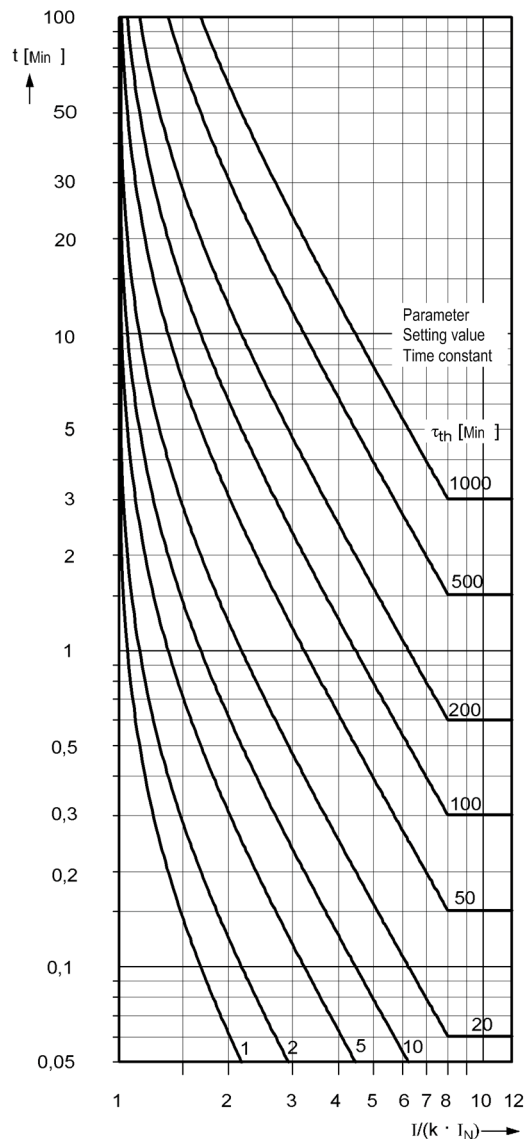

with 90 % pre-load:

$$t = \tau_{\text{th}} \cdot \ln \frac{\left(\frac{I}{k \cdot I_N}\right)^2 - \left(\frac{I_{\text{pre}}}{k \cdot I_N}\right)^2}{\left(\frac{I}{k \cdot I_N}\right)^2 - 1} [\text{Min}]$$

[ausloesekennlinie-ueberlast-1111203-he, 1, en_US]

Figure 4-10 Trip time curves for the thermal overload protection (49)

4.14 Ground Fault Detection (Sensitive/Insensitive)

Displacement Voltage Pickup for All Types of Ground Faults

Displacement voltage, measured	$V_0 > 1.8 \text{ V}$ to 200.0 V or	Increments 0.1 V
Displacement voltage, calculated	$3V_0 > 10.0 \text{ V}$ to 225.0 V	Increments 0.1 V
Pickup delay T-DELAY Pickup	0 s to 320.00 s or ∞	Increments 0.01 s
Additional tripping delay 64-1 DELAY	0.10 s to 40000.00 s or ∞ (disabled)	Increments 0.01 s
Operating time	approx. 50 ms	
Dropout value	0.95 or (pickup value – 0.6 V)	
Measurement tolerance		
$V_0 >$ (measured)	3 % of setting value or 0.3 V	
$3V_0 >$ (calculated)	3 % of setting value or 3 V	
Operating time tolerances	1 % of setting value or 10 ms	

Phase Detection for Ground Faults on an Ungrounded System

Measuring Principle	Voltage measurement (phase-ground)	
$V_{\text{PHASE MIN}}$ (Ground Fault Phase)	10 V to 100 V	Increments 1 V
$V_{\text{PHASE MAX}}$ (Healthy Phase)	10 V to 100 V	Increments 1 V
Measurement Tolerance acc. to VDE 0435, Part 303	3 % of setting value or 1 V	

Ground Fault Pickup for All Types of Ground Faults (Definite Time Characteristic)

Pickup current 50Ns-2 PICKUP, 50Ns-1 PICKUP		
for sensitive 1 A transformer	0.001 A to 1.600 A	Increments 0.001 A
for sensitive 5 A transformer	0.005 A to 8.000 A	Increments 0.005 A
for normal 1 A transformer	0.05 A to 35.00 A	Increments 0.01 A
for normal 5 A transformer	0.25 A to 175.00 A	Increments 0.05 A
Time delay 50Ns-2 DELAY, 50Ns-1 DELAY	0.00 s to 320.00 s or ∞ (disabled)	Increments 0.01 s
Dropout time delay 50Ns T DROP-OUT	0.00 s to 60.00 s	Increments 0.01 s
Operating time	≤ 50 ms (non-directional) ≤ 50 ms (directional)	
Dropout ratio	approx. 0.95 for INs > 50 mA	
Measurement tolerance		
sensitive	for I _{Nom} = 1 A	3 % of setting value or 1 mA
	I _{Nom} = 5 A	3 % of setting value or 5 mA
		for setting values < 10 mA ca. 20 %
non-sensitive	for I _{Nom} = 1 A	3 % of setting value or 15 mA
	for I _{Nom} = 5 A	3 % of setting value or 75 mA
Operating time tolerance		1 % of setting value or 10 ms

Ground Fault Pickup for All Types of Ground Faults (Inverse Time Characteristic)

User-defined characteristic (defined by a maximum of 20 value pairs of current and time delay in direction measurement method "cos phi and sin phi")		
Pickup current 51Ns		
for sensitive 1 A transformer	0.001 A to 1.400 A	Increments 0.001 A
for sensitive 5 A transformer	0.005 A to 7.000 A	Increments 0.005 A
for normal 1 A transformer	0.05 A to 4.00 A	Increments 0.01 A
for normal 5 A transformer	0.25 A to 20.00 A	Increments 0.05 A
Time multiplier T _{51Ns}	0.10 s to 4.00 s or ∞ (disabled)	Increments 0.01 s
Pickup threshold	approx. 1.10 · I _{51Ns}	
Dropout ratio	approx. 1.05 · I _{51Ns} for I _{51Ns} > 50 mA	
Measurement tolerance		
sensitive	for I _{Nom} = 1 A	3 % of setting value or 1 mA
	for I _{Nom} = 5 A	3 % of setting value or 5 mA
		for setting values < 10 mA ca. 20 %
non-sensitive	for I _{Nom} = 1 A	3 % of setting value or 15 mA
	for I _{Nom} = 5 A	3 % of setting value or 75 mA
Operating time tolerance in linear range		7 % of reference (calculated) value for 2 ≤ I/I _{51Ns} ≤ 20 + 2 % current tolerance, or 70 ms

Influencing Variables

Auxiliary DC voltage in range $0.8 \leq V_{Aux}/V_{AuxNom} \leq 1.15$	1 %
Temperature in range -5 °C (23 °F) $\leq \Theta_{amb} \leq 55$ °C (131 °F)	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{Nom} \leq 1.05$ ($f_{Nom} = 50$ Hz or 60 Hz)	1 %
Frequency outside range $0.95 \leq f/f_{Nom} \leq 1.05$	Increased tolerances
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %
Note: When using the sensitive transformer, the linear range of the measuring input for sensitive ground fault detection is from 0.001 A to 1.6 A or 0.005 A to 8.0 A, depending on parameter 205 CT SECONDARY. The function is however still preserved for larger currents.	

Direction Determination for all Types of Ground Fault with $\cos \phi$ / $\sin \phi$ Measurement

Direction measurement	- I_N and V_N measured - $3I_0$ and $3V_0$ calculated	
Measuring principle	Active/reactive power measurement	
Measuring release RELEASE DIRECT . (current component perpendicular (90°) to directional limit line)		
for sensitive 1 A transformer	0.001 A to 1.600 A	Increments 0.001 A
for sensitive 5 A transformer	0.005 A to 8.000 A	Increments 0.005 A
for normal 1 A transformer	0.05 A to 35.00 A	Increments 0.01 A
for normal 5-A transformer	0.25 A to 175.00 A	Increments 0.05 A
Dropout ratio	approx. 0.80	
Measurement method	$\cos \phi$ and $\sin \phi$	

Directional limit line PHI CORRECTION	-45.0° to +45.0°	Increments 0.1°
Dropout delay RESET DELAY	1 s to 60 s	Increments 1 s
Limitation of the directional areas using α_1 and α_2	1° to 15°	Increments 1°
Angle tolerance	3°	

Direction Determination for all Types of Ground Fault with V0 ϕ / I0 ϕ Measurement

Direction measurement	- I_N and V_N measured - $3I_0$ and $3V_0$ calculated	
Measuring principle	V0 / I0 phase angle measurement	
50Ns-1 element		
Minimum voltage 50Ns-1 Vmin		
V0 measured	0.4 V to 50 V	Increments 0.1 V
3V0 calculated	10 V to 90 V	Increments 1 V
Phase angle 50Ns-1 Phi	- 180° to 180°	Increments 1°
Delta phase angle 50Ns-1 DeltaPhi	0° to 180°	Increments 1°
50Ns-2 element		
Minimum voltage 50Ns-2 Vmin		
V0 measured	0.4 V to 50 V	Increments 0.1 V
3V0 calculated	10 V to 90 V	Increments 1 V
Phase angle 50Ns-2 Phi	- 180° to 180°	Increments 1°
Delta phase angle 50Ns-2 DeltaPhi	0° to 180°	Increments 1°
Angle tolerance	3°	

Angle tolerance

Angle correction for cable converter in two operating points F1/I1 and F2/I2:		
Angle correction F1, F2 (for resonant-grounded system)	0.0° to 5.0°	Increments 0.1°
Current values I1, I for angle correction		
for sensitive 1 A transformer	0.001 A to 1.600 A	Increments 0.001 A
for sensitive 5 A transformer	0.005 A to 8.000 A	Increments 0.005 A
for normal 1 A transformer	0.05 A to 36.00 A	Increments 0.01 A
for normal 5 A transformer	0.25 A to 175.00 A	Increments 0.05 A
Measurement tolerance		
sensitive	for $I_{Nom} = 1$ A	3 % of setting value or 1 mA
	for $I_{Nom} = 5$ A	3 % of setting value or 5 mA
		for setting values < 10 mA ca. 20 %
non-sensitive	for $I_{Nom} = 1$ A	3 % of setting value or 15 mA
	for $I_{Nom} = 5$ A	3 % of setting value or 75 mA
Note: Due to the high sensitivity, the linear range of the measuring input I_N with integrated sensitive input transformer is from $0.001 \cdot I_{Nom}$ to $1.6 \cdot I_{Nom}$. For currents greater than $1.6 \cdot I_{Nom}$, correct direction determination can no longer be guaranteed.		

EPTR Setting Ranges / Increments


Pickup current	for $I_N = 1$ A	0.001 A to 2.400 A	Increments 0.001 A
	for $I_N = 5$ A	0.005 A to 7.000 A	

Current at Maximum Time Delay	for $I_N = 1 \text{ A}$	0.001 A to 2.400 A	Increments 0.001 A
	for $I_N = 5 \text{ A}$	0.005 A to 7.000 A	
Current at Minimum Time Delay	for $I_N = 1 \text{ A}$	0.003 A to 4.000 A	Increments 0.001 A
	for $I_N = 5 \text{ A}$	0.015 A to 20.000 A	
Current at Knee Point	for $I_N = 1 \text{ A}$	0.003 A to 4.000 A	Increments 0.001 A
	for $I_N = 5 \text{ A}$	0.015 A to 20.000 A	
Time delay at Knee Point		0.20 s to 100.00 s	Increments 0.01 s
Minimum Time Delay		0.10 s to 30.00 s	Increments 0.01 s
Maximum Time Delay		0.50 s to 300.00 s	Increments 0.01 s
Delay Time T of the whole function		-0.50 s to 30.00 s	Increments 0.01 s

TNP Setting Ranges / Increments

Pickup current	0.05 A to 4.00 A	Increments 0.01 A
Current at Maximum Time Delay	0.05 A to 4.00 A	Increments 0.01 A
Current at Minimum Time Delay	0.05 A to 20.00 A	Increments 0.01 A
Current at Knee Point	0.05 A to 17.00 A	Increments 0.01 A
Time delay at Knee Point	0.20 s to 100.00 s	Increments 0.01 s
Minimum Time Delay	0.10 s to 30.00 s	Increments 0.01 s
Maximum Time Delay	0.50 s to 300.00 s	Increments 0.01 s
Delay Time T of the whole function	-0.50 s to 30.00 s	Increments 0.01 s

EPTR/TNP Tripping Time Characteristic

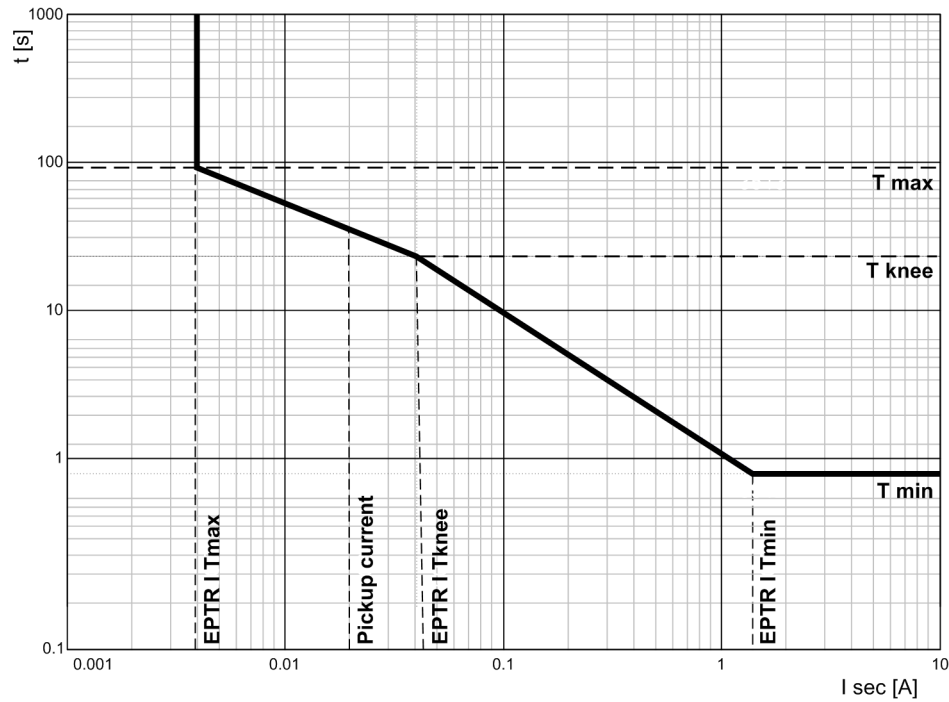

[7SJ80_knickpkt-kennlinie, 1, en_US]

Figure 4-11 Tripping Time Characteristic Curves of the Inverse-Time Ground-Fault Protection with Logarithmic-Inverse Knee-Point Characteristic Curve, Example EPTR

EPTR Trip Time characteristics

for a primary short circuit current between:

0.5 A; 6 A	$t = 88.1 \times (I_r)^{-2/3}$
Maximum Tolerance	$t^+ = 105.7 \times (I_r)^{-2/3}$
Maximum Tolerance	$t^- = 70.5 \times (I_r)^{-2/3}$
6 A; 80 A	$t = 160 \times (I_r)^{-1}$
Maximum Tolerance	$t^+ = 203.7 \times (I_r)^{-1.034}$
Maximum Tolerance	$t^- = 118.3 \times (I_r)^{-0.956}$
80 A; 200 A	$t = 160 \times (I_r)^{-1}$
Maximum Tolerance	$t^+ = 175.8 \times (I_r)^{-1.000}$
Maximum Tolerance	$t^- = 143.9 \times (I_r)^{-1.000}$
200 A; 300 A	$t = 0.80$
Maximum Tolerance	$t^+ = 0.88$
Maximum Tolerance	$t^- = 0.72$
300 A; 1000 A	$t = 0.80$
Maximum Tolerance	$t^+ = 0.58 \times (I_r)^{-0.073}$
Maximum Tolerance	$t^- = 1.26 \times (I_r)^{-0.098}$

EPTR/TNP Times

Pickup Time	Approx. 35 ms
Dropout time	Approx. 45 ms

EPTR/TNP Dropout Setting

Dropout Setting	Approx. 0.95 for $I_p/I_N > 0.005$

EPTR/TNP Tolerance

Pickup/dropout thresholds I_p	$I_{Nom} = 1 \text{ A}$	3 % of setting value or 1 mA
	$I_{Nom} = 5 \text{ A}$	3 % of setting value or 5 mA

4.15 Intermittent Ground Fault Protection

Intermittent Ground Fault Protection

Pickup Threshold			
with I_N	for $I_{Nom} = 1\text{ A}$	0.05 A to 35.00 A	Increments 0.01 A
	for $I_{Nom} = 5\text{ A}$	0.25 A to 175.00 A	Increments 0.01 A
with 3I0	for $I_{Nom} = 1\text{ A}$	0.05 A to 35.00 A	Increments 0.01 A
	for $I_{Nom} = 5\text{ A}$	0.25 A to 175.00 A	Increments 0.01 A
with I_{Ns}	for $I_{Nom} = 1\text{ A}$	0.005 A to 1.500 A	Increments 0.001 A
	for $I_{Nom} = 5\text{ A}$	0.025 A to 7.500 A	Increments 0.001 A
Pickup extension time T_v		0.00 s to 10.00 s	Increments 0.01 s
Ground Fault Accumulation Time T_{sum}		0.00 s to 100.00 s	Increments 0.01 s
Reset Time for Accumulation T_{res}		1 s to 600 s	Increments 1 s
Number of Pickups for Intermittent Ground Fault		2 to 10	Increments 1

Times

Pickup Times	
– Current = 1.25 x Pickup Value	approx. 30 ms
– for $\geq 2 \cdot$ Pickup Value	approx. 22 ms
Dropout Time (without extension time)	approx. 22 ms

Tolerances

Pickup threshold $I_{ie>}$	for $I_{Nom} = 1\text{ A}$	3 % of setting value or 10 mA
	for $I_{Nom} = 5\text{ A}$	3 % of setting value or 50 mA
Times T_v , T_{sum} , T_{res}		1 % of setting value or 10 ms

Influencing Variables

Power supply direct voltage in range $0.8 \leq V_{PS}/V_{PSNim} \leq 1.15$	<1 %
Temperature in range $23.00\text{ °F } (-5\text{ °C}) \leq \Theta_{amb} \leq 131.00\text{ °F } (55\text{ °C})$	<0.5 %/ K
Frequency in range 25 Hz to 70 Hz	<5 % relating to the set time

4.16 Directional intermittent ground fault protection

Setting Ranges / Increments

Pickup threshold $V_{gnd} > / 3V_0 >$	2.0 V .. 100.0 V	Increments 1 V
Monitoring time after pickup detected	0.04 s ... 10.00 s	Increments 0.01 s
Pulse no. for detecting the interm. E/F	2 ... 50	Increments 1

Dropout ratio

Dropout ratio $V_{gnd} > / 3V_0 >$	0,95 or (pickup value - 0,6 V)

Tolerances

Measurement tolerance $V_{gnd} > / 3V_0 >$	3 % of setting value
Times	1 % of setting value or 10 ms

Influencing Variables

Power supply direct voltage in range $0.8 \leq V_{PS}/V_{PSNom} \leq 1.15$	<1 %
Temperature in range $23.00\text{ °F } (-5\text{ °C}) \leq \Theta_{amb} \leq 131.00\text{ °F } (55\text{ °C})$	<0,5 %/ K

4.17 Automatic Reclosing

Number of Reclosures	0 to 9 (separated for phase and ground) Cycles 1 to 4 can be adjusted individually	
The following Protective Functions initiate the AR 79 (no 79 start / 79 start / 79 blocked)	50-3, 50-2, 50-1, 51, 67-3, 67-2, 67-1, 67-TOC 50N-3, 50N-2, 50N-1, 51N, 67N-3, 67N-2, 67N-1, 67- TOC TOCsensitive ground fault detection, unbalanced load, binary input	
Blocking of 79 by	Pick up of protective elements for which 79 blocking is set (see above)	
	3-phase pickup (optional)3-polige Anregung (wahlweise)	
	Binary input	
	last trip command after the reclosing cycle is complete (unsuccessful reclosure)	
	Trip command from the breaker failure	
	Opening the circuit breaker without 79	
	External CLOSE Command	
	Breaker failure monitoring	
Dead Time T_{Dead} (separate for phase and ground and individual for cycles 1 to 4)	0.01 s to 320.00 s	Increments 0.01 s
Extension of Dead Time	using binary input with time monitoring	
Blocking Duration for Manual-CLOSE Detection $T_{BLK Manual Close}$	0.50 s to 320.00 s oder ∞	Increments 0.01 s
Blocking Duration after reclosure $T_{Blocking Time}$	0.50 s to 320.00 s	Increments 0.01 s
Blocking Duration after Dynamic Blocking $T_{BLK DYN}$	0.01 s to 320.00 s	Increments 0.01 s
Start Signal Monitoring Time $T_{Start Mnitor}$	0.01 s to 320.00 s oder ∞	Increments 0.01 s
Circuit Breaker Monitoring Time $T_{CB Monitor}$	0.10 s to 320.00 s	Increments 0.01 s
Maximum Dead Time Extension $T_{Dead Exten}$	0.50 s to 320.00 s oder ∞	Increments 0.01 s
Start delay of dead time	using binary input with time monitoring	
Max. start delay of dead time $T_{Dead Delay}$	0,0 s to 1800,0 s oder ∞	Increments 1,0 s
Operating time $T_{Operate}$	0,01 s to 320,00 s oder ∞	Increments 0,01 s
The following protection functions can be influenced by the automatic reclosing function individually for the cycles 1 to 4 (setting value T=T/ instantaneous T=0/ blocked T=infinite):	50-3, 50-2, 50-1, 51, 67-3, 67-2, 67-1, 67-TOC 50N-3, 50N-2, 50N-1, 51N, 67N-3, 67N-2, 67N-1, 67- TOC	
Additional Functions	Lockout (Final Trip) Circuit breaker monitoring using breaker auxiliary contacts Synchronous closing (optionally with integrated or external synchrocheck,)	

4.18 Fault Locator

Units of Distance Measurement		in Ω primary and secondary in km or miles line length or in % of line length ¹⁾	
Trigger		trip command, Dropout of an Element, or External command via binary input	
Reactance Setting (secondary)	for $I_{Nom} = 1 \text{ A}$	0.0050 to 9.5000 Ω/km	Increments 0.0001
		0.0050 to 15.0000 Ω/Meile	Increments 0.0001
	for $I_{Nom} = 5 \text{ A}$	0.0010 to 1.9000 Ω/km	Increments 0.0001
		0.0010 to 3.0000 Ω/Meile	Increments 0.0001
For the remaining parameters refer to the Power System Data 2.			
When configuring mixed lines, the reactance value must be set for each line section (A1 to A3).			
Measurement Tolerance acc. to VDE 0435, Part 303 for Sinusoidal Measurement Quantities		2,0 % fault location (without intermediate infeed) $30^\circ \leq \varphi_K \leq 90^\circ$ and $V_K/V_{Nom} \geq 0.1$ and $I_K/I_{Nom} \geq 1.0$	

¹⁾ Homogeneous lines or correctly configured line sections are assumed when the fault distance is given in km, miles or %.

4.19 Breaker Failure Protection 50BF

Setting Ranges / Increments

Pickup threshold 50-1 BF	for $I_{Nom} = 1 \text{ A}$	0.05 A to 20.00 A	Increments 0.01 A
	for $I_{Nom} = 5 \text{ A}$	0.25 A to 100.00 A	Increments 0.01 A
Pickup threshold 50N-1 BF	for $I_{Nom} = 1 \text{ A}$	0.05 A to 20.00 A	Increments 0.01 A
	for $I_{Nom} = 5 \text{ A}$	0.25 A to 100.00 A	Increments 0.01 A
Delay time 50 BF Trip timer		0.06 s to 60.00 s or ∞	Increments 0.01 s
Delay time 50 BF-2 Delay		0.06 s to 60.00 s or ∞	Increments 0.01 s

Times

Pickup times	
- for internal start	Included in time delay
- for external start	Included in time delay
Dropout time	approx. 25 ms ¹⁾
Dropout ratio	0.95 (minimal hysteresis between pickup and tripping $\geq 32.5 \text{ mA}$)

¹⁾ A further delay for the current may be caused by compensation in the secondary CT circuit.

Tolerances

Pickup threshold 50-1 BF, 50N-1 BF	for $I_{Nom} = 1 \text{ A}$	3 % of setting value or 15 mA
	for $I_{Nom} = 5 \text{ A}$	3 % of setting value or 75 mA
Time delay 50 BF trip timer		1 % or 20 ms

Influencing Variables for Pickup Values

Auxiliary DC voltage in range $0.8 \leq V_{Aux}/V_{AuxNom} \leq 1.15$	1 %
Temperature in range $-5 \text{ °C (23 °F)} \leq \Theta_{amb} \leq 55 \text{ °C (131 °F)}$	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{Nom} \leq 1.05$ ($f_{Nom} = 50 \text{ Hz or } 60 \text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{Nom} \leq 1.05$	Increased tolerances
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %

4.20 Flexible Protection Functions

Measured Values / Modes of Operation

Three-phase	I, $3I_0$, I_1 , I_2 , I_2/I_1 , V, $3V_0$, V_1 , V_2 , dV/dt, P forward, P reverse, Q forward, Q reverse, cosφ
Single-phase	I, I_N , I_{NN} , I_{N2} , V, V_N , V_x , P forward, P reverse, Q forward, Q reverse, cosφ
Without fixed phase reference	f, df/dt, binary input
Measurement method for I, V	Fundamental, r.m.s. value (true RMS), positive sequence system, negative sequence system, zero sequence system
Pickup on	exceeding threshold value or falling below threshold value

Setting Ranges / Increments

Pickup thresholds:			
Current I, I_1 , I_2 , $3I_0$, I_N	for $I_{Nom} = 1$ A	0.05 A to 40.00 A	Increments 0.01 A
	for $I_{Nom} = 5$ A	0.25 A to 200.00 A	
Relationship I_2/I_1		15 % to 100 %	Increments 1 %
Sensitive ground current I_{Ns}		0.001 A to 1.500 A	Increments 0.001 A
Voltage V, V_1 , V_2 , $3V_0$		2.0 V to 260.0 V	Increments 0.1 V
Displacement voltage V_0		2.0 V to 200.0 V	Increments 0.1 V
Power P, Q	for $I_N = 1$ A	2.0 W to 10000 W	Increments 0.1 W
	for $I_N = 5$ A	10 W to 50000 W	
Power factor cosφ		-0.99 to +0.99	Increments 0.01
Frequency	for $f_{Nom} = 50$ Hz	40.0 Hz to 60.0 Hz	Increments 0.01 Hz
	for $f_{Nom} = 60$ Hz	50.0 Hz to 70.0 Hz	Increments 0.01 Hz
Frequency change df/dt		0.10 Hz/s to 20.00 Hz/s	Increments 0.01 Hz/s
Voltage change dV/dt		4 V/s to 100 V/s	Increments 1 V/s
Dropout ratio > element		1.01 to 3.00	Increments 0.01
Dropout ratio < element		0.70 to 0.99	Increments 0.01
Dropout difference f		0.02 Hz to 1.00 Hz	Increments 0.01 Hz
Pickup delay (standard)		0.00 s to 60.00 s	Increments 0.01 s
Pickup delay for I_2/I_1		0.00 s to 28,800.00 s	Increments 0.01 s
Command delay time		0.00 s to 3,600.00 s	Increments 0.01 s
Dropout delay		0.00 s to 60.00 s	Increments 0.01 s

Fixed Dropout Difference

Dropout difference df/dt	0.1 Hz/s
Dropout difference dV/dt	3 V/s

Function Limits

Power measurement three-phase	for $I_{\text{Nom}} = 1 \text{ A}$	Positive sequence system current $> 0.03 \text{ A}$
	for $I_{\text{Nom}} = 5 \text{ A}$	Positive sequence system current $> 0.15 \text{ A}$
Power measurement single-phase	for $I_{\text{Nom}} = 1 \text{ A}$	Phase current $> 0.03 \text{ A}$
	for $I_{\text{Nom}} = 5 \text{ A}$	Phase current $> 0.15 \text{ A}$
Relationship I_2/I_1 measurement	for $I_{\text{Nom}} = 1 \text{ A}$	Positive or negative sequence system current $> 0.1 \text{ A}$
	for $I_{\text{Nom}} = 5 \text{ A}$	Positive or negative sequence system current $> 0.5 \text{ A}$

Times

Pickup times:	
Current, voltage (phase quantities)	
for 2 times the setting value	approx. 30 ms
for 10 times the setting value	approx. 20 ms
Current, voltage (symmetrical components)	
for 2 times the setting value	approx. 40 ms
for 10 times the setting value	approx. 30 ms
Power	
typical	approx. 120 ms
maximum (small signals and threshold values)	approx. 350 ms
Power factor	300 to 600 ms
Frequency	approx. 100 ms
Frequency change for 1.25 times the setting value	approx. 220 ms
Voltage change dV/dt for 2 times the setting value	approx. 220 ms
Binary input	approx. 20 ms
Dropout times:	
Current, voltage (phase quantities)	$< 20 \text{ ms}$
Current, voltage (symmetrical components)	$< 30 \text{ ms}$
Power	
typical	$< 50 \text{ ms}$
maximum	$< 350 \text{ ms}$
Power factor	$< 300 \text{ ms}$
Frequency	$< 100 \text{ ms}$
Frequency change	$< 200 \text{ ms}$
Voltage change	$< 200 \text{ ms}$
Binary input	$< 10 \text{ ms}$

Tolerances

Pickup thresholds:		
Current	for $I_{\text{Nom}} = 1 \text{ A}$	3% of setting value or 15 mA
	for $I_{\text{Nom}} = 5 \text{ A}$	3% of setting value or 75 mA
Current (symmetrical components)	for $I_{\text{Nom}} = 1 \text{ A}$	4% of setting value or 20 mA
	for $I_{\text{Nom}} = 5 \text{ A}$	4% of setting value or 100 mA
Current (I_2/I_1)		4% of setting value
Voltage		3% of setting value or 0,2 V
Voltage (symmetrical components)		4% of setting value or 0,2 V

Voltage change dV/dt		5 % of setting value or 2 V/s
Power	for $I_{Nom} = 1 \text{ A}$	3% of setting value or 0,5 W
	for $I_{Nom} = 5 \text{ A}$	3% of setting value or 2,5 W
Power factor		3°
Frequency		15 mHz
Frequency change		5% of setting value or 0,05 Hz/s
Times		1% of setting value or 10 ms

Influencing Variables for Pickup Values

Auxiliary DC voltage in range $0.8 \leq V_{Aux}/V_{AuxNom} \leq 1,15$	1 %
Temperature in range $-5 \text{ °C (23 °F)} \leq \Theta_{amb} \leq 55 \text{ °C (131 °F)}$	0.5 %/10 K
Frequency in the range of 25 Hz to 70 Hz	
Frequency in the range of $0.95 \leq f/f_{Nom} \leq 1.05$ ($f_{Nom} = 50 \text{ Hz or } 60 \text{ Hz}$)	1 %
Frequency outside range $0.95 \leq f/f_{Nom} \leq 1.05$	Increased tolerances
Harmonics	
- up to 10 % 3rd harmonic	1 %
- up to 10 % 5th harmonic	1 %

4.21 Synchrocheck 25

Modes of Operation

- Synchrocheck

Additional Release Conditions

- Live bus / dead line,
- Dead bus / live line,
- Dead bus and dead line
- Bypassing

Voltages

Maximum operating voltage $V_{\max}$	20 V to 140 V (phase-to-phase)	Increments 1 V
Minimum operating voltage $V_{\min}$	20 V to 125 V (phase-to-phase)	Increments 1 V
$V<$ for dead line	1 V to 60 V (phase-to-phase)	Increments 1 V
$V>$ for live line	20 V to 140 V (phase-to-phase)	Increments 1 V
Primary transformer rated voltage $V2N$	0.10 kV to 800.00 kV	Increments 0.01 kV
Tolerances	2 % of pickup value or 2 V	
Dropout Ratios	approx. 0.9 ($V>$) or 1.1 ($V<$)	

Permissible Difference

Voltages differences $V2>V1$; $V2<V1$	0.5 V to 50.0 V (phase-to-phase)	Increments 0.1 V
Tolerance	1 V	
Frequency Difference $f2>f1$; $f2<f1$	0.01 Hz to 2.00 Hz	Increments 0.01 Hz
Tolerance	20 mHz	
Angle Difference $\alpha2 > \alpha1$; $\alpha2 < \alpha1$	2° to 80°	Increments 1°
Tolerance	2°	
Max. angle error	5° for $\Delta f \leq 1$ Hz 10° for $\Delta f > 1$ Hz	

Matching

Vector group matching via angle	0° to 360°	Increments 1°
Different voltage transformer $V1/V2$	0.50 to 2.00	Increments 0.01

Times

Minimum Measuring Time	approx. 80 ms	
Maximum duration $T_{\text{SYN DURATION}}$	0.01 s to 1200.00 s or ∞ (disabled)	Increments 0.01 s
Monitoring Time $T_{\text{SUP VOLTAGE}}$	0.00 s to 60.00 s	Increments 0.01 s
Tolerance of all times	1 % of setting value or 10 ms	

Measured Values of the Synchronism and Voltage Check

Reference voltage V1 - Range - Tolerance ¹⁾	in kV primary, in V secondary or in % V_{Nom} 10 % to 120 % of V_{Nom} ≤ 1 % of measured value, or 0,5 % V_{Nom}
Voltage to be synchronized V2 - Range - Tolerance ¹⁾	in kV primary, in V secondary or in % V_{Nom} 10 % to 120 % of V_{Nom} ≤ 1 % of measured value, or 0,5 % V_{Nom}
Frequency of the voltage V1 - Range - Tolerance ¹⁾	f1 in Hz $f_{Nom} \pm 5$ Hz 20 mHz
Frequency of the voltage V2 - Range - Tolerance ¹⁾	f2 in Hz $f_{Nom} \pm 5$ Hz 20 mHz
Voltage difference V2-V1 - Range - Tolerance ¹⁾	in kV primary, in V secondary or in % V_N 10 % bis 120 % of V_N ≤ 1 % of measured value, or 0,5 % V_N
Frequency difference f2-f1 - Range - Tolerance ¹⁾	in mHz $f_{Nom} \pm 5$ Hz 20 mHz
Angle difference $\lambda_2 - \lambda_1$ - Range - Tolerance ¹⁾	in ° 0 to 180° 0,5°
¹⁾ at nominal frequency	

4.22 User-defined Functions (CFC)

Function Blocks and Their Possible Assignments to Task Levels

Function block	Explanation	Task level			
		MW_ BEARB	PLC1_ BEARB	PLC_ BEARB	SFS_ BEARB
ABSVALUE	Magnitude Calculation	X	—	—	—
ADD	Addition	X	X	X	X
ALARM	Alarm	X	X	X	X
AND	AND - Gate	X	X	X	X
BLINK	Blink block	X	X	X	X
BOOL_TO_CO	Boolean to Control (conversion)	—	X	X	—
BOOL_TO_DI	Boolean to Double Point (conversion)	—	X	X	X
BOOL_TO_IC	Bool to Internal SI, Conversion	—	X	X	X
BUILD_DI	Create Double Point Annunciation	—	X	X	X
CMD_CANCEL	Cancel command	X	X	X	X
CMD_CHAIN	Switching Sequence	—	X	X	—
CMD_INF	Command Information	—	—	—	X
COMPARE	Metered value comparison	X	X	X	X
CONNECT	Connection	—	X	X	X
COUNTER	Counter	X	X	X	X
DI_GET_STATUS	Decode status of double-point indication	X	X	X	X
DI_SET_STATUS	Generate double-point indication with status	X	X	X	X
D_FF	D- Flipflop	—	X	X	X
D_FF_MEMO	Status Memory for Restart	X	X	X	X
DI_TO_BOOL	Double Point to Boolean (conversion)	—	X	X	X
DINT_TO_REAL	Adaptor	X	X	X	X
DIST_DECODE	Convert double-point indication with status into four single-point indications with status	X	X	X	X
DIV	Division	X	X	X	X
DM_DECODE	Decode Double Point	X	X	X	X
DYN_OR	Dynamic OR	X	X	X	X
INT_TO_REAL	Conversion	X	X	X	X
IO_UNIT	SICAM I/O Unit		X	X	
LIVE_ZERO	Live-zero, non-linear Curve	X	—	—	—
LONG_TIMER	Timer (max.1193h)	X	X	X	X
LOOP	Feedback Loop	X	X	—	X
LOWER_SETPOINT	Lower Limit	X	—	—	—
MUL	Multiplication	X	X	X	X
MV_GET_STATUS	Decode status of a value	X	X	X	X
MV_SET_STATUS	Set status of a value	X	X	X	X
NAND	NAND - Gate	X	X	X	X
NEG	Negator	X	X	X	X
NOR	NOR - Gate	X	X	X	X

Function block	Explanation	Task level			
		MW_ BEARB	PLC1_ BEARB	PLC_ BEARB	SFS_ BEARB
OR	OR - Gate	X	X	X	X
REAL_TO_DINT	Adaptor	X	X	X	X
REAL_TO_INT	Conversion	X	X	X	X
REAL_TO_UINT	Conversion	X	X	X	X
RISE_DETECT	Edge detector	X	X	X	X
RS_FF	RS- Flipflop	—	X	X	X
RS_FF_MEMO	RS- Flipflop with status memory	—	X	X	X
SQUARE_ROOT	Root Extractor	X	X	X	X
SR_FF	SR- Flipflop	—	X	X	X
SR_FF_MEMO	SR- Flipflop with status memory	—	X	X	X
ST_AND	AND gate with status	X	X	X	X
ST_NOT	Inverter with status	X	X	X	X
ST_OR	OR gate with status	X	X	X	X
SUB	Substraction	X	X	X	X
TIMER	Timer	—	X	X	—
TIMER_SHORT	Simple timer	—	X	X	—
UINT_TO_REAL	Conversion	X	X	X	X
UPPER_SETPOINT	Upper Limit	X	—	—	—
X_OR	XOR - Gate	X	X	X	X
ZERO_POINT	Zero Supression	X	—	—	—

Device-specific CFC Blocks

Table 4-1 ASWITCH – This block is used to switch between two REAL inputs (RMS values)

	Name	Type	Description	Default function						
Input	SWITCH	BOOL	Analog value selection	FALSE						
	IN1	REAL	Analog value	0.0						
	IN2	REAL	Analog value	0.0						
Output	OUT	REAL	Selected analog value							
Task levels:		Recommendation: Into task levels PLC1_BEARB and PLC_BEARB, because these levels are directly triggered. Note: If you use thi block in the task levels MW_BEARB and SFS_BEARB, a change of the SWITCH signal is only recognized if the signal lasts longer than the processing cycle of the task level.								
Behavior of inputs and outputs:		<table><tr><th>SWITCH</th><th>OUT</th></tr><tr><td>0</td><td>IN1</td></tr><tr><td>1</td><td>IN2</td></tr></table>			SWITCH	OUT	0	IN1	1	IN2
SWITCH	OUT									
0	IN1									
1	IN2									

General Limits

Description	Limit	Comment
Maximum number of all CFC charts considering all task levels	32	If the limit is exceeded, the device rejects the parameter set with an error message, restores the last valid parameter set and restarts using that parameter set.
Maximum number of all CFC charts considering one task level	16	When the limit is exceeded, an error message is output by the device. Consequently, the device starts monitoring. The red ERROR-LED lights up.
Maximum number of all CFC inputs considering all charts	400	When the limit is exceeded, an error message is output by the device. Consequently, the device starts monitoring. The red ERROR-LED lights up.
Maximum number of reset-resistant flipflops D_FF_MEMO	350	When the limit is exceeded, an error message is output by the device. Consequently, the device starts monitoring. The red ERROR-LED lights up.

Device-Specific Limits

Description	Limit	Comment
Maximum number of synchronous changes of chart inputs per task level	165	When the limit is exceeded, an error message is output by the device. Consequently, the device starts monitoring. The red ERROR-LED lights up.
Maximum number of chart outputs per task level	150	

Additional Limits

Additional limits ¹⁾ for the following CFC blocks:		
Task Level	Maximum Number of Modules in the Task Levels	
	TIMER ²⁾ ³⁾	TIMER_SHORT ²⁾ ³⁾
MW_BEARB	—	—
PLC1_BEARB	15	30
PLC_BEARB		
SFS_BEARB	—	—
¹⁾ When the limit is exceeded, an error message is issued by the device. Consequently, the device starts monitoring. The red ERROR-LED lights up. ²⁾ The following condition applies for the maximum number of timers: $(2 \cdot \text{number of TIMER} + \text{number of TIMER\_SHORT}) < 30$. TIMER and TIMER_SHORT hence share the available timer resources within the frame of this inequation. The limit does not apply to the LONG_TIMER. ³⁾ The time values for the blocks TIMER and TIMER_SHORT must not be selected shorter than the time resolution of the device of 10 ms, as then, the blocks will not then start with the starting pulse.		

Maximum Number of TICKS in the Task Levels

Task level	Limit in TICKS ¹⁾
MW_BEARB (measured value processing)	10000
PLC1_BEARB (slow PLC processing)	12000
PLC_BEARB (fast PLC processing)	600
SFS_BEARB (interlocking)	10000

¹⁾ When the sum of TICKS of all blocks exceeds the limits mentioned before, an error message is output in the CFC.

Processing Times in TICKS for the Individual Elements

Individual element		Number of TICKS
Block, basic requirement		5
Each input from the 3rd additional input on for generic modules		1
Combination with input signal border		6
Combination with output signal border		7
Additionally for each chart		1
Arithmetic	ABS_VALUE	5
	ADD	26
	SUB	26
	MUL	26
	DIV	54
	SQUARE_ROOT	83
Base logic	AND	5
	CONNECT	4
	DYN_OR	6
	NAND	5
	NEG	4
	NOR	5
	OR	5
	RISE_DETECT	4
	X_OR	5
Information status	SI_GET_STATUS	5
	CV_GET_STATUS	5
	DI_GET_STATUS	5
	MV_GET_STATUS	5
	SI_SET_STATUS	5
	DI_SET_STATUS	5
	MV_SET_STATUS	5
	ST_AND	5
	ST_OR	5
	ST_NOT	5
Memory	D_FF	5
	D_FF_MEMO	6
	RS_FF	4
	RS_FF_MEMO	4
	SR_FF	4
	SR_FF_MEMO	4
Control commands	BOOL_TO_CO	5
	BOOL_TO_IC	5
	CMD_INF	4
	CMD_INF_EXE	4
	CMD_CHAIN	34
	CMD_CANCEL	3
	LOOP	8
Type converter	BOOL_TO_DI	5
	BUILD_DI	5
	DI_TO_BOOL	5

Individual element		Number of TICKS
	DM_DECODE	8
	DINT_TO_REAL	5
	DIST_DECODE	8
	UINT_TO_REAL	5
	REAL_TO_DINT	10
	REAL_TO_UINT	10
Comparison	COMPARE	12
	LOWER_SETPPOINT	5
	UPPER_SETPPOINT	5
	LIVE_ZERO	5
	ZERO_POINT	5
Metered value (counter)	COUNTER	6
Time and clock pulse	TIMER	5
	TIMER_LONG	5
	TIMER_SHORT	8
	ALARM	21
	BLINK	11
Other	IO_UNIT	17

Routable in Matrix

In addition to the defined preassignments, indications and measured values can be freely routed to buffers, preconfigurations can be removed.

4.23 Auxiliary Functions

Operational Measured Values

Currents I_A, I_B, I_C Positive sequence component I_1 Negative sequence component I_2 I_N or $3I_0$		in A (kA) primary and in A secondary or in % I_{Nom}
	Range Tolerance ¹⁾	10 % to 150 % I_{Nom} 1.5 % of measured value or 1 % I_{Nom} and between 151 % and 200 % I_{Nom} 3 % of measured value
Voltages (phase-to-ground) $V_{A-N}, V_{B-N}, V_{C-N}$ Voltages (phase-to-phase) $V_{A-B}, V_{B-C}, V_{C-A}, V_{SYN}$ V_N, V_{ph-N}, V_x or V_0 Positive sequence component V_1 Negative sequence component V_2		in kV primary, in V secondary or in % V_{Nom}
	Range Tolerance ¹⁾	10 % to 120 % of V_{Nom} 1.5 % of measured value or 0.5 % V_{Nom}
S, apparent power		in kVAr (MVAR or GVAR) primary and in % S_{Nom}
	Range Tolerance ¹⁾	0 % to 120 % S_{Nom} 1.5 % of S_{Nom} for V/V_{Nom} and $I/I_{Nom} = 50$ to 120 %
P, Active power		with sign, total and phase-segregated in kW (MW or GW) primary and in % S_{Nom}
	Range Tolerance ¹⁾	0 % to 120 % S_{Nom} 2 % of S_{Nom} for V/V_{Nom} and $I/I_{Nom} = 50$ to 120 % and $ \cos \varphi = 0.707$ to 1 with $S_{Nom} = \sqrt{3} \cdot V_{Nom} \cdot I_{Nom}$
Q, reactive power		with sign, total and phase-segregated in kVAr (MVar or GVar) primary and in % S_{Nom}
	Range Tolerance ¹⁾	0 % to 120 % S_{Nom} 2 % of S_{Nom} for V/V_{Nom} and $I/I_{Nom} = 50$ to 120 % and $ \sin \varphi = 0.707$ to 1 with $S_{Nom} = \sqrt{3} \cdot V_{Nom} \cdot I_{Nom}$
cos φ , power factor		total and phase-segregated
	Range Tolerance ¹⁾	-1 to +1 2 % for $ \cos \varphi \geq 0.707$
Frequencies f		in Hz
	Range Tolerance ¹⁾	$f_{Nom} \pm 5$ Hz 20 mHz
Temperature overload protection Θ / Θ_{Trip}		in %

	Range Tolerance ¹⁾	0 % to 400 % 5 % class accuracy acc. to IEC 60255-8
Synchrocheck function 25		see Section (Synchrocheck)
Currents of sensitive ground fault detection (total, real, and reactive current) I_{Ns} , I_{Nsreal} , $I_{Nsreactive}$		in A (kA) primary and in mA secondary
	Range Tolerance ¹⁾	0 mA to 1600 mA or 0 A to 8 A for $I_{Nom} = 5$ A 3 % of measured value or 1 mA
Phase angle between zero sequence voltage and sensitive ground current ϕ ($3V_0$, I_{Ns})		in °
	Range Tolerance ¹⁾	- 180° to + 180° $\pm 1^\circ$

¹⁾ at nominal frequency

²⁾ Displaying of $\cos \phi$ as of I/I_{Nom} and V/V_{Nom} greater than 10%

Long-Term Mean Values

Time Window	5, 15, 30 or 60 minutes
Frequency of Updates	adjustable
Long-Term Averages	
of Currents of Real Power of Reactive Power of Apparent Power	I_{Admd} , I_{Bdmd} , I_{Cdmd} , I_{1dmd} in A (kA) P_{dmd} in W (kW, MW) Q_{dmd} in VAR (kVAR, MVAR) S_{dmd} in VAR (kVAR, MVAR)

Min./Max. Memory

Storage of Measured Values	with date and time
Reset automatic	Time of day adjustable (in minutes, 0 to 1439 min) Time frame and starting time adjustable (in days, 1 to 365 days, and ∞)
Manual Reset	Using binary input Using keypad Via communication
Min/Max Values for Current	I_A , I_B , I_C ; I_1 (positive sequence component)
Min/Max Values for Voltages	V_{A-N} , V_{B-N} , V_{C-N} ; V_1 (positive sequence component); V_{A-B} , V_{B-C} , V_{C-A}
Min/Max Values for Power	S , P ; Q , $\cos \phi$; frequency
Min/Max Values for Overload Protection	Θ/Θ_{TRIP}
Min/Max Values for Mean Values	I_{Admd} , I_{Bdmd} , I_{Cdmd} ; I_{1dmd} (positive sequence component); S_{dmd} , P_{dmd} , Q_{dmd}

Fuse Failure Monitor

Setting range of the displacement voltage 3V0 above which voltage failure is detected	10 - 100 V
Setting range of the ground current above which no voltage failure is assumed	0.1 - 1 A for $I_{Bdmd} = 1 \text{ A}$ 0.5 - 5A for $I_{Bdmd} = 5 \text{ A}$
Setting range of the pickup threshold $I >$ above which no voltage failure is assumed	0.1 - 35 A for $I_{Bdmd} = 1 \text{ A}$ 0.5 - 175 A for $I_{Bdmd} = 5 \text{ A}$
Measuring voltage monitoring	depends on the MLFB and configuration with measured and calculated values V_N and I_N

Broken-wire Monitoring of Voltage Transformer Circuits

suited for single-, two- or three-pole broken-wire detection of voltage transformer circuits; only for connection of phase-ground voltages

Local Measured Value Monitoring

Current asymmetry	$I_{\max}/I_{\min} > \text{symmetry factor, for } I > I_{\text{limit}}$
Voltage asymmetry	$V_{\max}/V_{\min} > \text{symmetry factor, for } V > V_{\text{limit}}$
Current sum	$ i_A + i_B + i_C + k_I \cdot i_E > \text{limit value, with}$ $k_I = \frac{I_{\text{gnd-CT PRIM}}/I_{\text{gnd-CT SEC}}}{\text{CT PRIMARY/CT SECONDARY}}$
Current phase sequence	Clockwise (ABC) / counter-clockwise (ACB)
Voltage phase sequence	Clockwise (ABC) / counter-clockwise (ACB)

Fault Logging

Recording of indications of the last 8 power system faults
Recording of indications of the last 3 power system ground faults

Time Allocation

Resolution for Event Log (Operational Annunciations)	1 ms
Resolution for Trip Log (Fault Annunciations)	1 ms
Maximum Time Deviation (Internal Clock)	0.01 %
Battery	Lithium battery 3 V/1 Ah, Typ CR 1/2 AA Message "Battery Fault" for insufficient battery charge

Fault Recording

maximum of 8 fault records saved; memory maintained by buffer battery in the case of auxiliary voltage failure	
Recording time	5 s per fault record, in total up to 18 s at 50 Hz (max. 15 s at 60 Hz)
Intervals at 50 Hz	1 instantaneous value each per 1.0 ms
Intervals at 60 Hz	1 instantaneous value each per 0.83 ms

Energy Counter

Meter Values for Energy Wp, Wq (real and reactive energy)	in kWh (MWh or GWh) or in kVARh (MVARh or GVARh)
Range	28 Bit or 0 to 2 68 435 455 decimal for IEC 60870-5-103 (VDEW protocol) 31 Bit or 0 to 2 147 483 647 for other protocols (other than VDEW) $\leq 2\%$ for $I > 0.1 I_N$, $V > 0.1 V_N$ and Tolerance ¹⁾ $ \cos \varphi \geq 0.707$

¹⁾ at nominal frequency

Switching Statistics

Saved Number of Trips	up to 9 digits
Number of Automatic Reclosing Commands (segregated according to 1st and $\geq$ 2nd cycle)	up to 9 digits
Accumulated Interrupted Current (segregated according to pole)	up to 4 digits

Operating Hours Counter

Display Range	Up to 7 digits
Criterion	Overshoot of an adjustable current threshold (element 50-1, BkrClosed I MIN)

Circuit Breaker Maintenance

Calculation methods	on true r.m.s value basis: ΣI , ΣI^x , $2P$; on instantaneous value basis: I^2t
Acquisition/conditioning of measured values	phase-selective
Evaluation	one threshold per subfunction
Number of saved statistic values	up to 13 digits

Trip Circuit Supervision

With one or two binary inputs

Commissioning Aids

- Phase rotation field check - Operational measured values - Circuit breaker test by means of control function - Creation of a test measurement report - Creation of messages

Clock

Time synchronization		Binary input Communication
Modes of operation for time tracking		
No.	Mode of operation	Explanations
1	Internal	Internal synchronization using RTC (presetting)
2	IEC 60870-5-103	External synchronization using port B (IEC 60870-5-103)

3	Pulse via binary input	External synchronization with pulse via binary input
4	Fieldbus (DNP (serial or DNP3 TCP), Modbus, IEC 60870-5-103 redundant)	External synchronization using field bus
5	SNTP (IEC 61850, DNP3 TCP, PROFINET IO)	External synchronization using port B (IEC 61850)
-	SNTP (no IEC61850)	External synchronization via port A Parameterization via device; notes under 2.1.2.2 Setting Notes

Setting Group Change Option of the Functional Settings

Number of Available Setting Groups	4 (parameter group A, B, C and D)
Switchover Performed	using the keypad DIGSI using the front PC port Protocol using port B Binary Input

IEC 61850 GOOSE (inter-relay communication)

The GOOSE communication service of IEC 61850 is qualified for switchgear interlocking. The runtime of GOOSE messages with the protection relay picked up depends on the number of connected IEC 61850 clients.


As from version V4.6 of the devices, applications with protective functions have to be checked with regard to their required runtime. In individual cases, the manufacturer has to be consulted with regard to the requirements to ensure that the application functions safely.

4.24 Switching Device Control

Number of Controlled Switching Devices	Depends on the number of binary inputs and outputs available
Interlocking	Freely programmable interlocking
Messages	Single command / double command
Control Commands	Single command / double command
Switching Command to Circuit Breaker	1-, 1½ - and 2-pole
Programmable Logic Controller	PLC logic, graphic input tool
Local Control	Control via menu control assignment of function keys
Remote Control	Using Communication Interfaces Using a substation automation and control system (e.g. SICAM) Using DIGSI (e.g. via Modem)

4.25 Dimensions

4.25.1 Panel Flush and Cubicle Mounting (Housing Size 1/6)

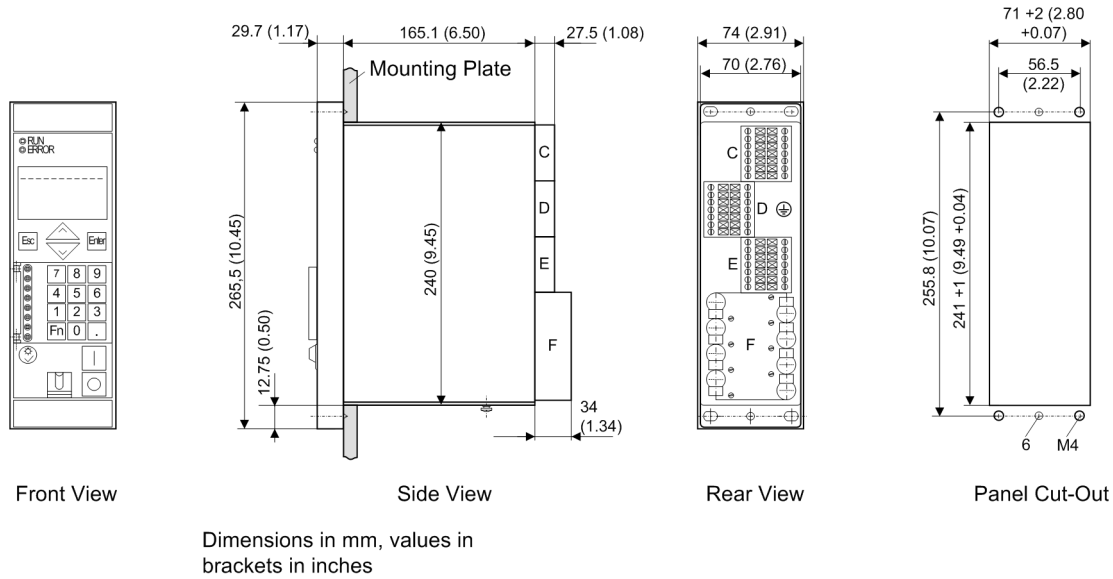


[abmess-sechststl-gehaeuse-7sx80-060606, 1, en_US]

Figure 4-12 Dimensional drawing of a 7SJ80 for panel flush or cubicle mounting (housing size 1/6)

Note: A set of mounting brackets (consisting of upper and lower mounting rail) (order no. C73165-A63-D200-1) is required for cubicle mounting. When using the Ethernet interface, it may be necessary to rework the lower mounting rail.

Provide for sufficient space at the device bottom side or below the device to accommodate the cables of the communication modules.




4.25.3 Bottom view



Figure 4-14 Bottom view of a 7SJ80 (housing size $1\frac{1}{6}$)

4.25.4 Varistor

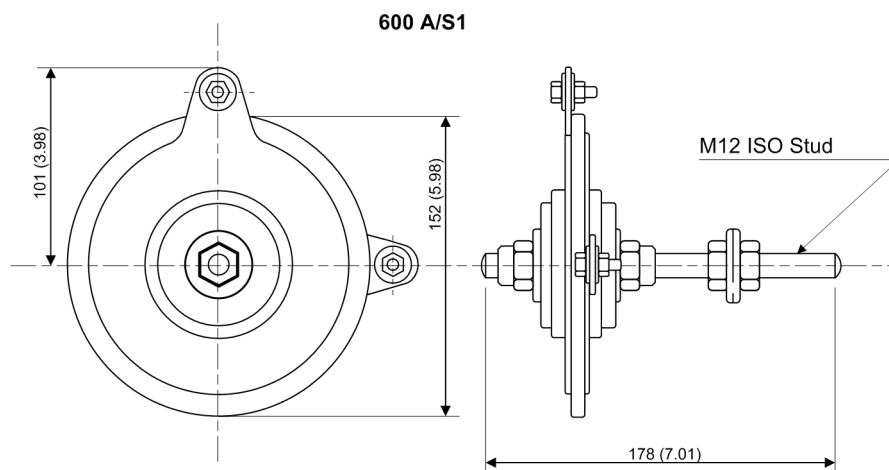

Dimensions in mm, values in brackets in inches

[varistor-20071105, 1, en_US]

Figure 4-15 Dimensional drawing of the varistor for voltage limiting in high-impedance differential protection

A Ordering Information and Accessories

A.1	Ordering Information 7SJ80	428
A.2	Accessories	433

A.1 Ordering Information 7SJ80

Multifunctional protection device with control						6	7		8	9	10	11	12		13	14	15	16		Zusatz
	7	S	J	8	0			–						–		F			+	

Number of binary inputs and outputs	Pos. 6
Housing 1/6 19" 4 x I, 3 BI, 5 BO (2 changeover contacts), 1 life status contact	1
Housing 1/6 19" 4 x I, 7 BI, 8 BO (2 changeover contacts), 1 life status contact	2
Housing 1/6 19" 4 x I, 3x V, 3 BI, 5 BO (2 changeover contacts), 1 life status contact	3
Housing 1/6 19" 4 x I, 3 x V, 7 BI, 8 BO (2 changeover contacts), 1 life status contact	4
Housing 1/6 19" 4 x I, 11 BI, 5 BO (2 changeover contacts), 1 life status contact	7
Housing 1/6 19" 4 x I, 3 x V, 11 BI, 5 BO (2 changeover contacts), 1 life status contact	8

Measuring inputs (4 x I)	Pos. 7
$I_{ph} = 1\text{ A} / 5\text{ A}$, $I_n = 1\text{ A} / 5\text{ A}$	1
$I_{ph} = 1\text{ A} / 5\text{ A}$, I_{ns} (sensitive) = 0.001 A to 1.6 A / 0.005 A to 8 A	2

Auxiliary voltage (power supply, pilot voltage)	Pos. 8
DC 24 V / 48 V	1
DC 60 V / 110 V / 125 V / 220 V / 250 V, AC 115 V, AC 230 V	5

Construction	Pos. 9
Surface-mounting case, screw-type terminals	B
Flush mounting case, screw-type terminals	E

Region-specific default settings / function versions and language default settings	Pos. 10
Region DE, IEC, language German (language can be changed, standard front panel)	A
Region world, IEC/ANSI, language English (language can be changed), standard front panel	B
Region US, ANSI, language US-English (language can be changed), US front panel	C
Region FR, IEC/ANSI, language French (language can be changed), standard front panel	D
Region world, IEC/ANSI, language Spanish (language can be changed), standard front panel	E
Region world, IEC/ANSI, language Italian (language can be changed), standard front panel	F
Region RUS, IEC/ANSI, language Russian (language can be changed), standard front panel	G
Region CHN, IEC/ANSI, language Chinese (language can not be changed), standard front panel Chinese	K

Port B (bottom side of device, rear)	Pos. 11
not equipped	0
IEC60870-5-103 or DIGSI4/Modem, electrical RS232	1
IEC60870-5-103 or DIGSI4/Modem, electrical RS485	2
IEC60870-5-103 or DIGSI4/Modem, optical 820nm, ST connector	3
For further interface options see Additional Information in the following	9

Additional information for additional ports (bottom side of device, rear, port B)	Supplementary
Profibus DP Slave, electrical RS485	+ L 0 A
Profibus DP Slave, 820 nm, optical double ring, ST connector	+ L 0 B
Modbus, electrical RS485	+ L 0 D
Modbus, optical 820 nm, ST connector	+ L 0 E
DNP3.0, electrical RS485	+ L 0 G
DNP3.0, optical 820 nm, ST connector	+ L 0 H

Additional information for additional ports (bottom side of device, rear, port B)		Supplementary
IEC 60870-5-103 Protocol, redundant, electrical RS485, RJ45 connector		+ L 0 P
IEC 61850, 100Mbit Ethernet electrical, double, RJ45 connector		+ L 0 R
IEC 61850 100 Mbit Ethernet optical, double, LC connector		+ L 0 S
DNP3 TCP, 100 Mbit Ethernet electrical, double, RJ45 connector		+ L 2 R
DNP3 TCP, 100 Mbit Ethernet optical, double, LC connector		+ L 2 S
PROFINET 100Mbit Ethernet electrical, double, RJ45 connector		+ L 3 R
PROFINET 100 Mbit Ethernet optical, double, LC connector		+ L 3 S
IEC 60870-5-104 and IEC 61850, 100Mbit Ethernet, electrical, double, RJ45 connector		+ L 4 R
IEC 60870-5-104 and IEC 61850, 100Mbit Ethernet, optical, double, LC connector		+ L 4 S
MODBUS TCP and IEC 61850, 100Mbit Ethernet, electrical, double, RJ45 connector		+ L 5 R
MODBUS TCP and IEC 61850, 100Mbit Ethernet, optical, double, LC connector		+ L 5 S

Converter	Order number	Use
SIEMENS OLM ¹⁾	6GK1502-2CB10	for single ring
SIEMENS OLM ¹⁾	6GK1502-3CB10	for double ring

¹⁾ The converter requires an operating voltage of 24 VDC. If the available operating voltage is > 24 VDC the additional power supply 7XV5810-0BA00 is required.

Port A (bottom side of device, front)	Pos. 12
not equipped	0
with Ethernet interface (DIGSI interface, I/O unit connection, not IEC61850), RJ45 connector	6

Measurement / Fault Recording	Pos. 13
With fault recording	1
With fault recording, average values, min/max values	3

Functions			Pos. 15
Name	ANSI-No.	Description	D
Basic function (included in all versions) ³⁾	—	Control	
	50/51	Time overcurrent protection phase 50-1, 50-2, 50-3, 51	
	50N/51N	Time overcurrent protection ground 50N-1, 50N-2, 50N-3, 51N	
	50N(s)/ 51N(s)	Ground fault protection/ ground short-circuit protection 50Ns-1, 50Ns-2, 51Ns ¹⁾	
	—	Intermittent ground fault protection	
	87N	High-impedance ground fault differential protection (87N (REF) only available with sensitive ground current input (position 7 = 2)	
	49	Thermal overload protection	
	74TC	Trip circuit supervision	
	46	Negative sequence overcurrent protection	
	50BF	Breaker failure protection 50BF	
	37	Undercurrent surveillance	
	86	Lock out	
	—	Cold-load pickup Monitoring functions Circuit breaker control Flexible protection functions (parameters from current) Inrush restraint	
Basic design ⁴⁾ + ground fault direction detection + voltage protection + frequency protection	51V	Voltage-controlled inverse-time overcurrent protection	B
	67N	Directional ground fault protection 67N-1, 67N-2, 67N-3, 67N-TOC	
	67N(s)	Directional ground fault protection/ground short circuit protection 67Ns-1, 67Ns-2, 67Ns-TOC ¹⁾	
	64/59N	Displacement voltage	
	27/59	Undervoltage / overvoltage	
	81 U/O	Underfrequency / overfrequency, f< ,f>	
	47	Phase sequence	
	32/55/81R/ 27R/59R	Flexible protection functions (parameters from current and voltage): Voltage protection, power protection, power factor protection, frequency change protection and voltage change protection	

Functions			Pos. 15
Basic design ⁴⁾ + ground fault direction detection + direction determination for phase + voltage protection + frequency protection	51V	Voltage-controlled inverse-time overcurrent protection	C
	67	Direction determination for overcurrent phases 67-1, 67- 2, 67-3, 67-TOC	
	67N	Directional ground fault protection 67N-1, 67N-2, 67N-3, 67N-TOC	
	67N(s)	Directional ground fault protection/ground short circuit protection 67Ns-1, 67Ns-2, 67Ns-TOC ¹⁾	
	64/59N	Displacement voltage	
	27/59	Undervoltage / overvoltage	
	81 U/O	Underfrequency / overfrequency, $f<$, $f>$	
	47	Phase sequence	
	32/55/81R/ 27R/59R	Flexible protection functions (parameters from current and voltage): Voltage protection, power protection, power factor protection, frequency change protection and voltage change protection	
Basic design ⁴⁾ + ground fault direction detection + direction determination for phase + voltage protection + frequency protection + QU protection + directional intermittent ground fault protection	51V	Voltage-controlled inverse-time overcurrent protection	F
	67	Direction determination for overcurrent phases 67-1, 67- 2, 67-3, 67-TOC	
	67N	Directional ground fault protection 67N-1, 67N-2, 67N-3, 67N-TOC	
	67N(s)	Directional ground fault protection/ground short circuit protection 67Ns-1, 67Ns-2, 67Ns-TOC ¹⁾	
	67Ns	Directional intermittent ground fault protection ²⁾	
	64/59N	Displacement voltage	
	27/59	Undervoltage / overvoltage	
	81 U/O	Underfrequency / overfrequency, $f<$, $f>$	
	—	Undervoltage-controlled reactive power protection ($Q>/U<$)	
	47	Phase sequence	
	32/55/81R/ 27R/59R	Flexible protection functions (parameters from current and voltage): Voltage protection, power protection, power factor protection, frequency change protection and voltage change protection	

Functions			Pos. 15
Basic design 5) + direction determination for phase + voltage protection + frequency protection + synchrocheck	51V	Voltage-controlled inverse-time overcurrent protection	Q
	67	Direction determination for overcurrent phases 67-1, 67- 2, 67-3, 67-TOC	
	27/59	Undervoltage / overvoltage	
	81 U/O	Underfrequency / overfrequency, f< ,f>	
	47	Phase sequence	
	25	Synchronism check	
	81R/27R/5 9R	Flexible protection functions (parameters from current and voltage): Voltage protection, power protection, power factor protection, frequency change protection and voltage change protection	
¹⁾ depending on the ground current input at position 7, the function works either as ground fault protection (sensitive input) or as ground short circuit protection (normal Ie input)			
²⁾ only with sensitive input, Position 7=2			
³⁾ only deliverable with position 6 = 1, 2 or 7			
⁴⁾ only deliverable with position 6 = 3, 4 (3 x V) or 8			
⁵⁾ only deliverable with position 6 = 3, 4 (3 x V) or 8 and position 16 = 0 or 1			

Automatic reclosing function 79AR / Fault locator 21FL			Pos. 16
		No 79, no fault locator	0
	79	With 79	1
	21FL	With fault locator ¹⁾	2
	79, 21FL	With AR, with fault locator ¹⁾	3
¹⁾ only deliverable with position 6 = 3, 4 or 8			

Conformal Coating	Supplementary
for 7SJ801, 7SJ803	+Z Y 15
for 7SJ802, 7SJ804, 7SJ807, 7SJ808	+Z Y 16

A.2 Accessories

Exchangeable interface modules

Name	Order number
RS232	C53207-A351-D641-1
RS485	C53207-A351-D642-1
FO 820 nm	C53207-A351-D643-1
Profibus DP RS485	C53207-A351-D611-1
Profibus DP double ring	C53207-A351-D613-1
Modbus RS 485	C53207-A351-D621-1
Modbus 820 nm	C53207-A351-D623-1
DNP 3.0 RS 485	C53207-A351-D631-1
DNP 3.0 820 nm	C53207-A351-D633-1
Ethernet electrical (EN 100)	C53207-A351-D675-2
Ethernet optical (EN 100), 4 ST connectors	C53207-A351-D678-1
Ethernet electrical (EN 100, PROFINET IO)	C53207-A351-D688-1
Ethernet optical (EN 100, PROFINET IO)	C53207-A351-D689-1
Ethernet electrical (EN 100, DNP3 TCP)	C53207-A351-D684-1
Ethernet optical (EN 100, DNP3 TCP), multimode	C53207-A351-D686-1
Ethernet optical (EN100, DNP3 TCP), single mode, 24 km	C53207-A351-D690-1
Ethernet electrical (EN 100, IEC 60870-5-104)	C53207-A351-D692-1
Ethernet optical (EN 100, IEC 60870-5-104)	C53207-A351-D693-1
Ethernet electrical (EN 100, Modbus TCP)	C53207-A351-D696-1
Ethernet optical (EN 100, Modbus TCP)	C53207-A351-D697-1
IEC 60870-5-103 protocol, redundant, RS485	C53207-A351-D644-1
Ethernet port electrical at port A	C53207-A351-D151-1

RS485 FO converter

RS485 FO converter	Order No.
820 nm, FC-Connector	7XV5650-0AA00
820 nm, with ST-Connector	7XV5650-0BA00

Mounting Rail for 19"-Racks

Name	Order Number
Mounting Rail Set	C73165-A63-D200-1

Surface mounting console (converts flush mounting variants into surface mounting variant)

Surface mounting console	C53207-A356-D850-1

Battery

Lithium battery 3 V/1 Ah, type CR 1/2 AA	Order No.
VARTA	6127 101 301
Panasonic	BR-1/2AA

Terminals

Terminals Voltage terminal block C or block E	C53207-A406-D181-1
Voltage terminal block D (inverse print)	C53207-A406-D182-1
Current terminal block 4xl	C53207-A406-D185-1
Current terminal block 3xl, 1xINs (sensitive)	C53207-A406-D186-1
Current terminal short circuit links, 3 pieces	C53207-A406-D193-1
Voltage terminal short circuit links, 6 pieces	C53207-A406-D194-1

Varistor

Voltage-limiting resistor for high-impedance differential protection


Name	Order number
125 Veff, 600 A, 1S/S256	W73028-V3125-A1
240 Veff, 600 A, 1S/S1088	W73028-V3300-A2

B Terminal Assignments

B.1	7SJ80 — Housing for panel flush mounting and cubicle installation and for panel surface mounting	436

B.1 7SJ80 — Housing for panel flush mounting and cubicle installation and for panel surface mounting


7SJ801*

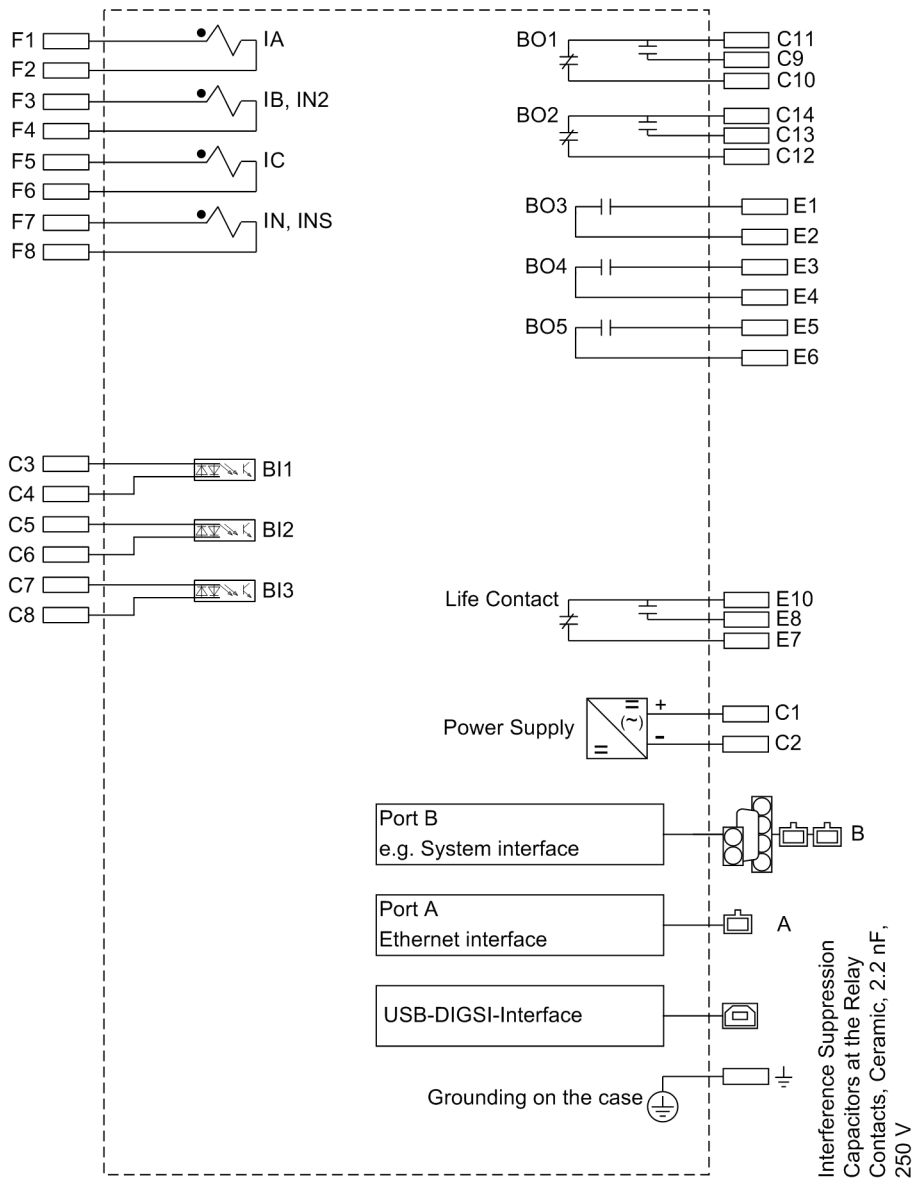

[kl-uebers-7sx80-1, 1, en_US]

Figure B-1 Block diagram 7SJ801*


7SJ802*

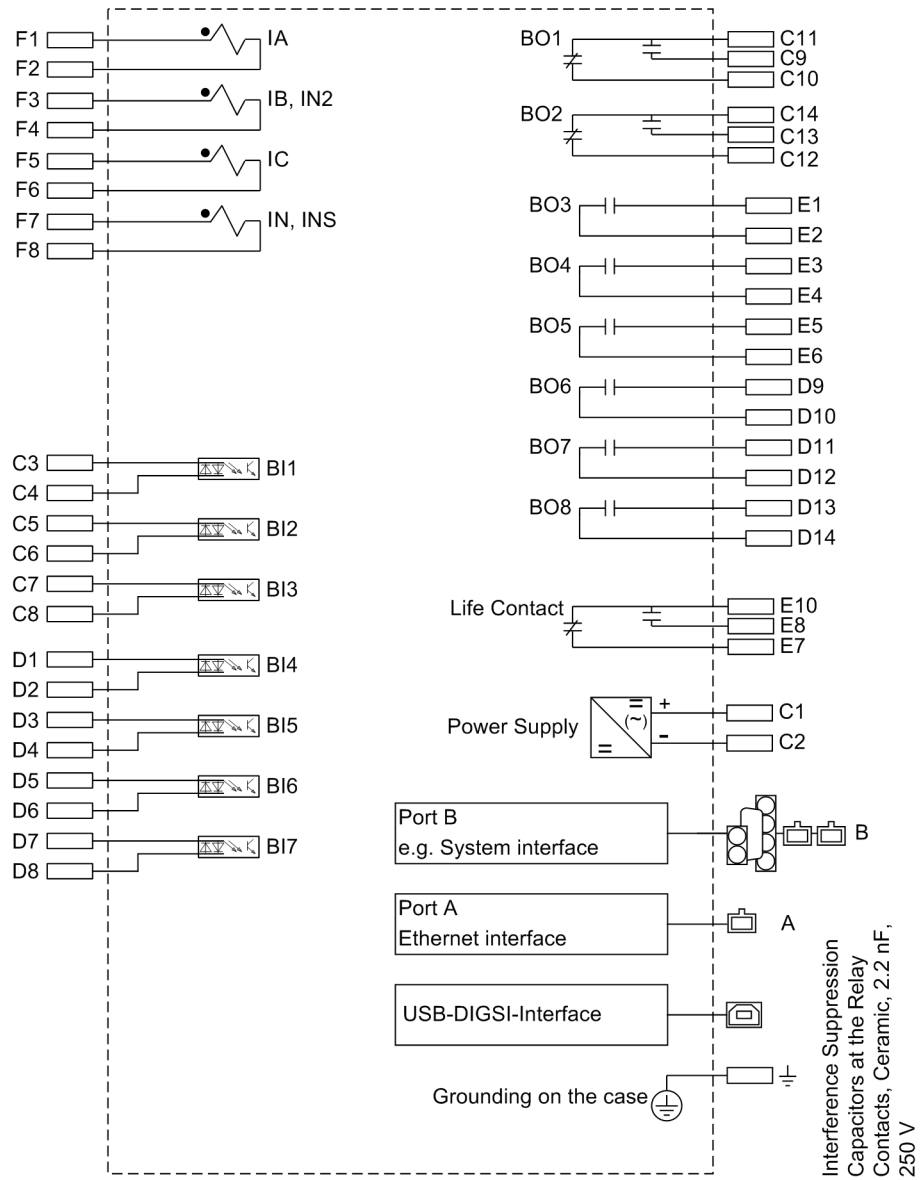

[kl-uebers-7sx80-2, 1, en_US]

Figure B-2 Block diagram 7SJ802*


7SJ803*

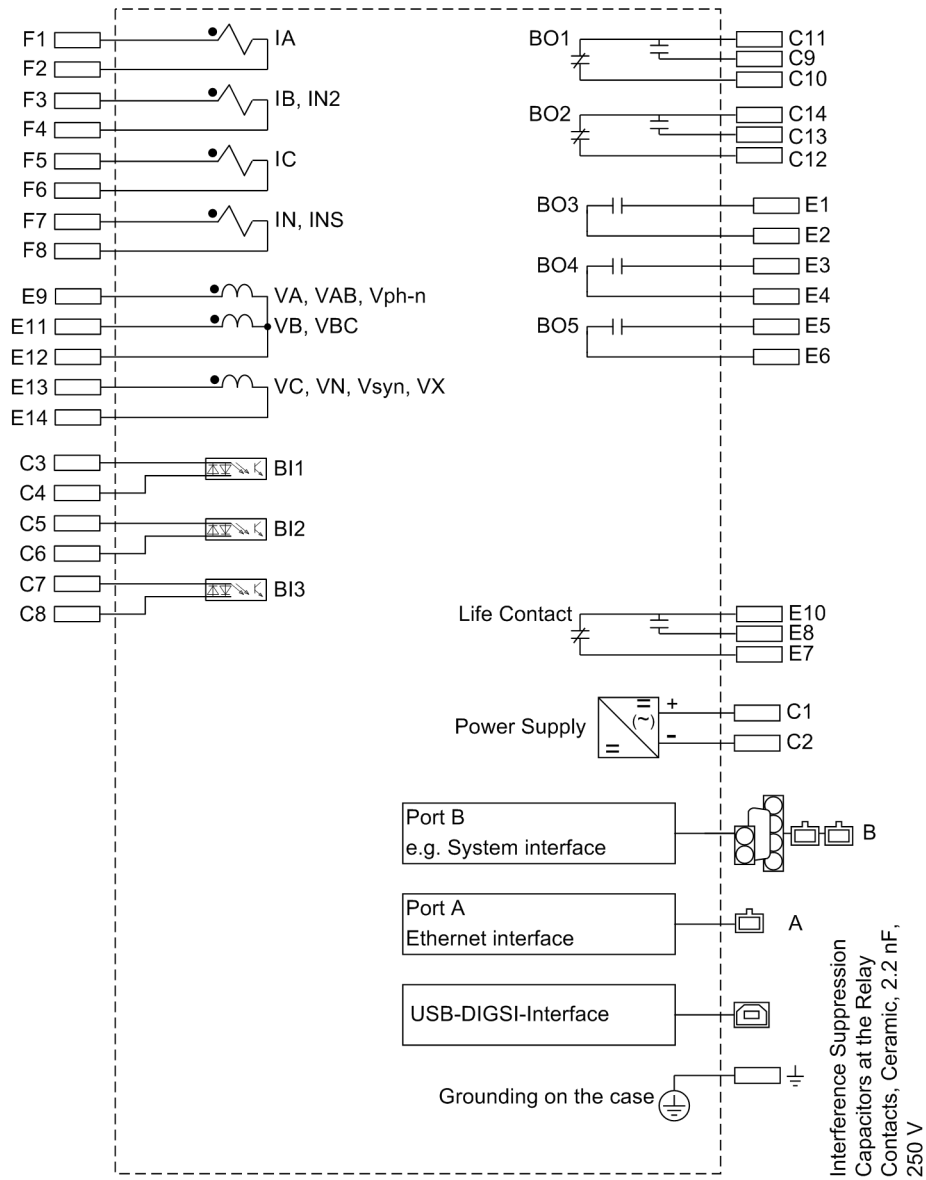

[kl-uebers-7sx80-3, 1, en_US]

Figure B-3 Block diagram 7SJ803*


7SJ804*

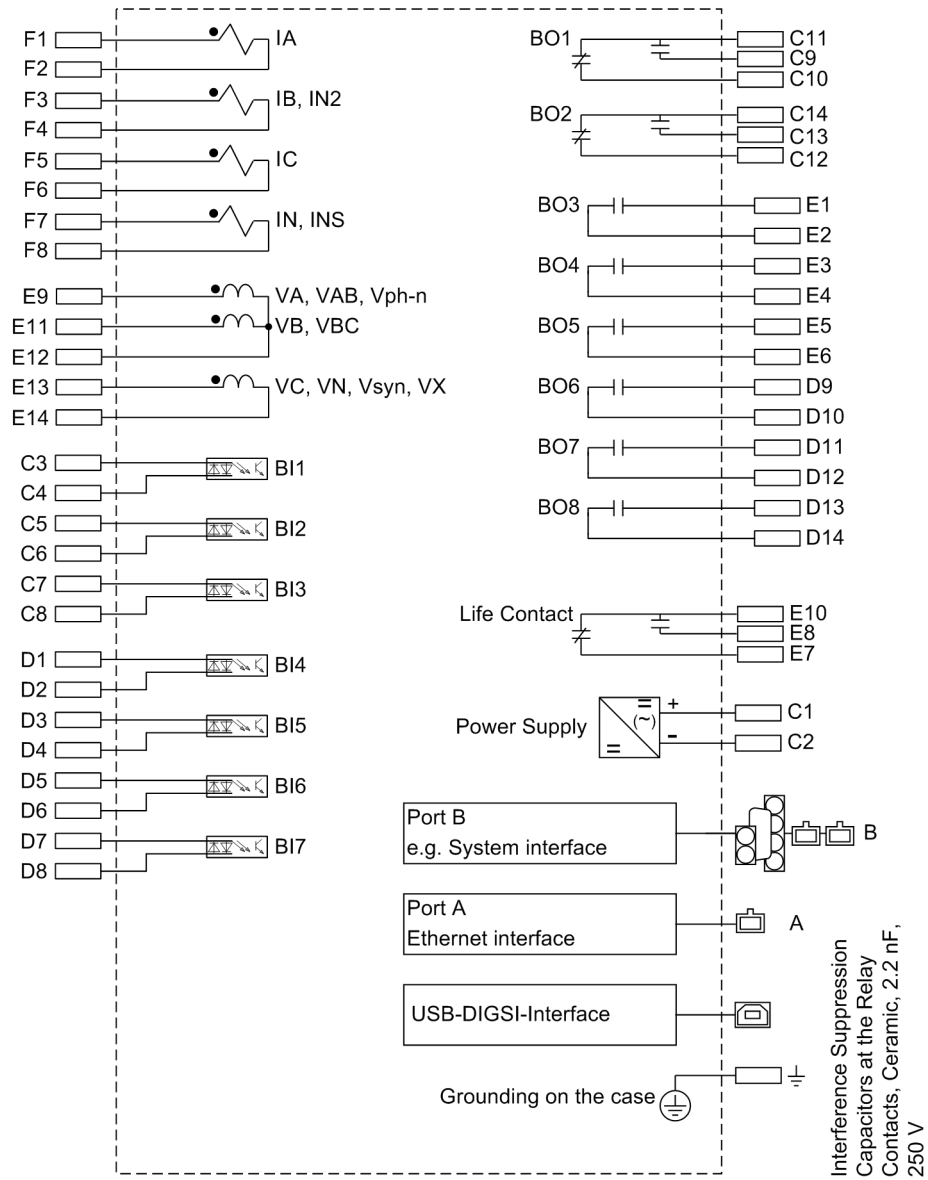

[kl-uebers-7sx80-4, 1, en_US]

Figure B-4 Block diagram 7SJ804*

7SJ807*

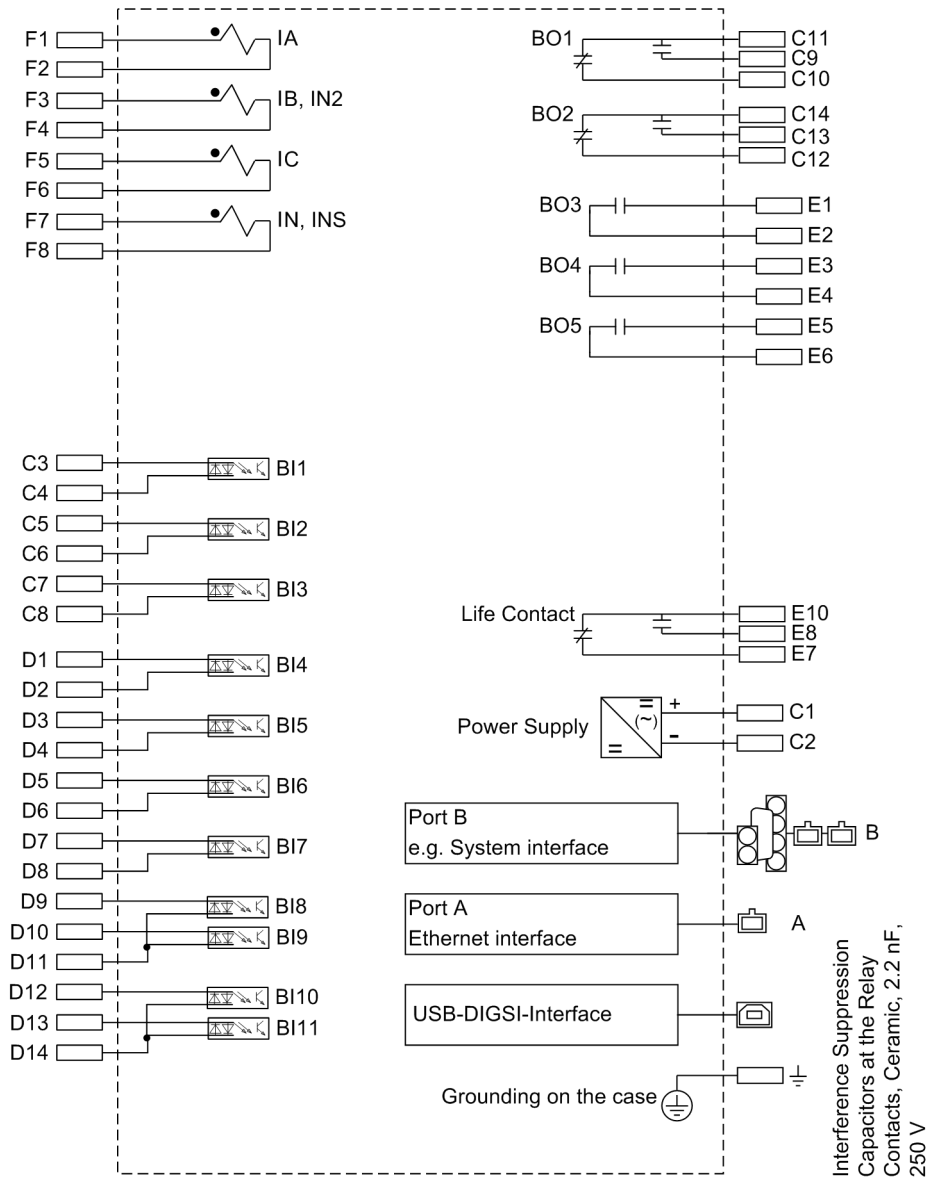


[kl-uebers-7sx80-7, 1, en_US]

Figure B-5 Block diagram 7SJ807*

*) The shield of the connecting cable is connected directly to the shield cover

7SJ808*

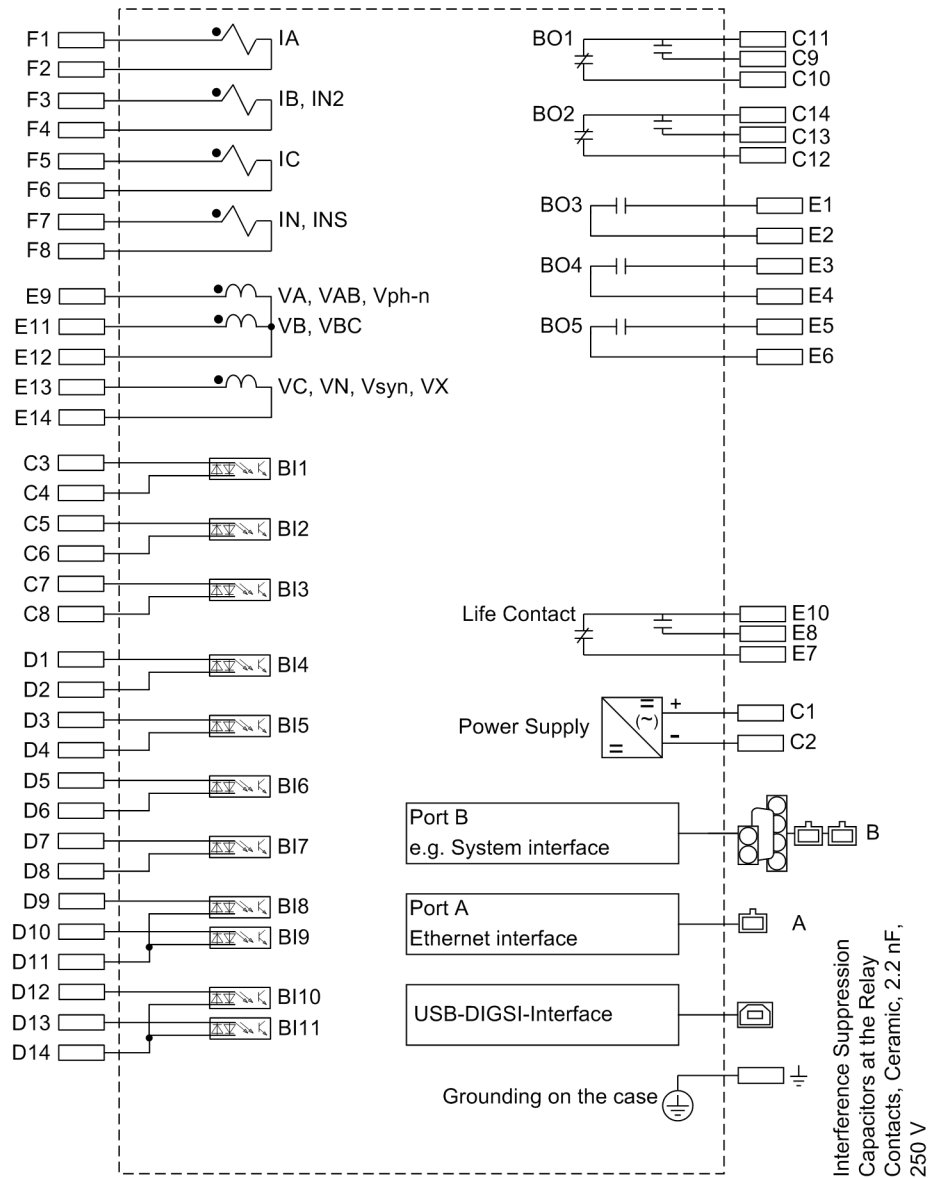

[kl-uebers-7sx80-8, 1, en_US]


Figure B-6 Block diagram 7SJ808*

*) The shield of the connecting cable is connected directly to the shield cover.

C Connection Examples


C.1	Connection Examples for Current and Voltage Transformers	444
C.2	Connection Examples for SICAM I/O Units	456

C.1 Connection Examples for Current and Voltage Transformers

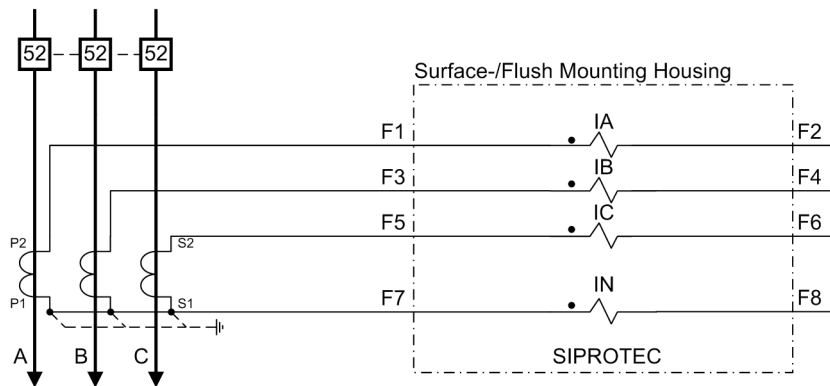


[anschl-3-stromwdl-sterpunktstrom-060606, 1, en_US]

Figure C-1 Current transformer connections to three current transformers and neutral point current (ground current) (Holmgreen connection) – appropriate for all networks

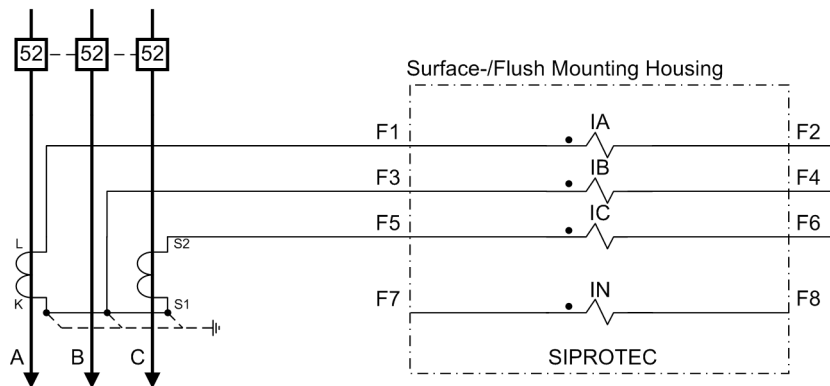

[anschl-2-stromwdl-060606, 1, en_US]


Figure C-2 Current transformer connections to two current transformers – only for isolated or resonant-grounded networks

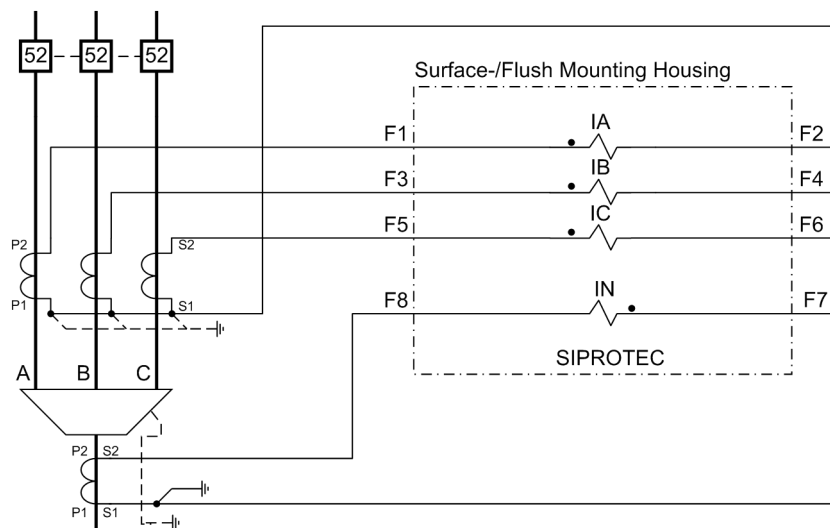

[anschl-3-stromwdl-summenstromw-060606, 1, en_US]

Figure C-3 Current transformer connections to three current transformers, ground current from additional summation current transformer – preferably for effectively or low-resistance grounded networks


Important: Grounding of the cable shield must be effected at the cable side
The switchover of the current polarity (address 201) also reverses the polarity of the current input IN!

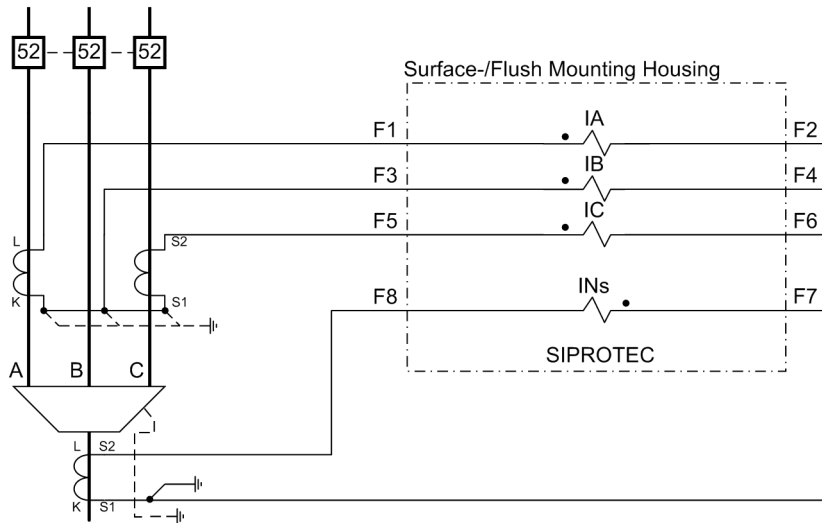

[anschl-2-stromwdl-kabelumbauw-060606, 1, en_US]

Figure C-4 Current transformer connections to two current transformers - additional cable-type current transformer for sensitive ground fault detection - only for isolated or resonant-grounded networks


Important: Grounding of the cable shield must be effected at the cable side
The switchover of the current polarity (address 201) also reverses the polarity of the current input IN!

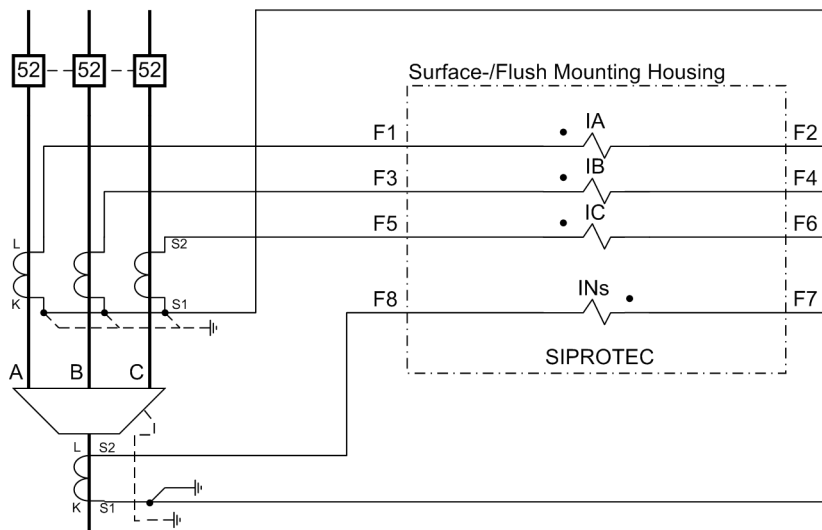

[anschl-3-stromwdl-kabelumbauw-060606, 1, en_US]


Figure C-5 Current transformer connections to three current transformers - ground current from additional cable-type current transformer for sensitive ground fault detection

Important: Grounding of the cable shield must be effected at the cable side
The switchover of the current polarity (address 201) also reverses the polarity of the current input INs!

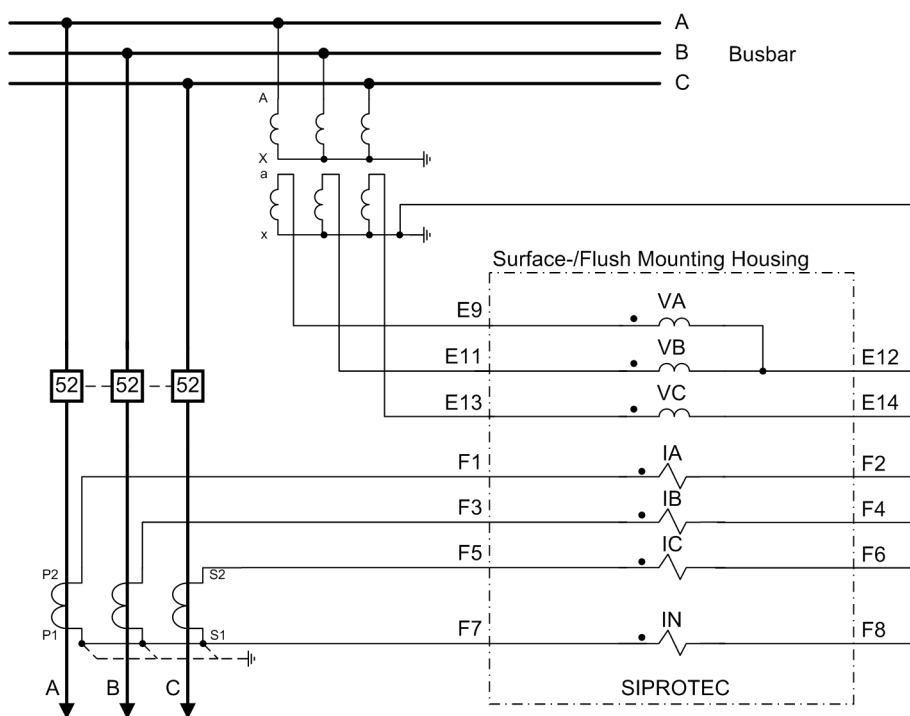


[anschl-3-stromwdl-3-spannungsw-060606, 1, en_US]

Figure C-6 Transformer connections to three current transformers and three voltage transformers (phase-to-ground voltages), normal circuit layout – appropriate for all networks

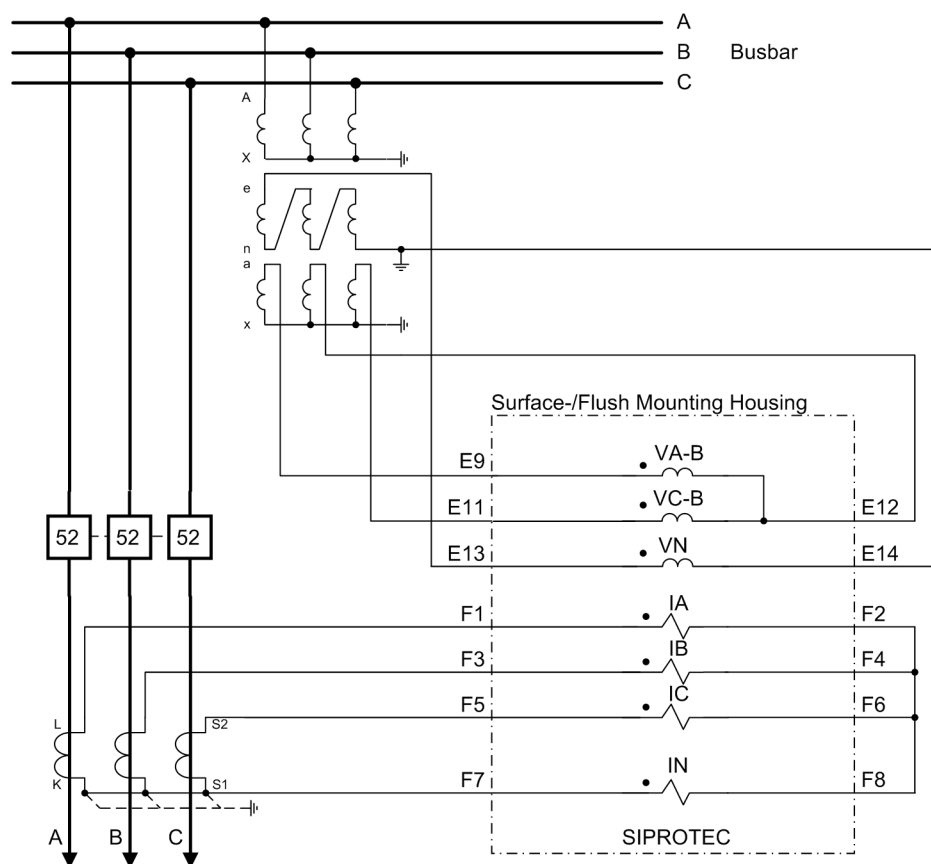


[anschl-3-stromwdl-2-spannung-e-n-wickl-060606, 1, en_US]

Figure C-7 Transformer connections to three current transformers, two voltage transformers (phase-to-phase voltages) and broken delta winding (da-dn) – appropriate for all networks

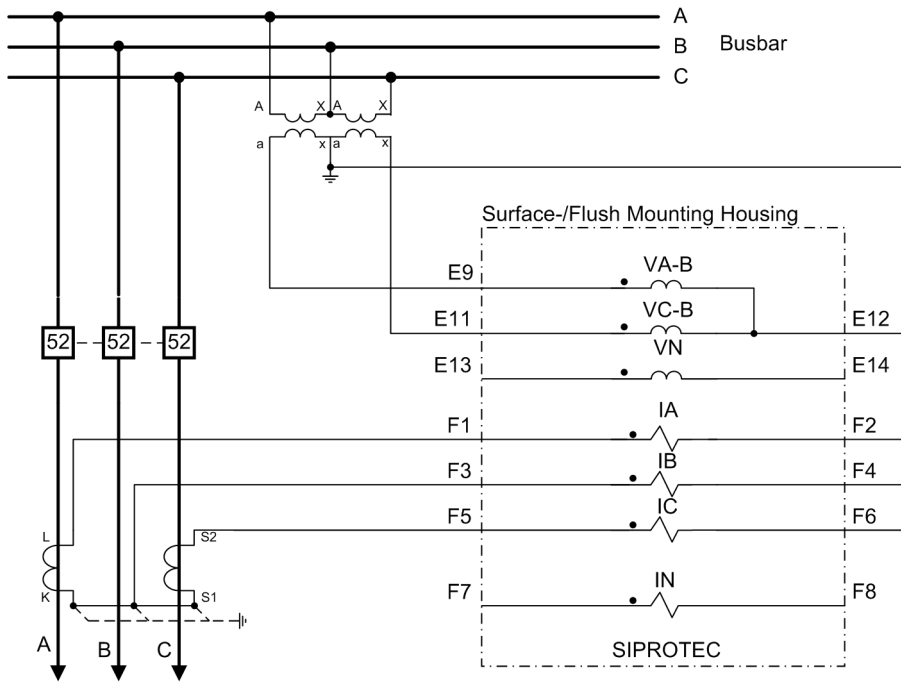

[anschl-2-stromwdl-v-schaltung-060606, 1, en_US]


Figure C-8 Current transformer connections to two current transformers and as open-delta connection the voltage transformer – for isolated or resonant-grounded networks when no directional ground protection is needed

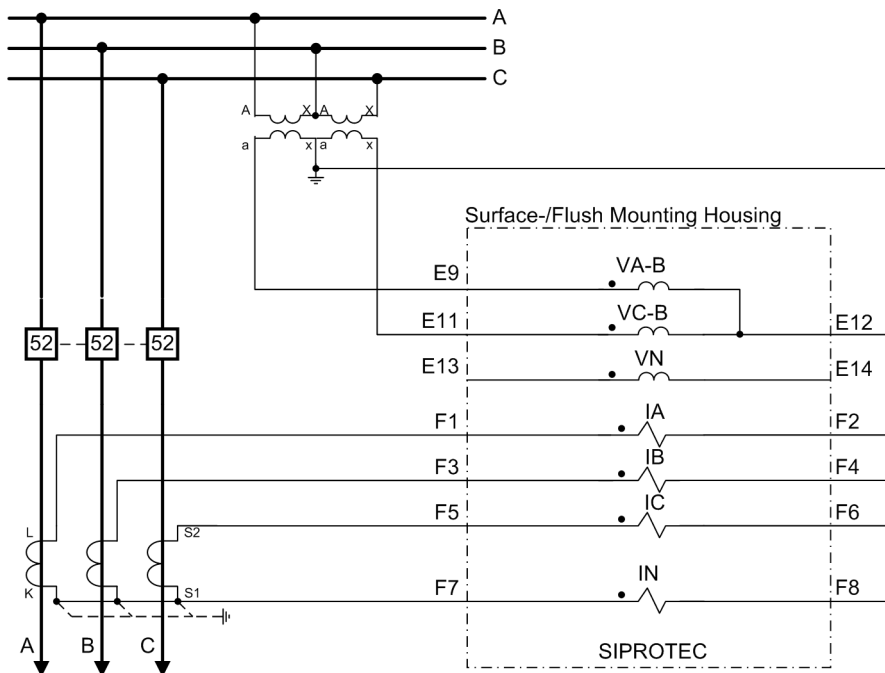

[anschl-3-stromwdl-sterne-v-schaltung-060606, 1, en_US]

Figure C-9 Current transformer connections to three current transformers, two voltage transformers in open-delta connection, only for isolated or resonant-grounded networks; no directional ground protection since displacement voltage cannot be calculated

Note: If the system has only 2 voltage transformers (open-delta connection), the device, too, should be connected in open-delta connection and the unused voltage input should be short-circuited.

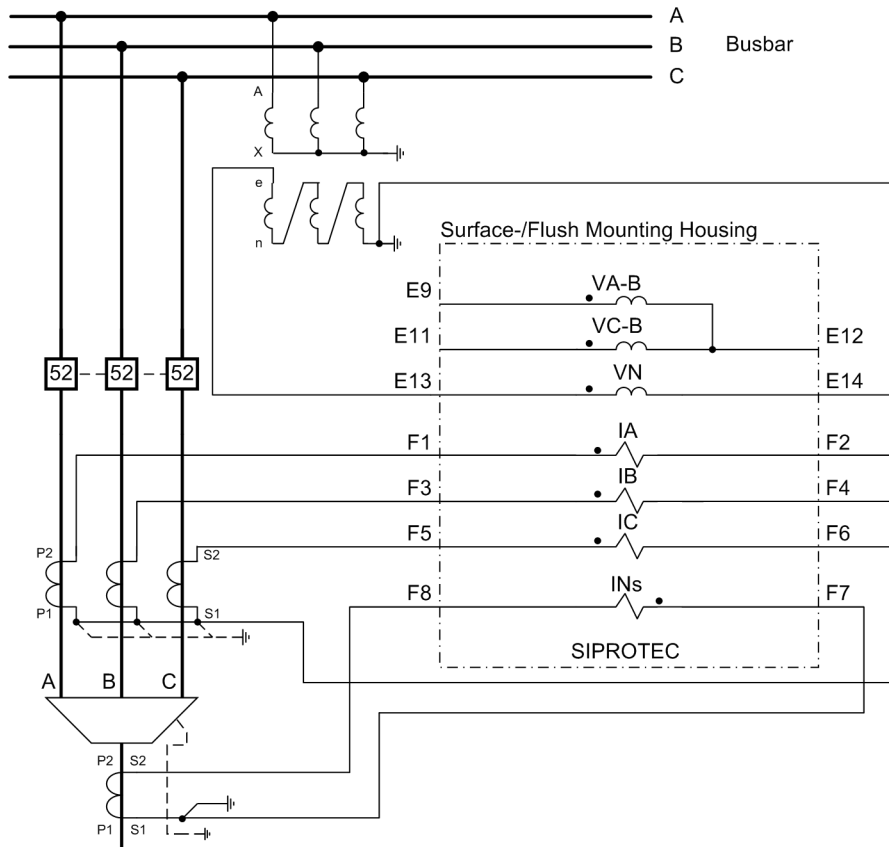


[anschl-3-stromwdl-kabelumbauw-e-n-wickl-060606, 1, en_US]

Figure C-10 Transformer connections to three current transformers, cable-type current transformer and broken delta winding, maximum precision for sensitive ground fault detection

Important! Grounding of the cable shield must be effected at the cable side

For busbar-side grounding of the current transformers, the current polarity of the device is changed via address 0201. This also reverses the polarity of the current input IN/INs. When using a cable-type current transformer, the connection of k and l at F8 and F7 must be exchanged.

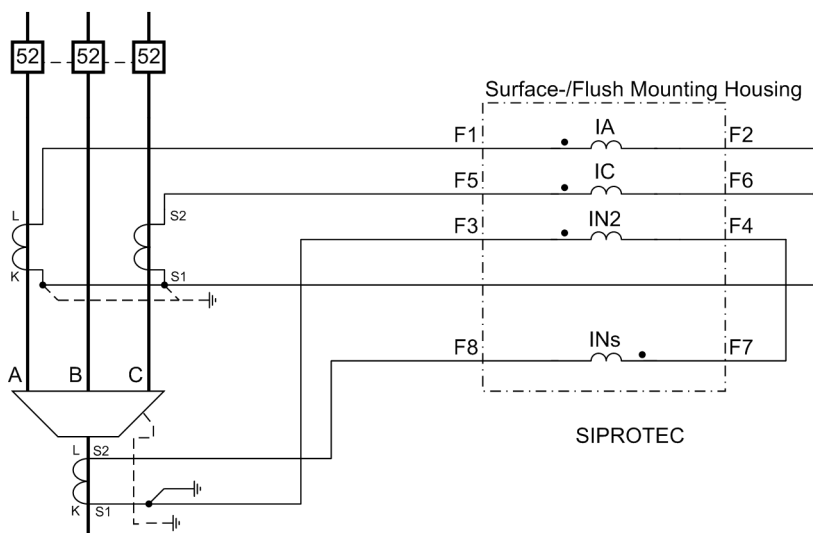


[stromwdl-2phasenstrwdl-1erdstrowdl-080211, 1, en_US]

Figure C-11 Current transformer connections to two phase-current transformers and a ground-current transformer; the ground current is taken via the highly sensitive and sensitive ground input.

Important! Grounding of the cable shield must be effected at the cable side

For busbar-side grounding of the current transformers, the current polarity of the device is changed via address 0201. This also reverses the polarity of the current input IN/INs. When using a cable-type current transformer, the connection of k and l at F8 and F7 must be exchanged.

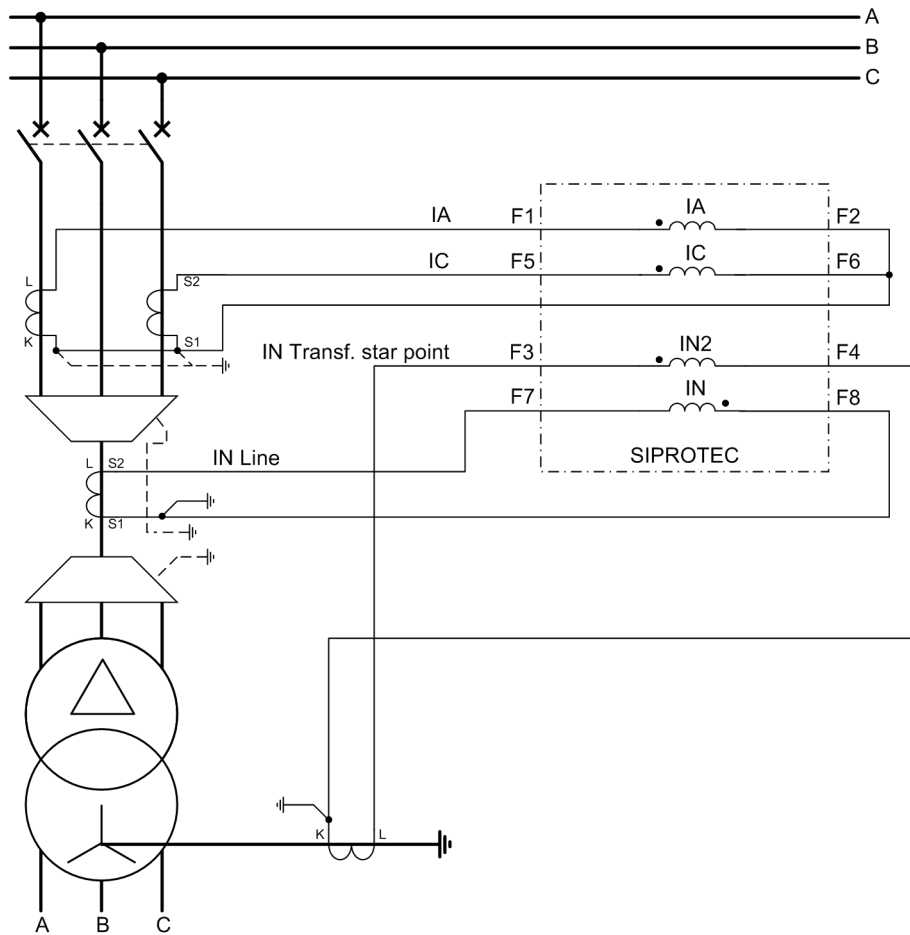


[7sj80-mess-2erdstroeme-20070301, 1, en_US]

Figure C-12 Current transformer connections to two phase currents and two ground currents; IN/INs – ground current of the line, IN2 – ground current of the transformer starpoint


Important! Grounding of the cable shield must be effected at the cable side

For busbar-side grounding of the current transformers, the current polarity of the device is changed via address 0201. This also reverses the polarity of the current input IN/INs. When using a cable-type current transformer, the connection of k and l at F8 and F7 must be exchanged.

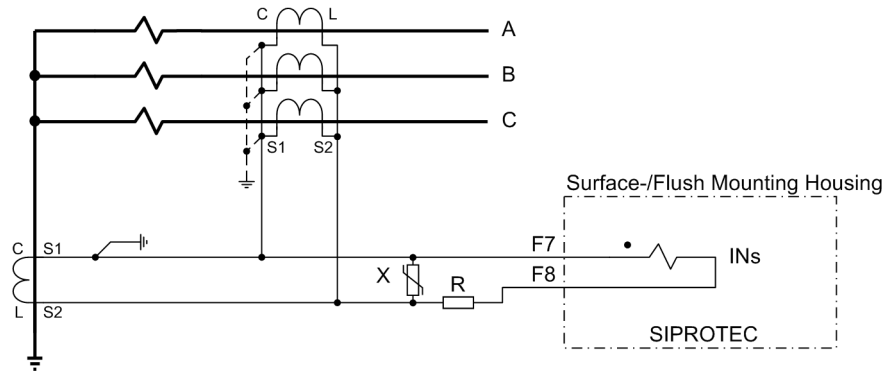


[hochimpedanz-traufowgeerdet-060606, 1, en_US]

Figure C-13 High-impedance differential protection for a grounded transformer winding (the illustration shows the partial connection for high-impedance differential protection)

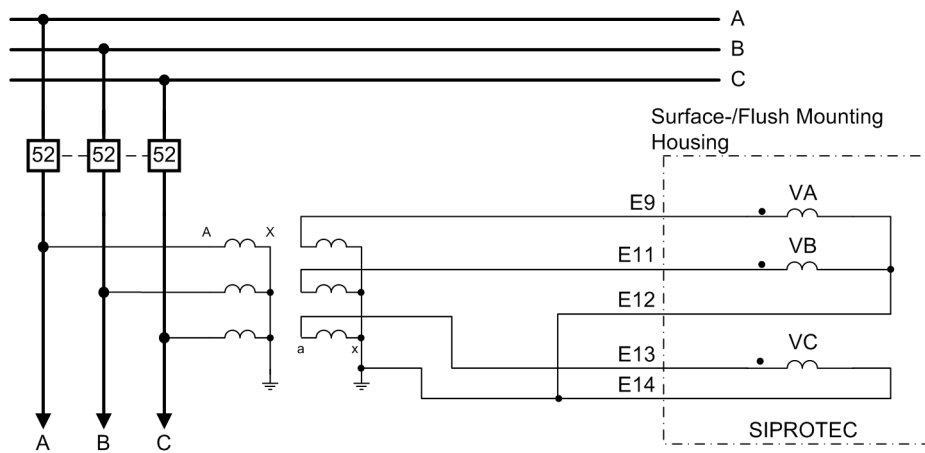


[anschl-u1e-u2e-u3e-abgang-20070129, 1, en_US]

Figure C-14 Example for the connection type "VAN, VBN, VCN" with voltage connection on the feeder side

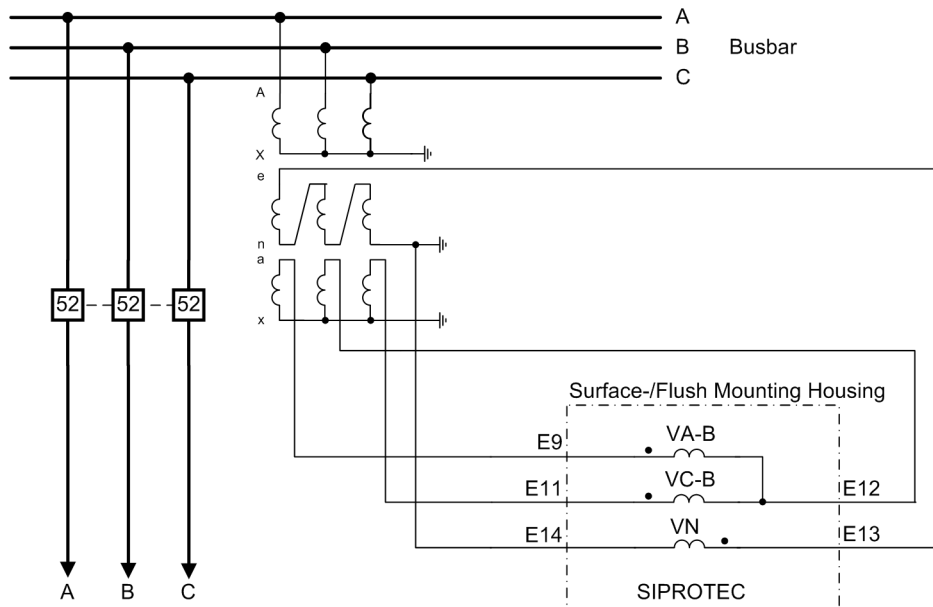


[anschl-u12-u23-ue-20070129, 1, en_US]

Figure C-15 Voltage transformer connections to two voltage transformers (phase-to-phase voltages) and broken delta winding (da-dn) – appropriate for all networks

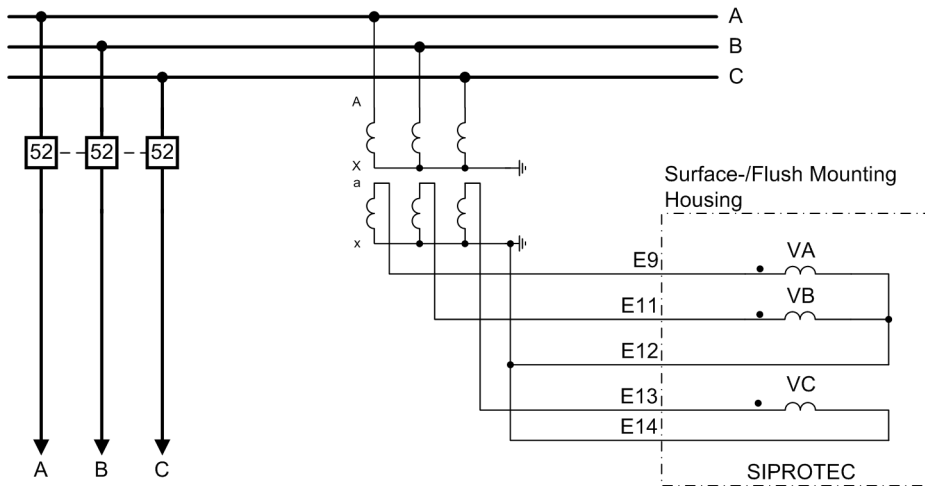

[anschl-u1e-u2e-u3e-ss-20070129, 1, en_US]


Figure C-16 Example for connection type "VAN, VBN, VCN" busbar-side voltage connection

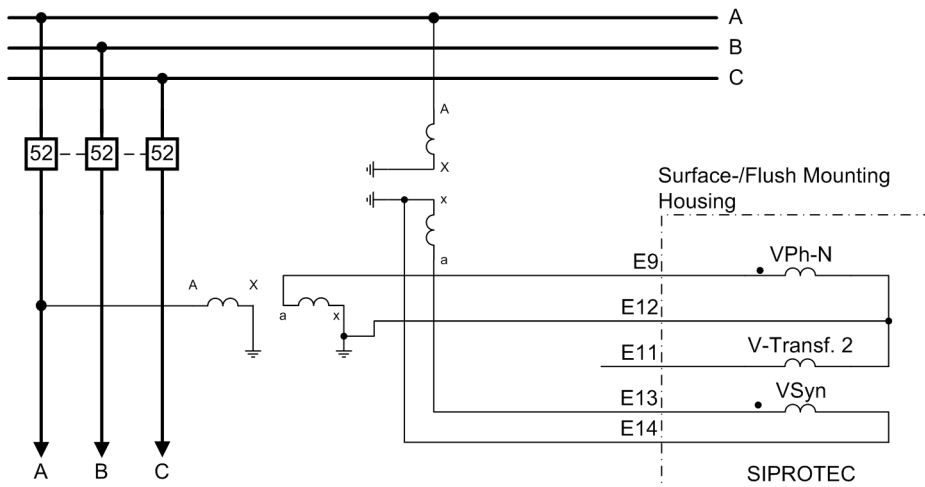

[anschl-uph-usyn-20070129, 1, en_US]


Figure C-17 Example for connection type "Vph-n, Vsyn"

The connection can be established at any one of the three phases. The phase must be the same for Vph-n and Vsyn.

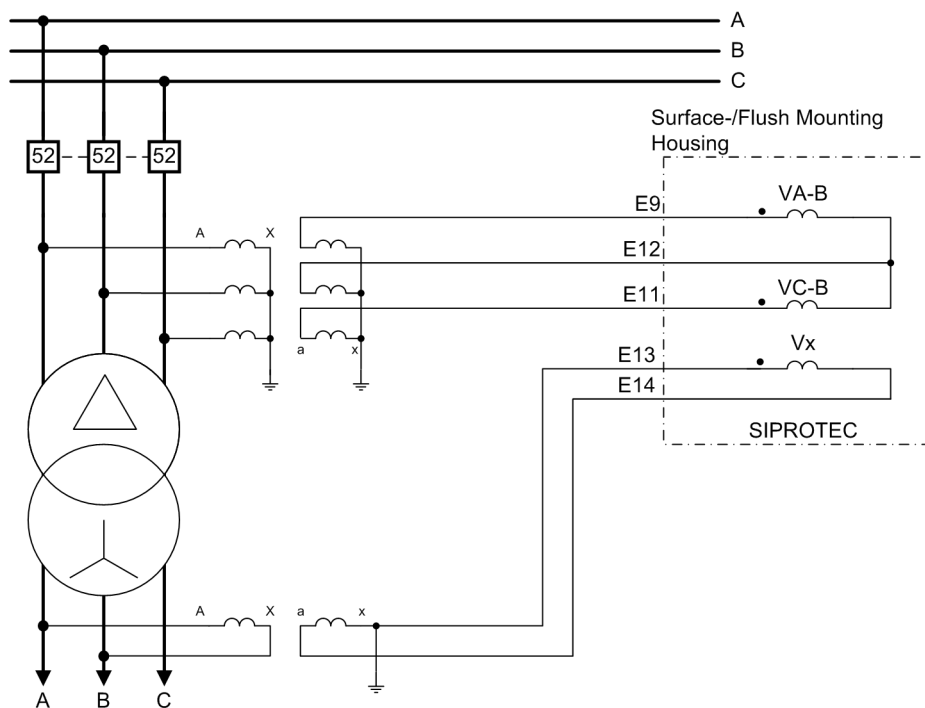


[anschl-u12-u23-ux-20070129, 1, en_US]

Figure C-18 Example for connection type "VAB, VBC, Vx"

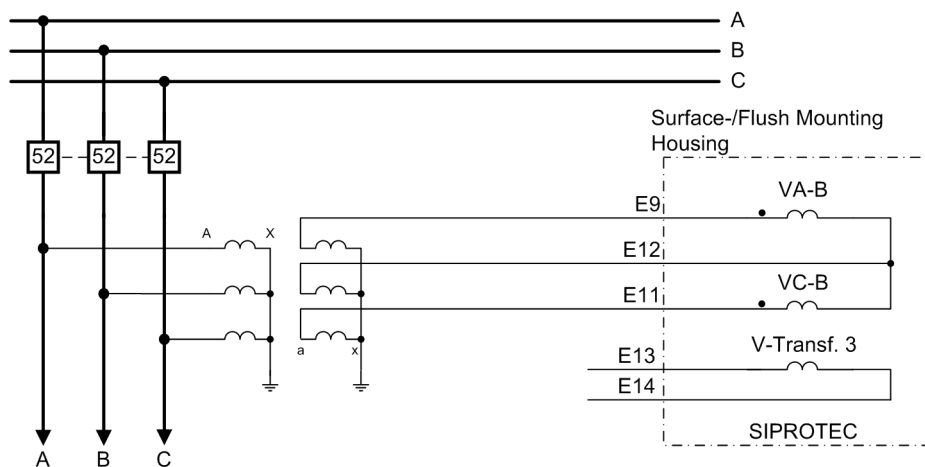


[anschl-u12-u23-20070129, 1, en_US]

Figure C-19 Example for connection type "VAB, VBC"

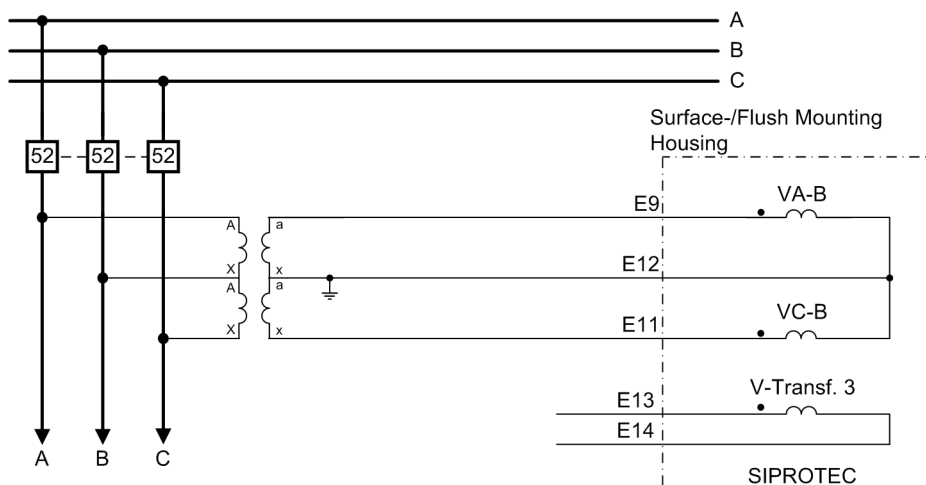


[anschl-u12-u23-v-schalt-20070129, 1, en_US]

Figure C-20 Example for connection type "VAB, VBC" with phase voltage connection as open-delta connection

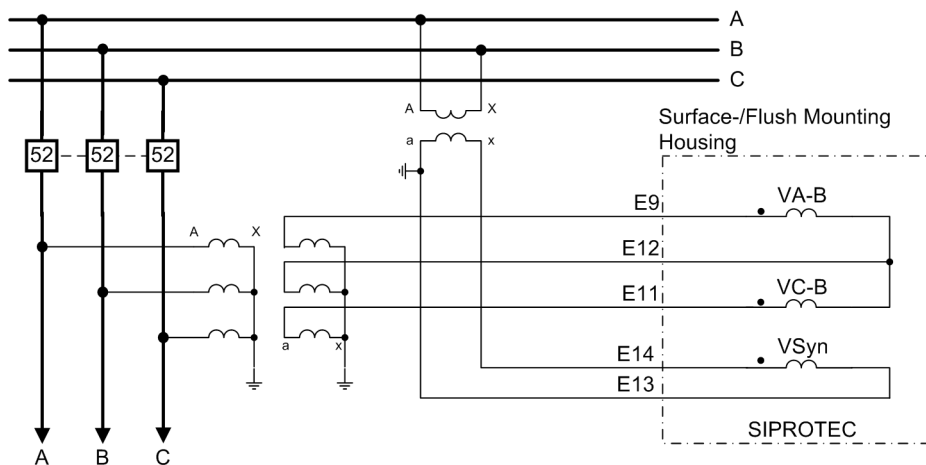

[anschl-u12-u23-usyn-20070129, 1, en_US]


Figure C-21 Example for connection type "VAB, VBC, VSYN"

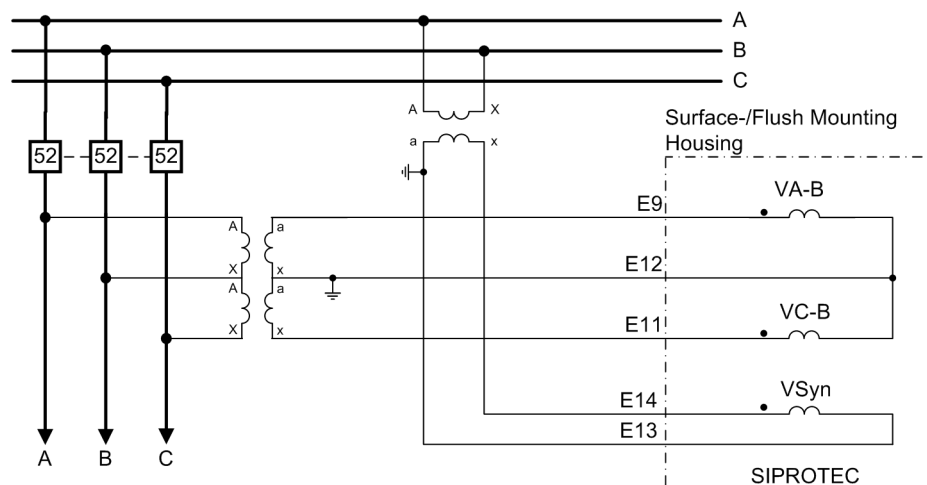

[anschl-u12-u23-usyn-v-schalt-20070129, 1, en_US]

Figure C-22 Example for connection type "VAB, VBC, VSYN" with phase voltage connection as open-delta connection

C.2 Connection Examples for SICAM I/O Units

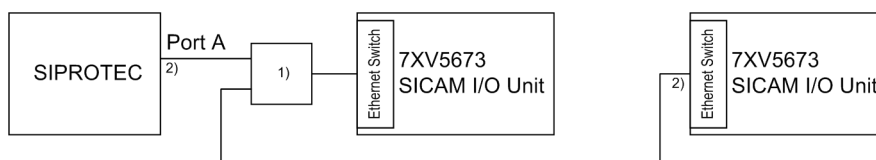

[sicam-io-unit-01-20120731-ko, 1, en_US]

Figure C-23 Connection of 2 SICAM I/O units to port A via Y cable (up to 2 SICAM I/O units connectable)

- 1 Y cable 7KE6000–8GD00–0BA2
- 2 RJ45 cable

D Current Transformer Requirements

The requirements for phase current transformers are usually determined by the overcurrent time protection, particularly by the high-current element settings. Besides, there is a minimum requirement based on experience.

The recommendations are given according to the standard IEC 60044-1.

The standards IEC 60044-6, BS 3938 and ANSI/IEEE C 57.13 are referred to for converting the requirement into the knee-point voltage and other transformer classes.

D.1	Accuracy limiting factors	458
D.2	Class conversion	459
D.3	Cable core balance current transformer	460

D.1 Accuracy limiting factors

Effective Accuracy Limiting Factor and Rated Accuracy Limiting Factor

Required minimum effective accuracy limiting factor	$K_{ALF}' = \frac{50-2_{PU}}{I_{pNom}}$	
	but at least 20	
	with	
	n'	Minimum effective accuracy limiting factor
	$I_{>>_{ALF}}$	Primary pickup value of the high-current element
	I_{pN}	Primary nominal transformer current
Resulting rated accuracy limiting factor	$K_{ALF} = \frac{R_{BC} + R_{Ct}}{R_{BN} + R_{Ct}} \cdot K_{ALF}'$	
	with	
	K_{ALF}	Rated accuracy limiting factor
	R_{BC}	Connected burden resistance (device and cables)
	R_{BN}	Nominal burden resistance
	R_{Ct}	Transformer internal burden resistance

Calculation example according to IEC 60044-1

$I_{sNom} = 1 \text{ A}$	$K_{ALF} = \frac{0.6+3}{5+3} \cdot 20 = 9$
$K_{ALF} = 20$	K_{ALF} set to 10, so that: 5P10, 5 VA
$R_{BC} = 0.6 \Omega$ (device and cables)	
$R_{Ct} = 3 \Omega$	
$R_{BN} = 5 \Omega$ (5 VA)	
with	
I_{sNom} = secondary transformer nominal current	

D.2 Class conversion

Table D-1 Conversion into other classes

British Standard BS 3938	$V_k = \frac{(R_{Ct} + R_{BN}) \cdot I_{sNom}}{1.3} \cdot K_{ALF}$	
ANSI/IEEE C 57.13, Klasse C	$V_{s.t.max} = 20 \cdot I_{sNom} \cdot R_{BN} \cdot \frac{K_{ALF}}{20}$ $I_{sNom} = 5 \text{ A (typical value)}$	
IEC 60044-6 (transient response), class TPS	$V_{al} = K \cdot K_{SSC} \cdot (R_{Ct} + R_{BN}) \cdot I_{sNom}$ $K \approx 1$ $K_{SSC} \approx K_{ALF}$	
Classes TPX, TPY, TPZ	Calaculation see Section above with: $K_{SSC} \approx K_{ALF}$ T_p depending on power system and specified closing sequence	
	with	
	with _k	Knee-point voltage
	R_{Ct}	Internal burden resistance
	R_{BN}	Nominal burden resistance
	I_{sN}	Secondary nominal transformer current
	K_{ALF}	Rated accuracy limiting factor
	$U_{s.t.max}$	Sec. terminal voltage at $20 I_{pNom}$
	U_{al}	Sec. magnetization limit voltage
	K	Dimensioning factor
	K_{SSC}	Factor symmetr. Rated fault current
	T_p	Primary time constant

D.3 Cable core balance current transformer

General

The requirements to the cable core balance current transformer are determined by the function "sensitive ground fault detection".

The recommendations are given according to the standards IEC 60044-1 and IEC61869-2.

Requirements to the cable core balance current transformer according to IEC 60044-1 and IEC61869-2

Transformation ratio, typical It may be necessary to select a different transformation ratio to suit the specific power system and thus the corresponding amount of the maximum ground fault current.	60 / 1
Accuracy limiting factor	FS = 10
Power	1 to 4 times the connected burden (device input plus infeeds)
Notes concerning the power: The burden of the sensitive ground-current input is very low (0.05 VA or 0.1 VA). Thus, an underburden of more than factor 4 is probable. In this case, clarify the suitability of the class accuracy concerning an important underburden with the transformer manufacturer. If necessary, request the accuracy for the range from 0 VA to the rated burden. This specification is then outside the standard, but in practice, it is possible in most cases. (Relevant standard: IEC 61869-2, Chapter 5.6.201.4 Extended burden range. There, the range 1 VA to rated burden is specified for rated burdens smaller than 15 VA.)	

Class accuracy

Table D-2 Minimum required class accuracy depending on neutral grounding and function operating principle

Starpoint	isolated	compensated	high-resistance grounded
Function directional	Class 1	Class 1	Class 1
Function non-directional	Class 3	Class 1	Class 3

Note that the class accuracy according to IEC 61869-2 below 5% I_{rated} (< 50 mA secondary) is not defined in general. For very sensitive directional measurements, Siemens recommends the classes 0.5S or 0.1S that define the class accuracy via an extended current range (up to 1% I_{rated}) (see chapter 5.6.201.5, IEC 61869-2).

Another possibility is to correct the phase-angle error of the transformer on the device, if this error is known (see function description Sensitive ground-fault detection).

E Default Settings and Protocol-dependent Functions

When the device leaves the factory, a large number of LED indications, binary inputs and outputs as well as function keys are already preset. They are summarized in the following table.

E.1	LEDs	462
E.2	Binary Input	464
E.3	Binary Output	465
E.4	Function Keys	466
E.5	Default Display	467
E.6	Protocol-dependent Functions	470

E.1 LEDs

Table E-1 7SJ801*

LEDs	Default function	Function No.	Description
LED1	Relay TRIP	511	Relay GENERAL TRIP command
LED2	50/51 Ph A PU	1762	50/51 Phase A picked up
LED3	50/51 Ph B PU	1763	50/51 Phase B picked up
LED4	50/51 Ph C PU	1764	50/51 Phase C picked up
LED5	50N/51NPickedup	1765	50N/51N picked up
LED6	Failure Σ I	162	Failure: Current Summation
	Fail I balance	163	Failure: Current Balance
	Fail Ph. Seq. I	175	Failure: Phase Sequence Current
LED7	Not configured	1	No Function configured
LED8	Brk OPENED		Breaker OPENED

Table E-2 7SJ802*

LEDs	Default function	Function No.	Description
LED1	Relay TRIP	511	Relay GENERAL TRIP command
LED2	50/51 Ph A PU	1762	50/51 Phase A picked up
LED3	50/51 Ph B PU	1763	50/51 Phase B picked up
LED4	50/51 Ph C PU	1764	50/51 Phase C picked up
LED5	50N/51NPickedup	1765	50N/51N picked up
LED6	Failure Σ I	162	Failure: Current Summation
	Fail I balance	163	Failure: Current Balance
	Fail Ph. Seq. I	175	Failure: Phase Sequence Current
LED7	Not configured	1	No Function configured
LED8	Brk OPENED		Breaker OPENED

Table E-3 7SJ803*

LEDs	Default function	Function No.	Description
LED1	Relay TRIP	511	Relay GENERAL TRIP command
LED2	50/51 Ph A PU	1762	50/51 Phase A picked up
	67 A picked up	2692	67/67-TOC Phase A picked up
LED3	50/51 Ph B PU	1763	50/51 Phase B picked up
	67 B picked up	2693	67/67-TOC Phase B picked up
LED4	50/51 Ph C PU	1764	50/51 Phase C picked up
	67 C picked up	2694	67/67-TOC Phase C picked up
LED5	50N/51NPickedup	1765	50N/51N picked up
LED6	Failure Σ I	162	Failure: Current Summation
	Fail I balance	163	Failure: Current Balance
	Fail V balance	167	Failure: Voltage Balance
	Fail Ph. Seq. I	175	Failure: Phase Sequence Current
	Fail Ph. Seq. V	176	Failure: Phase Sequence Voltage
	VT brk. wire	253	Failure VT circuit: broken wire
LED7	Not configured	1	No Function configured
LED8	Brk OPENED		Breaker OPENED

Table E-4 7SJ804*

LEDs	Default function	Function No.	Description
LED1	Relay TRIP	511	Relay GENERAL TRIP command
LED2	50/51 Ph A PU	1762	50/51 Phase A picked up
	67 A picked up	2692	67/67-TOC Phase A picked up
LED3	50/51 Ph B PU	1763	50/51 Phase B picked up
	67 B picked up	2693	67/67-TOC Phase B picked up
LED4	50/51 Ph C PU	1764	50/51 Phase C picked up
	67 C picked up	2694	67/67-TOC Phase C picked up
LED5	50N/51NPickedup	1765	50N/51N picked up
	67N picked up	2695	67N/67N-TOC picked up
LED6	Failure ΣI	162	Failure: Current Summation
	Fail I balance	163	Failure: Current Balance
	Fail V balance	167	Failure: Voltage Balance
	Fail Ph. Seq. I	175	Failure: Phase Sequence Current
	Fail Ph. Seq. V	176	Failure: Phase Sequence Voltage
	VT brk. wire	253	Failure VT circuit: broken wire
LED7	Not configured	1	No Function configured
LED8	Brk OPENED		Breaker OPENED

E.2 Binary Input

Table E-5 Binary input presettings for all devices and ordering variants

Binary Input	Default function	Function No.	Description
BI1	>BLOCK 50-2	1721	>BLOCK 50-2
	>BLOCK 50N-2	1724	>BLOCK 50N-2
BI2	>52-b	4602	>52-b contact (OPEN, if bkr is closed)
	52Breaker		52 Breaker
BI3	>52-a	4601	>52-a contact (OPEN, if bkr is open)
	52Breaker		52 Breaker

Table E-6 Further binary input presettings for 7SJ802* or 7SJ804*

Binary Input	Default function	Function No.	Description
BI4	not pre-assigned	-	-
BI5	not pre-assigned	-	-
BI6	not pre-assigned	-	-
BI7	not pre-assigned	-	-

Table E-7 Further binary input presettings for 7SJ807* or 7SJ808*

Binary Input	Default function	Function No.	Description
BI4	not pre-assigned	-	-
BI5	not pre-assigned	-	-
BI6	not pre-assigned	-	-
BI7	not pre-assigned	-	-
BI8	not pre-assigned	-	-
BI9	not pre-assigned	-	-
BI10	not pre-assigned	-	-
BI11	not pre-assigned	-	-

E.3 Binary Output

Table E-8 Output Relay Presettings for All Devices and Ordering Variants

Binary Output	Default function	Function No.	Description
BO1	Relay TRIP	511	Relay GENERAL TRIP command
	52Breaker		52 Breaker
BO2	52Breaker		52 Breaker
	79 Close	2851	79 - Close command
BO3	52Breaker		52 Breaker
	79 Close	2851	79 - Close command
BO4	Failure Σ I	162	Failure: Current Summation
	Fail I balance	163	Failure: Current Balance
	Fail V balance	167	Failure: Voltage Balance
	Fail Ph. Seq. I	175	Failure: Phase Sequence Current
	Fail Ph. Seq. V	176	Failure: Phase Sequence Voltage
	VT brk. wire	253	Failure VT circuit: broken wire
BO5	Relay PICKUP	501	Relay PICKUP

Table E-9 Further Output Relay Presettings for 7SJ802* or 7SJ804*

Binary Output	Default function	Function No.	Description
BO6	not pre-assigned	-	-
BO7	not pre-assigned	-	-
BO8	not pre-assigned	-	-

E.4 Function Keys

Table E-10 Applies to All Devices and Ordered Variants

Function Keys	Default function
F1	Display of the operational indications
F2	Display of the primary operational measured values
F3	Display of the last fault log buffer
F4	not pre-assigned
F5	not pre-assigned
F6	not pre-assigned
F7	not pre-assigned
F8	not pre-assigned
F9	not pre-assigned

E.5 Default Display

A number of pre-defined measured value pages are available depending on the device type. The start page of the default display appearing after startup of the device can be selected in the device data via parameter 640 **Start image DD**.

for the 6-line Display of 7SJ80

Side 1

A	:400A	12:20.0kV
B	:400A	23:20.0kV
C	:400A	31:20.0kV
N	: 0A	N: 0.0kV
SN	: 0A	x: 0.0kV
f	:50.0Hz	

Side 2

% : IL	VPh-N	VPh-Ph
A :100.0	100.0	100.0
B :100.0	100.0	100.0
C :100.0	100.0	100.0
f	: 50.0Hz	

Side 3

I1	: 400A
V1	: 11.5kV
P	: 13.8MV
Q	: 0.0MVAR
S	: 13.8MVA
cosφ	: 1.00

Side 4

P	:13.8MW	U12:20.0kV
Q	:0.0MVAR	U23:20.0kV
S	:13.8MVA	U31 :20.0kV
F	:50.0Hz	IA :400A
		IB :400A
		IC :400A
cosφ	:1.00	

Side 5

A	:400A
B	:400A
C	:400A
N	: 0A
SN	: 0A
f	: 50.0Hz

Side 6

Synchrocheck	
V1	:200·0kV f1:50·50Hz
V2	:201·0kV f2:50·30Hz
dV	: 1·0kV df: 0·20Hz
da	: 180°


Side 7

VPh-N	200·0kV
VSyn	200·0kV
f	50·0Hz

[grundbild6zei-mit-u-ohne-erw-mw-20070116, 1, en_US]

Figure E-1 Default display of the 7SJ80 for models with V without extended measured values

With the V0/IO ϕ measurement, the measured ground current IN2 is displayed under N and the ground current IN or INs under Ns.

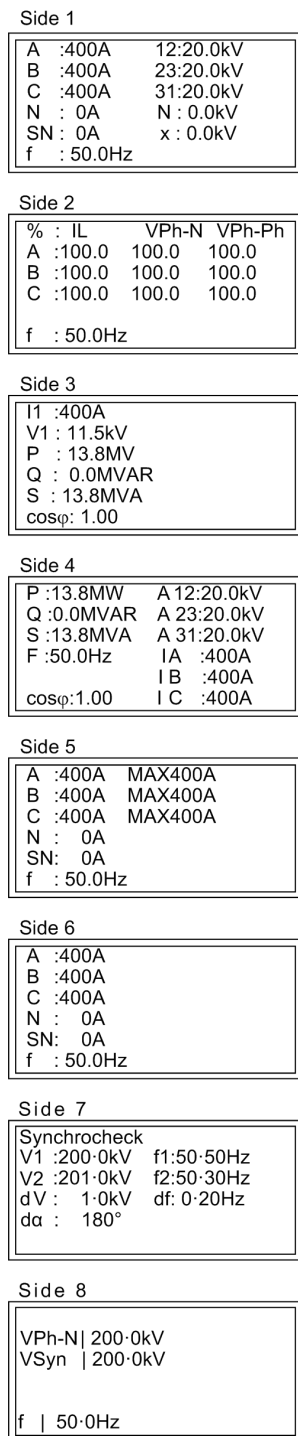

[grundbild6zei-mit-u-und-erw-mw-20070116, 1, en_US]

Figure E-2 Default display of the 7SJ80 for models with V with extended measured values

Side 1

A	:400A	100%
B	:400A	100%
C	:400A	100%
N	: 0A	
SN	: 0A	
f	: 50.0Hz	

[grundbild6zei-ohne-u-ohne-erw-mw-20070116, 1, en_US]

Figure E-3 Default display of the 7SJ80 for models without V and extended measured values

Side 1

A	:400A	100%
B	:400A	100%
C	:400A	100%
N	: 0A	
SN	: 0A	
f	: 50.0Hz	

Side 2

A	:400A	MAX400A
B	:400A	MAX400A
C	:400A	MAX400A
N	: 0A	
SN	: 0A	
f	: 50.0Hz	

[grundbild6zei-ohne-u-und-erw-mw-20070116, 1, en_US]

Figure E-4 Default display of the 7SJ80 for models without V with extended measured values

Spontaneous Fault Display

After a fault has occurred, the most important fault data are automatically displayed after general device pickup in the order shown in the picture below.

50-1 PU	Protective Function that Picked up First;
50-1 TRIP	Protective Function that Tripped Last;
T - Pickup	Operating Time from General Pickup to Dropout;
T - TRIP	Operating Time from General Pickup to the First Trip Command;

[anzeige-spontanmeldungen-im-display-des-geraetes-260602-kn, 1, en_US]

Figure E-5 Representation of spontaneous messages on the device display

E.6 Protocol-dependent Functions

Protocol → Function ↓	IEC 60870-5-103, single	IEC 60870-5-103, redundant	IEC 60870-5-104 Ethernet (EN 100)	IEC 61850 Ethernet (EN 100)	PROFINET Ethernet (EN100)	Profibus DP	DNP 3 TCP Ethernet (EN100)	DNP3.0 Modbus ASCII/RTU
Operational measured values	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes
Metered values	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes
Fault recording	Yes	Yes	Yes	Yes	No	No	Yes	No
Remote protection setting	No	Yes	No	Yes	No	No	No	No
User-defined indications and switching objects	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes
Time synchronization	Yes	Yes	Yes	Yes	Yes	Yes	Yes	Yes
Messages with time stamp	Yes	Yes	Yes		Yes	Yes	Yes	Yes
Commissioning aids								
Data transmission stop	Yes	Yes	Yes	Yes	No	No	No	No
Creating test messages	Yes	Yes	Yes	Yes	No	No	No	No
Physical mode	Asynchronous	Asynchronous		Synchronous		Asynchronous		Asynchronous
Transmission mode	cyclically/event	cyclically/event	cyclically	cyclically/event	cyclically	cyclically	cyclically/event	cyclically/event ^(DNP) cyclically ^(Modbus)
Baudrate	1 200 to 115 000	2 400 to 57 600	up to 100 MBaud	up to 100 MBaud	up to 100 MBaud	up to 1.5 MBaud (Lichtwellenleiter) 6 MBaud (RS485)	up to 100 MBaud	9600 to 57600 ^(DNP) 300 to 57600 ^(Modbus)
Baud rate	RS232 RS485 optical fiber	RS485	Ethernet TP	Ethernet TP Ethernet optical fiber	Ethernet TP	RS485 optical fiber (double ring)	Ethernet TP Ethernet optical fiber	RS485 optical fiber

F Functions, Settings, Information

F.1	Functional Scope	472
F.2	Settings	474
F.3	Information List	505
F.4	Group Indications	543
F.5	Measured Values	545

F.1 Functional Scope

Addr.	Parameter	Setting Options	Default Setting	Comments
103	Grp Chge OPTION	Disabled Enabled	Disabled	Setting Group Change Option
104	OSC. FAULT REC.	Disabled Enabled	Enabled	Oscillographic Fault Records
112	Charac. Phase	Disabled Definite Time TOC IEC TOC ANSI	Definite Time	50/51
113	Charac. Ground	Disabled Definite Time TOC IEC TOC ANSI	Definite Time	50N/51N
115	67/67-TOC	Disabled Definite Time TOC IEC TOC ANSI	Definite Time	67, 67-TOC
116	67N/67N-TOC	Disabled Definite Time TOC IEC TOC ANSI	Definite Time	67N, 67N-TOC
117	Coldload Pickup	Disabled Enabled	Disabled	Cold Load Pickup
122	InrushRestraint	Disabled Enabled	Disabled	2nd Harmonic Inrush Restraint
127	50 1Ph	Disabled Enabled	Disabled	50 1Ph
130	S.Gnd.F.Dir.Ch	$\cos \varphi / \sin \varphi$ V0/I0 φ mea.	$\cos \varphi / \sin \varphi$	(sens.) Ground fault dir. characteristic
131	Sens. Gnd Fault	Disabled Definite Time User Defined PU	Disabled	(sensitive) Ground fault
133	INTERM.EF	Disabled with Ignd with 3I0 with Ignd,sens.	Disabled	Intermittent earth fault protection
134	Dir. Interm. EF	Disabled Enabled	Disabled	Dir. Intermittent earth fault protection
135	E Flt(ext)	Disabled EPTR Trans. Neutral	Disabled	Earth Fault(extend)
140	46	Disabled TOC ANSI TOC IEC Definite Time	Disabled	46 Negative Sequence Protection
142	49	Disabled No ambient temp	No ambient temp	49 Thermal Overload Protection

Addr.	Parameter	Setting Options	Default Setting	Comments
150	27/59	Disabled Enabled	Disabled	27, 59 Under/Overvoltage Protection
154	81 O/U	Disabled Enabled	Disabled	81 Over/Underfrequency Protection
155	27/Q-Protection	Disabled Enabled	Disabled	27 / Q dir. con. Protection
161	25 Function 1	Disabled SYNCHROCHECK	Disabled	25 Function group 1
170	50BF	Disabled Enabled enabled w/ 3I0>	Disabled	50BF Breaker Failure Protection
171	79 Auto Recl.	Disabled Enabled	Disabled	79 Auto-Reclose Function
172	52 B.WEAR MONIT	Disabled Ix-Method 2P-Method I2t-Method	Disabled	52 Breaker Wear Monitoring
180	Fault Locator	Disabled Enabled	Disabled	Fault Locator
181	L-sections FL	1 Section 2 Sections 3 Sections	1 Section	Line sections for fault locator
182	74 Trip Ct Supv	Disabled 2 Binary Inputs 1 Binary Input	Disabled	74TC Trip Circuit Supervision
617	ServiProt (CM)	Disabled T103 DIGSI	T103	Port B usage
-	FLEXIBLE FKT. 1...20	Flexible Funktion 01 Flexible Funktion 02 Flexible Funktion 03 Flexible Funktion 04 Flexible Funktion 05 Flexible Funktion 06 Flexible Funktion 07 Flexible Funktion 08 Flexible Funktion 09 Flexible Funktion 10 Flexible Funktion 11 Flexible Funktion 12 Flexible Funktion 13 Flexible Funktion 14 Flexible Funktion 15 Flexible Funktion 16 Flexible Funktion 17 Flexible Funktion 18 Flexible Funktion 19 Flexible Funktion 20	Bitte auswählen	Flexible Funktionen 1...20

F.2 Settings

Addresses which have an appended "A" can only be changed with DIGSI, under "Additional Settings".

The table indicates region-specific default settings. Column C (configuration) indicates the corresponding secondary nominal current of the current transformer.

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
0	FLEXIBLE FUNC.	Flx		OFF ON Alarm Only	OFF	Flexible Function
0	OPERRAT. MODE	Flx		3-phase 1-phase no reference	3-phase	Mode of Operation
0	BLK f out of r	Flx		YES NO	YES	Block while Freq. is out of range
0	MEAS. QUANTITY	Flx		Please select Current Voltage P forward P reverse Q forward Q reverse Power factor dV/dt rising dV/dt falling Frequency df/dt rising df/dt falling Binray Input	Please select	Selection of Measured Quantity
0	MEAS. METHOD	Flx		Fundamental True RMS Positive seq. Negative seq. Zero sequence Ratio I2/I1	Fundamental	Selection of Measurement Method
0	PICKUP WITH	Flx		Exceeding Dropping below	Exceeding	Pickup with
0	CURRENT	Flx		Ia Ib Ic In In sensitive In2	Ia	Current

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
0	VOLTAGE	Flx		Please select Va-n Vb-n Vc-n Va-b Vb-c Vc-a Vn Vx	Please select	Voltage
0	POWER	Flx		Ia Va-n Ib Vb-n Ic Vc-n	Ia Va-n	Power
0	VOLTAGE SYSTEM	Flx		Phase-Phase Phase-Ground	Phase-Phase	Voltage System
0	P.U. THRESHOLD	Flx		0.05 .. 40.00 A	2.00 A	Pickup Threshold
0	P.U. THRESHOLD	Flx	1A	0.05 .. 40.00 A	2.00 A	Pickup Threshold
			5A	0.25 .. 200.00 A	10.00 A	
0	P.U. THRESHOLD	Flx	1A	0.001 .. 1.500 A	0.100 A	Pickup Threshold
			5A	0.005 .. 7.500 A	0.500 A	
0	P.U. THRESHOLD	Flx		2.0 .. 260.0 V	110.0 V	Pickup Threshold
0	P.U. THRESHOLD	Flx		2.0 .. 200.0 V	110.0 V	Pickup Threshold
0	P.U. THRESHOLD	Flx		40.00 .. 60.00 Hz	51.00 Hz	Pickup Threshold
0	P.U. THRESHOLD	Flx		50.00 .. 70.00 Hz	61.00 Hz	Pickup Threshold
0	P.U. THRESHOLD	Flx		0.10 .. 20.00 Hz/s	5.00 Hz/s	Pickup Threshold
0	P.U. THRESHOLD	Flx	1A	2.0 .. 10000.0 W	200.0 W	Pickup Threshold
			5A	10.0 .. 50000.0 W	1000.0 W	
0	P.U. THRESHOLD	Flx	1A	2.0 .. 10000.0 VAR	200.0 VAR	Pickup Threshold
			5A	10.0 .. 50000.0 VAR	1000.0 VAR	
0	P.U. THRESHOLD	Flx		-0.99 .. 0.99	0.50	Pickup Threshold
0	P.U. THRESHOLD	Flx		15 .. 100 %	20 %	Pickup Threshold
0	P.U. THRESHOLD	Flx		4 .. 100 V/s	60 V/s	Pickup Threshold
0	P.U. THRESHOLD	Flx		2.0 .. 260.0 V	110.0 V	Pickup Threshold
0	T TRIP DELAY	Flx		0.00 .. 3600.00 sec	1.00 sec	Trip Time Delay
0A	T PICKUP DELAY	Flx		0.00 .. 60.00 sec	0.00 sec	Pickup Time Delay
0	T PICKUP DELAY	Flx		0.00 .. 28800.00 sec	0.00 sec	Pickup Time Delay
0A	T DROPOUT DELAY	Flx		0.00 .. 60.00 sec	0.00 sec	Dropout Time Delay
0A	BLK.by Vol.Loss	Flx		NO YES	YES	Block in case of Meas.- Voltage Loss
0A	DROPOUT RATIO	Flx		0.70 .. 0.99	0.95	Dropout Ratio
0A	DROPOUT RATIO	Flx		1.01 .. 3.00	1.05	Dropout Ratio
0	DO differential	Flx		0.02 .. 1.00 Hz	0.03 Hz	Dropout differential
201	CT Starpoint	P.System Data 1		towards Line towards Busbar	towards Line	CT Starpoint
202	Vnom PRIMARY	P.System Data 1		0.10 .. 800.00 kV	20.00 kV	Rated Primary Voltage
203	Vnom SECONDARY	P.System Data 1		34 .. 225 V	100 V	Rated Secondary Voltage (L-L)

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
204	CT PRIMARY	P.System Data 1		10 .. 50000 A	400 A	CT Rated Primary Current
205	CT SECONDARY	P.System Data 1		1A 5A	1A	CT Rated Secondary Current
206A	Vph / Vdelta	P.System Data 1		1.00 .. 3.00	1.73	Matching ratio Phase-VT To Open-Delta-VT
207	Vol. Symmetry	P.System Data 1		NO YES	NO	Assumption voltage symmetry
209	PHASE SEQ.	P.System Data 1		A B C A C B	A B C	Phase Sequence
210A	TMin TRIP CMD	P.System Data 1		0.01 .. 32.00 sec	0.15 sec	Minimum TRIP Command Duration
211A	TMax CLOSE CMD	P.System Data 1		0.01 .. 32.00 sec	1.00 sec	Maximum Close Command Duration
212	BkrClosed I MIN	P.System Data 1	1A	0.04 .. 1.00 A	0.04 A	Closed Breaker Min. Current Threshold
			5A	0.20 .. 5.00 A	0.20 A	
213	VT Connect. 3ph	P.System Data 1		Van, Vbn, Vcn Vab, Vbc, VGnd Vab, Vbc, VSyn Vab, Vbc Vph-g, VSyn Vab, Vbc, Vx	Van, Vbn, Vcn	VT Connection, three-phase
214	Rated Frequency	P.System Data 1		50 Hz 60 Hz	50 Hz	Rated Frequency
215	Distance Unit	P.System Data 1		km Miles	km	Distance measurement unit
217	Ignd-CT PRIM	P.System Data 1		1 .. 50000 A	60 A	Ignd-CT rated primary current
218	Ignd-CT SEC	P.System Data 1		1A 5A	1A	Ignd-CT rated secondary current
220	Threshold BI 1	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 1
221	Threshold BI 2	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 2
222	Threshold BI 3	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 3
223	Threshold BI 4	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 4
224	Threshold BI 5	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 5
225	Threshold BI 6	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 6

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
226	Threshold BI 7	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 7
227	Threshold BI 8	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 8
228	Threshold BI 9	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 9
229	Threshold BI 10	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 10
230	Threshold BI 11	P.System Data 1		Thresh. BI 176V Thresh. BI 88V Thresh. BI 19V	Thresh. BI 176V	Threshold for Binary Input 11
232	VXnom PRIMARY	P.System Data 1		0.10 .. 800.00 kV	20.00 kV	Rated Primary Voltage X
233	VXnom SECON-DARY	P.System Data 1		100 .. 225 V	100 V	Rated Secondary Voltage X
235A	ATEX100	P.System Data 1		NO YES	YES	Storage of th. Replicas w/o Power Supply
238	Ignd2-CT PRIM.	P.System Data 1		1 .. 50000 A	400 A	Ignd2-CT rated primary c. (conn. to I2)
239	Ignd2-CT SEC.	P.System Data 1		1A 5A	1A	Ignd2-CT rated secondary current (I2)
250A	50/51 2-ph prot	P.System Data 1		OFF ON	OFF	50, 51 Time Overcurrent with 2ph. prot.
251A	CT Connect.	P.System Data 1		A, B, C, (Gnd) A,G2,C,G; G->B A,G2,C,G; G2->B	A, B, C, (Gnd)	CT Connection
252	Ph LPCT pol.	P.System Data 1		not reversed reversed	not reversed	Phase LPCT orientation / polarity
260	Ir-52	P.System Data 1		10 .. 50000 A	125 A	Rated Normal Current (52 Breaker)
261	OP.CYCLES AT Ir	P.System Data 1		100 .. 1000000	10000	Switching Cycles at Rated Normal Current
262	Isc-52	P.System Data 1		10 .. 100000 A	25000 A	Rated Short-Circuit Breaking Current
263	OP.CYCLES Isc	P.System Data 1		1 .. 1000	50	Switch. Cycles at Rated Short-Cir. Curr.
264	Ix EXPONENT	P.System Data 1		1.0 .. 3.0	2.0	Exponent for the Ix-Method
265	Cmd.via control	P.System Data 1		(Einstellmöglich-keiten anwendung-sabhängig)	none	52 B.Wear: Open Cmd. via Control Device
266	T 52 BREAKTIME	P.System Data 1		1 .. 600 ms	80 ms	Breaktime (52 Breaker)
267	T 52 OPENING	P.System Data 1		1 .. 500 ms	65 ms	Opening Time (52 Breaker)

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
280	Holmgr. for Σi	P.System Data 1		NO YES	NO	Holmgreen-conn. (for fast sum-i-monit.)
302	CHANGE	Change Group		Group A Group B Group C Group D Binary Input Protocol	Group A	Change to Another Setting Group
310	Iph-PRIM ref.	P.System Data 1		10 .. 50000 A	400 A	Primary refer. phase current for prot.
311	Iph-LPCT PRIM	P.System Data 1		1 .. 5000 A	400 A	Rated primary phase current LPCT
312	Ignd-PRIM ref.	P.System Data 1		1 .. 50000 A	60 A	Primary refer. ground current for prot.
313	Ignd-LPCT PRIM	P.System Data 1		0.01 .. 5000.00 A	2.00 A	Rated primary ground current LPCT
314	Vph-LPCT SEC	P.System Data 1		10.0 .. 1000.0 mV	225.0 mV	Rated secondary phase voltage LPCT
315	Vgnd-LPCT SEC	P.System Data 1		10.0 .. 1000.0 mV	225.0 mV	Rated secondary ground voltage LPCT
320A	Corr.factor IL1	P.System Data 1		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IL1
321A	Corr.factor IL2	P.System Data 1		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IL2
322A	Corr.factor IL3	P.System Data 1		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IL3
323A	Corr.factor IE	P.System Data 1		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IE
324A	Corr.factor IEE	P.System Data 1		0.9000 .. 1.1000	1.0000	Correction factor for magnitude IEE
330	V-LPVT SEC	P.System Data 1		3.00 .. 17.00 V	3.25 V	rated secondary voltage LPVT
332A	V-LPVT PHA	P.System Data 1		-10.00 .. 10.00 °	0.00 °	phase angle LPVT
401	WAVEFORM-TRIGGER	Osc. Fault Rec.		Save w. Pickup Save w. TRIP Start w. TRIP	Save w. Pickup	Waveform Capture
402	WAVEFORM DATA	Osc. Fault Rec.		Fault event Pow.Sys.Flt.	Fault event	Scope of Waveform Data
403	MAX. LENGTH	Osc. Fault Rec.		0.30 .. 5.00 sec	2.00 sec	Max. length of a Waveform Capture Record
404	PRE. TRIG. TIME	Osc. Fault Rec.		0.05 .. 0.50 sec	0.25 sec	Captured Waveform Prior to Trigger
405	POST REC. TIME	Osc. Fault Rec.		0.05 .. 0.50 sec	0.10 sec	Captured Waveform after Event
406	BinIn CAPT.TIME	Osc. Fault Rec.		0.10 .. 5.00 sec; ∞	0.50 sec	Capture Time via Binary Input
610	FltDisp.LED/LCD	Device, General		Target on PU Target on TRIP	Target on PU	Fault Display on LED / LCD

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
611	Spont. FltDisp.	Device, General		YES NO	NO	Spontaneous display of flt.annunciations
613A	Gnd O/Cprot. w.	P.System Data 1		Ignd (measured) 3I0 (calcul.)	Ignd (measured)	Ground Overcurrent protection with
614A	OP. QUANTITY 59	P.System Data 1		Vphph Vph-n V1 V2	Vphph	Opera. Quantity for 59 Overvolt. Prot.
615A	OP. QUANTITY 27	P.System Data 1		V1 Vphph Vph-n	V1	Opera. Quantity for 27 Undervolt. Prot.
616	STATIC GEN.	P.System Data 1		YES NO	NO	Static or non self-exc. Asyn. Generator
640	Start image DD	Device, General		image 1 image 2 image 3 image 4 image 5 image 6 image 7 image 8	image 1	Start image Default Display
651	ParEN100(LC)blk	Device, General		OFF ON	OFF	DIGSI-config. over EN100 (LC) blocked
660	IP adr[0](Prim)	Device, General		0 .. 255	0	IP address [0] (NTP- Primary)
661	IP adr[1](Prim)	Device, General		0 .. 255	0	IP address [1] (NTP- Primary)
662	IP adr[2](Prim)	Device, General		0 .. 255	0	IP address [2] (NTP- Primary)
663	IP adr[3](Prim)	Device, General		0 .. 255	0	IP address [3] (NTP- Primary)
664	IP adr[0] (Sec)	Device, General		0 .. 255	0	IP address [0] (NTP- Sekundary)
665	IP adr[1] (Sec)	Device, General		0 .. 255	0	IP address [1] (NTP- Sekundary)
666	IP adr[2] (Sec)	Device, General		0 .. 255	0	IP address [2] (NTP- Sekundary)
667	IP adr[3] (Sec)	Device, General		0 .. 255	0	IP address [3] (NTP- Sekundary)
668	Client activ	Device, General		OFF ON	OFF	Client activ
669	Daylight Set	Device, General		OFF ON	OFF	Daylight Set
670	Offset TZ/min	Device, General		-1440 .. 1440 min	60 min	Offset for time zone in minutes
671	Offset DayT/min	Device, General		-1440 .. 1440 min	60 min	Offset for daylight in minutes
672	W2S month	Device, General		1 .. 12	3	month of time set winter to summer

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
673	W2S week	Device, General		1 .. 5	5	week of time set winter to summer
674	W2S day	Device, General		Monday Tuesday Wednesday Thursday Friday Saturday Sunday	Sunday	day of time set winter to summer
675	W2S hour	Device, General		1 .. 24	2	hour of time set winter to summer
676	S2W month	Device, General		1 .. 12	10	month of time set summer to winter
677	S2W week	Device, General		1 .. 5	5	week of time set summer to winter
678	S2W day	Device, General		Monday Tuesday Wednesday Thursday Friday Saturday Sunday	Sunday	day of time set summer to winter
679	S2W hour	Device, General		1 .. 24	3	hour of time set summer to winter
700	GOOSE-Stop	Device, General		YES NO	NO	GOOSE-Stop
1101	FullScaleVolt.	P.System Data 2		0.10 .. 800.00 kV	20.00 kV	Measurem:FullScale-Voltage(Equipm.rating)
1102	FullScaleCurr.	P.System Data 2		10 .. 50000 A	400 A	Measurem:FullScaleCurrent(Equipm.rating)
1103	RE/RL	P.System Data 2		-0.33 .. 7.00	1.00	Zero seq. compensating factor RE/RL
1104	XE/XL	P.System Data 2		-0.33 .. 7.00	1.00	Zero seq. compensating factor XE/XL
1105	x'	P.System Data 2	1A	0.0050 .. 15.0000 Ω/mi	0.2420 Ω/mi	feeder reactance per mile: x'
			5A	0.0010 .. 3.0000 Ω/mi	0.0484 Ω/mi	
1106	x'	P.System Data 2	1A	0.0050 .. 9.5000 Ω/km	0.1500 Ω/km	feeder reactance per km: x'
			5A	0.0010 .. 1.9000 Ω/km	0.0300 Ω/km	
1107	I MOTOR START	P.System Data 2	1A	0.40 .. 10.00 A	2.50 A	Motor Start Current (Block 49, Start 48)
			5A	2.00 .. 50.00 A	12.50 A	
1108	P,Q sign	P.System Data 2		not reversed reversed	not reversed	P,Q operational measured values sign
1109	Line angle	P.System Data 2		10 .. 89 °	85 °	Line angle
1110	Line length	P.System Data 2		0.1 .. 1000.0 km	100.0 km	Line length in kilometer

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
1111	Line length	P.System Data 2		0.1 .. 650.0 Miles	62.1 Miles	Line length in miles
1201	FCT 50/51	50/51 Overcur.		ON OFF	ON	50, 51 Phase Time Over-current
1202	50-2 PICKUP	50/51 Overcur.	1A	0.10 .. 35.00 A; ∞	4.00 A	50-2 Pickup
			5A	0.50 .. 175.00 A; ∞	20.00 A	
1203	50-2 DELAY	50/51 Overcur.		0.00 .. 60.00 sec; ∞	0.00 sec	50-2 Time Delay
1204	50-1 PICKUP	50/51 Overcur.	1A	0.10 .. 35.00 A; ∞	1.00 A	50-1 Pickup
			5A	0.50 .. 175.00 A; ∞	5.00 A	
1205	50-1 DELAY	50/51 Overcur.		0.00 .. 60.00 sec; ∞	0.50 sec	50-1 Time Delay
1207	51 PICKUP	50/51 Overcur.	1A	0.10 .. 4.00 A	1.00 A	51 Pickup
			5A	0.50 .. 20.00 A	5.00 A	
1208	51 TIME DIAL	50/51 Overcur.		0.05 .. 3.20 sec; ∞	0.50 sec	51 Time Dial
1209	51 TIME DIAL	50/51 Overcur.		0.50 .. 15.00 ; ∞	5.00	51 Time Dial
1210	51 Drop-out	50/51 Overcur.		Instantaneous Disk Emulation	Disk Emulation	Drop-out characteristic
1211	51 IEC CURVE	50/51 Overcur.		Normal Inverse Very Inverse Extremely Inv. Long Inverse	Normal Inverse	IEC Curve
1212	51 ANSI CURVE	50/51 Overcur.		Very Inverse Inverse Short Inverse Long Inverse Moderately Inv. Extremely Inv. Definite Inv.	Very Inverse	ANSI Curve
1213A	MANUAL CLOSE	50/51 Overcur.		50-3 instant. 50-2 instant. 50 -1 instant. 51 instant. Inactive	50-2 instant.	Manual Close Mode
1214A	50-2 active	50/51 Overcur.		Always with 79 active	Always	50-2 active
1215A	50 T DROP-OUT	50/51 Overcur.		0.00 .. 60.00 sec	0.00 sec	50 Drop-Out Time Delay
1216A	50-3 active	50/51 Overcur.		Always with 79 active	Always	50-3 active
1217	50-3 PICKUP	50/51 Overcur.	1A	1.00 .. 35.00 A; ∞	∞ A	50-3 Pickup
			5A	5.00 .. 175.00 A; ∞	∞ A	
1218	50-3 DELAY	50/51 Overcur.		0.00 .. 60.00 sec; ∞	0.00 sec	50-3 Time Delay
1219A	50-3 measurem.	50/51 Overcur.		Fundamental True RMS Instantaneous	Fundamental	50-3 measurement of
1220A	50-2 measurem.	50/51 Overcur.		Fundamental True RMS	Fundamental	50-2 measurement of
1221A	50-1 measurem.	50/51 Overcur.		Fundamental True RMS	Fundamental	50-1 measurement of

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
1222A	51 measur.	50/51 Overcur.		Fundamental True RMS	Fundamental	51 measurement of
1223	VOLT. INFLUENCE	50/51 Overcur.		NO Volt. controll. Volt. restraint	NO	51V Voltage Influence
1224	51V V<	50/51 Overcur.		10.0 .. 125.0 V	75.0 V	51V V< Threshold for Release Ip
1301	FCT 50N/51N	50/51 Overcur.		ON OFF	ON	50N, 51N Ground Time Overcurrent
1302	50N-2 PICKUP	50/51 Overcur.	1A	0.05 .. 35.00 A; ∞	0.50 A	50N-2 Pickup
			5A	0.25 .. 175.00 A; ∞	2.50 A	
1303	50N-2 DELAY	50/51 Overcur.		0.00 .. 60.00 sec; ∞	0.10 sec	50N-2 Time Delay
1304	50N-1 PICKUP	50/51 Overcur.	1A	0.05 .. 35.00 A; ∞	0.20 A	50N-1 Pickup
			5A	0.25 .. 175.00 A; ∞	1.00 A	
1305	50N-1 DELAY	50/51 Overcur.		0.00 .. 60.00 sec; ∞	0.50 sec	50N-1 Time Delay
1307	51N PICKUP	50/51 Overcur.	1A	0.05 .. 4.00 A	0.20 A	51N Pickup
			5A	0.25 .. 20.00 A	1.00 A	
1308	51N TIME DIAL	50/51 Overcur.		0.05 .. 3.20 sec; ∞	0.20 sec	51N Time Dial
1309	51N TIME DIAL	50/51 Overcur.		0.50 .. 15.00 ; ∞	5.00	51N Time Dial
1310	51N Drop-out	50/51 Overcur.		Instantaneous Disk Emulation	Disk Emulation	Drop-Out Characteristic
1311	51N IEC CURVE	50/51 Overcur.		Normal Inverse Very Inverse Extremely Inv. Long Inverse	Normal Inverse	IEC Curve
1312	51N ANSI CURVE	50/51 Overcur.		Very Inverse Inverse Short Inverse Long Inverse Moderately Inv. Extremely Inv. Definite Inv.	Very Inverse	ANSI Curve
1313A	MANUAL CLOSE	50/51 Overcur.		50N-3 instant. 50N-2 instant. 50N-1 instant. 51N instant. Inactive	50N-2 instant.	Manual Close Mode
1314A	50N-2 active	50/51 Overcur.		Always With 79 Active	Always	50N-2 active
1315A	50N T DROP-OUT	50/51 Overcur.		0.00 .. 60.00 sec	0.00 sec	50N Drop-Out Time Delay
1316A	50N-3 active	50/51 Overcur.		Always with 79 active	Always	50N-3 active
1317	50N-3 PICKUP	50/51 Overcur.		0.25 .. 35.00 A; ∞	∞ A	50N-3 Pickup
1318	50N-3 DELAY	50/51 Overcur.		0.00 .. 60.00 sec; ∞	0.05 sec	50N-3 Time Delay
1319A	50N-3 measur.	50/51 Overcur.		Fundamental True RMS Instantaneous	Fundamental	50N-3 measurement of

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
1320A	50N-2 measurem.	50/51 Overcur.		Fundamental True RMS	Fundamental	50N-2 measurement of
1321A	50N-1 measurem.	50/51 Overcur.		Fundamental True RMS	Fundamental	50N-1 measurement of
1322A	51N measurem.	50/51 Overcur.		Fundamental True RMS	Fundamental	51N measurement of
1501	FCT 67/67-TOC	67 Direct. O/C		OFF ON	OFF	67, 67-TOC Phase Time Overcurrent
1502	67-2 PICKUP	67 Direct. O/C	1A	0.10 .. 35.00 A; ∞	2.00 A	67-2 Pickup
			5A	0.50 .. 175.00 A; ∞	10.00 A	
1503	67-2 DELAY	67 Direct. O/C		0.00 .. 60.00 sec; ∞	0.10 sec	67-2 Time Delay
1504	67-1 PICKUP	67 Direct. O/C	1A	0.10 .. 35.00 A; ∞	1.00 A	67-1 Pickup
			5A	0.50 .. 175.00 A; ∞	5.00 A	
1505	67-1 DELAY	67 Direct. O/C		0.00 .. 60.00 sec; ∞	0.50 sec	67-1Time Delay
1507	67-TOC PICKUP	67 Direct. O/C	1A	0.10 .. 4.00 A	1.00 A	67-TOC Pickup
			5A	0.50 .. 20.00 A	5.00 A	
1508	67 TIME DIAL	67 Direct. O/C		0.05 .. 3.20 sec; ∞	0.50 sec	67-TOC Time Dial
1509	67 TIME DIAL	67 Direct. O/C		0.50 .. 15.00 ; ∞	5.00	67-TOC Time Dial
1510	67-TOC Drop-out	67 Direct. O/C		Instantaneous Disk Emulation	Disk Emulation	Drop-Out Characteristic
1511	67- IEC CURVE	67 Direct. O/C		Normal Inverse Very Inverse Extremely Inv. Long Inverse	Normal Inverse	IEC Curve
1512	67- ANSI CURVE	67 Direct. O/C		Very Inverse Inverse Short Inverse Long Inverse Moderately Inv. Extremely Inv. Definite Inv.	Very Inverse	ANSI Curve
1513A	MANUAL CLOSE	67 Direct. O/C		67-3 instant. 67-2 instant. 67-1 instant. 67-TOC instant. Inactive	67-2 instant.	Manual Close Mode
1514A	67-2 active	67 Direct. O/C		with 79 active always	always	67-2 active
1518A	67 T DROP-OUT	67 Direct. O/C		0.00 .. 60.00 sec	0.00 sec	67 Drop-Out Time Delay
1519A	ROTATION ANGLE	67 Direct. O/C		-180 .. 180 °	45 °	Rotation Angle of Refer- ence Voltage
1520A	67-2 MEASUREM.	67 Direct. O/C		Fundamental True RMS	Fundamental	67-2 measurement of
1521A	67-1 MEASUREM.	67 Direct. O/C		Fundamental True RMS	Fundamental	67-1 measurement of
1522A	67-TOC MEASUR.	67 Direct. O/C		Fundamental True RMS	Fundamental	67-TOC measurement of

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
1523	67-2 Direction	67 Direct. O/C		Forward Reverse Non-Directional	Forward	67-2 Direction
1524	67-1 Direction	67 Direct. O/C		Forward Reverse Non-Directional	Forward	67-1 Direction
1525	67-TOC Direct.	67 Direct. O/C		Forward Reverse Non-Directional	Forward	67-TOC Direction
1526	67-3 Direction	67 Direct. O/C		Forward Reverse Non-Directional	Forward	67-3 Direction
1527A	67-3 MEASUREM.	67 Direct. O/C		Fundamental True RMS	Fundamental	67-3 measurement of
1528	67-3 PICKUP	67 Direct. O/C	1A	1.00 .. 35.00 A; ∞	∞ A	67-3 Pickup
			5A	5.00 .. 175.00 A; ∞	∞ A	
1529	67-3 DELAY	67 Direct. O/C		0.00 .. 60.00 sec; ∞	0.00 sec	67-3 Time Delay
1530	67	67 Direct. O/C		1.00 .. 20.00 I/lp; ∞ 0.01 .. 999.00 TD		67
1531	MofPU Res T/Tp	67 Direct. O/C		0.05 .. 0.95 I/lp; ∞ 0.01 .. 999.00 TD		Multiple of Pickup <-> T/Tp
1532A	67-3 active	67 Direct. O/C		always with 79 active	always	67-3 active
1601	FCT 67N/67N-TOC	67 Direct. O/C		OFF ON	OFF	67N, 67N-TOC Ground Time Overcurrent
1602	67N-2 PICKUP	67 Direct. O/C	1A	0.05 .. 35.00 A; ∞	0.50 A	67N-2 Pickup
			5A	0.25 .. 175.00 A; ∞	2.50 A	
1603	67N-2 DELAY	67 Direct. O/C		0.00 .. 60.00 sec; ∞	0.10 sec	67N-2 Time Delay
1604	67N-1 PICKUP	67 Direct. O/C	1A	0.05 .. 35.00 A; ∞	0.20 A	67N-1 Pickup
			5A	0.25 .. 175.00 A; ∞	1.00 A	
1605	67N-1 DELAY	67 Direct. O/C		0.00 .. 60.00 sec; ∞	0.50 sec	67N-1 Time Delay
1607	67N-TOC PICKUP	67 Direct. O/C	1A	0.05 .. 4.00 A	0.20 A	67N-TOC Pickup
			5A	0.25 .. 20.00 A	1.00 A	
1608	67N-TOC T-DIAL	67 Direct. O/C		0.05 .. 3.20 sec; ∞	0.20 sec	67N-TOC Time Dial
1609	67N-TOC T-DIAL	67 Direct. O/C		0.50 .. 15.00 ; ∞	5.00	67N-TOC Time Dial
1610	67N-TOC DropOut	67 Direct. O/C		Instantaneous Disk Emulation	Disk Emulation	Drop-Out Characteristic
1611	67N-TOC IEC	67 Direct. O/C		Normal Inverse Very Inverse Extremely Inv. Long Inverse	Normal Inverse	IEC Curve
1612	67N-TOC ANSI	67 Direct. O/C		Very Inverse Inverse Short Inverse Long Inverse Moderately Inv. Extremely Inv. Definite Inv.	Very Inverse	ANSI Curve

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
1613A	MANUAL CLOSE	67 Direct. O/C		67N-3 instant. 67N-2 instant. 67N-1 instant. 67N-TOC instant Inactive	67N-2 instant.	Manual Close Mode
1614A	67N-2 active	67 Direct. O/C		always with 79 active	always	67N-2 active
1617	67N POLARIZAT.	67 Direct. O/C		with VN and IN with V2 and I2	with VN and IN	Ground Polarization
1618A	67N T DROP-OUT	67 Direct. O/C		0.00 .. 60.00 sec	0.00 sec	67N Drop-Out Time Delay
1619A	ROTATION ANGLE	67 Direct. O/C		-180 .. 180 °	-45 °	Rotation Angle of Reference Voltage
1620A	67N-2 MEASUREM.	67 Direct. O/C		Fundamental True RMS	Fundamental	67N-2 measurement of
1621A	67N-1 MEASUREM.	67 Direct. O/C		Fundamental True RMS	Fundamental	67N-1 measurement of
1622A	67N-TOC MEASUR.	67 Direct. O/C		Fundamental True RMS	Fundamental	67N-TOC measurement of
1623	67N-2 Direction	67 Direct. O/C		Forward Reverse Non-Directional	Forward	67N-2 Direction
1624	67N-1 Direction	67 Direct. O/C		Forward Reverse Non-Directional	Forward	67N-1 Direction
1625	67N-TOC Direct.	67 Direct. O/C		Forward Reverse Non-Directional	Forward	67N-TOC Direction
1626	67N-3 Direction	67 Direct. O/C		Forward Reverse Non-Directional	Forward	67N-3 Direction
1627A	67N-3 MEASUREM.	67 Direct. O/C		Fundamental True RMS	Fundamental	67N-3 measurement of
1628	67N-3 PICKUP	67 Direct. O/C		0.50 .. 35.00 A; ∞	∞ A	67N-3 Pickup
1629	67N-3 DELAY	67 Direct. O/C		0.00 .. 60.00 sec; ∞	0.00 sec	67N-3 Time Delay
1630	M.of PU TD	67 Direct. O/C		1.00 .. 20.00 I/I _p ; ∞ 0.01 .. 999.00 TD		Multiples of PU Time-Dial
1631	I/I _p R _f T/T _{Ep}	67 Direct. O/C		0.05 .. 0.95 I/I _p ; ∞ 0.01 .. 999.00 TD		67N TOC
1632A	67N-3 active	67 Direct. O/C		always with 79 active	always	67N-3 active
1701	COLDLOAD PICKUP	ColdLoadPickup		OFF ON	OFF	Cold-Load-Pickup Function
1702	Start Condition	ColdLoadPickup		No Current Breaker Contact 79 ready	No Current	Start Condition
1703	CB Open Time	ColdLoadPickup		0 .. 21600 sec	3600 sec	Circuit Breaker OPEN Time
1704	Active Time	ColdLoadPickup		0 .. 21600 sec	3600 sec	Active Time

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
1705	Stop Time	ColdLoadPickup		1 .. 600 sec; ∞	600 sec	Stop Time
1801	50c-2 PICKUP	ColdLoadPickup	1A	0.10 .. 35.00 A; ∞	10.00 A	50c-2 Pickup
			5A	0.50 .. 175.00 A; ∞	50.00 A	
1802	50c-2 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.00 sec	50c-2 Time Delay
1803	50c-1 PICKUP	ColdLoadPickup	1A	0.10 .. 35.00 A; ∞	2.00 A	50c-1 Pickup
			5A	0.50 .. 175.00 A; ∞	10.00 A	
1804	50c-1 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.30 sec	50c-1 Time Delay
1805	51c PICKUP	ColdLoadPickup	1A	0.10 .. 4.00 A	1.50 A	51c Pickup
			5A	0.50 .. 20.00 A	7.50 A	
1806	51c TIME DIAL	ColdLoadPickup		0.05 .. 3.20 sec; ∞	0.50 sec	51c Time dial
1807	51c TIME DIAL	ColdLoadPickup		0.50 .. 15.00 ; ∞	5.00	51c Time dial
1808	50c-3 PICKUP	ColdLoadPickup	1A	1.00 .. 35.00 A; ∞	∞ A	50c-3 Pickup
			5A	5.00 .. 175.00 A; ∞	∞ A	
1809	50c-3 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.00 sec	50c-3 Time Delay
1901	50Nc-2 PICKUP	ColdLoadPickup	1A	0.05 .. 35.00 A; ∞	7.00 A	50Nc-2 Pickup
			5A	0.25 .. 175.00 A; ∞	35.00 A	
1902	50Nc-2 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.00 sec	50Nc-2 Time Delay
1903	50Nc-1 PICKUP	ColdLoadPickup	1A	0.05 .. 35.00 A; ∞	1.50 A	50Nc-1 Pickup
			5A	0.25 .. 175.00 A; ∞	7.50 A	
1904	50Nc-1 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.30 sec	50Nc-1 Time Delay
1905	51Nc PICKUP	ColdLoadPickup	1A	0.05 .. 4.00 A	1.00 A	51Nc Pickup
			5A	0.25 .. 20.00 A	5.00 A	
1906	51Nc T-DIAL	ColdLoadPickup		0.05 .. 3.20 sec; ∞	0.50 sec	51Nc Time Dial
1907	51Nc T-DIAL	ColdLoadPickup		0.50 .. 15.00 ; ∞	5.00	51Nc Time Dial
1908	50Nc-3 PICKUP	ColdLoadPickup		0.05 .. 35.00 A; ∞	∞ A	50Nc-3 Pickup
1909	50Nc-3 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.00 sec	50Nc-3 Time Delay
2001	67c-2 PICKUP	ColdLoadPickup	1A	0.10 .. 35.00 A; ∞	10.00 A	67c-2 Pickup
			5A	0.50 .. 175.00 A; ∞	50.00 A	
2002	67c-2 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.00 sec	67c-2 Time Delay
2003	67c-1 PICKUP	ColdLoadPickup	1A	0.10 .. 35.00 A; ∞	2.00 A	67c-1 Pickup
			5A	0.50 .. 175.00 A; ∞	10.00 A	
2004	67c-1 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.30 sec	67c-1 Time Delay
2005	67c-TOC PICKUP	ColdLoadPickup	1A	0.10 .. 4.00 A	1.50 A	67c Pickup
			5A	0.50 .. 20.00 A	7.50 A	
2006	67c-TOC T-DIAL	ColdLoadPickup		0.05 .. 3.20 sec; ∞	0.50 sec	67c Time Dial
2007	67c-TOC T-DIAL	ColdLoadPickup		0.50 .. 15.00 ; ∞	5.00	67c Time Dial
2008	67c-3 PICKUP	ColdLoadPickup	1A	1.00 .. 35.00 A; ∞	∞ A	67c-3 Pickup
			5A	5.00 .. 175.00 A; ∞	∞ A	
2009	67c-3 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.00 sec	67c-3 Time Delay
2101	67Nc-2 PICKUP	ColdLoadPickup	1A	0.05 .. 35.00 A; ∞	7.00 A	67Nc-2 Pickup
			5A	0.25 .. 175.00 A; ∞	35.00 A	
2102	67Nc-2 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.00 sec	67Nc-2 Time Delay
2103	67Nc-1 PICKUP	ColdLoadPickup	1A	0.05 .. 35.00 A; ∞	1.50 A	67Nc-1 Pickup
			5A	0.25 .. 175.00 A; ∞	7.50 A	
2104	67Nc-1 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.30 sec	67Nc-1 Time Delay
2105	67Nc-TOC PICKUP	ColdLoadPickup	1A	0.05 .. 4.00 A	1.00 A	67Nc-TOC Pickup
			5A	0.25 .. 20.00 A	5.00 A	

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
2106	67Nc-TOC T-DIAL	ColdLoadPickup		0.05 .. 3.20 sec; ∞	0.50 sec	67Nc-TOC Time Dial
2107	67Nc-TOC T-DIAL	ColdLoadPickup		0.50 .. 15.00 ; ∞	5.00	67Nc-TOC Time Dial
2108	67Nc-3 PICKUP	ColdLoadPickup		0.25 .. 35.00 A; ∞	∞ A	67Nc-3 Pickup
2109	67Nc-3 DELAY	ColdLoadPickup		0.00 .. 60.00 sec; ∞	0.00 sec	67Nc-3 Time Delay
2201	INRUSH REST.	50/51 Overcur.		OFF ON	OFF	Inrush Restraint
2202	2nd HARMONIC	50/51 Overcur.		10 .. 45 %	15 %	2nd. harmonic in % of fundamental
2203	CROSS BLOCK	50/51 Overcur.		NO YES	NO	Cross Block
2204	CROSS BLK TIMER	50/51 Overcur.		0.00 .. 180.00 sec	0.00 sec	Cross Block Time
2205	I Max	50/51 Overcur.	1A	0.30 .. 25.00 A	7.50 A	Maximum Current for Inrush Restraint
			5A	1.50 .. 125.00 A	37.50 A	
2701	50 1Ph	50 1Ph		OFF ON	OFF	50 1Ph
2703	50 1Ph-2 PICKUP	50 1Ph	1A	0.001 .. 1.600 A; ∞	0.300 A	50 1Ph-2 Pickup
			5A	0.005 .. 8.000 A; ∞	1.500 A	
2704	50 1Ph-2 DELAY	50 1Ph		0.00 .. 60.00 sec; ∞	0.10 sec	50 1Ph-2 Time Delay
2706	50 1Ph-1 PICKUP	50 1Ph	1A	0.001 .. 1.600 A; ∞	0.100 A	50 1Ph-1 Pickup
			5A	0.005 .. 8.000 A; ∞	0.500 A	
2707	50 1Ph-1 DELAY	50 1Ph		0.00 .. 60.00 sec; ∞	0.50 sec	50 1Ph-1 Time Delay
3101	Sens. Gnd Fault	Sens. Gnd Fault		OFF ON ON with GF log Alarm Only	OFF	(Sensitive) Ground Fault
3102	CT Err. I1	Sens. Gnd Fault	1A	0.001 .. 1.600 A	0.050 A	Current I1 for CT Angle Error
			5A	0.005 .. 8.000 A	0.250 A	
3102	CT Err. I1	Sens. Gnd Fault	1A	0.05 .. 35.00 A	1.00 A	Current I1 for CT Angle Error
			5A	0.25 .. 175.00 A	5.00 A	
3103	CT Err. F1	Sens. Gnd Fault		0.0 .. 5.0 °	0.0 °	CT Angle Error at I1
3104	CT Err. I2	Sens. Gnd Fault	1A	0.001 .. 1.600 A	1.000 A	Current I2 for CT Angle Error
			5A	0.005 .. 8.000 A	5.000 A	
3104	CT Err. I2	Sens. Gnd Fault	1A	0.05 .. 35.00 A	10.00 A	Current I2 for CT Angle Error
			5A	0.25 .. 175.00 A	50.00 A	
3105	CT Err. F2	Sens. Gnd Fault		0.0 .. 5.0 °	0.0 °	CT Angle Error at I2
3106	VPH MIN	Sens. Gnd Fault		10 .. 100 V	40 V	L-Gnd Voltage of Faulted Phase Vph Min
3107	VPH MAX	Sens. Gnd Fault		10 .. 100 V	75 V	L-Gnd Voltage of Unfaulted Phase Vph Max
3109	64-1 VGND	Sens. Gnd Fault		1.8 .. 200.0 V; ∞	40.0 V	64-1 Ground Displacement Voltage
3110	64-1 VGND	Sens. Gnd Fault		10.0 .. 225.0 V; ∞	70.0 V	64-1 Ground Displacement Voltage
3111	T-DELAY Pickup	Sens. Gnd Fault		0.04 .. 320.00 sec; ∞	1.00 sec	Time-DELAY Pickup
3112	64-1 DELAY	Sens. Gnd Fault		0.10 .. 40000.00 sec; ∞	10.00 sec	64-1 Time Delay

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
3113	50Ns-2 PICKUP	Sens. Gnd Fault	1A	0.001 .. 1.600 A	0.300 A	50Ns-2 Pickup
			5A	0.005 .. 8.000 A	1.500 A	
3113	50Ns-2 PICKUP	Sens. Gnd Fault	1A	0.05 .. 35.00 A	10.00 A	50Ns-2 Pickup
			5A	0.25 .. 175.00 A	50.00 A	
3114	50Ns-2 DELAY	Sens. Gnd Fault		0.00 .. 320.00 sec; ∞	1.00 sec	50Ns-2 Time Delay
3115	67Ns-2 DIRECT	Sens. Gnd Fault		Forward Reverse Non-Directional	Forward	67Ns-2 Direction
3117	50Ns-1 PICKUP	Sens. Gnd Fault	1A	0.001 .. 1.600 A	0.100 A	50Ns-1 Pickup
			5A	0.005 .. 8.000 A	0.500 A	
3117	50Ns-1 PICKUP	Sens. Gnd Fault	1A	0.05 .. 35.00 A	2.00 A	50Ns-1 Pickup
			5A	0.25 .. 175.00 A	10.00 A	
3118	50Ns-1 DELAY	Sens. Gnd Fault		0.00 .. 320.00 sec; ∞	2.00 sec	50Ns-1 Time delay
3119	51Ns PICKUP	Sens. Gnd Fault	1A	0.001 .. 1.400 A	0.100 A	51Ns Pickup
			5A	0.005 .. 7.000 A	0.500 A	
3119	51Ns PICKUP	Sens. Gnd Fault	1A	0.05 .. 4.00 A	1.00 A	51Ns Pickup
			5A	0.25 .. 20.00 A	5.00 A	
3120	51Ns TIME DIAL	Sens. Gnd Fault		0.10 .. 4.00 sec; ∞	1.00 sec	51Ns Time Dial
3121A	50Ns T DROP-OUT	Sens. Gnd Fault		0.00 .. 60.00 sec	0.00 sec	50Ns Drop-Out Time Delay
3122	67Ns-1 DIRECT.	Sens. Gnd Fault		Forward Reverse Non-Directional	Forward	67Ns-1 Direction
3123	RELEASE DIRECT.	Sens. Gnd Fault	1A	0.001 .. 1.200 A	0.010 A	Release directional element
			5A	0.005 .. 6.000 A	0.050 A	
3123	RELEASE DIRECT.	Sens. Gnd Fault	1A	0.05 .. 30.00 A	0.50 A	Release directional element
			5A	0.25 .. 150.00 A	2.50 A	
3124	PHI CORRECTION	Sens. Gnd Fault		-45.0 .. 45.0 °	0.0 °	Correction Angle for Dir. Determination
3125	MEAS. METHOD	Sens. Gnd Fault		COS ϕ SIN ϕ	COS ϕ	Measurement method for Direction
3126	RESET DELAY	Sens. Gnd Fault		0 .. 60 sec	1 sec	Reset Delay
3130	PU CRITERIA	Sens. Gnd Fault		Vgnd OR INs Vgnd AND INs	Vgnd OR INs	Sensitive Ground Fault PICKUP criteria
3131	M.of PU TD	Sens. Gnd Fault		1.00 .. 20.00 MofPU; ∞ 0.01 .. 999.00 TD		Multiples of PU Time-Dial
3150	50Ns-2 Vmin	Sens. Gnd Fault		0.4 .. 50.0 V	2.0 V	50Ns-2 minimum voltage
3150	50Ns-2 Vmin	Sens. Gnd Fault		10.0 .. 90.0 V	10.0 V	50Ns-2 minimum voltage
3151	50Ns-2 Phi	Sens. Gnd Fault		-180.0 .. 180.0 °	-90.0 °	50Ns-2 angle phi
3152	50Ns-2 DeltaPhi	Sens. Gnd Fault		0.0 .. 180.0 °	30.0 °	50Ns-2 angle delta phi
3153	50Ns-1 Vmin	Sens. Gnd Fault		0.4 .. 50.0 V	6.0 V	50Ns-1 minimum voltage
3153	50Ns-1 Vmin	Sens. Gnd Fault		10.0 .. 90.0 V	15.0 V	50Ns-1 minimum voltage
3154	50Ns-1 Phi	Sens. Gnd Fault		-180.0 .. 180.0 °	-160.0 °	50Ns-1 angle phi
3155	50Ns-1 DeltaPhi	Sens. Gnd Fault		0.0 .. 180.0 °	100.0 °	50Ns-1 angle delta phi

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
3160	α1 red.dir.area	Sens. Gnd Fault		1 .. 15 °	2 °	Alpha1 (reduction directional area)
3161	α2 red.dir.area	Sens. Gnd Fault		1 .. 15 °	2 °	Alpha2 (reduction directional area)
3301	INTERM.EF	Intermit. EF		OFF ON	OFF	Intermittent earth fault protection
3302	lie>	Intermit. EF	1A	0.05 .. 35.00 A	1.00 A	Pick-up value of interm. E/F stage
			5A	0.25 .. 175.00 A	5.00 A	
3302	lie>	Intermit. EF	1A	0.05 .. 35.00 A	1.00 A	Pick-up value of interm. E/F stage
			5A	0.25 .. 175.00 A	5.00 A	
3302	lie>	Intermit. EF		0.005 .. 1.500 A	1.000 A	Pick-up value of interm. E/F stage
3303	T-det.ext.	Intermit. EF		0.00 .. 10.00 sec	0.10 sec	Detection extension time
3304	T-sum det.	Intermit. EF		0.00 .. 100.00 sec	20.00 sec	Sum of detection times
3305	T-reset	Intermit. EF		1 .. 600 sec	300 sec	Reset time
3306	Nos.det.	Intermit. EF		2 .. 10	3	No. of det. for start of int. E/F prot
3401	Dir. Interm. EF	Dir. Interm. EF		OFF ON ON with GF log Alarm Only	OFF	Dir. Intermittent earth fault protection
3402	Direction	Dir. Interm. EF		Forward Reverse	Forward	Direction to be protected
3403	No. of pulses	Dir. Interm. EF		2 .. 50	5	Pulse no. for detecting the interm. E/F
3404	Monitoring time	Dir. Interm. EF		0.04 .. 10.00 sec	2.00 sec	Monitoring time after pickup detected
3405	Vgnd> / 3V0>	Dir. Interm. EF		2.0 .. 100.0 V	20.0 V	Vgnd> measured / 3V0> calculated
3406	Pickup	Dir. Interm. EF		with Vgnd/3V0> with oper. dir.	with Vgnd/3V0>	Pickup of the function
3501	EPTR	E Flt(ext)		OFF ON	OFF	EPTR
3502	Trans. Neutral	E Flt(ext)		OFF ON	OFF	Transformer Neutral protection(TNP)
3503	Pickup current	E Flt(ext)	1A	0.001 .. 1.400 A	0.008 A	Pickup current
			5A	0.005 .. 7.000 A	0.040 A	
3504	Pickup current	E Flt(ext)		0.05 .. 4.00 A	0.12 A	Pickup current
3505	EPTR I Tmax	E Flt(ext)	1A	0.001 .. 1.400 A	0.008 A	Current at Maximum Time Delay
			5A	0.005 .. 7.000 A	0.040 A	
3506	TNP I Tmax	E Flt(ext)		0.05 .. 4.00 A	0.12 A	Current at Maximum Time Delay
3507	EPTR I Tmin	E Flt(ext)	1A	0.003 .. 4.000 A	3.333 A	Current at Minimum Time Delay
			5A	0.015 .. 20.000 A	16.665 A	
3508	TNP I Tmin	E Flt(ext)		0.05 .. 20.00 A	1.00 A	Current at Minimum Time Delay
3509	EPTR I Tknee	E Flt(ext)	1A	0.003 .. 1.400 A	0.100 A	Current at Knee Point
			5A	0.015 .. 7.000 A	0.500 A	
3510	TNP I Tknee	E Flt(ext)		0.05 .. 17.00 A	0.20 A	Current at Knee Point

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
3511	T knee	E Flt(ext) E Flt(ext)		0.20 .. 100.00 sec	26.70 sec	Time Delay at Knee Point
3512	T min	E Flt(ext) E Flt(ext)		0.10 .. 30.00 sec	0.80 sec	Minimum Time Delay
3513	T max	E Flt(ext) E Flt(ext)		0.50 .. 300.00 sec	139.90 sec	Maximum Time Delay
3514	TRANSLATION T	E Flt(ext) E Flt(ext)		-0.50 .. 30.00 sec	0.00 sec	Delay time T of the whole function
4001	FCT 46	46 Negative Seq		OFF ON	OFF	46 Negative Sequence Protection
4002	46-1 PICKUP	46 Negative Seq	1A	0.05 .. 3.00 A	0.10 A	46-1 Pickup
			5A	0.25 .. 15.00 A	0.50 A	
4003	46-1 DELAY	46 Negative Seq		0.00 .. 60.00 sec; ∞	1.50 sec	46-1 Time Delay
4004	46-2 PICKUP	46 Negative Seq	1A	0.05 .. 3.00 A	0.50 A	46-2 Pickup
			5A	0.25 .. 15.00 A	2.50 A	
4005	46-2 DELAY	46 Negative Seq		0.00 .. 60.00 sec; ∞	1.50 sec	46-2 Time Delay
4006	46 IEC CURVE	46 Negative Seq		Normal Inverse Very Inverse Extremely Inv.	Extremely Inv.	IEC Curve
4007	46 ANSI CURVE	46 Negative Seq		Extremely Inv. Inverse Moderately Inv. Very Inverse	Extremely Inv.	ANSI Curve
4008	46-TOC PICKUP	46 Negative Seq	1A	0.05 .. 2.00 A	0.90 A	46-TOC Pickup
			5A	0.25 .. 10.00 A	4.50 A	
4009	46-TOC TIMEDIAL	46 Negative Seq		0.50 .. 15.00 ; ∞	5.00	46-TOC Time Dial
4010	46-TOC TIMEDIAL	46 Negative Seq		0.05 .. 3.20 sec; ∞	0.50 sec	46-TOC Time Dial
4011	46-TOC RESET	46 Negative Seq		Instantaneous Disk Emulation	Instantaneous	46-TOC Drop Out
4012A	46 T DROP-OUT	46 Negative Seq		0.00 .. 60.00 sec	0.00 sec	46 Drop-Out Time Delay
4201	FCT 49	49 Th.Overload		OFF ON Alarm Only	OFF	49 Thermal overload protection
4202	49 K-FACTOR	49 Th.Overload		0.10 .. 4.00	1.10	49 K-Factor
4203	TIME CONSTANT	49 Th.Overload		1.0 .. 999.9 min	100.0 min	Time Constant
4204	49 Θ ALARM	49 Th.Overload		50 .. 100 %	90 %	49 Thermal Alarm Stage
4205	I ALARM	49 Th.Overload	1A	0.10 .. 4.00 A	1.00 A	Current Overload Alarm Setpoint
			5A	0.50 .. 20.00 A	5.00 A	
4207A	Kt-FACTOR	49 Th.Overload		1.0 .. 10.0	1.0	Kt-FACTOR when motor stops
4208A	T EMERGENCY	49 Th.Overload		10 .. 15000 sec	100 sec	Emergency time

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
5001	FCT 59	27/59 O/U Volt.		OFF ON Alarm Only	OFF	59 Overvoltage Protection
5002	59-1 PICKUP	27/59 O/U Volt.		20 .. 260 V	110 V	59-1 Pickup
5003	59-1 PICKUP	27/59 O/U Volt.		20 .. 150 V	110 V	59-1 Pickup
5004	59-1 DELAY	27/59 O/U Volt.		0.00 .. 200.00 sec; ∞	0.50 sec	59-1 Time Delay
5005	59-2 PICKUP	27/59 O/U Volt.		20 .. 260 V	120 V	59-2 Pickup
5006	59-2 PICKUP	27/59 O/U Volt.		20 .. 150 V	120 V	59-2 Pickup
5007	59-2 DELAY	27/59 O/U Volt.		0.00 .. 200.00 sec; ∞	0.50 sec	59-2 Time Delay
5015	59-1 PICKUP V2	27/59 O/U Volt.		2 .. 150 V	30 V	59-1 Pickup V2
5016	59-2 PICKUP V2	27/59 O/U Volt.		2 .. 150 V	50 V	59-2 Pickup V2
5017A	59-1 DOUT RATIO	27/59 O/U Volt.		0.90 .. 0.99	0.95	59-1 Dropout Ratio
5018A	59-2 DOUT RATIO	27/59 O/U Volt.		0.90 .. 0.99	0.95	59-2 Dropout Ratio
5019	59-1 PICKUP V1	27/59 O/U Volt.		20 .. 150 V	110 V	59-1 Pickup V1
5020	59-2 PICKUP V1	27/59 O/U Volt.		20 .. 150 V	120 V	59-2 Pickup V1
5030	59.S1 PICKUP	27/59 O/U Volt.		0.20 .. 1.50 Un	1.10 Un	59.S1 Pickup
5032A	59.S1 D-RATIO	27/59 O/U Volt.		0.90 .. 0.99	0.96	59.S1 Dropout Ratio
5034	59.S2 PICKUP	27/59 O/U Volt.		0.20 .. 1.50 Un	1.20 Un	59.S2 Pickup
5035	59.S2 Oper. T	27/59 O/U Volt.		0.05 .. 100.00 sec; ∞	0.60 sec	59.S2 Operating Time
5036A	59.S2 D-RATIO	27/59 O/U Volt.		0.90 .. 0.99	0.96	59.S2 Dropout Ratio
5101	FCT 27	27/59 O/U Volt.		OFF ON Alarm Only	OFF	27 Undervoltage Protection
5102	27-1 PICKUP	27/59 O/U Volt.		10 .. 210 V	75 V	27-1 Pickup
5103	27-1 PICKUP	27/59 O/U Volt.		10 .. 120 V	45 V	27-1 Pickup
5106	27-1 DELAY	27/59 O/U Volt.		0.00 .. 200.00 sec; ∞	1.50 sec	27-1 Time Delay
5110	27-2 PICKUP	27/59 O/U Volt.		10 .. 210 V	70 V	27-2 Pickup
5111	27-2 PICKUP	27/59 O/U Volt.		10 .. 120 V	40 V	27-2 Pickup
5112	27-2 DELAY	27/59 O/U Volt.		0.00 .. 200.00 sec; ∞	0.50 sec	27-2 Time Delay
5113A	27-1 DOUT RATIO	27/59 O/U Volt.		1.01 .. 3.00	1.20	27-1 Dropout Ratio
5114A	27-2 DOUT RATIO	27/59 O/U Volt.		1.01 .. 3.00	1.20	27-2 Dropout Ratio
5120A	CURRENT SUPERV.	27/59 O/U Volt.		OFF ON	ON	Current Supervision
5130	27.S1 PICKUP	27/59 O/U Volt.		0.10 .. 1.20 Un	0.85 Un	27.S1 Pickup
5131	27.S1 Oper. T	27/59 O/U Volt.		0.05 .. 100.00 sec; ∞	1.50 sec	27.S1 Operating Time
5132A	27.S1 D-RATIO	27/59 O/U Volt.		1.01 .. 3.00	1.04	27.S1 Dropout Ratio
5134	27.S2 PICKUP	27/59 O/U Volt.		0.10 .. 1.20 Un	0.30 Un	27.S2 Pickup
5135	27.S2 Oper. T	27/59 O/U Volt.		0.05 .. 100.00 sec; ∞	0.20 sec	27.S2 Operating Time
5136A	27.S2 D-RATIO	27/59 O/U Volt.		1.01 .. 3.00	1.04	27.S2 Dropout Ratio
5201	VT BROKEN WIRE	Meas- urem.Superv		ON OFF	OFF	VT broken wire supervision

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
5202	$\Sigma V >$	Meas- urem.Superv		1.0 .. 100.0 V	8.0 V	Threshold voltage sum
5203	Vph-ph max<	Meas- urem.Superv		1.0 .. 100.0 V	16.0 V	Maximum phase to phase voltage
5204	Vph-ph min<	Meas- urem.Superv		1.0 .. 100.0 V	16.0 V	Minimum phase to phase voltage
5205	Vph-ph max-min>	Meas- urem.Superv		10.0 .. 200.0 V	16.0 V	Symmetry phase to phase voltages
5206	I min>	Meas- urem.Superv	1A	0.04 .. 1.00 A	0.04 A	Minimum line current
			5A	0.20 .. 5.00 A	0.20 A	
5208	T DELAY ALARM	Meas- urem.Superv		0.00 .. 32.00 sec	1.25 sec	Alarm delay time
5301	FUSE FAIL MON.	Meas- urem.Superv		OFF Solid grounded Coil.gnd./isol.	OFF	Fuse Fail Monitor
5302	FUSE FAIL 3Vo	Meas- urem.Superv		10 .. 100 V	30 V	Zero Sequence Voltage
5303	FUSE FAIL RESID	Meas- urem.Superv	1A	0.10 .. 1.00 A	0.10 A	Residual Current
			5A	0.50 .. 5.00 A	0.50 A	
5308A	FFM Idiff (3ph)	Meas- urem.Superv	1A	0.05 .. 1.00 A	0.10 A	Differential Current Threshold (3phase)
			5A	0.25 .. 5.00 A	0.50 A	
5310	BLOCK PROT.	Meas- urem.Superv		NO YES	YES	Block protection by FFM
5401	FCT 81 O/U	81 O/U Freq.		OFF ON	OFF	81 Over/Under Frequency Protection
5402	Vmin	81 O/U Freq.		10 .. 150 V	65 V	Minimum required voltage for operation
5402	Vmin	81 O/U Freq.		20 .. 150 V	35 V	Minimum required voltage for operation
5403	81-1 PICKUP	81 O/U Freq.		40.00 .. 60.00 Hz	49.50 Hz	81-1 Pickup
5404	81-1 PICKUP	81 O/U Freq.		50.00 .. 70.00 Hz	59.50 Hz	81-1 Pickup
5405	81-1 DELAY	81 O/U Freq.		0.00 .. 100.00 sec; ∞	60.00 sec	81-1 Time Delay
5406	81-2 PICKUP	81 O/U Freq.		40.00 .. 60.00 Hz	49.00 Hz	81-2 Pickup
5407	81-2 PICKUP	81 O/U Freq.		50.00 .. 70.00 Hz	59.00 Hz	81-2 Pickup
5408	81-2 DELAY	81 O/U Freq.		0.00 .. 100.00 sec; ∞	30.00 sec	81-2 Time Delay
5409	81-3 PICKUP	81 O/U Freq.		40.00 .. 60.00 Hz	47.50 Hz	81-3 Pickup
5410	81-3 PICKUP	81 O/U Freq.		50.00 .. 70.00 Hz	57.50 Hz	81-3 Pickup
5411	81-3 DELAY	81 O/U Freq.		0.00 .. 100.00 sec; ∞	3.00 sec	81-3 Time delay
5412	81-4 PICKUP	81 O/U Freq.		40.00 .. 60.00 Hz	51.00 Hz	81-4 Pickup
5413	81-4 PICKUP	81 O/U Freq.		50.00 .. 70.00 Hz	61.00 Hz	81-4 Pickup
5414	81-4 DELAY	81 O/U Freq.		0.00 .. 100.00 sec; ∞	30.00 sec	81-4 Time delay
5415A	DO differential	81 O/U Freq.		0.02 .. 1.00 Hz	0.02 Hz	Dropout differential
5421	FCT 81-1 O/U	81 O/U Freq.		OFF ON f> ON f<	OFF	81-1 Over/Under Frequency Protection

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
5422	FCT 81-2 O/U	81 O/U Freq.		OFF ON f> ON f<	OFF	81-2 Over/Under Frequency Protection
5423	FCT 81-3 O/U	81 O/U Freq.		OFF ON f> ON f<	OFF	81-3 Over/Under Frequency Protection
5424	FCT 81-4 O/U	81 O/U Freq.		OFF ON f> ON f<	OFF	81-4 Over/Under Frequency Protection
5430	FCT 81>.S1	81 O/U Freq.		OFF ON	ON	81 S1 Over Frequency Protection
5431	FCT 81<.S1	81 O/U Freq.		OFF ON	ON	81 S1 Under Frequency Protection
5432	FCT 81>.S2	81 O/U Freq.		OFF ON	ON	81 S2 Over Frequency Protection
5433	FCT 81<.S2	81 O/U Freq.		OFF ON	ON	81 S2 Under Frequency Protection
5435A	Vmin	81 O/U Freq.		0.20 .. 1.50 Un	0.20 Un	Minimum Required Voltage for Operation
5436A	DO differential	81 O/U Freq.		0.02 .. 1.00 Hz	0.10 Hz	Dropout Differential
5437A	Accel. Act. T	81 O/U Freq.		0.00 .. 60.00 sec	30.00 sec	Active Time of Accelerating Function
5438A	Accel. Oper. T	81 O/U Freq.		0.05 .. 5.00 sec	0.20 sec	Accelerated Operating Time
5439	81>.S1 PICKUP	81 O/U Freq.		50.00 .. 60.00 Hz	50.20 Hz	81>.S1 Pickup
5440	81>.S1 PICKUP	81 O/U Freq.		60.00 .. 70.00 Hz	60.20 Hz	81>.S1 Pickup
5441	81>.S1 Opert. T	81 O/U Freq.		0.05 .. 100.00 sec; ∞	0.15 sec	81>.S1 Operating Time
5443	81<.S1 PICKUP	81 O/U Freq.		40.00 .. 50.00 Hz	49.80 Hz	81<.S1 Pickup
5444	81<.S1 PICKUP	81 O/U Freq.		50.00 .. 60.00 Hz	59.80 Hz	81<.S1 Pickup
5445	81<.S1 Opert. T	81 O/U Freq.		0.05 .. 100.00 sec; ∞	0.15 sec	81<.S1 Operating Time
5447	81>.S2 PICKUP	81 O/U Freq.		50.00 .. 60.00 Hz	51.50 Hz	81>.S2 Pickup
5448	81>.S2 PICKUP	81 O/U Freq.		60.00 .. 70.00 Hz	61.50 Hz	81>.S2 Pickup
5449	81>.S2 Opert. T	81 O/U Freq.		0.05 .. 100.00 sec; ∞	1.00 sec	81>.S2 Operating Time
5451	81<.S2 PICKUP	81 O/U Freq.		40.00 .. 50.00 Hz	47.50 Hz	81<.S2 Pickup
5452	81<.S2 PICKUP	81 O/U Freq.		50.00 .. 60.00 Hz	57.50 Hz	81<.S2 Pickup
5453	81<.S2 Opert. T	81 O/U Freq.		0.05 .. 100.00 sec; ∞	4.00 sec	81<.S2 Operating Time
5456	59V0 PICKUP	81 O/U Freq.		0.01 .. 1.15 Uen	0.05 Uen	59V0 Pickup
5457	59V0 Opert. T	81 O/U Freq.		0.05 .. 100.00 sec; ∞	25.00 sec	59V0 Operating Time
5458A	59V0 D-RATIO	81 O/U Freq.		0.90 .. 0.99	0.96	59V0 Dropout Ratio
5460	81V 27V1 PICKUP	81 O/U Freq.		0.10 .. 1.20 Uphn	0.70 Uphn	81V 27V1 Pickup
5461A	81V 27V1 DO	81 O/U Freq.		1.01 .. 3.00	1.04	81V 27V1 Dropout Ratio
5462	81V 59V2 PICKUP	81 O/U Freq.		0.02 .. 1.50 Uphn	0.15 Uphn	81V 59V2 Pickup
5463A	81V 59V2 DO	81 O/U Freq.		0.90 .. 0.99	0.96	81V 59V2 Dropout Ratio

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
5464A	81V Rst T1 59V0	81 O/U Freq.		0.00 .. 0.20 sec	0.20 sec	81V Reset Time 1 for 59V0
5465A	81V Rst T2 81V	81 O/U Freq.		1.00 .. 240.00 sec	30.00 sec	81V Reset Time 2 for volt release
5466	59V0	81 O/U Freq.		OFF ON	ON	59V0 Zero sequence overvoltage
5501	27/Q-Protection	27/Q		OFF ON	OFF	27 / Q dir. con. Protection
5502	I-Release	27/Q	1A	0.02 .. 0.20 A; 0	0.10 A	Current-Rel. for Trip and Reclose
			5A	0.10 .. 1.00 A; 0	0.50 A	
5503	Inrush blk	27/Q		NO YES	NO	blocking with inrush
5504	27/Q Direction	27/Q		Forward Reverse	Forward	Direction of 27/Q
5511	Q> Pickup	27/Q	1A	1.70 .. 10000.00 VAR	8.70 VAR	Reactive power threshold for pickup
			5A	8.50 .. 50000.00 VAR	43.50 VAR	
5512	U< Pickup	27/Q		10.00 .. 210.00 V	85.00 V	Undervoltage threshold for pickup
5513	Delay Gen. CB	27/Q		0.00 .. 60.00 sec	0.50 sec	Trip time delay generator CB
5514	Delay Grid CB	27/Q		0.00 .. 60.00 sec	1.50 sec	Trip time delay grid CB
5521	Recl. release	27/Q		OFF ON	OFF	Reclosure release
5522	U> Reclose	27/Q		10.00 .. 210.00 V	95.00 V	Voltage threshold for reclosure rel.
5523	T Reclose	27/Q		0.00 .. 3600.00 sec	0.00 sec	Reclosure Delay Time
5524	Pos. f-diff	27/Q		0.01 .. 5.00 Hz	0.05 Hz	Pos. f-diff threshold for reclosure rel.
5525	Neg. f-diff	27/Q		-5.00 .. -0.01 Hz	-2.50 Hz	Neg. f-diff threshold for reclosure rel.
5526A	Incl. 27/Q Trip	27/Q		NO YES	NO	Include 27/Q Trip for reclosure rel.
6001	S1: RE/RL	P.System Data 2		-0.33 .. 7.00	1.00	S1: Zero seq. compensating factor RE/RL
6002	S1: XE/XL	P.System Data 2		-0.33 .. 7.00	1.00	S1: Zero seq. compensating factor XE/XL
6003	S1: x'	P.System Data 2	1A	0.0050 .. 15.0000 Ω/mi	0.2420 Ω/mi	S1: feeder reactance per mile: x'
			5A	0.0010 .. 3.0000 Ω/mi	0.0484 Ω/mi	
6004	S1: x'	P.System Data 2	1A	0.0050 .. 9.5000 Ω/km	0.1500 Ω/km	S1: feeder reactance per km: x'
			5A	0.0010 .. 1.9000 Ω/km	0.0300 Ω/km	
6005	S1: Line angle	P.System Data 2		10 .. 89 °	85 °	S1: Line angle
6006	S1: Line length	P.System Data 2		0.1 .. 650.0 Miles	62.1 Miles	S1: Line length in miles

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
6007	S1: Line length	P.System Data 2		0.1 .. 1000.0 km	100.0 km	S1: Line length in kilometer
6011	S2: RE/RL	P.System Data 2		-0.33 .. 7.00	1.00	S2: Zero seq. compensating factor RE/RL
6012	S2: XE/XL	P.System Data 2		-0.33 .. 7.00	1.00	S2: Zero seq. compensating factor XE/XL
6013	S2: x'	P.System Data 2	1A	0.0050 .. 15.0000 Ω/mi	0.2420 Ω/mi	S2: feeder reactance per mile: x'
			5A	0.0010 .. 3.0000 Ω/mi	0.0484 Ω/mi	
6014	S2: x'	P.System Data 2	1A	0.0050 .. 9.5000 Ω/km	0.1500 Ω/km	S2: feeder reactance per km: x'
			5A	0.0010 .. 1.9000 Ω/km	0.0300 Ω/km	
6015	S2: Line angle	P.System Data 2		10 .. 89 °	85 °	S2: Line angle
6016	S2: Line length	P.System Data 2		0.1 .. 650.0 Miles	62.1 Miles	S2: Line length in miles
6017	S2: Line length	P.System Data 2		0.1 .. 1000.0 km	100.0 km	S2: Line length in kilometer
6021	S3: RE/RL	P.System Data 2		-0.33 .. 7.00	1.00	S3: Zero seq. compensating factor RE/RL
6022	S3: XE/XL	P.System Data 2		-0.33 .. 7.00	1.00	S3: Zero seq. compensating factor XE/XL
6023	S3: x'	P.System Data 2	1A	0.0050 .. 15.0000 Ω/mi	0.2420 Ω/mi	S3: feeder reactance per mile: x'
			5A	0.0010 .. 3.0000 Ω/mi	0.0484 Ω/mi	
6024	S3: x'	P.System Data 2	1A	0.0050 .. 9.5000 Ω/km	0.1500 Ω/km	S3: feeder reactance per km: x'
			5A	0.0010 .. 1.9000 Ω/km	0.0300 Ω/km	
6025	S3: Line angle	P.System Data 2		10 .. 89 °	85 °	S3: Line angle
6026	S3: Line length	P.System Data 2		0.1 .. 650.0 Miles	62.1 Miles	S3: Line length in miles
6027	S3: Line length	P.System Data 2		0.1 .. 1000.0 km	100.0 km	S3: Line length in kilometer
6101	Synchronizing	SYNC function 1		ON OFF	OFF	Synchronizing Function
6102	SyncCB	SYNC function 1		(Einstellmöglichkeiten anwendung-sabhängig)	none	Synchronizable circuit breaker
6103	Vmin	SYNC function 1		20 .. 125 V	90 V	Minimum voltage limit: Vmin
6104	Vmax	SYNC function 1		20 .. 140 V	110 V	Maximum voltage limit: Vmax
6105	V<	SYNC function 1		1 .. 60 V	5 V	Threshold V1, V2 without voltage
6106	V>	SYNC function 1		20 .. 140 V	80 V	Threshold V1, V2 with voltage

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
6107	SYNC V1<V2>	SYNC function 1		YES NO	NO	ON-Command at V1< and V2>
6108	SYNC V1>V2<	SYNC function 1		YES NO	NO	ON-Command at V1> and V2<
6109	SYNC V1<V2<	SYNC function 1		YES NO	NO	ON-Command at V1< and V2<
6110A	Direct CO	SYNC function 1		YES NO	NO	Direct ON-Command
6111A	TSUP VOLTAGE	SYNC function 1		0.00 .. 60.00 sec	0.10 sec	Supervision time of V1>;V2> or V1<;V2<
6112	T-SYN. DURATION	SYNC function 1		0.01 .. 1200.00 sec; ∞	30.00 sec	Maximum duration of Synchronization
6113A	25 Synchron	SYNC function 1		YES NO	YES	Switching at synchronous condition
6121	Balancing V1/V2	SYNC function 1		0.50 .. 2.00	1.00	Balancing factor V1/V2
6122A	ANGLE ADJUSTM.	SYNC function 1		0 .. 360 °	0 °	Angle adjustment (transformer)
6123	CONNECTIONof V2	SYNC function 1		A-B B-C C-A	A-B	Connection of V2
6125	VT Vn2, primary	SYNC function 1		0.10 .. 800.00 kV	20.00 kV	VT nominal voltage V2, primary
6150	dV SYNCHK V2>V1	SYNC function 1		0.5 .. 50.0 V	5.0 V	Maximum voltage difference V2>V1
6151	dV SYNCHK V2<V1	SYNC function 1		0.5 .. 50.0 V	5.0 V	Maximum voltage difference V2<V1
6152	df SYNCHK f2>f1	SYNC function 1		0.01 .. 2.00 Hz	0.10 Hz	Maximum frequency difference f2>f1
6153	df SYNCHK f2<f1	SYNC function 1		0.01 .. 2.00 Hz	0.10 Hz	Maximum frequency difference f2<f1
6154	da SYNCHK α 2> α 1	SYNC function 1		2 .. 80 °	10 °	Maximum angle difference α 2> α 1
6155	da SYNCHK α 2< α 1	SYNC function 1		2 .. 80 °	10 °	Maximum angle difference α 2< α 1
7001	FCT 50BF	50BF BkrFailure		OFF ON	OFF	50BF Breaker Failure Protection
7004	Chk BRK CONTACT	50BF BkrFailure		OFF ON	OFF	Check Breaker contacts
7005	TRIP-Timer	50BF BkrFailure		0.06 .. 60.00 sec; ∞	0.25 sec	TRIP-Timer
7006	50BF PICKUP	50BF BkrFailure	1A	0.05 .. 20.00 A	0.10 A	50BF Pickup current threshold
			5A	0.25 .. 100.00 A	0.50 A	
7007	50BF PICKUP IE>	50BF BkrFailure	1A	0.05 .. 20.00 A	0.10 A	50BF Pickup earth current threshold
			5A	0.25 .. 100.00 A	0.50 A	
7008	50BF-2 Delay	50BF BkrFailure		0.06 .. 60.00 sec; ∞	0.50 sec	Delay of 2nd stage for busbar trip
7101	FCT 79	79M Auto Recl.		OFF ON	OFF	79 Auto-Reclose Function
7103	BLOCK MC Dur.	79M Auto Recl.		0.50 .. 320.00 sec; 0	1.00 sec	AR blocking duration after manual close

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
7105	TIME RESTRAINT	79M Auto Recl.		0.50 .. 320.00 sec	3.00 sec	79 Auto Reclosing reset time
7108	SAFETY 79 ready	79M Auto Recl.		0.01 .. 320.00 sec	0.50 sec	Safety Time until 79 is ready
7113	CHECK CB?	79M Auto Recl.		No check Chk each cycle	No check	Check circuit breaker before AR?
7114	T-Start MONITOR	79M Auto Recl.		0.01 .. 320.00 sec; ∞	0.50 sec	AR start-signal monitoring time
7115	CB TIME OUT	79M Auto Recl.		0.10 .. 320.00 sec	3.00 sec	Circuit Breaker (CB) Supervision Time
7116	Max. DEAD EXT.	79M Auto Recl.		0.50 .. 1800.00 sec; ∞	100.00 sec	Maximum dead time extension
7117	T-ACTION	79M Auto Recl.		0.01 .. 320.00 sec; ∞	∞ sec	Action time
7118	T DEAD DELAY	79M Auto Recl.		0.0 .. 1800.0 sec; ∞	1.0 sec	Maximum Time Delay of Dead-Time Start
7127	DEADTIME 1: PH	79M Auto Recl.		0.01 .. 320.00 sec	0.50 sec	Dead Time 1: Phase Fault
7128	DEADTIME 1: G	79M Auto Recl.		0.01 .. 320.00 sec	0.50 sec	Dead Time 1: Ground Fault
7129	DEADTIME 2: PH	79M Auto Recl.		0.01 .. 320.00 sec	0.50 sec	Dead Time 2: Phase Fault
7130	DEADTIME 2: G	79M Auto Recl.		0.01 .. 320.00 sec	0.50 sec	Dead Time 2: Ground Fault
7131	DEADTIME 3: PH	79M Auto Recl.		0.01 .. 320.00 sec	0.50 sec	Dead Time 3: Phase Fault
7132	DEADTIME 3: G	79M Auto Recl.		0.01 .. 320.00 sec	0.50 sec	Dead Time 3: Ground Fault
7133	DEADTIME 4: PH	79M Auto Recl.		0.01 .. 320.00 sec	0.50 sec	Dead Time 4: Phase Fault
7134	DEADTIME 4: G	79M Auto Recl.		0.01 .. 320.00 sec	0.50 sec	Dead Time 4: Ground Fault
7135	# OF RECL. GND	79M Auto Recl.		0 .. 9	1	Number of Reclosing Cycles Ground
7136	# OF RECL. PH	79M Auto Recl.		0 .. 9	1	Number of Reclosing Cycles Phase
7137	Cmd.via control	79M Auto Recl.		(Einstellmöglichkeiten anwendung-sabhängig)	none	Close command via control device
7138	Internal SYNC	79M Auto Recl.		(Einstellmöglichkeiten anwendung-sabhängig)	none	Internal 25 synchronisation
7139	External SYNC	79M Auto Recl.		YES NO	NO	External 25 synchronisation
7140	ZONE SEQ.COORD.	79M Auto Recl.		OFF ON	OFF	ZSC - Zone sequence coordination
7150	50-1	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	50-1
7151	50N-1	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	50N-1

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
7152	50-2	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	50-2
7153	50N-2	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	50N-2
7154	51	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	51
7155	51N	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	51N
7156	67-1	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	67-1
7157	67N-1	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	67N-1
7158	67-2	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	67-2
7159	67N-2	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	67N-2
7160	67 TOC	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	67 TOC
7161	67N TOC	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	67N TOC
7162	sens Ground Flt	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	(Sensitive) Ground Fault
7163	46	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	46
7164	BINARY INPUT	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	Binary Input
7165	3Pol.PICKUP BLK	79M Auto Recl.		YES NO	NO	3 Pole Pickup blocks 79
7166	50-3	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	50-3
7167	50N-3	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	50N-3

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
7168	67-3	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	67-3
7169	67N-3	79M Auto Recl.		No influence Starts 79 Stops 79	No influence	67N-3
7200	bef.1.Cy:50-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50-1
7201	bef.1.Cy:50N-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50N-1
7202	bef.1.Cy:50-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50-2
7203	bef.1.Cy:50N-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50N-2
7204	bef.1.Cy:51	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 51
7205	bef.1.Cy:51N	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 51N
7206	bef.1.Cy:67-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67-1
7207	bef.1.Cy:67N-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67N-1
7208	bef.1.Cy:67-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67-2
7209	bef.1.Cy:67N-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67N-2
7210	bef.1.Cy:67 TOC	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67 TOC
7211	bef.1.Cy:67NTOC	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67N TOC
7212	bef.2.Cy:50-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50-1
7213	bef.2.Cy:50N-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50N-1

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
7214	bef.2.Cy:50-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50-2
7215	bef.2.Cy:50N-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50N-2
7216	bef.2.Cy:51	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 51
7217	bef.2.Cy:51N	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 51N
7218	bef.2.Cy:67-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67-1
7219	bef.2.Cy:67N-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67N-1
7220	bef.2.Cy:67-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67-2
7221	bef.2.Cy:67N-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67N-2
7222	bef.2.Cy:67 TOC	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67 TOC
7223	bef.2.Cy:67NTOC	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67N TOC
7224	bef.3.Cy:50-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50-1
7225	bef.3.Cy:50N-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50N-1
7226	bef.3.Cy:50-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50-2
7227	bef.3.Cy:50N-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50N-2
7228	bef.3.Cy:51	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 51
7229	bef.3.Cy:51N	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 51N

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
7230	bef.3.Cy:67-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67-1
7231	bef.3.Cy:67N-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67N-1
7232	bef.3.Cy:67-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67-2
7233	bef.3.Cy:67N-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67N-2
7234	bef.3.Cy:67 TOC	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67 TOC
7235	bef.3.Cy:67NTOC	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67N TOC
7236	bef.4.Cy:50-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50-1
7237	bef.4.Cy:50N-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50N-1
7238	bef.4.Cy:50-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50-2
7239	bef.4.Cy:50N-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50N-2
7240	bef.4.Cy:51	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 51
7241	bef.4.Cy:51N	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 51N
7242	bef.4.Cy:67-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67-1
7243	bef.4.Cy:67N-1	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67N-1
7244	bef.4.Cy:67-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67-2
7245	bef.4.Cy:67N-2	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67N-2

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
7246	bef.4.Cy:67 TOC	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67 TOC
7247	bef.4.Cy:67NTOC	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67N TOC
7248	bef.1.Cy:50-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50-3
7249	bef.1.Cy:50N-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 50N-3
7250	bef.2.Cy:50-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50-3
7251	bef.2.Cy:50N-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 50N-3
7252	bef.3.Cy:50-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50-3
7253	bef.3.Cy:50N-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 50N-3
7254	bef.4.Cy:50-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50-3
7255	bef.4.Cy:50N-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 50N-3
7256	bef.1.Cy:67-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: 67-3
7257	bef.1.Cy:67N-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 1. Cycle: IE>>> directional
7258	bef.2.Cy:67-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: 67-3
7259	bef.2.Cy:67N-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 2. Cycle: IE>>> directional
7260	bef.3.Cy:67-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: 67-3
7261	bef.3.Cy:67N-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 3. Cycle: IE>>> directional

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
7262	bef.4.Cy:67-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67-3
7263	bef.4.Cy:67N-3	79M Auto Recl.		Set value T=T instant. T=0 blocked T=∞	Set value T=T	before 4. Cycle: 67N-3
8001	START	Fault Locator		Pickup TRIP	Pickup	Start fault locator with
8101	MEASURE. SUPERV	Meas- urem.Superv		OFF ON	ON	Measurement Supervision
8102	BALANCE V-LIMIT	Meas- urem.Superv		10 .. 100 V	50 V	Voltage Threshold for Balance Monitoring
8103	BAL. FACTOR V	Meas- urem.Superv		0.58 .. 0.90	0.75	Balance Factor for Voltage Monitor
8104	BALANCE I LIMIT	Meas- urem.Superv	1A 5A	0.10 .. 1.00 A 0.50 .. 5.00 A	0.50 A 2.50 A	Current Threshold for Balance Monitoring
8105	BAL. FACTOR I	Meas- urem.Superv		0.10 .. 0.90	0.50	Balance Factor for Current Monitor
8106	Σ I THRESHOLD	Meas- urem.Superv	1A 5A	0.05 .. 2.00 A; ∞ 0.25 .. 10.00 A; ∞	0.10 A 0.50 A	Summated Current Moni- toring Threshold
8107	Σ I FACTOR	Meas- urem.Superv		0.00 .. 0.95	0.10	Summated Current Moni- toring Factor
8109	FAST Σ i MONIT	Meas- urem.Superv		OFF ON	ON	Fast Summated Current Monitoring
8110A	T BAL. V LIMIT	Meas- urem.Superv		0 .. 100 sec	5 sec	T Balance Factor for Voltage Monitor
8111A	T BAL. I LIMIT	Meas- urem.Superv		0 .. 100 sec	5 sec	T Current Balance Monitor
8201	FCT 74TC	74TC TripCirc.		ON OFF	ON	74TC TRIP Circuit Supervi- sion
8202	Alarm Delay	74TC TripCirc.		1 .. 30 sec	2 sec	Delay Time for alarm
8301	DMD Interval	Demand meter		15 Min., 1 Sub 15 Min., 3 Subs 15 Min., 15 Subs 30 Min., 1 Sub 60 Min., 1 Sub 60 Min., 10 Subs 5 Min., 5 Subs	60 Min., 1 Sub	Demand Calculation Inter- vals
8302	DMD Sync.Time	Demand meter		On The Hour 15 After Hour 30 After Hour 45 After Hour	On The Hour	Demand Synchronization Time
8311	MinMax cycRESET	Min/Max meter		NO YES	YES	Automatic Cyclic Reset Function
8312	MiMa RESET TIME	Min/Max meter		0 .. 1439 min	0 min	MinMax Reset Timer
8313	MiMa RESETCYCLE	Min/Max meter		1 .. 365 Days	7 Days	MinMax Reset Cycle Period

Addr.	Parameter	Function	C	Setting Options	Default Setting	Comments
8314	MinMaxRES.START	Min/Max meter		1 .. 365 Days	1 Days	MinMax Start Reset Cycle in
8315	MeterResolution	Energy		Standard Factor 10 Factor 100	Standard	Meter resolution

F.3 Information List

Indications for IEC 60 870-5-103 are always reported ON / OFF if they are subject to general interrogation for IEC 60 870-5-103. If not, they are reported only as ON.

New user-defined indications or such newly allocated to IEC 60 870-5-103 are set to ON / OFF and subjected to general interrogation if the information type is not a spontaneous event ("..Ev"). Further information on indications can be found in detail in the SIPROTEC 4 System Description, Order No. E50417-H1176-C151.

In columns "Event Log", "Trip Log" and "Ground Fault Log" the following applies:

UPPER CASE NOTATION "ON/OFF":	definitely set, not allocatable
lower case notation "on/off":	preset, allocatable
*:	not preset, allocatable
<blank>:	neither preset nor allocatable

In the column "Marked in Oscill. Record" the following applies:

UPPER CASE NOTATION "M":	definitely set, not allocatable
lower case notation "m":	preset, allocatable
*:	not preset, allocatable
<blank>:	neither preset nor allocatable

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
–	>Back Light on (>Light on)	Device, General	SP	On Off	*		*	LED	BI		BO					
–	Reset LED (Reset LED)	Device, General	IntS P	On	*		*	LED			BO		16 0	19	1	No
–	Stop data transmission (DataStop)	Device, General	IntS P	On Off	*		*	LED			BO		16 0	20	1	Yes
–	Test mode (Test mode)	Device, General	IntS P	On Off	*		*	LED			BO		16 0	21	1	Yes
–	Feeder GROUNDED (Feeder gnd)	Device, General	IntS P	*	*		*	LED			BO					
–	Breaker OPENED (Brk OPENED)	Device, General	IntS P	*	*		*	LED			BO					
–	Hardware Test Mode (HWTTestMod)	Device, General	IntS P	On Off	*		*	LED			BO					
–	Clock Synchronization (SynchClock)	Device, General	IntS P_E V	*	*		*									
–	Disturbance CFC (Distur.CFC)	Device, General	OUT	On Off	*			LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
–	Fault Recording Start (FltRecSta)	Osc. Fault Rec.	IntSP	On Off	*		m	LED			BO					
–	Setting Group A is active (P-GrpA act)	Change Group	IntSP	On Off	*		*	LED			BO		160	23	1	Yes
–	Setting Group B is active (P-GrpB act)	Change Group	IntSP	On Off	*		*	LED			BO		160	24	1	Yes
–	Setting Group C is active (P-GrpC act)	Change Group	IntSP	On Off	*		*	LED			BO		160	25	1	Yes
–	Setting Group D is active (P-GrpD act)	Change Group	IntSP	On Off	*		*	LED			BO		160	26	1	Yes
–	Controlmode REMOTE (ModeREMOTE)	Cntrl Authority	IntSP	On Off	*			LED			BO					
–	Control Authority (Cntrl Auth)	Cntrl Authority	IntSP	On Off	*			LED			BO		101	85	1	Yes
–	Controlmode LOCAL (ModeLOCAL)	Cntrl Authority	IntSP	On Off	*			LED			BO		101	86	1	Yes
–	52 Breaker (52Breaker)	Control Device	CF_D12	On Off				LED			BO		240	160	20	
–	52 Breaker (52Breaker)	Control Device	DP	On Off					BI			CB	240	160	1	Yes
–	Disconnect Switch (Disc.Swit.)	Control Device	CF_D2	On Off				LED			BO		240	161	20	
–	Disconnect Switch (Disc.Swit.)	Control Device	DP	On Off					BI			CB	240	161	1	Yes
–	Ground Switch (GndSwit.)	Control Device	CF_D2	On Off				LED			BO		240	164	20	
–	Ground Switch (GndSwit.)	Control Device	DP	On Off					BI			CB	240	164	1	Yes
–	>CB ready Spring is charged (>CB ready)	Process Data	SP	*	*		*	LED	BI		BO	CB				

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
–	>Door closed (>Door-Close)	Process Data	SP	*	*		*	LED	BI		BO	CB				
–	>Cabinet door open (>Door open)	Process Data	SP	On Off	*		*	LED	BI		BO	CB	101	1	1	Yes
–	>CB waiting for Spring charged (>CB wait)	Process Data	SP	On Off	*		*	LED	BI		BO	CB	101	2	1	Yes
–	>No Voltage (Fuse blown) (>No Volt.)	Process Data	SP	On Off	*		*	LED	BI		BO	CB	160	38	1	Yes
–	>Error Motor Voltage (>Err Mot V)	Process Data	SP	On Off	*		*	LED	BI		BO	CB	240	181	1	Yes
–	>Error Control Voltage (>ErrCntrlV)	Process Data	SP	On Off	*		*	LED	BI		BO	CB	240	182	1	Yes
–	>SF6-Loss (>SF6-Loss)	Process Data	SP	On Off	*		*	LED	BI		BO	CB	240	183	1	Yes
–	>Error Meter (>Err Meter)	Process Data	SP	On Off	*		*	LED	BI		BO	CB	240	184	1	Yes
–	>Transformer Temperature (>Tx Temp.)	Process Data	SP	On Off	*		*	LED	BI		BO	CB	240	185	1	Yes
–	>Transformer Danger (>Tx Danger)	Process Data	SP	On Off	*		*	LED	BI		BO	CB	240	186	1	Yes
–	Reset Minimum and Maximum counter (ResMinMax)	Min/Max meter	IntS P_E v	ON												
–	Reset meter (Meter res)	Energy	IntS P_E v	ON					BI							
–	Error Systeminterface (SysIntErr.)	Protocol	IntS P	On Off	*	*		LED			BO					
–	DCP identify (DCP ident)	Protocol	IntS P	*	*	*		LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
–	Threshold Value 1 (ThreshVal1)	Thresh.-Switch	IntSP	On Off				LED		FK TO NL IN E	BO	CB				
1	No Function configured (Not configured)	Device, General	SP	*	*											
2	Function Not Available (Non Existent)	Device, General	SP	*	*											
3	>Synchronize Internal Real Time Clock (>Time Synch)	Device, General	SP_Ev	*	*			LED	BI		BO		135	48	1	Yes
4	>Trigger Waveform Capture (>Trig.Wave.Cap.)	Osc. Fault Rec.	SP	*	*		m	LED	BI		BO		135	49	1	Yes
5	>Reset LED (>Reset LED)	Device, General	SP	*	*		*	LED	BI		BO		135	50	1	Yes
7	>Setting Group Select Bit 0 (>Set Group Bit0)	Change Group	SP	*	*		*	LED	BI		BO		135	51	1	Yes
8	>Setting Group Select Bit 1 (>Set Group Bit1)	Change Group	SP	*	*		*	LED	BI		BO		135	52	1	Yes
009.0100	Failure EN100 Modul (Failure Modul)	EN100-Modul 1	IntSP	On Off	*		*	LED			BO					
009.0101	Failure EN100 Link Channel 1 (Ch1) (Fail Ch1)	EN100-Modul 1	IntSP	On Off	*		*	LED			BO					
009.0102	Failure EN100 Link Channel 2 (Ch2) (Fail Ch2)	EN100-Modul 1	IntSP	On Off	*		*	LED			BO					
15	>Test mode (>Test mode)	Device, General	SP	*	*		*	LED	BI		BO		135	53	1	Yes
16	>Stop data transmission (>DataStop)	Device, General	SP	*	*		*	LED	BI		BO		135	54	1	Yes
51	Device is Operational and Protecting (Device OK)	Device, General	OUT	On Off	*		*	LED			BO		135	81	1	Yes
52	At Least 1 Protection Funct. is Active (ProtActive)	Device, General	IntSP	On Off	*		*	LED			BO		160	18	1	Yes
55	Reset Device (Reset Device)	Device, General	OUT	On	*		*						160	4	1	No
56	Initial Start of Device (Initial Start)	Device, General	OUT	On	*		*	LED			BO		160	5	1	No

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
67	Resume (Resume)	Device, General	OUT	On	*		*	LED			BO					
68	Clock Synchronization Error (Clock SyncError)	Device, General	OUT	On Off	*		*	LED			BO					
69	Daylight Saving Time (DayLightSavTime)	Device, General	OUT	On Off	*		*	LED			BO					
70	Setting calculation is running (Settings Calc.)	Device, General	OUT	On Off	*		*	LED			BO		160	22	1	Yes
71	Settings Check (Settings Check)	Device, General	OUT	*	*		*	LED			BO					
72	Level-2 change (Level-2 change)	Device, General	OUT	On Off	*		*	LED			BO					
73	Local setting change (Local change)	Device, General	OUT	*	*		*									
110	Event lost (Event Lost)	Device, General	OUT_Ev	On	*			LED			BO		135	130	1	No
113	Flag Lost (Flag Lost)	Device, General	OUT	On	*		m	LED			BO		135	136	1	Yes
125	Chatter ON (Chatter ON)	Device, General	OUT	On Off	*		*	LED			BO		135	145	1	Yes
126	Protection ON/OFF (via system port) (ProtON/OFF)	P.System Data 2	IntS P	On Off	*		*	LED			BO					
127	79 ON/OFF (via system port) (79 ON/OFF)	79M Auto Recl.	IntS P	On Off	*		*	LED			BO					
140	Error with a summary alarm (Error Sum Alarm)	Device, General	OUT	On Off	*		*	LED			BO		160	47	1	Yes
160	Alarm Summary Event (Alarm Sum Event)	Device, General	OUT	On Off	*		*	LED			BO		160	46	1	Yes
161	Failure: General Current Supervision (Fail I Superv.)	Meas-urem.Super v	OUT	On Off	*		*	LED			BO		160	32	1	Yes
162	Failure: Current Summation (Failure Σ I)	Meas-urem.Super v	OUT	On Off	*		*	LED			BO		135	182	1	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
163	Failure: Current Balance (Fail I balance)	Meas-urem.Super v	OUT	On Of f	*		*	LED			BO		135	183	1	Yes
167	Failure: Voltage Balance (Fail V balance)	Meas-urem.Super v	OUT	On Of f	*		*	LED			BO		135	186	1	Yes
169	VT Fuse Failure (alarm >10s) (VT FuseFail>10s)	Meas-urem.Super v	OUT	On Of f	*		*	LED			BO		135	188	1	Yes
170	VT Fuse Failure (alarm instantaneous) (VT Fuse-Fail)	Meas-urem.Super v	OUT	On Of f	*		*	LED			BO					
170.0001	>25-group 1 activate (>25-1 act)	SYNC function 1	SP	On Of f			*	LED	BI							
170.0043	>25 Synchronization request (>25 Sync requ.)	SYNC function 1	SP	On Of f			*	LED	BI							
170.0049	25 Sync. Release of CLOSE Command (25 CloseRelease)	SYNC function 1	OUT	On Of f			*	LED			BO		41	201	1	Yes
170.0050	25 Synchronization Error (25 Sync. Error)	SYNC function 1	OUT	On Of f			*	LED			BO		41	202	1	Yes
170.0051	25-group 1 is BLOCKED (25-1 BLOCK)	SYNC function 1	OUT	On Of f			*	LED			BO		41	204	1	Yes
170.2007	25 Sync. Measuring request of Control (25 Measu. req.)	SYNC function 1	SP	On Of f			*	LED								
170.2008	>BLOCK 25-group 1 (>BLK 25-1)	SYNC function 1	SP	On Of f			*	LED	BI							
170.2009	>25 Direct Command output (>25direct CO)	SYNC function 1	SP	On Of f			*	LED	BI							
170.2011	>25 Start of synchroniza-tion (>25 Start)	SYNC function 1	SP	On Of f			*	LED	BI							
170.2012	>25 Stop of synchroniza-tion (>25 Stop)	SYNC function 1	SP	On Of f			*	LED	BI							

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
170.20 13	>25 Switch to V1> and V2< (>25 V1>V2<)	SYNC function 1	SP	On Off			*	LED	BI							
170.20 14	>25 Switch to V1< and V2> (>25 V1<V2>)	SYNC function 1	SP	On Off			*	LED	BI							
170.20 15	>25 Switch to V1< and V2< (>25 V1<V2<)	SYNC function 1	SP	On Off			*	LED	BI							
170.20 16	>25 Switch to Sync (>25 synchr.)	SYNC function 1	SP	On Off			*	LED	BI							
170.20 22	25-group 1: measurement in progress (25-1 meas.)	SYNC function 1	OUT	On Off			*	LED			BO		41	203	1	Yes
170.20 25	25 Monitoring time exceeded (25 MonTimeExc)	SYNC function 1	OUT	On Off			*	LED			BO		41	205	1	Yes
170.20 26	25 Synchronization conditions okay (25 Synchron)	SYNC function 1	OUT	On Off			*	LED			BO		41	206	1	Yes
170.20 27	25 Condition V1>V2< fulfilled (25 V1> V2<)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 28	25 Condition V1<V2> fulfilled (25 V1< V2>)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 29	25 Condition V1<V2< fulfilled (25 V1< V2<)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 30	25 Voltage difference (Vdiff) okay (25 Vdiff ok)	SYNC function 1	OUT	On Off			*	LED			BO		41	207	1	Yes
170.20 31	25 Frequency difference (fdiff) okay (25 fdiff ok)	SYNC function 1	OUT	On Off			*	LED			BO		41	208	1	Yes
170.20 32	25 Angle difference (alphadiff) okay (25 adiff ok)	SYNC function 1	OUT	On Off			*	LED			BO		41	209	1	Yes
170.20 33	25 Frequency f1 > fmax permissible (25 f1>>)	SYNC function 1	OUT	On Off			*	LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
170.20 34	25 Frequency $f_1 < f_{min}$ permissible (25 $f_1 <<$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 35	25 Frequency $f_2 > f_{max}$ permissible (25 $f_2 >>$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 36	25 Frequency $f_2 < f_{min}$ permissible (25 $f_2 <<$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 37	25 Voltage $V_1 > V_{max}$ permissible (25 $V_1 >>$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 38	25 Voltage $V_1 < V_{min}$ permissible (25 $V_1 <<$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 39	25 Voltage $V_2 > V_{max}$ permissible (25 $V_2 >>$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 40	25 Voltage $V_2 < V_{min}$ permissible (25 $V_2 <<$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 90	25 Vdiff too large ($V_2 > V_1$) (25 $V_2 > V_1$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 91	25 Vdiff too large ($V_2 < V_1$) (25 $V_2 < V_1$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 92	25 fdiff too large ($f_2 > f_1$) (25 $f_2 > f_1$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 93	25 fdiff too large ($f_2 < f_1$) (25 $f_2 < f_1$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 94	25 alphadiff too large ($a_2 > a_1$) (25 $a_2 > a_1$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 95	25 alphadiff too large ($a_2 < a_1$) (25 $a_2 < a_1$)	SYNC function 1	OUT	On Off			*	LED			BO					
170.20 96	25 Multiple selection of func-groups (25 FG-Error)	SYNC function 1	OUT	On Off				LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
170.2097	25 Setting error (25 Set-Error)	SYNC function 1	OUT	On Off				LED			BO					
170.2101	Sync-group 1 is switched OFF (25-1 OFF)	SYNC function 1	OUT	On Off			*	LED			BO		41	36	1	Yes
170.2102	>BLOCK 25 CLOSE command (>BLK 25 CLOSE)	SYNC function 1	SP	On Off			*	LED	BI							
170.2103	25 CLOSE command is BLOCKED (25 CLOSE BLK)	SYNC function 1	OUT	On Off			*	LED			BO		41	37	1	Yes
171	Failure: Phase Sequence (Fail Ph. Seq.)	Meas-urem.Super v	OUT	On Off	*		*	LED			BO		160	35	1	Yes
175	Failure: Phase Sequence Current (Fail Ph. Seq. I)	Meas-urem.Super v	OUT	On Off	*		*	LED			BO		135	191	1	Yes
176	Failure: Phase Sequence Voltage (Fail Ph. Seq. V)	Meas-urem.Super v	OUT	On Off	*		*	LED			BO		135	192	1	Yes
177	Failure: Battery empty (Fail Battery)	Device, General	OUT	On Off	*		*	LED			BO					
178	I/O-Board Error (I/O-Board error)	Device, General	OUT	On Off	*		*	LED			BO					
181	Error: A/D converter (Error A/D-conv.)	Device, General	OUT	On Off	*		*	LED			BO					
191	Error: Offset (Error Offset)	Device, General	OUT	On Off	*		*	LED			BO					
193	Alarm: NO calibration data available (Alarm NO calibr)	Device, General	OUT	On Off	*		*	LED			BO					
194	Error: Neutral CT different from MLFB (Error neutralCT)	Device, General	OUT	On Off	*											
197	Measurement Supervision is switched OFF (MeasSup OFF)	Meas-urem.Super v	OUT	On Off	*		*	LED			BO		135	197	1	Yes
203	Waveform data deleted (Wave. deleted)	Osc. Fault Rec.	OUT_Ev	On	*			LED			BO		135	203	1	No

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
232	LPCT phase Current Transf. mismatching (CT ph mismatch)	Device, General	OUT	On Off			*	LED			BO					
233	LPCT ground Current Transf. mismatching (CT gnd mismatch)	Device, General	OUT	On Off			*	LED			BO					
234.2100	27, 59 blocked via operation (27, 59 blk)	27/59 O/U Volt.	IntSP	On Off	*		*	LED			BO					
235.2110	>BLOCK Function \$00 (>BLOCK \$00)	Flx	SP	On Off	On Off	*	*	LED	BI	FK TO NL IN E	BO					
235.2111	>Function \$00 instantaneous TRIP (>\$00 instant.)	Flx	SP	On Off	On Off	*	*	LED	BI	FK TO NL IN E	BO					
235.2112	>Function \$00 Direct TRIP (>\$00 Dir.TRIP)	Flx	SP	On Off	On Off	*	*	LED	BI	FK TO NL IN E	BO					
235.2113	>Function \$00 BLOCK TRIP Time Delay (>\$00 BLK.TDly)	Flx	SP	On Off	On Off	*	*	LED	BI	FK TO NL IN E	BO					
235.2114	>Function \$00 BLOCK TRIP (>\$00 BLK.TRIP)	Flx	SP	On Off	On Off	*	*	LED	BI	FK TO NL IN E	BO					
235.2115	>Function \$00 BLOCK TRIP Phase A (>\$00 BL.TripA)	Flx	SP	On Off	On Off	*	*	LED	BI	FK TO NL IN E	BO					
235.2116	>Function \$00 BLOCK TRIP Phase B (>\$00 BL.TripB)	Flx	SP	On Off	On Off	*	*	LED	BI	FK TO NL IN E	BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
235.21 17	>Function \$00 BLOCK TRIP Phase C (>\$00 BL.TripC)	Flx	SP	On Off	On Off	*	*	LED	BI	FK TO NL IN E	BO					
235.21 18	Function \$00 is BLOCKED (\$00 BLOCKED)	Flx	OUT	On Off	On Off	*	*	LED			BO					
235.21 19	Function \$00 is switched OFF (\$00 OFF)	Flx	OUT	On Off	*	*	*	LED			BO					
235.21 20	Function \$00 is ACTIVE (\$00 ACTIVE)	Flx	OUT	On Off	*	*	*	LED			BO					
235.21 21	Function \$00 picked up (\$00 picked up)	Flx	OUT	On Off	On Off	*	*	LED			BO					
235.21 22	Function \$00 Pickup Phase A (\$00 pickup A)	Flx	OUT	On Off	On Off	*	*	LED			BO					
235.21 23	Function \$00 Pickup Phase B (\$00 pickup B)	Flx	OUT	On Off	On Off	*	*	LED			BO					
235.21 24	Function \$00 Pickup Phase C (\$00 pickup C)	Flx	OUT	On Off	On Off	*	*	LED			BO					
235.21 25	Function \$00 TRIP Delay Time Out (\$00 Time Out)	Flx	OUT	On Off	On Off	*	*	LED			BO					
235.21 26	Function \$00 TRIP (\$00 TRIP)	Flx	OUT	On Off	On	*	*	LED			BO					
235.21 28	Function \$00 has invalid settings (\$00 inval.set)	Flx	OUT	On Off	On Off	*	*	LED			BO					
236.21 27	BLOCK Flexible Function (BLK. Flex.Fct.)	Device, General	IntS P	On Off	*	*	*	LED			BO					
253	Failure VT circuit: broken wire (VT brk. wire)	Meas- urem.Super v	OUT	On Off	*		*	LED			BO					
255	Failure VT circuit (Fail VT circuit)	Meas- urem.Super v	OUT	On Off	*		*	LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
256	Failure VT circuit: 1 pole broken wire (VT b.w. 1 pole)	Meas-urem.Super v	OUT	On Of f	*		*	LED			BO					
257	Failure VT circuit: 2 pole broken wire (VT b.w. 2 pole)	Meas-urem.Super v	OUT	On Of f	*		*	LED			BO					
258	Failure VT circuit: 3 pole broken wire (VT b.w. 3 pole)	Meas-urem.Super v	OUT	On Of f	*		*	LED			BO					
272	Set Point Operating Hours (SP. Op Hours>)	SetPoint(Sta t)	OUT	On Of f	*		*	LED			BO		13 5	22 9	1	Yes
301	Power System fault (Pow.Sys.Flt.)	Device, General	OUT	On Of f	On Off								13 5	23 1	2	Yes
302	Fault Event (Fault Event)	Device, General	OUT	*	On								13 5	23 2	2	Yes
303	sensitive Ground fault (sens Gnd flt)	Device, General	OUT			ON OF F										
320	Warn: Limit of Memory Data exceeded (Warn Mem. Data)	Device, General	OUT	On Of f	*		*	LED			BO					
321	Warn: Limit of Memory Parameter exceeded (Warn Mem. Para.)	Device, General	OUT	On Of f	*		*	LED			BO					
322	Warn: Limit of Memory Operation exceeded (Warn Mem. Oper.)	Device, General	OUT	On Of f	*		*	LED			BO					
323	Warn: Limit of Memory New exceeded (Warn Mem. New)	Device, General	OUT	On Of f	*		*	LED			BO					
335	>GOOSE-Stop (>GOOSE-Stop)	Device, General	SP	On Of f			*	LED	BI	FK TO NL IN E	BO					
356	>Manual close signal (>Manual Close)	P.System Data 2	SP	*	*		*	LED	BI		BO		15 0	6	1	Yes
395	>I MIN/MAX Buffer Reset (>I MinMax Reset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
396	>I1 MIN/MAX Buffer Reset (>I1 MiMaReset)	Min/Max meter	SP	On	*		*	LED	BI		BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
397	>V MIN/MAX Buffer Reset (>V MiMaReset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
398	>Vphph MIN/MAX Buffer Reset (>VphphMiMaRes)	Min/Max meter	SP	On	*		*	LED	BI		BO					
399	>V1 MIN/MAX Buffer Reset (>V1 MiMa Reset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
400	>P MIN/MAX Buffer Reset (>P MiMa Reset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
401	>S MIN/MAX Buffer Reset (>S MiMa Reset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
402	>Q MIN/MAX Buffer Reset (>Q MiMa Reset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
403	>Idmd MIN/MAX Buffer Reset (>Idmd MiMaReset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
404	>Pdmd MIN/MAX Buffer Reset (>Pdmd MiMaReset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
405	>Qdmd MIN/MAX Buffer Reset (>Qdmd MiMaReset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
406	>Sdmd MIN/MAX Buffer Reset (>Sdmd MiMaReset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
407	>Frq. MIN/MAX Buffer Reset (>Frq MiMa Reset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
408	>Power Factor MIN/MAX Buffer Reset (>PF MiMaReset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
409	>BLOCK Op Counter (>BLOCK Op Count)	Statistics	SP	On Off			*	LED	BI		BO					
412	>Theta MIN/MAX Buffer Reset (> Θ MiMa Reset)	Min/Max meter	SP	On	*		*	LED	BI		BO					
466.4010	Trip via control command (Cmd Trip)	P.System Data 2	IntSP	On Off	On		*	LED			BO					
501	Relay PICKUP (Relay PICKUP)	P.System Data 2	OUT		ON		m	LED			BO		150	151	2	Yes
502	Relay Drop Out (Relay Drop Out)	Device, General	SP	*	*											
510	General CLOSE of relay (Relay CLOSE)	Device, General	SP	*	*											

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
511	Relay GENERAL TRIP command (Relay TRIP)	P.System Data 2	OUT		ON		m	LED			BO		150	161	2	Yes
533	Primary fault current Ia (Ia =)	P.System Data 2	VI		ON OFF								150	177	4	No
534	Primary fault current Ib (Ib =)	P.System Data 2	VI		ON OFF								150	178	4	No
535	Primary fault current Ic (Ic =)	P.System Data 2	VI		ON OFF								150	179	4	No
545	Time from Pickup to drop out (PU Time)	Device, General	VI													
546	Time from Pickup to TRIP (TRIP Time)	Device, General	VI													
561	Manual close signal detected (Man.Clos.Detect)	P.System Data 2	OUT	On Off	*		*	LED			BO					
916	Increment of active energy (WpΔ=)	Energy	-													
917	Increment of reactive energy (WqΔ=)	Energy	-													
1020	Counter of operating hours (Op.Hours=)	Statistics	VI													
1021	Accumulation of interrupted current Ph A (ΣI_a =)	Statistics	VI													
1022	Accumulation of interrupted current Ph B (ΣI_b =)	Statistics	VI													
1023	Accumulation of interrupted current Ph C (ΣI_c =)	Statistics	VI													
1106	>Start Fault Locator (>Start Flt. Loc)	Fault Locator	SP	On	*		*	LED	BI		BO		151	6	1	Yes
1114	Flt Locator: primary RESISTANCE (Rpri =)	Fault Locator	VI		ON OFF								151	14	4	No
1115	Flt Locator: primary REACTANCE (Xpri =)	Fault Locator	VI		ON OFF								151	15	4	No
1117	Flt Locator: secondary RESISTANCE (Rsec =)	Fault Locator	VI		ON OFF								151	17	4	No
1118	Flt Locator: secondary REACTANCE (Xsec =)	Fault Locator	VI		ON OFF								151	18	4	No
1119	Flt Locator: Distance to fault (dist =)	Fault Locator	VI		ON OFF								151	19	4	No

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
1120	Flt Locator: Distance [%] to fault (d[%] =)	Fault Locator	VI		ON OFF								15 1	20	4	No
1122	Flt Locator: Distance to fault (dist =)	Fault Locator	VI		ON OFF								15 1	22	4	No
1123	Fault Locator Loop AG (FL Loop AG)	Fault Locator	OUT	*	On		*	LED			BO					
1124	Fault Locator Loop BG (FL Loop BG)	Fault Locator	OUT	*	On		*	LED			BO					
1125	Fault Locator Loop CG (FL Loop CG)	Fault Locator	OUT	*	On		*	LED			BO					
1126	Fault Locator Loop AB (FL Loop AB)	Fault Locator	OUT	*	On		*	LED			BO					
1127	Fault Locator Loop BC (FL Loop BC)	Fault Locator	OUT	*	On		*	LED			BO					
1128	Fault Locator Loop CA (FL Loop CA)	Fault Locator	OUT	*	On		*	LED			BO					
1132	Fault location invalid (Flt.Loc.invalid)	Fault Locator	OUT	*	On		*	LED			BO					
1201	>BLOCK 64 (>BLOCK 64)	Sens. Gnd Fault	SP	On Off	*		*	LED	BI		BO		15 1	10 1	1	Yes
1202	>BLOCK 50Ns-2 (>BLOCK 50Ns-2)	Sens. Gnd Fault	SP	On Off	*		*	LED	BI		BO		15 1	10 2	1	Yes
1203	>BLOCK 50Ns-1 (>BLOCK 50Ns-1)	Sens. Gnd Fault	SP	On Off	*		*	LED	BI		BO		15 1	10 3	1	Yes
1204	>BLOCK 51Ns (>BLOCK 51Ns)	Sens. Gnd Fault	SP	On Off	*		*	LED	BI		BO		15 1	10 4	1	Yes
1207	>BLOCK 50Ns/67Ns (>BLK 50Ns/67Ns)	Sens. Gnd Fault	SP	On Off	*		*	LED	BI		BO		15 1	10 7	1	Yes
1211	50Ns/67Ns is OFF (50Ns/67Ns OFF)	Sens. Gnd Fault	OUT	On Off	*		*	LED			BO		15 1	11 1	1	Yes
1212	50Ns/67Ns is ACTIVE (50Ns/67Ns ACT)	Sens. Gnd Fault	OUT	On Off	*		*	LED			BO		15 1	11 2	1	Yes
1215	64 displacement voltage pick up (64 Pickup)	Sens. Gnd Fault	OUT	*	On Off		*	LED			BO		15 1	11 5	2	Yes
1217	64 displacement voltage element TRIP (64 TRIP)	Sens. Gnd Fault	OUT	*	On		m	LED			BO		15 1	11 7	2	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
1221	50Ns-2 Pickup (50Ns-2 Pickup)	Sens. Gnd Fault	OUT	*	On Off		*	LED			BO		151	121	2	Yes
1223	50Ns-2 TRIP (50Ns-2 TRIP)	Sens. Gnd Fault	OUT	*	On		m	LED			BO		151	123	2	Yes
1224	50Ns-1 Pickup (50Ns-1 Pickup)	Sens. Gnd Fault	OUT	*	On Off		*	LED			BO		151	124	2	Yes
1226	50Ns-1 TRIP (50Ns-1 TRIP)	Sens. Gnd Fault	OUT	*	On		m	LED			BO		151	126	2	Yes
1227	51Ns picked up (51Ns Pickup)	Sens. Gnd Fault	OUT	*	On Off		*	LED			BO		151	127	2	Yes
1229	51Ns TRIP (51Ns TRIP)	Sens. Gnd Fault	OUT	*	On		m	LED			BO		151	129	2	Yes
1230	Sensitive ground fault detection BLOCKED (Sens. Gnd block)	Sens. Gnd Fault	OUT	On Off	On Off		*	LED			BO		151	130	1	Yes
1264	Corr. Resistive Earth current (IEEa =)	Sens. Gnd Fault	VI			ON OFF										
1265	Corr. Reactive Earth current (IEEr =)	Sens. Gnd Fault	VI			ON OFF										
1266	Earth current, absolute Value (IEE =)	Sens. Gnd Fault	VI			ON OFF										
1267	Displacement Voltage VGND, 3Vo (VGND, 3Vo)	Sens. Gnd Fault	VI			ON OFF										
1271	Sensitive Ground fault pick up (Sens.Gnd Pickup)	Sens. Gnd Fault	OUT	*	*			LED			BO		151	171	1	Yes
1272	Sensitive Ground fault picked up in Ph A (Sens. Gnd Ph A)	Sens. Gnd Fault	OUT	On Off	On	On Off	*	LED			BO		160	48	1	Yes
1273	Sensitive Ground fault picked up in Ph B (Sens. Gnd Ph B)	Sens. Gnd Fault	OUT	On Off	On	On Off	*	LED			BO		160	49	1	Yes
1274	Sensitive Ground fault picked up in Ph C (Sens. Gnd Ph C)	Sens. Gnd Fault	OUT	On Off	On	On Off	*	LED			BO		160	50	1	Yes
1276	Sensitive Gnd fault in forward direction (SensGnd Forward)	Sens. Gnd Fault	OUT	On Off	On	On Off	*	LED			BO		160	51	1	Yes
1277	Sensitive Gnd fault in reverse direction (SensGnd Reverse)	Sens. Gnd Fault	OUT	On Off	On	On Off	*	LED			BO		160	52	1	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
1278	Sensitive Gnd fault direction undefined (SensGnd undef.)	Sens. Gnd Fault	OUT	On Off	On	On Off	*	LED			BO		151	178	1	Yes
1403	>BLOCK 50BF (>BLOCK 50BF)	50BF BkrFailure	SP	On Off	*		*	LED	BI		BO		166	103	1	Yes
1404	>50BF Activate 310> threshold (>50BFactiv.310>)	50BF BkrFailure	SP	On Off	*		*	LED	BI		BO					
1431	>50BF initiated externally (>50BF ext SRC)	50BF BkrFailure	SP	On Off	*		*	LED	BI		BO		166	104	1	Yes
1451	50BF is switched OFF (50BF OFF)	50BF BkrFailure	OUT	On Off	*		*	LED			BO		166	151	1	Yes
1452	50BF is BLOCKED (50BF BLOCK)	50BF BkrFailure	OUT	On Off			*	LED			BO		166	152	1	Yes
1453	50BF is ACTIVE (50BF ACTIVE)	50BF BkrFailure	OUT	On Off	*		*	LED			BO		166	153	1	Yes
1456	50BF (internal) PICKUP (50BF int Pickup)	50BF BkrFailure	OUT	*	On Off		*	LED			BO		166	156	2	Yes
1457	50BF (external) PICKUP (50BF ext Pickup)	50BF BkrFailure	OUT	*	On Off		*	LED			BO		166	157	2	Yes
1471	50BF TRIP (50BF TRIP)	50BF BkrFailure	OUT	*	On		m	LED			BO		160	85	2	No
1480	50BF (internal) TRIP (50BF int TRIP)	50BF BkrFailure	OUT	*	On		*	LED			BO		166	180	2	Yes
1481	50BF (external) TRIP (50BF ext TRIP)	50BF BkrFailure	OUT	*	On		*	LED			BO		166	181	2	Yes
1494	50BF TRIP 2 (50BF TRIP 2)	50BF BkrFailure	OUT	*	On		*	LED			BO					
1503	>BLOCK 49 Overload Protection (>BLOCK 49 O/L)	49 Th.Overload	SP	*	*		*	LED	BI		BO		167	3	1	Yes
1507	>Emergency start of motors (>EmergencyStart)	49 Th.Overload	SP	On Off	*		*	LED	BI		BO		167	7	1	Yes
1511	49 Overload Protection is OFF (49 O / L OFF)	49 Th.Overload	OUT	On Off	*		*	LED			BO		167	11	1	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
1512	49 Overload Protection is BLOCKED (49 O/L BLOCK)	49 Th.Overload	OUT	On Off	On Off		*	LED			BO		167	12	1	Yes
1513	49 Overload Protection is ACTIVE (49 O/L ACTIVE)	49 Th.Overload	OUT	On Off	*		*	LED			BO		167	13	1	Yes
1515	49 Overload Current Alarm (I alarm) (49 O/L I Alarm)	49 Th.Overload	OUT	On Off	*		*	LED			BO		167	15	1	Yes
1516	49 Overload Alarm! Near Thermal Trip (49 O/L Θ Alarm)	49 Th.Overload	OUT	On Off	*		*	LED			BO		167	16	1	Yes
1517	49 Winding Overload (49 Winding O/L)	49 Th.Overload	OUT	On Off	*		*	LED			BO		167	17	1	Yes
1521	49 Thermal Overload TRIP (49 Th O/L TRIP)	49 Th.Overload	OUT	*	On		m	LED			BO		167	21	2	Yes
1580	>49 Reset of Thermal Overload Image (>RES 49 Image)	49 Th.Overload	SP	On Off	*		*	LED	BI		BO					
1581	49 Thermal Overload Image reset (49 Image res.)	49 Th.Overload	OUT	On Off	*		*	LED			BO					
1704	>BLOCK 50/51 (>BLK 50/51)	50/51 Overcur.	SP	*	*		*	LED	BI		BO					
1714	>BLOCK 50N/51N (>BLK 50N/51N)	50/51 Overcur.	SP	*	*		*	LED	BI		BO					
1718	>BLOCK 50-3 (>BLOCK 50-3)	50/51 Overcur.	SP	*	*		*	LED	BI		BO		60	144	1	Yes
1719	>BLOCK 50N-3 (>BLOCK 50N-3)	50/51 Overcur.	SP	*	*		*	LED	BI		BO		60	145	1	Yes
1721	>BLOCK 50-2 (>BLOCK 50-2)	50/51 Overcur.	SP	*	*		*	LED	BI		BO		60	1	1	Yes
1722	>BLOCK 50-1 (>BLOCK 50-1)	50/51 Overcur.	SP	*	*		*	LED	BI		BO		60	2	1	Yes
1723	>BLOCK 51 (>BLOCK 51)	50/51 Overcur.	SP	*	*		*	LED	BI		BO		60	3	1	Yes
1724	>BLOCK 50N-2 (>BLOCK 50N-2)	50/51 Overcur.	SP	*	*		*	LED	BI		BO		60	4	1	Yes
1725	>BLOCK 50N-1 (>BLOCK 50N-1)	50/51 Overcur.	SP	*	*		*	LED	BI		BO		60	5	1	Yes
1726	>BLOCK 51N (>BLOCK 51N)	50/51 Overcur.	SP	*	*		*	LED	BI		BO		60	6	1	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
1730	>BLOCK Cold-Load-Pickup (>BLOCK CLP)	ColdLoad-Pickup	SP	*	*		*	LED	BI		BO					
1731	>BLOCK Cold-Load-Pickup stop timer (>BLK CLP stpTim)	ColdLoad-Pickup	SP	On Off	*		*	LED	BI		BO		60	243	1	Yes
1732	>ACTIVATE Cold-Load-Pickup (>ACTIVATE CLP)	ColdLoad-Pickup	SP	On Off	*		*	LED	BI		BO					
1751	50/51 O/C switched OFF (50/51 PH OFF)	50/51 Overcur.	OUT	On Off	*		*	LED			BO		60	21	1	Yes
1752	50/51 O/C is BLOCKED (50/51 PH BLK)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	22	1	Yes
1753	50/51 O/C is ACTIVE (50/51 PH ACT)	50/51 Overcur.	OUT	On Off	*		*	LED			BO		60	23	1	Yes
1756	50N/51N is OFF (50N/51N OFF)	50/51 Overcur.	OUT	On Off	*		*	LED			BO		60	26	1	Yes
1757	50N/51N is BLOCKED (50N/51N BLK)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	27	1	Yes
1758	50N/51N is ACTIVE (50N/51N ACT)	50/51 Overcur.	OUT	On Off	*		*	LED			BO		60	28	1	Yes
1761	50(N)/51(N) O/C PICKUP (50(N)/51(N) PU)	50/51 Overcur.	OUT	*	On Off		m	LED			BO		160	84	2	Yes
1762	50/51 Phase A picked up (50/51 Ph A PU)	50/51 Overcur.	OUT	*	On Off		m	LED			BO		160	64	2	Yes
1763	50/51 Phase B picked up (50/51 Ph B PU)	50/51 Overcur.	OUT	*	On Off		m	LED			BO		160	65	2	Yes
1764	50/51 Phase C picked up (50/51 Ph C PU)	50/51 Overcur.	OUT	*	On Off		m	LED			BO		160	66	2	Yes
1765	50N/51N picked up (50N/51NPickedup)	50/51 Overcur.	OUT	*	On Off		m	LED			BO		160	67	2	Yes
1767	50-3 picked up (50-3 picked up)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	146	2	Yes
1768	50N-3 picked up (50N-3 picked up)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	147	2	Yes
1769	50-3 TRIP (50-3 TRIP)	50/51 Overcur.	OUT	*	On		*	LED			BO		60	148	2	Yes
1770	50N-3 TRIP (50N-3 TRIP)	50/51 Overcur.	OUT	*	On		*	LED			BO		60	149	2	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
1787	50-3 TimeOut (50-3 TimeOut)	50/51 Overcur.	OUT	*	*		*	LED			BO		60	167	2	Yes
1788	50N-3 TimeOut (50N-3 TimeOut)	50/51 Overcur.	OUT	*	*		*	LED			BO		60	168	2	Yes
1791	50(N)/51(N) TRIP (50(N)/51(N)TRIP)	50/51 Overcur.	OUT	*	On		m	LED			BO		160	68	2	No
1800	50-2 picked up (50-2 picked up)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	75	2	Yes
1804	50-2 Time Out (50-2 TimeOut)	50/51 Overcur.	OUT	*	*		*	LED			BO		60	49	2	Yes
1805	50-2 TRIP (50-2 TRIP)	50/51 Overcur.	OUT	*	On		m	LED			BO		160	91	2	No
1810	50-1 picked up (50-1 picked up)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	76	2	Yes
1814	50-1 Time Out (50-1 TimeOut)	50/51 Overcur.	OUT	*	*		*	LED			BO		60	53	2	Yes
1815	50-1 TRIP (50-1 TRIP)	50/51 Overcur.	OUT	*	On		m	LED			BO		160	90	2	No
1820	51 picked up (51 picked up)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	77	2	Yes
1824	51 Time Out (51 Time Out)	50/51 Overcur.	OUT	*	*		*	LED			BO		60	57	2	Yes
1825	51 TRIP (51 TRIP)	50/51 Overcur.	OUT	*	On		m	LED			BO		60	58	2	Yes
1831	50N-2 picked up (50N-2 picked up)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	59	2	Yes
1832	50N-2 Time Out (50N-2 TimeOut)	50/51 Overcur.	OUT	*	*		*	LED			BO		60	60	2	Yes
1833	50N-2 TRIP (50N-2 TRIP)	50/51 Overcur.	OUT	*	On		m	LED			BO		160	93	2	No
1834	50N-1 picked up (50N-1 picked up)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	62	2	Yes
1835	50N-1 Time Out (50N-1 TimeOut)	50/51 Overcur.	OUT	*	*		*	LED			BO		60	63	2	Yes
1836	50N-1 TRIP (50N-1 TRIP)	50/51 Overcur.	OUT	*	On		m	LED			BO		160	92	2	No
1837	51N picked up (51N picked up)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	64	2	Yes
1838	51N Time Out (51N TimeOut)	50/51 Overcur.	OUT	*	*		*	LED			BO		60	65	2	Yes
1839	51N TRIP (51N TRIP)	50/51 Overcur.	OUT	*	On		m	LED			BO		60	66	2	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
1840	Phase A inrush detection (PhA InrushDet)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	101	2	Yes
1841	Phase B inrush detection (PhB InrushDet)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	102	2	Yes
1842	Phase C inrush detection (PhC InrushDet)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	103	2	Yes
1843	Cross blk: PhX blocked PhY (INRUSH X-BLK)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	104	2	Yes
1851	50-1 BLOCKED (50-1 BLOCKED)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	105	1	Yes
1852	50-2 BLOCKED (50-2 BLOCKED)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	106	1	Yes
1853	50N-1 BLOCKED (50N-1 BLOCKED)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	107	1	Yes
1854	50N-2 BLOCKED (50N-2 BLOCKED)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	108	1	Yes
1855	51 BLOCKED (51 BLOCKED)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	109	1	Yes
1856	51N BLOCKED (51N BLOCKED)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	110	1	Yes
1866	51 Disk emulation Pickup (51 Disk Pickup)	50/51 Overcur.	OUT	*	*		*	LED			BO					
1867	51N Disk emulation picked up (51N Disk Pickup)	50/51 Overcur.	OUT	*	*		*	LED			BO					
1994	Cold-Load-Pickup switched OFF (CLP OFF)	ColdLoad-Pickup	OUT	On Off	*		*	LED			BO		60	244	1	Yes
1995	Cold-Load-Pickup is BLOCKED (CLP BLOCKED)	ColdLoad-Pickup	OUT	On Off	On Off		*	LED			BO		60	245	1	Yes
1996	Cold-Load-Pickup is RUNNING (CLP running)	ColdLoad-Pickup	OUT	On Off	*		*	LED			BO		60	246	1	Yes
1997	Dynamic settings are ACTIVE (Dyn set. ACTIVE)	ColdLoad-Pickup	OUT	On Off	*		*	LED			BO		60	247	1	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
2603	67N-3 TRIP (67N-3 TRIP)	67 Direct. O/C	OUT	*	On		*	LED			BO					
2604	>BLOCK 67/67-TOC (>BLK 67/67-TOC)	67 Direct. O/C	SP	*	*		*	LED	BI		BO					
2605	67N-3 is BLOCKED (67N-3 BLOCKED)	67 Direct. O/C	OUT	On Of f	On Off f		*	LED			BO					
2606	67-3 is BLOCKED (67-3 BLOCKED)	67 Direct. O/C	OUT	On Of f	On Off f		*	LED			BO					
2614	>BLOCK 67N/67N-TOC (>BLK 67N/67NTOC)	67 Direct. O/C	SP	*	*		*	LED	BI		BO					
2615	>BLOCK 67-2 (>BLOCK 67-2)	67 Direct. O/C	SP	*	*		*	LED	BI		BO		63	73	1	Yes
2616	>BLOCK 67N-2 (>BLOCK 67N-2)	67 Direct. O/C	SP	*	*		*	LED	BI		BO		63	74	1	Yes
2617	>BLOCK 67-3 (>BLOCK 67-3)	67 Direct. O/C	SP	*	*		*	LED	BI		BO					
2618	>BLOCK 67N-3 (>BLOCK 67N-3)	67 Direct. O/C	SP	*	*		*	LED	BI		BO					
2621	>BLOCK 67-1 (>BLOCK 67-1)	67 Direct. O/C	SP	*	*		*	LED	BI		BO		63	1	1	Yes
2622	>BLOCK 67-TOC (>BLOCK 67-TOC)	67 Direct. O/C	SP	*	*		*	LED	BI		BO		63	2	1	Yes
2623	>BLOCK 67N-1 (>BLOCK 67N-1)	67 Direct. O/C	SP	*	*		*	LED	BI		BO		63	3	1	Yes
2624	>BLOCK 67N-TOC (>BLOCK 67N-TOC)	67 Direct. O/C	SP	*	*		*	LED	BI		BO		63	4	1	Yes
2628	Phase A forward (Phase A forward)	67 Direct. O/C	OUT	On	*		*	LED			BO		63	81	1	Yes
2629	Phase B forward (Phase B forward)	67 Direct. O/C	OUT	On	*		*	LED			BO		63	82	1	Yes
2630	Phase C forward (Phase C forward)	67 Direct. O/C	OUT	On	*		*	LED			BO		63	83	1	Yes
2632	Phase A reverse (Phase A reverse)	67 Direct. O/C	OUT	On	*		*	LED			BO		63	84	1	Yes
2633	Phase B reverse (Phase B reverse)	67 Direct. O/C	OUT	On	*		*	LED			BO		63	85	1	Yes
2634	Phase C reverse (Phase C reverse)	67 Direct. O/C	OUT	On	*		*	LED			BO		63	86	1	Yes
2635	Ground forward (Ground forward)	67 Direct. O/C	OUT	On	*		*	LED			BO		63	87	1	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
2636	Ground reverse (Ground reverse)	67 Direct. O/C	OUT	On	*		*	LED			BO		63	88	1	Yes
2637	67-1 is BLOCKED (67-1 BLOCKED)	67 Direct. O/C	OUT	On Off f	On Off f		*	LED			BO		63	91	1	Yes
2642	67-2 picked up (67-2 picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	67	2	Yes
2646	67N-2 picked up (67N-2 picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	62	2	Yes
2647	67-2 Time Out (67-2 Time Out)	67 Direct. O/C	OUT	*	*		*	LED			BO		63	71	2	Yes
2648	67N-2 Time Out (67N-2 Time Out)	67 Direct. O/C	OUT	*	*		*	LED			BO		63	63	2	Yes
2649	67-2 TRIP (67-2 TRIP)	67 Direct. O/C	OUT	*	On		m	LED			BO		63	72	2	Yes
2651	67/67-TOC switched OFF (67/67-TOC OFF)	67 Direct. O/C	OUT	On Off f	*		*	LED			BO		63	10	1	Yes
2652	67/67-TOC is BLOCKED (67 BLOCKED)	67 Direct. O/C	OUT	On Off f	On Off f		*	LED			BO		63	11	1	Yes
2653	67/67-TOC is ACTIVE (67 ACTIVE)	67 Direct. O/C	OUT	On Off f	*		*	LED			BO		63	12	1	Yes
2655	67-2 is BLOCKED (67-2 BLOCKED)	67 Direct. O/C	OUT	On Off f	On Off f		*	LED			BO		63	92	1	Yes
2656	67N/67N-TOC switched OFF (67N OFF)	67 Direct. O/C	OUT	On Off f	*		*	LED			BO		63	13	1	Yes
2657	67N/67N-TOC is BLOCKED (67N BLOCKED)	67 Direct. O/C	OUT	On Off f	On Off f		*	LED			BO		63	14	1	Yes
2658	67N/67N-TOC is ACTIVE (67N ACTIVE)	67 Direct. O/C	OUT	On Off f	*		*	LED			BO		63	15	1	Yes
2659	67N-1 is BLOCKED (67N-1 BLOCKED)	67 Direct. O/C	OUT	On Off f	On Off f		*	LED			BO		63	93	1	Yes
2660	67-1 picked up (67-1 picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	20	2	Yes
2664	67-1 Time Out (67-1 Time Out)	67 Direct. O/C	OUT	*	*		*	LED			BO		63	24	2	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
2665	67-1 TRIP (67-1 TRIP)	67 Direct. O/C	OUT	*	On		m	LED			BO		63	25	2	Yes
2668	67N-2 is BLOCKED (67N-2 BLOCKED)	67 Direct. O/C	OUT	On Off	On Off		*	LED			BO		63	94	1	Yes
2669	67-TOC is BLOCKED (67-TOC BLOCKED)	67 Direct. O/C	OUT	On Off	On Off		*	LED			BO		63	95	1	Yes
2670	67-TOC picked up (67-TOC pickedup)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	30	2	Yes
2674	67-TOC Time Out (67-TOC Time Out)	67 Direct. O/C	OUT	*	*		*	LED			BO		63	34	2	Yes
2675	67-TOC TRIP (67-TOC TRIP)	67 Direct. O/C	OUT	*	On		m	LED			BO		63	35	2	Yes
2676	67-TOC disk emulation is ACTIVE (67-TOC DiskPU)	67 Direct. O/C	OUT	*	*		*	LED			BO					
2677	67N-TOC is BLOCKED (67N-TOC BLOCKED)	67 Direct. O/C	OUT	On Off	On Off		*	LED			BO		63	96	1	Yes
2678	67-3 TRIP (67-3 TRIP)	67 Direct. O/C	OUT	*	On		*	LED			BO					
2679	67N-2 TRIP (67N-2 TRIP)	67 Direct. O/C	OUT	*	On		m	LED			BO		63	64	2	Yes
2681	67N-1 picked up (67N-1 picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	41	2	Yes
2682	67N-1 Time Out (67N-1 Time Out)	67 Direct. O/C	OUT	*	*		*	LED			BO		63	42	2	Yes
2683	67N-1 TRIP (67N-1 TRIP)	67 Direct. O/C	OUT	*	On		m	LED			BO		63	43	2	Yes
2684	67N-TOC picked up (67N-TOC Pickedup)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	44	2	Yes
2685	67N-TOC Time Out (67N-TOC TimeOut)	67 Direct. O/C	OUT	*	*		*	LED			BO		63	45	2	Yes
2686	67N-TOC TRIP (67N-TOC TRIP)	67 Direct. O/C	OUT	*	On		m	LED			BO		63	46	2	Yes
2687	67N-TOC disk emulation is ACTIVE (67N-TOC Disk PU)	67 Direct. O/C	OUT	*	*		*	LED			BO					
2691	67/67N picked up (67/67N pickedup)	67 Direct. O/C	OUT	*	On Off		m	LED			BO		63	50	2	Yes
2692	67/67-TOC Phase A picked up (67 A picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	51	2	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
2693	67/67-TOC Phase B picked up (67 B picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	52	2	Yes
2694	67/67-TOC Phase C picked up (67 C picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	53	2	Yes
2695	67N/67N-TOC picked up (67N picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO		63	54	2	Yes
2696	67/67N TRIP (67/67N TRIP)	67 Direct. O/C	OUT	*	On		m	LED			BO		63	55	2	Yes
2697	67-3 picked up (67-3 picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO					
2698	67N-3 picked up (67N-3 picked up)	67 Direct. O/C	OUT	*	On Off		*	LED			BO					
2699	67-3 Time Out (67-3 Time Out)	67 Direct. O/C	OUT	*	*		*	LED			BO					
2700	67N-3 Time Out (67N-3 Time Out)	67 Direct. O/C	OUT	*	*		*	LED			BO					
2701	>79 ON (>79 ON)	79M Auto Recl.	SP	On Off	*		*	LED	BI		BO		40	1	1	Yes
2702	>79 OFF (>79 OFF)	79M Auto Recl.	SP	On Off	*		*	LED	BI		BO		40	2	1	Yes
2703	>BLOCK 79 (>BLOCK 79)	79M Auto Recl.	SP	On Off	*		*	LED	BI		BO		40	3	1	Yes
2711	>79 External start of internal A/R (>79 Start)	79M Auto Recl.	SP	*	On Off		*	LED	BI		BO					
2715	>Start 79 Ground program (>Start 79 Gnd)	79M Auto Recl.	SP	*	On		*	LED	BI		BO		40	15	2	Yes
2716	>Start 79 Phase program (>Start 79 Ph)	79M Auto Recl.	SP	*	On		*	LED	BI		BO		40	16	2	Yes
2720	>Enable 50/67-(N)-2 (override 79 blk) (>Enable ANSI#-2)	P.System Data 2	SP	On Off	*		*	LED	BI		BO		40	20	1	Yes
2722	>Switch zone sequence coordination ON (>ZSC ON)	79M Auto Recl.	SP	On Off	*		*	LED	BI		BO					
2723	>Switch zone sequence coordination OFF (>ZSC OFF)	79M Auto Recl.	SP	On Off	*		*	LED	BI		BO					
2730	>Circuit breaker READY for reclosing (>CB Ready)	79M Auto Recl.	SP	On Off	*		*	LED	BI		BO		40	30	1	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
2731	>79: Sync. release from ext. sync.-check (>Sync.release)	79M Auto Recl.	SP	*	On		*	LED	BI		BO					
2753	79: Max. Dead Time Start Delay expired (79 DT delay ex.)	79M Auto Recl.	OUT	On	*		*	LED			BO					
2754	>79: Dead Time Start Delay (>79 DT St.Delay)	79M Auto Recl.	SP	On Off	*		*	LED	BI		BO					
2781	79 Auto recloser is switched OFF (79 OFF)	79M Auto Recl.	OUT	On	*		*	LED			BO		40	81	1	Yes
2782	79 Auto recloser is switched ON (79 ON)	79M Auto Recl.	IntS P	On Off	*		*	LED			BO		160	16	1	Yes
2784	79 Auto recloser is NOT ready (79 is NOT ready)	79M Auto Recl.	OUT	On Off	*		*	LED			BO		160	130	1	Yes
2785	79 - Auto-reclose is dynamically BLOCKED (79 DynBlock)	79M Auto Recl.	OUT	On Off	On		*	LED			BO		40	85	1	Yes
2788	79: CB ready monitoring window expired (79 T-CBreadyExp)	79M Auto Recl.	OUT	On	*		*	LED			BO					
2801	79 - in progress (79 in progress)	79M Auto Recl.	OUT	*	On		*	LED			BO		40	101	2	Yes
2808	79: CB open with no trip (79 BLK: CB open)	79M Auto Recl.	OUT	On Off	*		*	LED			BO					
2809	79: Start-signal monitoring time expired (79 T-Start Exp)	79M Auto Recl.	OUT	On	*		*	LED			BO					
2810	79: Maximum dead time expired (79 TdeadMax Exp)	79M Auto Recl.	OUT	On	*		*	LED			BO					
2823	79: no starter configured (79 no starter)	79M Auto Recl.	OUT	On Off	*		*	LED			BO					
2824	79: no cycle configured (79 no cycle)	79M Auto Recl.	OUT	On Off	*		*	LED			BO					
2827	79: blocking due to trip (79 BLK by trip)	79M Auto Recl.	OUT	On	*		*	LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
2828	79: blocking due to 3-phase pickup (79 BLK:3ph p.u.)	79M Auto Recl.	OUT	On	*		*	LED			BO					
2829	79: action time expired before trip (79 Tact expired)	79M Auto Recl.	OUT	On	*		*	LED			BO					
2830	79: max. no. of cycles exceeded (79 Max. No. Cyc)	79M Auto Recl.	OUT	On	*		*	LED			BO					
2844	79 1st cycle running (79 1stCyc. run.)	79M Auto Recl.	OUT	*	On		*	LED			BO					
2845	79 2nd cycle running (79 2ndCyc. run.)	79M Auto Recl.	OUT	*	On		*	LED			BO					
2846	79 3rd cycle running (79 3rdCyc. run.)	79M Auto Recl.	OUT	*	On		*	LED			BO					
2847	79 4th or higher cycle running (79 4thCyc. run.)	79M Auto Recl.	OUT	*	On		*	LED			BO					
2851	79 - Close command (79 Close)	79M Auto Recl.	OUT	*	On		m	LED			BO		160	128	2	No
2862	79 - cycle successful (79 Successful)	79M Auto Recl.	OUT	On	On		*	LED			BO		40	162	1	Yes
2863	79 - Lockout (79 Lockout)	79M Auto Recl.	OUT	On	On		*	LED			BO		40	163	2	Yes
2865	79: Synchro-check request (79 Sync.Request)	79M Auto Recl.	OUT	*	On		*	LED			BO					
2878	79-A/R single phase reclosing sequence (79 L-N Sequence)	79M Auto Recl.	OUT	*	On		*	LED			BO		40	180	2	Yes
2879	79-A/R multi-phase reclosing sequence (79 L-L Sequence)	79M Auto Recl.	OUT	*	On		*	LED			BO		40	181	2	Yes
2883	Zone Sequencing is active (ZSC active)	79M Auto Recl.	OUT	On Off	On		*	LED			BO					
2884	Zone sequence coordination switched ON (ZSC ON)	79M Auto Recl.	OUT	On	*		*	LED			BO					
2885	Zone sequence coordination switched OFF (ZSC OFF)	79M Auto Recl.	OUT	On	*		*	LED			BO					
2889	79 1st cycle zone extension release (79 1.CycZoneRel)	79M Auto Recl.	OUT	*	*		*	LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
2890	79 2nd cycle zone extension release (79 2.CycZoneRel)	79M Auto Recl.	OUT	*	*		*	LED			BO					
2891	79 3rd cycle zone extension release (79 3.CycZoneRel)	79M Auto Recl.	OUT	*	*		*	LED			BO					
2892	79 4th cycle zone extension release (79 4.CycZoneRel)	79M Auto Recl.	OUT	*	*		*	LED			BO					
2896	No. of 1st AR-cycle CLOSE commands,3pole (79 #Close1./3p=)	Statistics	VI													
2898	No. of higher AR-cycle CLOSE commands,3p (79 #Close2./3p=)	Statistics	VI													
2899	79: Close request to Control Function (79 CloseRequest)	79M Auto Recl.	OUT	*	On		*	LED			BO					
4601	>52-a contact (OPEN, if bkr is open) (>52-a)	P.System Data 2	SP	On Off	*		*	LED	BI		BO					
4602	>52-b contact (OPEN, if bkr is closed) (>52-b)	P.System Data 2	SP	On Off	*		*	LED	BI		BO					
5143	>BLOCK 46 (>BLOCK 46)	46 Negative Seq	SP	*	*		*	LED	BI		BO		70	12 6	1	Yes
5145	>Reverse Phase Rotation (>Reverse Rot.)	P.System Data 1	SP	On Off	*		*	LED	BI		BO					
5147	Phase rotation ABC (Rotation ABC)	P.System Data 1	OUT	On Off	*		*	LED			BO		70	12 8	1	Yes
5148	Phase rotation ACB (Rotation ACB)	P.System Data 1	OUT	On Off	*		*	LED			BO		70	12 9	1	Yes
5151	46 switched OFF (46 OFF)	46 Negative Seq	OUT	On Off	*		*	LED			BO		70	13 1	1	Yes
5152	46 is BLOCKED (46 BLOCKED)	46 Negative Seq	OUT	On Off	On Off		*	LED			BO		70	13 2	1	Yes
5153	46 is ACTIVE (46 ACTIVE)	46 Negative Seq	OUT	On Off	*		*	LED			BO		70	13 3	1	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
5159	46-2 picked up (46-2 picked up)	46 Negative Seq	OUT	*	On Off		*	LED			BO		70	138	2	Yes
5165	46-1 picked up (46-1 picked up)	46 Negative Seq	OUT	*	On Off		*	LED			BO		70	150	2	Yes
5166	46-TOC picked up (46-TOC picked up)	46 Negative Seq	OUT	*	On Off		*	LED			BO		70	141	2	Yes
5170	46 TRIP (46 TRIP)	46 Negative Seq	OUT	*	On		m	LED			BO		70	149	2	Yes
5171	46 Disk emulation picked up (46 Dsk picked up)	46 Negative Seq	OUT	*	*		*	LED			BO					
5203	>BLOCK 81O/U (>BLOCK 81O/U)	81 O/U Freq.	SP	On Off	*		*	LED	BI		BO		70	176	1	Yes
5206	>BLOCK 81-1 (>BLOCK 81-1)	81 O/U Freq.	SP	On Off	*		*	LED	BI		BO		70	177	1	Yes
5207	>BLOCK 81-2 (>BLOCK 81-2)	81 O/U Freq.	SP	On Off	*		*	LED	BI		BO		70	178	1	Yes
5208	>BLOCK 81-3 (>BLOCK 81-3)	81 O/U Freq.	SP	On Off	*		*	LED	BI		BO		70	179	1	Yes
5209	>BLOCK 81-4 (>BLOCK 81-4)	81 O/U Freq.	SP	On Off	*		*	LED	BI		BO		70	180	1	Yes
5211	81 OFF (81 OFF)	81 O/U Freq.	OUT	On Off	*		*	LED			BO		70	181	1	Yes
5212	81 BLOCKED (81 BLOCKED)	81 O/U Freq.	OUT	On Off	On Off		*	LED			BO		70	182	1	Yes
5213	81 ACTIVE (81 ACTIVE)	81 O/U Freq.	OUT	On Off	*		*	LED			BO		70	183	1	Yes
5214	81 Under Voltage Block (81 Under V Blk)	81 O/U Freq.	OUT	On Off	On Off		*	LED			BO		70	184	1	Yes
5232	81-1 picked up (81-1 picked up)	81 O/U Freq.	OUT	*	On Off		*	LED			BO		70	230	2	Yes
5233	81-2 picked up (81-2 picked up)	81 O/U Freq.	OUT	*	On Off		*	LED			BO		70	231	2	Yes
5234	81-3 picked up (81-3 picked up)	81 O/U Freq.	OUT	*	On Off		*	LED			BO		70	232	2	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
5235	81-4 picked up (81-4 picked up)	81 O/U Freq.	OUT	*	On Off		*	LED			BO		70	23 3	2	Yes
5236	81-1 TRIP (81-1 TRIP)	81 O/U Freq.	OUT	*	On		m	LED			BO		70	23 4	2	Yes
5237	81-2 TRIP (81-2 TRIP)	81 O/U Freq.	OUT	*	On		m	LED			BO		70	23 5	2	Yes
5238	81-3 TRIP (81-3 TRIP)	81 O/U Freq.	OUT	*	On		m	LED			BO		70	23 6	2	Yes
5239	81-4 TRIP (81-4 TRIP)	81 O/U Freq.	OUT	*	On		m	LED			BO		70	23 7	2	Yes
5951	>BLOCK 50 1Ph (>BLK 50 1Ph)	50 1Ph	SP	*	*		*	LED	BI		BO					
5952	>BLOCK 50 1Ph-1 (>BLK 50 1Ph-1)	50 1Ph	SP	*	*		*	LED	BI		BO					
5953	>BLOCK 50 1Ph-2 (>BLK 50 1Ph-2)	50 1Ph	SP	*	*		*	LED	BI		BO					
5961	50 1Ph is OFF (50 1Ph OFF)	50 1Ph	OUT	On Off	*		*	LED			BO					
5962	50 1Ph is BLOCKED (50 1Ph BLOCKED)	50 1Ph	OUT	On Off	On Off		*	LED			BO					
5963	50 1Ph is ACTIVE (50 1Ph ACTIVE)	50 1Ph	OUT	On Off	*		*	LED			BO					
5966	50 1Ph-1 is BLOCKED (50 1Ph-1 BLK)	50 1Ph	OUT	On Off	On Off		*	LED			BO					
5967	50 1Ph-2 is BLOCKED (50 1Ph-2 BLK)	50 1Ph	OUT	On Off	On Off		*	LED			BO					
5971	50 1Ph picked up (50 1Ph Pickup)	50 1Ph	OUT	*	On Off		*	LED			BO					
5972	50 1Ph TRIP (50 1Ph TRIP)	50 1Ph	OUT	*	On		*	LED			BO					
5974	50 1Ph-1 picked up (50 1Ph-1 PU)	50 1Ph	OUT	*	On Off		*	LED			BO					
5975	50 1Ph-1 TRIP (50 1Ph-1 TRIP)	50 1Ph	OUT	*	On		*	LED			BO					
5977	50 1Ph-2 picked up (50 1Ph-2 PU)	50 1Ph	OUT	*	On Off		*	LED			BO					
5979	50 1Ph-2 TRIP (50 1Ph-2 TRIP)	50 1Ph	OUT	*	On		*	LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
5980	50 1Ph: I at pick up (50 1Ph I:)	50 1Ph	VI	*	On Off											
6401	>QV-Protection Blocked (>27/Q Block)	27/Q	SP	*	*		*	LED	BI		BO		74	201	1	Yes
6411	27/Q -Protection off (27/Q OFF)	27/Q	OUT	On Off	*		*	LED			BO		74	211	1	Yes
6412	27/Q -Protection blocked (27/Q block)	27/Q	OUT	On Off	On Off		*	LED			BO		74	212	1	Yes
6413	27/Q -Protection active (27/Q ACT)	27/Q	OUT	On Off	*		*	LED			BO		74	213	1	Yes
6421	27/Q -Protection Gen TRIP (27/Q Gen TRIP)	27/Q	OUT	*	On Off		*	LED			BO		74	221	2	Yes
6422	27/Q -Protection Grid TRIP (27/Q Grid TRIP)	27/Q	OUT	*	On Off		*	LED			BO		74	222	2	Yes
6423	27/Q-Protection PICKUP (27/Q PICKUP)	27/Q	OUT	*	On Off		*	LED			BO		74	223	2	No
6424	Reclosure release (Reclosure rel.)	27/Q	OUT	*	On Off		*	LED			BO		74	224	2	Yes
6425	27/Q pickup blocked by Inrush (27/Q blk.b.Inr.)	27/Q	OUT	On Off	On Off		*	LED			BO		74	225	2	Yes
6503	>BLOCK 27 undervoltage protection (>BLOCK 27)	27/59 O/U Volt.	SP	*	*		*	LED	BI		BO		74	3	1	Yes
6505	>27-Switch current supervision ON (>27 I SUPRVSN)	27/59 O/U Volt.	SP	On Off	*		*	LED	BI		BO		74	5	1	Yes
6506	>BLOCK 27-1 Under-voltage protection (>BLOCK 27-1)	27/59 O/U Volt.	SP	On Off	*		*	LED	BI		BO		74	6	1	Yes
6508	>BLOCK 27-2 Under-voltage protection (>BLOCK 27-2)	27/59 O/U Volt.	SP	On Off	*		*	LED	BI		BO		74	8	1	Yes
6509	>Failure: Feeder VT (>FAIL:FEEDER VT)	Meas-urem.Super v	SP	On Off	*		*	LED	BI		BO		74	9	1	Yes
6510	>Failure: Busbar VT (>FAIL: BUS VT)	Meas-urem.Super v	SP	On Off	*		*	LED	BI		BO		74	10	1	Yes
6513	>BLOCK 59 overvoltage protection (>BLOCK 59)	27/59 O/U Volt.	SP	*	*		*	LED	BI		BO		74	13	1	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
6530	27 Undervoltage protection switched OFF (27 OFF)	27/59 O/U Volt.	OUT	On Off	*		*	LED			BO		74	30	1	Yes
6531	27 Undervoltage protection is BLOCKED (27 BLOCKED)	27/59 O/U Volt.	OUT	On Off	On Off		*	LED			BO		74	31	1	Yes
6532	27 Undervoltage protection is ACTIVE (27 ACTIVE)	27/59 O/U Volt.	OUT	On Off	*		*	LED			BO		74	32	1	Yes
6533	27-1 Undervoltage picked up (27-1 picked up)	27/59 O/U Volt.	OUT	*	On Off		*	LED			BO		74	33	2	Yes
6534	27-1 Undervoltage PICKUP w/curr. superv (27-1 PU CS)	27/59 O/U Volt.	OUT	*	On Off		*	LED			BO		74	34	2	Yes
6537	27-2 Undervoltage picked up (27-2 picked up)	27/59 O/U Volt.	OUT	*	On Off		*	LED			BO		74	37	2	Yes
6538	27-2 Undervoltage PICKUP w/curr. superv (27-2 PU CS)	27/59 O/U Volt.	OUT	*	On Off		*	LED			BO		74	38	2	Yes
6539	27-1 Undervoltage TRIP (27-1 TRIP)	27/59 O/U Volt.	OUT	*	On		m	LED			BO		74	39	2	Yes
6540	27-2 Undervoltage TRIP (27-2 TRIP)	27/59 O/U Volt.	OUT	*	On		*	LED			BO		74	40	2	Yes
6565	59-Overvoltage protection switched OFF (59 OFF)	27/59 O/U Volt.	OUT	On Off	*		*	LED			BO		74	65	1	Yes
6566	59-Overvoltage protection is BLOCKED (59 BLOCKED)	27/59 O/U Volt.	OUT	On Off	On Off		*	LED			BO		74	66	1	Yes
6567	59-Overvoltage protection is ACTIVE (59 ACTIVE)	27/59 O/U Volt.	OUT	On Off	*		*	LED			BO		74	67	1	Yes
6568	59-1 Overvoltage V> picked up (59-1 picked up)	27/59 O/U Volt.	OUT	*	On Off		*	LED			BO		74	68	2	Yes
6570	59-1 Overvoltage V> TRIP (59-1 TRIP)	27/59 O/U Volt.	OUT	*	On		m	LED			BO		74	70	2	Yes
6571	59-2 Overvoltage V>> picked up (59-2 picked up)	27/59 O/U Volt.	OUT	*	On Off		*	LED			BO					
6573	59-2 Overvoltage V>> TRIP (59-2 TRIP)	27/59 O/U Volt.	OUT	*	On		*	LED			BO					
6851	>BLOCK 74TC (>BLOCK 74TC)	74TC Trip-Circ.	SP	*	*		*	LED	BI		BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
6852	>74TC Trip circuit superv.: trip relay (>74TC trip rel.)	74TC Trip-Circ.	SP	On Off	*		*	LED	BI		BO		170	51	1	Yes
6853	>74TC Trip circuit superv.: bkr relay (>74TC brk rel.)	74TC Trip-Circ.	SP	On Off	*		*	LED	BI		BO		170	52	1	Yes
6861	74TC Trip circuit supervision OFF (74TC OFF)	74TC Trip-Circ.	OUT	On Off	*		*	LED			BO		170	53	1	Yes
6862	74TC Trip circuit supervision is BLOCKED (74TC BLOCKED)	74TC Trip-Circ.	OUT	On Off			*	LED			BO		153	16	1	Yes
6863	74TC Trip circuit supervision is ACTIVE (74TC ACTIVE)	74TC Trip-Circ.	OUT	On Off	*		*	LED			BO		153	17	1	Yes
6864	74TC blocked. Bin. input is not set (74TC ProgFail)	74TC Trip-Circ.	OUT	On Off	*		*	LED			BO		170	54	1	Yes
6865	74TC Failure Trip Circuit (74TC Trip cir.)	74TC Trip-Circ.	OUT	On Off	*		*	LED			BO		170	55	1	Yes
6903	>block interm. E/F prot. (>IEF block)	Intermit. EF	SP	*	*		*	LED	BI		BO		152	1	1	Yes
6921	Interm. E/F prot. is switched off (IEF OFF)	Intermit. EF	OUT	On Off	*		*	LED			BO		152	10	1	Yes
6922	Interm. E/F prot. is blocked (IEF blocked)	Intermit. EF	OUT	On Off			*	LED			BO		152	11	1	Yes
6923	Interm. E/F prot. is active (IEF enabled)	Intermit. EF	OUT	On Off	*		*	LED			BO		152	12	1	Yes
6924	Interm. E/F detection stage lie> (IIE Fault det)	Intermit. EF	OUT	*	*		*	LED			BO					
6925	Interm. E/F stab detection (IIE stab.Flt)	Intermit. EF	OUT	*	*		*	LED			BO					
6926	Interm.E/F det.stage lie> f.Flt. ev.Prot (IIE Flt.det FE)	Intermit. EF	OUT	*	On		*						152	13	2	No
6927	Interm. E/F detected (Intermitt.EF)	Intermit. EF	OUT	*	On Off		*	LED			BO		152	14	2	Yes
6928	Counter of det. times elapsed (IEF Tsum exp.)	Intermit. EF	OUT	*	On		*	LED			BO		152	15	2	No

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
6929	Interm. E/F: reset time running (IEF Tres run.)	Intermit. EF	OUT	*	On Off		*	LED			BO		152	16	2	Yes
6930	Interm. E/F: trip (IEF Trip)	Intermit. EF	OUT	*	On		*	LED			BO		152	17	2	No
6931	Max RMS current value of fault = (I _{ie} /I _n =)	Intermit. EF	VI		ON OFF		*						152	18	4	No
6932	No. of detections by stage I _{ie} >= (Nos.IIE=)	Intermit. EF	VI		ON OFF		*						152	19	4	No
6951	>Block directional interm. E/F prot. (>dIEF block)	Dir. Interm. EF	SP	On Off	*	*	*	LED	BI		BO					
6961	Dir. Interm. E/F prot. is switched off (dIEF OFF)	Dir. Interm. EF	OUT	On Off	*	*	*	LED			BO					
6962	Dir. Interm. E/F prot. is blocked (dIEF blocked)	Dir. Interm. EF	OUT	On Off	*	*	*	LED	BI		BO					
6963	Dir. Interm. E/F prot. is active (dIEF active)	Dir. Interm. EF	OUT	On Off	*	*	*	LED	BI		BO					
6972	dIEF: pick up (dIEF pick up)	Dir. Interm. EF	OUT	*	On Off	On Off	*	LED			BO					
6973	dIEF: Trip (dIEF TRIP)	Dir. Interm. EF	OUT	*	On	On Off	*	LED			BO					
6974	dIEF: No. of detected forward pulses = (No.forward=)	Dir. Interm. EF	VI	*	On Off	On Off										
6975	dIEF: No. of detected reverse pulses = (No.reverse=)	Dir. Interm. EF	VI	*	On Off	On Off										
6976	dIEF: No. of detected undefined pulses = (No.undef.=)	Dir. Interm. EF	VI	*	On Off	On Off										
6979	dIEF: Alarm (dIEF ALARM)	Dir. Interm. EF	OUT	*	On Off	On Off	*	LED			BO					
7551	50-1 InRush picked up (50-1 InRushPU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	80	2	Yes
7552	50N-1 InRush picked up (50N-1 InRushPU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	81	2	Yes
7553	51 InRush picked up (51 InRushPU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	82	2	Yes
7554	51N InRush picked up (51N InRushPU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	83	2	Yes

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
7556	InRush OFF (InRush OFF)	50/51 Overcur.	OUT	On Off	*		*	LED			BO		60	92	1	Yes
7557	InRush BLOCKED (InRush BLK)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	93	1	Yes
7558	InRush Ground detected (InRush Gnd Det)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	94	2	Yes
7559	67-1 InRush picked up (67-1 InRushPU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	84	2	Yes
7560	67N-1 InRush picked up (67N-1 InRushPU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	85	2	Yes
7561	67-TOC InRush picked up (67-TOC InRushPU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	86	2	Yes
7562	67N-TOC InRush picked up (67N-TOC InRushPU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	87	2	Yes
7563	>BLOCK InRush (>BLOCK InRush)	50/51 Overcur.	SP	*	*		*	LED	BI		BO					
7564	Ground InRush picked up (Gnd InRush PU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	88	2	Yes
7565	Phase A InRush picked up (Ia InRush PU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	89	2	Yes
7566	Phase B InRush picked up (Ib InRush PU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	90	2	Yes
7567	Phase C InRush picked up (Ic InRush PU)	50/51 Overcur.	OUT	*	On Off		*	LED			BO		60	91	2	Yes
10034	50-3 BLOCKED (50-3 BLOCKED)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	169	1	Yes
10035	50N-3 BLOCKED (50N-3 BLOCKED)	50/51 Overcur.	OUT	On Off	On Off		*	LED			BO		60	170	1	Yes
10080	Error Extension I/O (Error Ext I/O)	Device, General	OUT	On Off	*		*	LED			BO					
10081	Error Ethernet (Error Ethernet)	Device, General	OUT	On Off	*		*	LED			BO					
10082	Error Current Terminal (Error Terminal)	Device, General	OUT	On Off	*		*	LED			BO					
10083	Error Basic I/O (Error Basic I/O)	Device, General	OUT	On Off	*		*	LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
16001	Sum Current Exponentiation Ph A to I_r^x ($\Sigma I^x A=$)	Statistics	VI													
16002	Sum Current Exponentiation Ph B to I_r^x ($\Sigma I^x B=$)	Statistics	VI													
16003	Sum Current Exponentiation Ph C to I_r^x ($\Sigma I^x C=$)	Statistics	VI													
16005	Threshold Sum Curr. Exponent. exceeded (Threshold $\Sigma I^x >$)	SetPoint(Stat)	OUT	On Off	*		*	LED			BO					
16006	Residual Endurance Phase A (Resid.Endu. A=)	Statistics	VI													
16007	Residual Endurance Phase B (Resid.Endu. B=)	Statistics	VI													
16008	Residual Endurance Phase C (Resid.Endu. C=)	Statistics	VI													
16010	Dropped below Threshold CB Res.Endurance (Thresh.R.Endu.<)	SetPoint(Stat)	OUT	On Off	*		*	LED			BO					
16011	Number of mechanical Trips Phase A (mechan.TRIP A=)	Statistics	VI													
16012	Number of mechanical Trips Phase B (mechan.TRIP B=)	Statistics	VI													
16013	Number of mechanical Trips Phase C (mechan.TRIP C=)	Statistics	VI													
16014	Sum Squared Current Integral Phase A ($\Sigma I^2 t A=$)	Statistics	VI													
16015	Sum Squared Current Integral Phase B ($\Sigma I^2 t B=$)	Statistics	VI													
16016	Sum Squared Current Integral Phase C ($\Sigma I^2 t C=$)	Statistics	VI													
16018	Threshold Sum Squa. Curr. Int. exceeded (Thresh. $\Sigma I^2 t >$)	SetPoint(Stat)	OUT	On Off	*		*	LED			BO					
16019	>52 Breaker Wear Start Criteria (>52 Wear start)	P.System Data 2	SP	On Off	*		*	LED	BI		BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
16020	52 Wear blocked by Time Setting Failure (52 WearSet.fail)	P.System Data 2	OUT	On Off	*		*	LED			BO					
16027	52 Breaker Wear Logic blk Ir-CB>=Isc-CB (52WL.blk I PErr)	P.System Data 2	OUT	On Off	*		*	LED			BO					
16028	52 Breaker W.Log.blk SwCyc.Isc>=SwCyc.Ir (52WL.blk n PErr)	P.System Data 2	OUT	On Off	*		*	LED			BO					
16029	Sens.gnd.flt. 51Ns BLOCKED Setting Error (51Ns BLK PaErr)	Sens. Gnd Fault	OUT	On Off	*		*	LED			BO					
16030	Angle between 3Vo and INsens. ($\phi(3Vo, INs) =$)	Sens. Gnd Fault	VI			ON OFF										
18901	>BLOCK Earth fault (extend) (>BLK E Flt(ext))	E Flt(ext)	SP	On Off	*		*	LED	BI		BO					
18902	>BLOCK EPTR (>BLOCK EPTR)	E Flt(ext)	SP	On Off	*		*	LED	BI		BO					
18903	>BLOCK Transformer Neutral (TNP) (>BLOCK TNP)	E Flt(ext)	SP	On Off	*		*	LED	BI		BO					
18904	Earth fault (extend) is OFF (E Flt(ext) OFF)	E Flt(ext)	OUT	On Off	*		*	LED	BI		BO					
18905	Earth fault (extend) is ACTIVE (E Flt(ext) ACT)	E Flt(ext)	OUT	On Off	*		*	LED	BI		BO					
18906	EPTR is OFF (EPTR OFF)	E Flt(ext)	OUT	On Off	*		*	LED			BO					
18907	EPTR is ACTIVE (EPTR ACT)	E Flt(ext)	OUT	On Off	*		*	LED			BO					
18908	Transformer Neutral(TNP) is OFF (TNP OFF)	E Flt(ext)	OUT	On Off	*		*	LED			BO					
18909	Transformer Neutral(TNP) is ACTIVE (TNP ACT)	E Flt(ext)	OUT	On Off	*		*	LED			BO					
18910	EPTR picked up (EPTR picked up)	E Flt(ext)	OUT	*	On Off		*	LED			BO					

No.	Description	Function	Type of Information	Log Buffers				Configurable in Matrix					IEC 60870-5-103			
				Event Log ON/OFF	Trip (Fault) Log ON/OFF	Ground Fault Log ON/OFF	Marked in Oscill. Record	LED	Binary Input	Function Key	Relay	Chatter Suppression	Type	information number	Data Unit	General Interrogation
18911	EPTR TRIP (EPTR TRIP)	E Flt(ext)	OUT	*	On		m	LED			BO					
18912	Transformer Neutral (TNP) picked up (TNP picked up)	E Flt(ext)	OUT	*	On Off		*	LED			BO					
18913	Transformer Neutral (TNP) TRIP (TNP TRIP)	E Flt(ext)	OUT	*	On		m	LED			BO					
18914	Earth fault (extend) picked up (E Flt(ext) PU)	E Flt(ext)	OUT	*	On Off		m	LED			BO					
18915	Earth fault (extend) TRIP (E Flt(ext) Trip)	E Flt(ext)	OUT	*	On		m	LED			BO					
18916	Earth fault (extend) is BLOCKED (E Flt(ext) BLK)	E Flt(ext)	OUT	On Off	On Off		*	LED			BO					
18917	EPTR is BLOCKED (EPTR BLOCKED)	E Flt(ext)	OUT	On Off	On Off	*	*	LED			BO					
18918	Transformer Neutral(TNP) is BLOCKED (TNP BLOCKED)	E Flt(ext)	OUT	On Off	On Off	*	*	LED			BO					
18919	Earth fault (extend) BLOCK Setting Error (EF BLK PaErr)	E Flt(ext)	OUT	On Off	*	*	*	LED			BO					
30053	Fault recording is running (Fault rec. run.)	Osc. Fault Rec.	OUT	*	*		*	LED			BO					
31000	Q0 operationcounter= (Q0 OpCnt=)	Control Device	VI	*												
31001	Q1 operationcounter= (Q1 OpCnt=)	Control Device	VI	*												
31008	Q8 operationcounter= (Q8 OpCnt=)	Control Device	VI	*												

F.4 Group Indications

No.	Description	Function No.	Description
140	Error Sum Alarm	177 178 10080 10081 10082 10083 191 193	Fail Battery I/O-Board error Error Ext I/O Error Ethernet Error Terminal Error Basic I/O Error Offset Alarm NO calibr
160	Alarm Sum Event	162 163 167 175 176	I Failure Σ I Fail I balance Fail V balance Fail Ph. Seq. I Fail Ph. Seq. V
161	Fail I Superv.	162 163	I Failure Σ I Fail I balance
171	Fail Ph. Seq.	175 176	Fail Ph. Seq. I Fail Ph. Seq. V

No.	Description	Function No.	Description
501	Relay PICKUP	1517	49 Winding O/L
		5159	46-2 picked up
		5165	46-1 picked up
		5166	46-TOC pickedup
		5971	50 1Ph Pickup
		5974	50 1Ph-1 PU
		5977	50 1Ph-2 PU
		1761	50(N)/51(N) PU
		2691	67/67N pickedup
		1224	50Ns-1 Pickup
		1221	50Ns-2 Pickup
		1215	64 Pickup
		6423	27/Q PICKUP
511	Relay TRIP	235.2126	\$00 TRIP
		1217	64 TRIP
		1223	50Ns-2 TRIP
		1226	50Ns-1 TRIP
		1229	51Ns TRIP
		5236	81-1 TRIP
		5237	81-2 TRIP
		5238	81-3 TRIP
		5239	81-4 TRIP
		6930	IEF Trip
		6973	dIEF TRIP
		5170	46 TRIP
		6539	27-1 TRIP
		6540	27-2 TRIP
		6570	59-1 TRIP
		6573	59-2 TRIP
		1471	50BF TRIP
		1494	50BF TRIP 2
		5972	50 1Ph TRIP
		1521	49 Th O/L TRIP
		1791	50(N)/51(N)TRIP
		2696	67/67N TRIP

F.5 Measured Values

No.	Description	Function	IEC 60870-5-103					Configurable in Matrix		
			Type	information number	Compatibility	Data Unit	Position	CFC	Control Display	Default Display
–	Number of TRIPs= (#of TRIPs=)	Statistics	–	–	–	–	–	CFC		
–	Operating hours greater than (OpHour>)	SetPoint(Stat)	–	–	–	–	–	CFC		
170.20 50	V1 = (V1 =)	SYNC function 1	130	1	No	9	1	CFC		
170.20 51	f1 = (f1 =)	SYNC function 1	130	1	No	9	4	CFC		
170.20 52	V2 = (V2 =)	SYNC function 1	130	1	No	9	3	CFC		
170.20 53	f2 = (f2 =)	SYNC function 1	130	1	No	9	7	CFC		
170.20 54	dV = (dV =)	SYNC function 1	130	1	No	9	2	CFC		
170.20 55	df = (df =)	SYNC function 1	130	1	No	9	5	CFC		
170.20 56	dalpha = (dα =)	SYNC function 1	130	1	No	9	6	CFC		
601	Ia (Ia =)	Measurement	134	157	No	9	1	CFC		
602	Ib (Ib =)	Measurement	160	145	Yes	3	1	CFC		
			134	157	No	9	2			
603	Ic (Ic =)	Measurement	134	157	No	9	3	CFC		
604	In (In =)	Measurement	134	157	No	9	4	CFC		
605	I1 (positive sequence) (I1 =)	Measurement	–	–	–	–	–	CFC		
606	I2 (negative sequence) (I2 =)	Measurement	–	–	–	–	–	CFC		
621	Va (Va =)	Measurement	134	157	No	9	6	CFC		
622	Vb (Vb =)	Measurement	134	157	No	9	7	CFC		
623	Vc (Vc =)	Measurement	134	157	No	9	8	CFC		
624	Va-b (Va-b=)	Measurement	160	145	Yes	3	2	CFC		
			134	157	No	9	9			
625	Vb-c (Vb-c=)	Measurement	134	157	No	9	10	CFC		
626	Vc-a (Vc-a=)	Measurement	134	157	No	9	11	CFC		
627	VN (VN =)	Measurement	134	118	No	9	1	CFC		
629	V1 (positive sequence) (V1 =)	Measurement	–	–	–	–	–	CFC		
630	V2 (negative sequence) (V2 =)	Measurement	–	–	–	–	–	CFC		
632	Vsync (synchronism) (Vsync =)	Measurement	–	–	–	–	–	CFC		
641	P (active power) (P =)	Measurement	134	157	No	9	12	CFC		
642	Q (reactive power) (Q =)	Measurement	134	157	No	9	13	CFC		
644	Frequency (Freq=)	Measurement	134	157	No	9	5	CFC		
645	S (apparent power) (S =)	Measurement	–	–	–	–	–	CFC		

No.	Description	Function	IEC 60870-5-103					Configurable in Matrix		
			Type	information number	Compatibility	Data Unit	Position	CFC	Control Display	Default Display
680	Angle Va-Ia (Phi A =)	Measurement	–	–	–	–	–	CFC		
681	Angle Vb-Ib (Phi B =)	Measurement	–	–	–	–	–	CFC		
682	Angle Vc-Ic (Phi C =)	Measurement	–	–	–	–	–	CFC		
701	Resistive ground current in isol systems (INs Real)	Measurement	134	157	No	9	15	CFC		
702	Reactive ground current in isol systems (INs Reac)	Measurement	134	157	No	9	16	CFC		
807	Thermal Overload (Θ/Θ_{trip} =)	Measurement	–	–	–	–	–	CFC		
830	INs Sensitive Ground Fault Current (INs =)	Measurement	134	158	No	9	1	CFC		
831	3Io (zero sequence) (3Io =)	Measurement	–	–	–	–	–	CFC		
832	Vo (zero sequence) (Vo =)	Measurement	134	118	No	9	2	CFC		
833	I1 (positive sequence) Demand (I1 dmd=)	Demand meter	–	–	–	–	–	–		
834	Active Power Demand (P dmd =)	Demand meter	–	–	–	–	–	–		
835	Reactive Power Demand (Q dmd =)	Demand meter	–	–	–	–	–	–		
836	Apparent Power Demand (S dmd =)	Demand meter	–	–	–	–	–	–		
837	I A Demand Minimum (IAdmdMin)	Min/Max meter	–	–	–	–	–	–		
838	I A Demand Maximum (IAdmdMax)	Min/Max meter	–	–	–	–	–	–		
839	I B Demand Minimum (IBdmdMin)	Min/Max meter	–	–	–	–	–	–		
840	I B Demand Maximum (IBdmdMax)	Min/Max meter	–	–	–	–	–	–		
841	I C Demand Minimum (ICdmdMin)	Min/Max meter	–	–	–	–	–	–		
842	I C Demand Maximum (ICdmdMax)	Min/Max meter	–	–	–	–	–	–		
843	I1 (positive sequence) Demand Minimum (I1dmdMin)	Min/Max meter	–	–	–	–	–	–		
844	I1 (positive sequence) Demand Maximum (I1dmdMax)	Min/Max meter	–	–	–	–	–	–		
845	Active Power Demand Minimum (PdMin=)	Min/Max meter	–	–	–	–	–	–		
846	Active Power Demand Maximum (PdMax=)	Min/Max meter	–	–	–	–	–	–		
847	Reactive Power Minimum (QdMin=)	Min/Max meter	–	–	–	–	–	–		
848	Reactive Power Maximum (QdMax=)	Min/Max meter	–	–	–	–	–	–		
849	Apparent Power Minimum (SdMin=)	Min/Max meter	–	–	–	–	–	–		

No.	Description	Function	IEC 60870-5-103					Configurable in Matrix		
			Type	information number	Compatibility	Data Unit	Position	CFC	Control Display	Default Display
850	Apparent Power Maximum (SdMax=)	Min/Max meter	–	–	–	–	–	–		
851	Ia Min (Ia Min=)	Min/Max meter	–	–	–	–	–	–		
852	Ia Max (Ia Max=)	Min/Max meter	–	–	–	–	–	–		
853	Ib Min (Ib Min=)	Min/Max meter	–	–	–	–	–	–		
854	Ib Max (Ib Max=)	Min/Max meter	–	–	–	–	–	–		
855	Ic Min (Ic Min=)	Min/Max meter	–	–	–	–	–	–		
856	Ic Max (Ic Max=)	Min/Max meter	–	–	–	–	–	–		
857	I1 (positive sequence) Minimum (I1 Min=)	Min/Max meter	–	–	–	–	–	–		
858	I1 (positive sequence) Maximum (I1 Max=)	Min/Max meter	–	–	–	–	–	–		
859	Va-n Min (Va-nMin=)	Min/Max meter	–	–	–	–	–	–		
860	Va-n Max (Va-nMax=)	Min/Max meter	–	–	–	–	–	–		
861	Vb-n Min (Vb-nMin=)	Min/Max meter	–	–	–	–	–	–		
862	Vb-n Max (Vb-nMax=)	Min/Max meter	–	–	–	–	–	–		
863	Vc-n Min (Vc-nMin=)	Min/Max meter	–	–	–	–	–	–		
864	Vc-n Max (Vc-nMax=)	Min/Max meter	–	–	–	–	–	–		
865	Va-b Min (Va-bMin=)	Min/Max meter	–	–	–	–	–	–		
867	Va-b Max (Va-bMax=)	Min/Max meter	–	–	–	–	–	–		
868	Vb-c Min (Vb-cMin=)	Min/Max meter	–	–	–	–	–	–		
869	Vb-c Max (Vb-cMax=)	Min/Max meter	–	–	–	–	–	–		
870	Vc-a Min (Vc-aMin=)	Min/Max meter	–	–	–	–	–	–		
871	Vc-a Max (Vc-aMax=)	Min/Max meter	–	–	–	–	–	–		
872	V neutral Min (Vn Min =)	Min/Max meter	–	–	–	–	–	–		
873	V neutral Max (Vn Max =)	Min/Max meter	–	–	–	–	–	–		
874	V1 (positive sequence) Voltage Minimum (V1 Min =)	Min/Max meter	–	–	–	–	–	–		
875	V1 (positive sequence) Voltage Maximum (V1 Max =)	Min/Max meter	–	–	–	–	–	–		
876	Active Power Minimum (Pmin=)	Min/Max meter	–	–	–	–	–	–		
877	Active Power Maximum (Pmax=)	Min/Max meter	–	–	–	–	–	–		
878	Reactive Power Minimum (Qmin=)	Min/Max meter	–	–	–	–	–	–		
879	Reactive Power Maximum (Qmax=)	Min/Max meter	–	–	–	–	–	–		
880	Apparent Power Minimum (Smin=)	Min/Max meter	–	–	–	–	–	–		
881	Apparent Power Maximum (Smax=)	Min/Max meter	–	–	–	–	–	–		
882	Frequency Minimum (fmin=)	Min/Max meter	–	–	–	–	–	–		
883	Frequency Maximum (fmax=)	Min/Max meter	–	–	–	–	–	–		

No.	Description	Function	IEC 60870-5-103					Configurable in Matrix		
			Type	information number	Compatibility	Data Unit	Position	CFC	Control Display	Default Display
884	Power Factor Maximum (PF Max=)	Min/Max meter	–	–	–	–	–	–		
885	Power Factor Minimum (PF Min=)	Min/Max meter	–	–	–	–	–	–		
888	Pulsed Energy Wp (active) (Wp(puls))	Energy	133	55	No	205	–	CFC		
889	Pulsed Energy Wq (reactive) (Wq(puls))	Energy	133	56	No	205	–	CFC		
901	Power Factor (PF =)	Measurement	134	157	No	9	14	CFC		
924	Wp Forward (WpForward)	Energy	133	51	No	205	–	CFC		
925	Wq Forward (WqForward)	Energy	133	52	No	205	–	CFC		
928	Wp Reverse (WpReverse)	Energy	133	53	No	205	–	CFC		
929	Wq Reverse (WqReverse)	Energy	133	54	No	205	–	CFC		
963	I A demand (Ia dmd=)	Demand meter	–	–	–	–	–	CFC		
964	I B demand (Ib dmd=)	Demand meter	–	–	–	–	–	CFC		
965	I C demand (Ic dmd=)	Demand meter	–	–	–	–	–	CFC		
1058	Overload Meter Max (Θ/Θ_{TrpMax})	Min/Max meter	–	–	–	–	–	CFC		
1059	Overload Meter Min (Θ/Θ_{TrpMin})	Min/Max meter	–	–	–	–	–	CFC		
16004	Threshold Sum Current Exponentiation (ΣI^x)	SetPoint(Stat)	–	–	–	–	–	CFC		
16009	Lower Threshold of CB Residual Endurance (Resid.Endu. <)	SetPoint(Stat)	–	–	–	–	–	CFC		
16017	Threshold Sum Squared Current Integral ($\Sigma I^2 t$)	SetPoint(Stat)	–	–	–	–	–	CFC		
16031	Angle between 3Vo and INsens. ($\varphi(3V_o, I_{Ns})$)	Measurement	–	–	–	–	–	CFC		
18473	Va-b RMS(10 minute RMS value) (Va-b RMS=)	Measurement	–	–	–	–	–	CFC		
18474	Vb-c RMS(10 minute RMS value) (Vb-c RMS=)	Measurement	–	–	–	–	–	CFC		
18475	Vc-a RMS(10 minute RMS value) (Vc-a RMS=)	Measurement	–	–	–	–	–	CFC		
30701	Pa (active power, phase A) (Pa =)	Measurement	–	–	–	–	–	CFC		
30702	Pb (active power, phase B) (Pb =)	Measurement	–	–	–	–	–	CFC		
30703	Pc (active power, phase C) (Pc =)	Measurement	–	–	–	–	–	CFC		
30704	Qa (reactive power, phase A) (Qa =)	Measurement	–	–	–	–	–	CFC		
30705	Qb (reactive power, phase B) (Qb =)	Measurement	–	–	–	–	–	CFC		
30706	Qc (reactive power, phase C) (Qc =)	Measurement	–	–	–	–	–	CFC		
30707	Power Factor, phase A (PFa =)	Measurement	–	–	–	–	–	CFC		
30708	Power Factor, phase B (PFb =)	Measurement	–	–	–	–	–	CFC		

No.	Description	Function	IEC 60870-5-103					Configurable in Matrix		
			Type	information number	Compatibility	Data Unit	Position	CFC	Control Display	Default Display
30709	Power Factor, phase C (PFc =)	Measurement	–	–	–	–	–	CFC		
30800	Voltage VX (VX =)	Measurement	–	–	–	–	–	CFC		
30801	Voltage phase-neutral (Vph-n =)	Measurement	–	–	–	–	–	CFC		

Literature

- /1/ SIPROTEC 4 System Description
E50417-H1176-C151-B6
- /2/ SIPROTEC DIGSI, Start UP
E50417-G1176-C152-A3
- /3/ DIGSI CFC, Manual
E50417-H1176-C098-B2
- /4/ SIPROTEC SIGRA 4, Manual
E50417-H1176-C070-A7
- /5/ Additional description for the protection of explosion-protected motors of protection type increased safety "e"
C53000-B1174-C170

Glossary

Bay controllers

Bay controllers are devices with control and monitoring functions without protective functions.

Bit pattern indication

Bit pattern indication is a processing function by means of which items of digital process information applying across several inputs can be detected together in parallel and processed further. The bit pattern length can be specified as 1, 2, 3 or 4 bytes.

BP_xx

→ Bit pattern indication (Bitstring Of x Bit), x designates the length in bits (8, 16, 24 or 32 bits).

Buffer battery

The buffer battery ensures that specified data areas, flags, timers and counters are retained retentively.

C_xx

Command without feedback

CF_xx

Command with feedback

CFC

Continuous Function Chart. CFC is a graphical editor with which a program can be created and configured by using ready-made blocks.

CFC blocks

Blocks are parts of the user program delimited by their function, their structure or their purpose.

Chatter ON

A rapidly intermittent input (for example, due to a relay contact fault) is switched off after a configurable monitoring time and can thus not generate any further signal changes. The function prevents overloading of the system when a fault arises.

Combination devices

Combination devices are bay devices with protection functions and a control display.

Combination matrix

From DIGSI V4.6 onward, up to 32 compatible SIPROTEC 4 devices can communicate with one another in an Inter Relay Communication combination (IRC combination). Which device exchanges which information is defined with the help of the combination matrix.

Communication branch

A communications branch corresponds to the configuration of 1 to n users that communicate by means of a common bus.

Communication reference CR

The communication reference describes the type and version of a station in communication by PROFIBUS.

Component view

In addition to a topological view, SIMATIC Manager offers you a component view. The component view does not offer any overview of the hierarchy of a project. It does, however, provide an overview of all the SIPROTEC 4 devices within a project.

COMTRADE

Common Format for Transient Data Exchange, format for fault records.

Container

If an object can contain other objects, it is called a container. The object Folder is an example of such a container.

Control Display

The display which is displayed on devices with a large (graphic) display after you have pressed the control key is called the control display. It contains the switchgear that can be controlled in the feeder with status display. It is used to perform switching operations. Defining this display is part of the configuration.

Data pane

The right-hand area of the project window displays the contents of the area selected in the → navigation window, for example indications, measured values, etc. of the information lists or the function selection for the device configuration.

DCF77

The extremely precise official time is determined in Germany by the "Physikalisch-Technische-Bundesanstalt PTB" in Braunschweig. The atomic clock station of the PTB transmits this time via the long-wave time-signal transmitter in Mainflingen near Frankfurt/Main. The emitted time signal can be received within a radius of approx. 1,500 km from Frankfurt/Main.

Device container

In the Component View, all SIPROTEC 4 devices are assigned to an object of type Device container. This object is a special object of DIGSI Manager. However, since there is no component view in DIGSI Manager, this object only becomes visible in conjunction with STEP 7.

Double command

Double commands are process outputs which indicate 4 process states at 2 outputs: 2 defined (for example ON/OFF) and 2 undefined states (for example intermediate positions)

Double-point indication

Double-point indications are items of process information which indicate 4 process states at 2 inputs: 2 defined (for example ON/OFF) and 2 undefined states (for example intermediate positions).

DP

→ Double-point indication

DP_I

→ Double point indication, intermediate position 00

Drag and drop

Copying, moving and linking function, used at graphics user interfaces. Objects are selected with the mouse, held and moved from one data area to another.

Earth

The conductive earth whose electric potential can be set equal to zero at every point. In the area of earth electrodes the earth can have a potential deviating from zero. The term "Earth reference plane" is often used for this state.

Earth (verb)

This term means that a conductive part is connected via an earthing system to the → earth.

Earthing

Earthing is the total of all means and measures used for earthing.

Electromagnetic compatibility

Electromagnetic compatibility (EMC) is the ability of an electrical apparatus to function fault-free in a specified environment without influencing the environment unduly.

EMC

→ Electromagnetic compatibility

ESD protection

ESD protection is the total of all the means and measures used to protect electrostatic sensitive devices.

EVA

Limiting value, user-defined

ExBPxx

External bit pattern indication via an ETHERNET connection, device-specific → Bit pattern indication

ExC

External command without feedback via an ETHERNET connection, device-specific

ExCF

Command with feedback via an ETHERNET connection, device-specific

ExDP

External double point indication via an ETHERNET connection, device-specific → Double point indication

ExDP_I

External double point indication via an ETHERNET connection, intermediate position 00, device-specific → Double point indication

ExMV

External metered value via an ETHERNET connection, device-specific

ExSI

External single point indication via an ETHERNET connection, device-specific → Single point indication

ExSI_F

External single point indication via an ETHERNET connection, Spontaneous event, device-specific → Fleeting indication, → Single point indication

Field devices

Generic term for all devices assigned to the field level: Protection devices, combination devices, bay controllers.

Fleeting Indication

Fleeting indications are single-point indications present for a very short time, in which only the coming of the process signal is logged and further processed time-correctly.

FMS communication branch

Within an FMS communication branch, the users communicate on the basis of the PROFIBUS FMS protocol via a PROFIBUS FMS network.

Folder

This object type is used to create the hierarchical structure of a project.

General interrogation (GI)

During the system start-up the state of all the process inputs, of the status and of the fault image is sampled. This information is used to update the system-end process image. The current process state can also be sampled after a data loss by means of a GI.

GOOSE message

GOOSE messages (Generic Object Oriented Substation Event) according to IEC 61850 are data packets which are transferred event-controlled via the Ethernet communication system. They serve for direct information exchange among the relays. This mechanism implements cross-communication between bay units.

GPS

Global Positioning System. Satellites with atomic clocks on board orbit the earth twice a day on different paths in approx. 20,000 km. They transmit signals which also contain the GPS universal time. The GPS receiver determines its own position from the signals received. From its position it can derive the delay time of a satellite signal and thus correct the transmitted GPS universal time.

Hierarchy level

Within a structure with higher-level and lower-level objects a hierarchy level is a container of equivalent objects.

HV field description

The HV project description file contains details of fields which exist in a ModPara-project. The actual field information of each field is stored in a HV field description file. Within the HV project description file, each field is allocated such a HV field description file by a reference to the file name.

HV project description

All the data is exported once the configuration and parameterization of PCUs and sub-modules using ModPara has been completed. This data is split up into several files. One file contains details about the fundamental project structure. This also includes, for example, information detailing which fields exist in this project. This file is called a HV project description file.

ID

Internal double point indication → Double point indication

ID_S

Internal double point indication, intermediate position 00 → Double point indication

IEC

International Electrotechnical Commission, international standardization body

IEC61850

International communication standard for communication in substations. The objective of this standard is the interoperability of devices from different manufacturers on the station bus. An Ethernet network is used for data transfer.

IEC address

Within an IEC bus a unique IEC address has to be assigned to each SIPROTEC 4 device. A total of 254 IEC addresses are available for each IEC bus.

IEC communication branch

Within an IEC communication branch the users communicate on the basis of the IEC60-870-5-103 protocol via an IEC bus.

Initialization string

An initialization string comprises a range of modem-specific commands. These are transmitted to the modem within the framework of modem initialization. The commands can, for example, force specific settings for the modem.

Inter relay communication

→ IRC combination

IntSP

Internal single point indication → Single point indication

IntSP_Ev

Internal indication Spontaneous event → Fleeting indication, → Single point indication

IRC combination

Inter Relay Communication, IRC, is used for directly exchanging process information between SIPROTEC 4 devices. You require an object of type IRC combination to configure an inter relay communication. Each user of the combination and all the necessary communication parameters are defined in this object. The type and scope of the information exchanged between the users is also stored in this object.

IRIG B

Time signal code of the Inter-Range Instrumentation Group

ISO 9001

The ISO 9000 ff range of standards defines measures used to assure the quality of a product from the development stage to the manufacturing stage.

LFO-Filter

(Low-Frequency-Oscillation) Filter for low frequency oscillations

Link address

The link address gives the address of a V3/V2 device.

List view

The right window section of the project window displays the names and icons of objects which represent the contents of a container selected in the tree view. Because they are displayed in the form of a list, this area is called the list view.

LPS

Line Post Sensor

LV

Limiting value

Master

Masters may send data to other users and request data from other users. DIGSI operates as a master.

Metered value

Metered values are a processing function with which the total number of discrete similar events (counting pulses) is determined for a period, usually as an integrated value. In power supply companies the electrical work is usually recorded as a metered value (energy purchase/supply, energy transportation).

MLFB

MLFB is the abbreviation for "MaschinenLesbare FabrikateBezeichnung" (machine-readable product designation). This is the equivalent of an order number. The type and version of a SIPROTEC 4 device is coded in the order number.

Modem connection

This object type contains information on both partners of a modem connection, the local modem and the remote modem.

Modem profile

A modem profile consists of the name of the profile, a modem driver and may also comprise several initialization commands and a user address. You can create several modem profiles for one physical modem. To do so you need to link various initialization commands or user addresses to a modem driver and its properties and save them under different names.

Modems

Modem profiles for a modem connection are stored in this object type.

MV

Measured value

MVMV

Metered value which is formed from the measured value

MVT

Measured value with time

MVU

Measured value, user-defined

Navigation pane

The left pane of the project window displays the names and symbols of all containers of a project in the form of a folder tree.

Object

Each element of a project structure is called an object in DIGSI.

Object properties

Each object has properties. These might be general properties that are common to several objects. An object can also have specific properties.

Off-line

In offline mode a connection to a SIPROTEC 4 device is not required. You work with data which are stored in files.

On-line

When working in online mode, there is a physical connection to a SIPROTEC 4 device. This connection can be implemented as a direct connection, as a modem connection or as a PROFIBUS FMS connection.

OUT

Output Indication

OUT_Ev

Output indication Spontaneous event → Fleeting indication

Parameterization

Comprehensive term for all setting work on the device. The parameterization is done with DIGSI or sometimes also directly on the device.

Parameter set

The parameter set is the set of all parameters that can be set for a SIPROTEC 4 device.

Phone book

User addresses for a modem connection are saved in this object type.

PMV

Pulse metered value

Process bus

Devices with a process bus interface allow direct communication with SICAM HV modules. The process bus interface is equipped with an Ethernet module.

PROFIBUS

PROcess Field BUS, the German process and field bus standard, as specified in the standard EN 50170, Volume 2, PROFIBUS. It defines the functional, electrical, and mechanical properties for a bit-serial field bus.

PROFIBUS address

Within a PROFIBUS network a unique PROFIBUS address has to be assigned to each SIPROTEC 4 device. A total of 254 PROFIBUS addresses are available for each PROFIBUS network.

Project

Content-wise, a project is the image of a real power supply system. Graphically, a project is represented as a number of objects which are integrated in a hierarchical structure. Physically, a project consists of a number of directories and files containing project data.

Protection devices

All devices with a protective function and no control display.

Reorganizing

Frequent addition and deletion of objects results in memory areas that can no longer be used. By reorganizing projects, you can release these memory areas again. However, a cleanup also reassigns the VD addresses. The consequence is that all SIPROTEC 4 devices have to be reinitialized.

RIO file

Relay data Interchange format by Omicron.

RSxxx-interface

Serial interfaces RS232, RS422/485

Service interface

Rear serial interface on the devices for connecting DIGSI (for example, via modem).

SICAM PAS (Power Automation System)

Substation control system: The range of possible configurations spans from integrated standalone systems (SICAM PAS and M&C with SICAM PAS CC on one computer) to separate hardware for SICAM PAS and SICAM PAS CC to distributed systems with multiple SICAM Station Units. The software is a modular system with basic and optional packages. SICAM PAS is a purely distributed system: the process interface is implemented by the use of bay units / remote terminal units.

SICAM Station Unit

The SICAM Station Unit with its special hardware (no fan, no rotating parts) and its Windows XP Embedded operating system is the basis for SICAM PAS.

SICAM WinCC

The SICAM WinCC operator control and monitoring system displays the state of your network graphically, visualizes alarms, interrupts and indications, archives the network data, offers the possibility of intervening manually in the process and manages the system rights of the individual employee.

Single command

Single commands are process outputs which indicate 2 process states (for example, ON/OFF) at one output.

Single point indication

Single indications are items of process information which indicate 2 process states (for example, ON/OFF) at one output.

SIPROTEC

The registered trademark SIPROTEC is used for devices implemented on system base V4.

SIPROTEC 4 device

This object type represents a real SIPROTEC 4 device with all the setting values and process data it contains.

SIPROTEC 4 Variant

This object type represents a variant of an object of type SIPROTEC 4 device. The device data of this variant may well differ from the device data of the original object. However, all variants derived from the original object have the same VD address as the original object. For this reason they always correspond to the same real SIPROTEC 4 device as the original object. Objects of type SIPROTEC 4 variant have a variety of uses, such as documenting different operating states when entering parameter settings of a SIPROTEC 4 device.

Slave

A slave may only exchange data with a master after being prompted to do so by the master. SIPROTEC 4 devices operate as slaves.

SP

→ Single point indication

SP_W

→ Single point indication Spontaneous event → Fleeting indication, → Single point indication

System interface

Rear serial interface on the devices for connecting to a substation controller via IEC or PROFIBUS.

TI

Transformer Tap Indication

Time stamp

Time stamp is the assignment of the real time to a process event.

Topological view

DIGSI Manager always displays a project in the topological view. This shows the hierarchical structure of a project with all available objects.

Transformer Tap Indication

Transformer tap indication is a processing function on the DI by means of which the tap of the transformer tap changer can be detected together in parallel and processed further.

Tree view

The left pane of the project window displays the names and symbols of all containers of a project in the form of a folder tree. This area is called the tree view.

Ungrounded

Without any electrical connection to → ground.

User address

A user address comprises the name of the user, the national code, the area code and the user-specific phone number.

Users

From DIGSI V4.6 onward , up to 32 compatible SIPROTEC 4 devices can communicate with one another in an Inter Relay Communication combination. The individual participating devices are called users.

VD

A VD (Virtual Device) includes all communication objects and their properties and states that are used by a communication user through services. A VD can be a physical device, a module of a device or a software module.

VD address

The VD address is assigned automatically by DIGSI Manager. It exists only once in the entire project and thus serves to identify unambiguously a real SIPROTEC 4 device. The VD address assigned by DIGSI Manager must be transferred to the SIPROTEC 4 device in order to allow communication with DIGSI Device Editor.

VFD

A VFD (Virtual Field Device) includes all communication objects and their properties and states that are used by a communication user through services.

VI

VI stands for Value Indication.

Index

A

Action Time 210
Alternating Voltage 357
Analog Inputs 356
ATEX100 148
Automatic Reclosing 207, 405
Auxiliary voltage 356

B

Binary Inputs 357
Binary Outputs 357
Block diagram 436
Blocking Time 211
Blocking via FFM 89
Breaker Failure Protection 233
Breaker Failure Protection 50BF 407
Broken Wire Monitoring 160
Buffer Battery 152
Busbar protection 115, 120

C

Change Setting Group 312
Changing Setting Groups 49
Checking the System Connections 331
Checking: Breaker Failure Protection 341
Checking: Direction 345
Checking: Phase Rotation 343
Checking: Polarity at Current Input IE 349
Checking: Status of Binary Inputs and Outputs 339
Checking: Switching the Configured Operating Devices 351
Checking: User-Defined Functions 343
Checking: Voltage Transformer Miniature Circuit Breaker (VT mcb) 344
Circuit Breaker Maintenance 421
Circuit Breaker Monitoring 213
Circuit Breaker Status Detection 213
Climatic Stress Tests 363
Clock 421
Commissioning Aids 421
Communication Interfaces 358

Constructive Design 363
Controlling Protection Elements 214
Cross Blocking 68
CTs
 knee-point voltage 113
Current Criterion 123
Current Inputs 356
Current sum monitoring. 152
Current Symmetry Monitoring 155
Current transformers 118

D

Dead Time Start Delay 210
Definite-time Overcurrent Protection 365
Determination of Direction 90
Direct Voltage 356
Direction Check with Load Current 345
Directional intermittent ground fault protection 202, 404
Directional Overcurrent Protection 82, 88, 378
Dynamic Blocking 212
Dynamic Cold Load Pickup 106, 381

E

Earth fault 119
Electrical Tests 360
EMC Tests for Immunity (Type Tests) 361
EMC Tests for Noise Emission (Type Test) 362
EN100-Module
 Interface Selection 55
Energy Counter 421

F

Fault Location Determination 230
Fault Locator 230, 406
 double ground faults 230
Fault Logging 420
Fault Messages
 Setting notes 34
Fault Recording 420

Fault Records 47
Fiber-optic Cables 331
Final Preparation of the Device 353
Flexible Protection Functions 408
Frequency protection 138
Frequency Protection 81 O/U 392
Function Blocks 413

G

General Device Pickup 274
General Tripping 274
Ground fault 114, 114
 measurements $\cos \phi$ 173
Ground Fault Check 348
Ground fault detection
 Direction determination for $\cos\phi/\sin\phi$ 187
 Logic with $\cos\phi/\sin\phi$ 173
Ground Fault Detection
 Current Elements with $\cos\phi/\sin\phi$ 171
 Current Elements with U0/I0- ϕ 177
 Determination of Direction with $\cos\phi/\sin\phi$ 171
 Logic with U0/I0 ϕ 178
 Trip delay with U0/I0 ϕ 188
 Tripping Area with U0/I0- ϕ 177
 voltage element with $\cos\phi/\sin\phi$ 170
 Voltage Element with U0/I0- ϕ 176
Ground Fault Detection (Sensitive/Insensitive) 397

H

Hardware Monitoring 152
High-impedance Protection 116
 Sensitivity 118
 Stability 117
Hours Meter "CB open" 278
Humidity 363

I

Inrush Restraint 68, 90, 380
Insulation Test 360
Interlocked 301
Intermittent Ground Fault Protection 196, 403
Inverse Time Overcurrent 62
Inverse-time Overcurrent Protection 367

L

Limits CFC blocks 415
Limits User-defined Functions 415

Line sections 230, 231
Local Measured Value Monitoring 420
Long-Term Mean Values 419

M

Malfunction Responses 168
Mechanical Tests 362
Measurement Monitoring 152
Min./Max. Memory 419
Monitoring of the Circuit Breaker Auxiliary Contacts 234
Monitoring of the Current Flow 234

N

Negative Sequence Protection 132
Negative Sequence Protection (definite-time characteristic) 385
Negative Sequence Protection (inverse-time characteristics) 386
Non-Interlocked Switching 301

O

Offset Monitoring 154
Operating Hours Counter 421
Operational measured values 418
Ordering Information 428
Output Relays Binary Outputs 357
Overcurrent Protection 56
 1-phase 382
 pickup value 116, 120
 Rated data of a CT 116
 time delay 120
 trip time delay 116
Overcurrent Protection 1-phase
 Current Elements 382
Overcurrent Protection Ground Current
 Frequency 382
Overcurrent Protection Single-phase
 Frequency 382
Overfrequency 138
Overload Protection 147
Overvoltage Protection 59 123

P

Phase Rotation 273
Phase Sequence Monitoring 156
Pickup Logic 274
Polarity Check for Current Input IE 349

Port A 358
Port B 358

R

Reclosing Programs 210
Regulations 360
Reverse Interlocking 71
Rush stabilisation 90

S

Saved Number of Trips 421
Schalthoheit 304
Schaltmodus 305
Selection of Default Display
 Start page 34
Sensitive Ground Fault Protection 170
Service Conditions 363
Setting Group Change 312
Setting Group Change Option of the Functional
 Settings 422
Setting Groups Changing 49
Software Monitoring 154
Standard Interlocking 302
Static Blocking 211
Switchgear Control 298
Switching Device Control 423
Synchrocheck 25 411

T

Tank leakage protection 115
Tank Leakage Protection 120
 sensitivity 120
 time delay 120
Temperatures 363
Terminal Assignments 436
Terminating the Trip Signal 274
Test fault record 351
Testing: System Interface 334
Thermal Overload Protection 395
Thermal Replica 147
Time Allocation 420
Time synchronization 421
Transformer
 Saturation voltage 114
Triggering Oscillographic Recording 352
Trip Circuit Supervision 164, 421
Trip tests with circuit breaker 351
Trip/Close Tests for the Configured Operating
 Devices 351
Tripping Logic 274

Two-phase Overcurrent Protection 70

U

Überstromzeitschutz einphasig
 Dropout Ratios 382
Underfrequency 138
Undervoltage Consideration 65
Undervoltage Protection 27 124
Undervoltage-controlled reactive power protection (27/
 Q) 393
User Interface 358
User-defined Functions (CFC) 413

V

Vibration and Shock Stress during Steady-State Opera-
 tion 362
Vibration and Shock Stress during Transport 362
voltage controlled 65
Voltage Inputs 356
Voltage limit 115
Voltage Protection 383
voltage restraint 65
Voltage supply 356
Voltage Symmetry monitoring 155

W

Watchdog 154

